




Project :		FORMER PRIMARY SCHOOL, GCH		Ref :		3129	
Title :		TRIAL PIT LOCATIONS					
By :	Ckd :	Appd :	Date :	Doc ref :	Revision :		



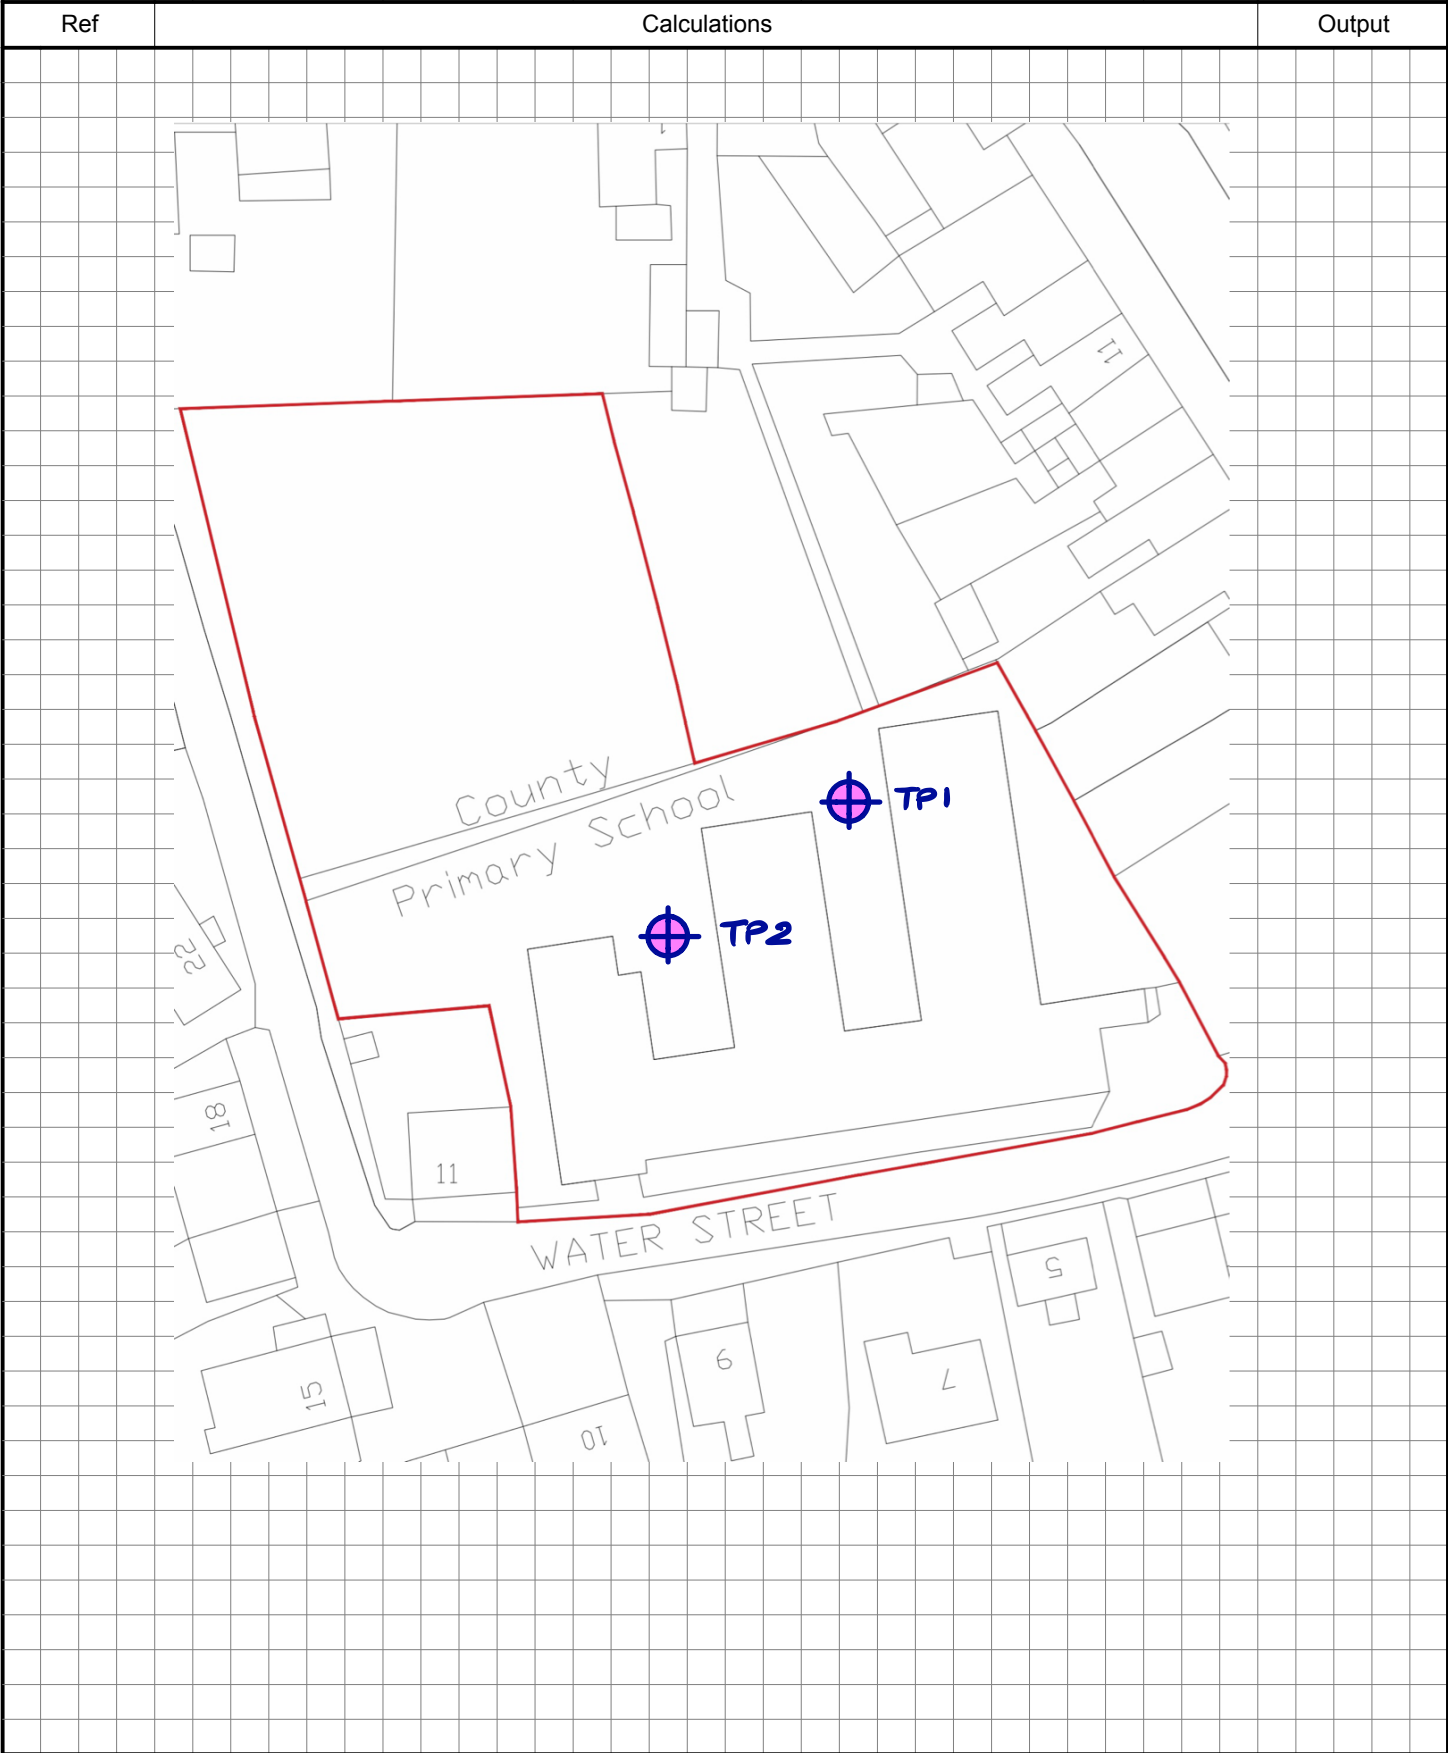

Project :	Former Primary School, CGC	Ref :	3129
Title : Soakaway Test Results - TP1			

By :	Ckd :	Appd :	Date :	Doc ref :	Revision :
HG	NG	NG	26/03/2019		

Ref	Calculations	Output
-----	--------------	--------

Test Photos

Test Pit 1



depth of pit 2500mm
width of pit 450mm
length of pit 1500mm

Test Results

Test 1

Time	Depth to water (mm)
10.09	710
10.26	710
10.54	710
11.09	710
11.24	710
11.39	710
12.07	710
13.35	710
14.00	710
15.05	710
16.00	710
16.34	710



Project : Former Primary School, CGC		Ref : 3129
Title : Soakaway Test Results - TP1		

By : HG	Ckd : NG	Appd : NG	Date : 26/03/2019	Doc ref :	Revision :
------------	-------------	--------------	----------------------	-----------	------------

Ref	Calculations	Output
-----	--------------	--------

Test Photos

Test Pit 2



depth of pit 2500mm
width of pit 450mm
length of pit 1500mm

Test Results

Test 1

Time	Depth to water (mm)
10.21	950 (after filling)
10.40	940
10.52	940
11.06	940
11.17	940
11.24	940
11.39	940
12.07	940
13.35	940
14.00	940
15.05	940
16.00	940
16.34	940