

Barratt Associates Ltd

Civil, Structural & Geotechnical Engineering Consultants

Project No. 202106

Mr and Mrs Zdyb

Structural Design of Retaining Structure

at

**5 Dyffryn Road.
Pontardawe,
Swansea,
SA8 3BX.**

Details prepared by:

R L Davies

MEng (Hons) GMICE FGS

Details checked by:

I Lumby

BSc (Hons) IEng CMgr MIMechE MCMI

Barratt Associates

Structural & Civil Engineering Consultants

Heol Rhosybonwen,
Cefneithin,
Cross Hands,
Carmarthenshire,
SA14 7DJ



Email : info@barratt-associates.co.uk



Tel : 07946 065051



www.barratt-associates.co.uk



<https://www.facebook.com/barrattassociates/>

Barratt Associates Ltd Barratt Associates Civil & Structural Engineering Consultants info@barratt-associates.co.uk 07946 065051	Project				Job Ref.	
	5 Dyffryn Road, Pontardawe				202106	
	Section				Sheet no./rev.	
	Structural Calculations				2	
	Calc. by	Date	Chk'd by	Date	App'd by	Date
	RD	29/06/2020	IL	29/06/2020	BA	29/06/2020

Table of Contents

Design philosophy and codes of practice3

Loading4

Retaining wall Design5

RETAINING WALL ANALYSIS (BS 8002:1994)5

RETAINING WALL DESIGN (BS 8002:1994)8

Design of reinforced concrete retaining wall toe (BS 8002:1994)9

Design of reinforced concrete retaining wall heel (BS 8002:1994)10

Design of cavity reinforced masonry retaining wall stem - BS5628-2:2000.....11

Indicative retaining wall reinforcement diagram13

Barratt Associates Ltd Barratt Associates Civil & Structural Engineering Consultants info@barratt-associates.co.uk 07946 065051	Project 5 Dyffryn Road, Pontardawe				Job Ref. 202106	
	Section Structural Calculations				Sheet no./rev. 3	
	Calc. by RD	Date 29/06/2020	Chk'd by IL	Date 29/06/2020	App'd by BA	Date 29/06/2020

DESIGN PHILOSOPHY AND CODES OF PRACTICE

Codes of practice

All calculations are carried out in accordance with the relevant standards set out below:

Loading : **BS 6399-1: 1996**

Concrete : **BS 8002:1994**

Barratt Associates Ltd Barratt Associates Civil & Structural Engineering Consultants info@barratt-associates.co.uk 07946 065051	Project				Job Ref.	
	5 Dyffryn Road, Pontardawe				202106	
	Section				Sheet no./rev.	
	Structural Calculations				4	
	Calc. by	Date	Chk'd by	Date	App'd by	Date
	RD	29/06/2020	IL	29/06/2020	BA	29/06/2020

LOADING

Pitched Roof - Trussed

Dead

Roof pitch	$\theta_{VR} = 40^\circ$
Roof cover (Plain tiles)	$VR_{\text{Roof}_{d1}} = 0.80 \text{ kN/m}^2$
Batten & Felt	$VR_{\text{Roof}_{d2}} = 0.05 \text{ kN/m}^2$
Trusses	$VR_{\text{Roof}_{d3}} = 0.30 \text{ kN/m}^2$
Ceiling	$VR_{\text{Roof}_{d3}} = 0.15 \text{ kN/m}^2$
Insulation	$VR_{\text{Roof}_{d4}} = 0.05 \text{ kN/m}^2$
Plasterboard & skim	$VR_{\text{Roof}_{d5}} = 0.15 \text{ kN/m}^2$
Dead load on plan	$VR_{\text{Roof}_d} = ((VR_{\text{Roof}_{d1}} + VR_{\text{Roof}_{d2}}) / \cos(\theta_{VR})) + VR_{\text{Roof}_{d3}} + VR_{\text{Roof}_{d4}} + VR_{\text{Roof}_{d5}} = \mathbf{1.46 \text{ kN/m}^2}$

Imposed

Snow	$VR_{\text{Roof}_{im1}} = 0.60 \text{ kN/m}^2$
Attic	$VR_{\text{Roof}_{im2}} = 0.00 \text{ kN/m}^2$
Imposed load on plan	$VR_{\text{Roof}_{im}} = VR_{\text{Roof}_{im1}} + VR_{\text{Roof}_{im2}} = \mathbf{0.60 \text{ kN/m}^2}$

First floor loading

Dead

18mm Chipboard flooring	$SF_{\text{Floor}_{d1}} = 0.15 \text{ kN/m}^2$
Floor joists	$SF_{\text{Floor}_{d2}} = 0.15 \text{ kN/m}^2$
Insulation	$SF_{\text{Floor}_{d3}} = 0.05 \text{ kN/m}^2$
Ceiling & services	$SF_{\text{Floor}_{d4}} = 0.15 \text{ kN/m}^2$
Dead load on plan	$SF_{\text{Floor}_d} = \text{sum}(SF_{\text{Floor}_{d1}}, SF_{\text{Floor}_{d2}}, SF_{\text{Floor}_{d3}}, SF_{\text{Floor}_{d4}}) = \mathbf{0.50 \text{ kN/m}^2}$

Imposed

Partitions	$SF_{\text{Floor}_{im1}} = 0.50 \text{ kN/m}^2$
Domestic	$SF_{\text{Floor}_{im2}} = 1.50 \text{ kN/m}^2$
Imposed load on plan	$SF_{\text{Floor}_{im}} = \text{sum}(SF_{\text{Floor}_{im1}}, SF_{\text{Floor}_{im2}}) = \mathbf{2.00 \text{ kN/m}^2}$

External wall – Type 1

External blockwork 100 thick	$Wall_{\text{ext1}_d1} = 1.80 \text{ kN/m}^2$
Internal leaf blockwork 100 thick	$Wall_{\text{ext1}_d2} = 1.80 \text{ kN/m}^2$
Internal and external finishes	$Wall_{\text{ext1}_d3} = 0.60 \text{ kN/m}^2$
Dead load from 100 thick wall	$Wall_{\text{ext1}_d} = Wall_{\text{ext1}_d1} + Wall_{\text{ext1}_d2} + Wall_{\text{ext1}_d3} = \mathbf{4.20 \text{ kN/m}^2}$

Internal wall

Single skin of brick 102mm thick	$Wall_{\text{int}_d1} = 2.10 \text{ kN/m}^2$
Render & Skim both sides	$Wall_{\text{int}_d2} = 0.60 \text{ kN/m}^2$
Dead load from 100 thick wall	$Wall_{\text{int}_d} = Wall_{\text{int}_d1} + Wall_{\text{int}_d2} = \mathbf{2.70 \text{ kN/m}^2}$

Internal Stud walls


Plasterboard and skim internally both sides	$Wall_{\text{int1}_d1} = 0.30 \text{ kN/m}^2$
Timber studding	$Wall_{\text{int1}_d2} = 0.35 \text{ kN/m}^2$
Insulation	$Wall_{\text{int1}_d3} = 0.05 \text{ kN/m}^2$
Dead load from timber framed wall	$Wall_{\text{int1}_d} = Wall_{\text{int1}_d1} + Wall_{\text{int1}_d2} + Wall_{\text{int1}_d3} = \mathbf{0.70 \text{ kN/m}^2}$

Barratt Associates Ltd Barratt Associates Civil & Structural Engineering Consultants info@barratt-associates.co.uk 07946 065051	Project				Job Ref.	
	5 Dyffryn Road, Pontardawe				202106	
	Section				Sheet no./rev.	
	Structural Calculations				5	
	Calc. by	Date	Chk'd by	Date	App'd by	Date
	RD	29/06/2020	IL	29/06/2020	BA	29/06/2020

RETAINING WALL DESIGN

RETAINING WALL ANALYSIS (BS 8002:1994)

TEDDS calculation version 1.2.01.07

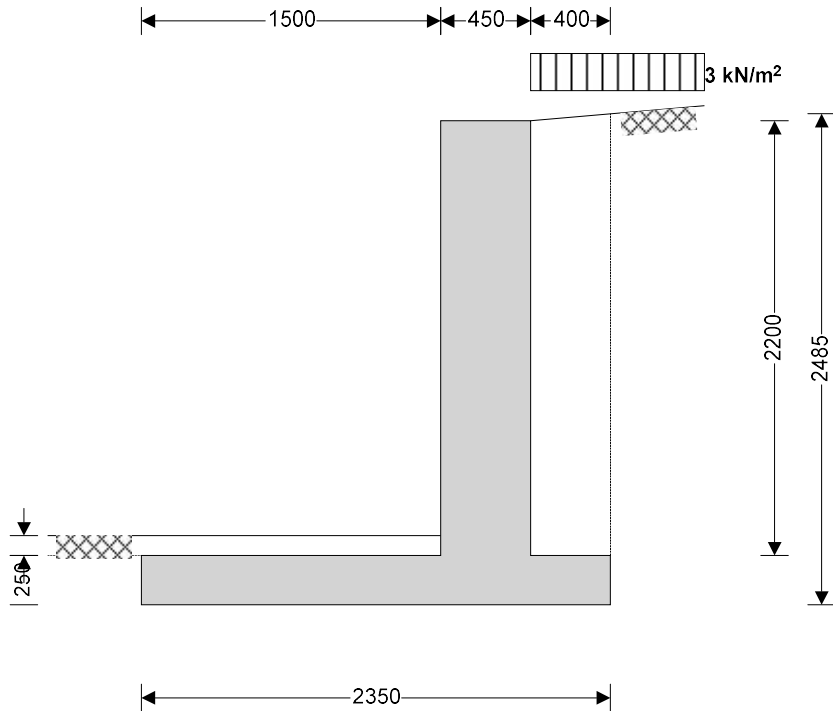

Wall details

Retaining wall type
Height of retaining wall stem
Thickness of wall stem
Length of toe
Length of heel
Overall length of base
Thickness of base
Depth of downstand
Position of downstand
Thickness of downstand
Height of retaining wall
Depth of cover in front of wall
Depth of unplanned excavation
Height of ground water behind wall
Height of saturated fill above base
Density of wall construction
Density of base construction
Angle of rear face of wall
Angle of soil surface behind wall
Effective height at virtual back of wall

Unpropped cantilever

$h_{\text{stem}} = 2200$ mm
 $t_{\text{wall}} = 450$ mm
 $l_{\text{toe}} = 1500$ mm
 $l_{\text{heel}} = 400$ mm
 $l_{\text{base}} = l_{\text{toe}} + l_{\text{heel}} + t_{\text{wall}} = 2350$ mm
 $t_{\text{base}} = 250$ mm
 $d_{\text{ds}} = 0$ mm
 $l_{\text{ds}} = 1150$ mm
 $t_{\text{ds}} = 250$ mm
 $h_{\text{wall}} = h_{\text{stem}} + t_{\text{base}} + d_{\text{ds}} = 2450$ mm
 $d_{\text{cover}} = 100$ mm
 $d_{\text{exc}} = 100$ mm
 $h_{\text{water}} = 0$ mm
 $h_{\text{sat}} = \max(h_{\text{water}} - t_{\text{base}} - d_{\text{ds}}, 0 \text{ mm}) = 0$ mm
 $\gamma_{\text{wall}} = 23.6$ kN/m³
 $\gamma_{\text{base}} = 23.6$ kN/m³
 $\alpha = 90.0$ deg
 $\beta = 5.0$ deg
 $h_{\text{eff}} = h_{\text{wall}} + l_{\text{heel}} \times \tan(\beta) = 2485$ mm

Retained material details

Mobilisation factor
 $M = 1.5$

Barratt Associates Ltd Barratt Associates Civil & Structural Engineering Consultants info@barratt-associates.co.uk 07946 065051	Project				Job Ref.	
	5 Dyffryn Road, Pontardawe				202106	
	Section				Sheet no./rev.	
	Structural Calculations				6	
Calc. by	Date	Chk'd by	Date	App'd by	Date	
RD	29/06/2020	IL	29/06/2020	BA	29/06/2020	

Moist density of retained material $\gamma_m = 18.0 \text{ kN/m}^3$

Saturated density of retained material $\gamma_s = 21.0 \text{ kN/m}^3$

Design shear strength $\phi' = 29.3 \text{ deg}$

Angle of wall friction $\delta = 18.6 \text{ deg}$

Base material details

Moist density $\gamma_{mb} = 18.0 \text{ kN/m}^3$

Design shear strength $\phi'_b = 24.2 \text{ deg}$

Design base friction $\delta_b = 18.6 \text{ deg}$

Allowable bearing pressure $P_{\text{bearing}} = 100 \text{ kN/m}^2$

Using Coulomb theory

Active pressure coefficient for retained material

$$K_a = \sin(\alpha + \phi')^2 / (\sin(\alpha)^2 \times \sin(\alpha - \delta) \times [1 + \sqrt{(\sin(\phi' + \delta) \times \sin(\phi' - \beta) / (\sin(\alpha - \delta) \times \sin(\alpha + \beta)))})^2] = 0.326$$

Passive pressure coefficient for base material

$$K_p = \sin(90 - \phi'_b)^2 / (\sin(90 - \delta_b) \times [1 - \sqrt{(\sin(\phi'_b + \delta_b) \times \sin(\phi'_b) / (\sin(90 + \delta_b)))})^2] = 4.187$$

At-rest pressure

At-rest pressure for retained material $K_0 = 1 - \sin(\phi') = 0.511$

Loading details

Surcharge load on plan Surcharge = **2.5 kN/m²**

Applied vertical dead load on wall $W_{\text{dead}} = 0.0 \text{ kN/m}$


Applied vertical live load on wall $W_{\text{live}} = 0.0 \text{ kN/m}$

Position of applied vertical load on wall $l_{\text{load}} = 0 \text{ mm}$

Applied horizontal dead load on wall $F_{\text{dead}} = 0.0 \text{ kN/m}$

Applied horizontal live load on wall $F_{\text{live}} = 0.0 \text{ kN/m}$

Height of applied horizontal load on wall $h_{\text{load}} = 0 \text{ mm}$

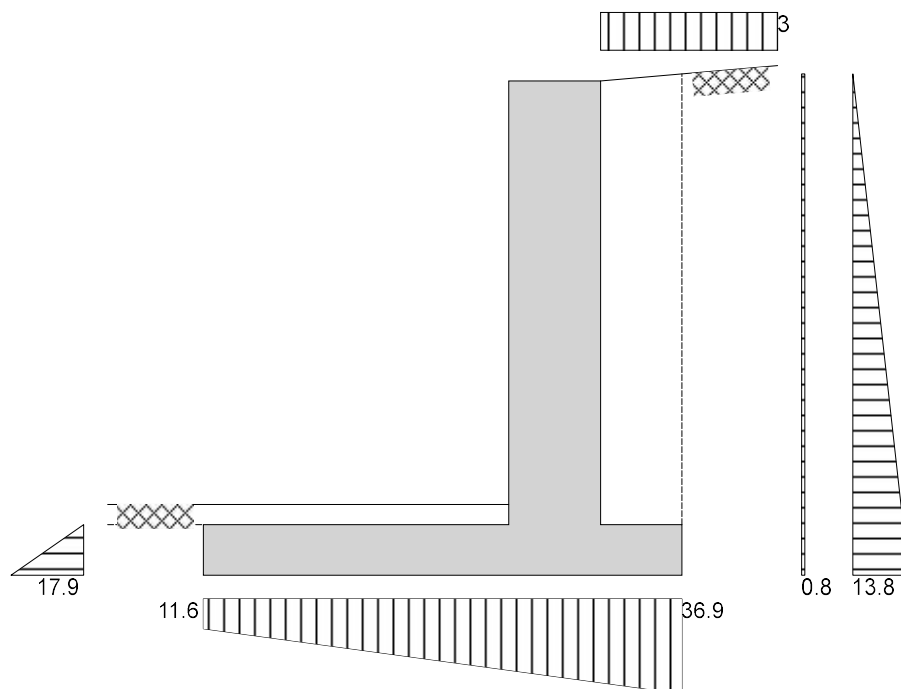

Loads shown in kN/m, pressures shown in kN/m²

Barratt Associates Ltd Barratt Associates Civil & Structural Engineering Consultants info@barratt-associates.co.uk 07946 065051	Project				Job Ref.	
	5 Dyffryn Road, Pontardawe				202106	
	Section				Sheet no./rev.	
	Structural Calculations				7	
	Calc. by	Date	Chk'd by	Date	App'd by	Date
	RD	29/06/2020	IL	29/06/2020	BA	29/06/2020

Vertical forces on wall

Wall stem

$$W_{\text{wall}} = h_{\text{stem}} \times t_{\text{wall}} \times \gamma_{\text{wall}} = \mathbf{23.4 \text{ kN/m}}$$

Wall base

$$W_{\text{base}} = l_{\text{base}} \times t_{\text{base}} \times \gamma_{\text{base}} = \mathbf{13.9 \text{ kN/m}}$$

Surcharge

$$W_{\text{sur}} = \text{Surcharge} \times l_{\text{heel}} = \mathbf{1 \text{ kN/m}}$$

Moist backfill to top of wall

$$W_{\text{m}_w} = l_{\text{heel}} \times (h_{\text{stem}} - h_{\text{sat}}) \times \gamma_m = \mathbf{15.8 \text{ kN/m}}$$

Moist backfill above top of wall

$$W_{\text{m}_s} = 0.5 \times l_{\text{heel}}^2 \times \tan(\beta) \times \gamma_m = \mathbf{0.1 \text{ kN/m}}$$

Soil in front of wall

$$W_p = l_{\text{toe}} \times d_{\text{cover}} \times \gamma_{\text{mb}} = \mathbf{2.7 \text{ kN/m}}$$

Total vertical load

$$W_{\text{total}} = W_{\text{wall}} + W_{\text{base}} + W_{\text{sur}} + W_{\text{m}_w} + W_{\text{m}_s} + W_p = \mathbf{56.9 \text{ kN/m}}$$

Horizontal forces on wall

Surcharge

$$F_{\text{sur}} = K_a \times \cos(90 - \alpha + \delta) \times \text{Surcharge} \times h_{\text{eff}} = \mathbf{1.9 \text{ kN/m}}$$

Moist backfill above water table

$$F_{\text{m}_a} = 0.5 \times K_a \times \cos(90 - \alpha + \delta) \times \gamma_m \times (h_{\text{eff}} - h_{\text{water}})^2 = \mathbf{17.2 \text{ kN/m}}$$

Total horizontal load

$$F_{\text{total}} = F_{\text{sur}} + F_{\text{m}_a} = \mathbf{19.1 \text{ kN/m}}$$

Calculate stability against sliding

Passive resistance of soil in front of wall

$$F_p = 0.5 \times K_p \times \cos(\delta_b) \times (d_{\text{cover}} + t_{\text{base}} + d_{\text{ds}} - d_{\text{exc}})^2 \times \gamma_{\text{mb}} = \mathbf{2.2 \text{ kN/m}}$$

Resistance to sliding

$$F_{\text{res}} = F_p + (W_{\text{total}} - W_{\text{sur}} - W_p) \times \tan(\delta_b) = \mathbf{20.1 \text{ kN/m}}$$

PASS - Resistance force is greater than sliding force

Overturning moments

Surcharge

$$M_{\text{sur}} = F_{\text{sur}} \times (h_{\text{eff}} - 2 \times d_{\text{ds}}) / 2 = \mathbf{2.4 \text{ kNm/m}}$$

Moist backfill above water table

$$M_{\text{m}_a} = F_{\text{m}_a} \times (h_{\text{eff}} + 2 \times h_{\text{water}} - 3 \times d_{\text{ds}}) / 3 = \mathbf{14.2 \text{ kNm/m}}$$

Total overturning moment

$$M_{\text{ot}} = M_{\text{sur}} + M_{\text{m}_a} = \mathbf{16.6 \text{ kNm/m}}$$

Restoring moments

Wall stem

$$M_{\text{wall}} = W_{\text{wall}} \times (l_{\text{toe}} + t_{\text{wall}} / 2) = \mathbf{40.3 \text{ kNm/m}}$$

Wall base

$$M_{\text{base}} = W_{\text{base}} \times l_{\text{base}} / 2 = \mathbf{16.3 \text{ kNm/m}}$$

Moist backfill

$$M_{\text{m}_r} = (W_{\text{m}_w} \times (l_{\text{base}} - l_{\text{heel}} / 2) + W_{\text{m}_s} \times (l_{\text{base}} - l_{\text{heel}} / 3)) = \mathbf{34.3 \text{ kNm/m}}$$

Total restoring moment

$$M_{\text{rest}} = M_{\text{wall}} + M_{\text{base}} + M_{\text{m}_r} = \mathbf{90.9 \text{ kNm/m}}$$

Check stability against overturning

Total overturning moment

$$M_{\text{ot}} = \mathbf{16.6 \text{ kNm/m}}$$

Total restoring moment

$$M_{\text{rest}} = \mathbf{90.9 \text{ kNm/m}}$$

PASS - Restoring moment is greater than overturning moment

Check bearing pressure

Surcharge

$$M_{\text{sur}_r} = W_{\text{sur}} \times (l_{\text{base}} - l_{\text{heel}} / 2) = \mathbf{2.2 \text{ kNm/m}}$$

Soil in front of wall

$$M_{\text{p}_r} = W_p \times l_{\text{toe}} / 2 = \mathbf{2 \text{ kNm/m}}$$

Total moment for bearing

$$M_{\text{total}} = M_{\text{rest}} - M_{\text{ot}} + M_{\text{sur}_r} + M_{\text{p}_r} = \mathbf{78.5 \text{ kNm/m}}$$

Total vertical reaction

$$R = W_{\text{total}} = \mathbf{56.9 \text{ kN/m}}$$

Distance to reaction

$$x_{\text{bar}} = M_{\text{total}} / R = \mathbf{1380 \text{ mm}}$$

Eccentricity of reaction

$$e = \text{abs}((l_{\text{base}} / 2) - x_{\text{bar}}) = \mathbf{205 \text{ mm}}$$

Reaction acts within middle third of base

Bearing pressure at toe

$$p_{\text{toe}} = (R / l_{\text{base}}) - (6 \times R \times e / l_{\text{base}}^2) = \mathbf{11.6 \text{ kN/m}^2}$$

Bearing pressure at heel

$$p_{\text{heel}} = (R / l_{\text{base}}) + (6 \times R \times e / l_{\text{base}}^2) = \mathbf{36.9 \text{ kN/m}^2}$$

PASS - Maximum bearing pressure is less than allowable bearing pressure

Barratt Associates Ltd Barratt Associates Civil & Structural Engineering Consultants info@barratt-associates.co.uk 07946 065051	Project				Job Ref.	
	5 Dyffryn Road, Pontardawe				202106	
	Section				Sheet no./rev.	
	Structural Calculations				8	
	Calc. by	Date	Chk'd by	Date	App'd by	Date
	RD	29/06/2020	IL	29/06/2020	BA	29/06/2020

RETAINING WALL DESIGN (BS 8002:1994)

TEDDS calculation version 1.2.01.07

Ultimate limit state load factors

Dead load factor	$\gamma_{f_d} = 1.4$
Live load factor	$\gamma_{f_l} = 1.6$
Earth and water pressure factor	$\gamma_{f_e} = 1.4$

Factored vertical forces on wall

Wall stem	$W_{wall_f} = \gamma_{f_d} \times h_{stem} \times t_{wall} \times \gamma_{wall} = 32.7 \text{ kN/m}$
Wall base	$W_{base_f} = \gamma_{f_d} \times l_{base} \times t_{base} \times \gamma_{base} = 19.4 \text{ kN/m}$
Surcharge	$W_{sur_f} = \gamma_{f_l} \times \text{Surcharge} \times l_{heel} = 1.6 \text{ kN/m}$
Moist backfill to top of wall	$W_{m_w_f} = \gamma_{f_d} \times l_{heel} \times (h_{stem} - h_{sat}) \times \gamma_m = 22.2 \text{ kN/m}$
Moist backfill above top of wall	$W_{m_s_f} = \gamma_{f_d} \times 0.5 \times l_{heel}^2 \times \tan(\beta) \times \gamma_m = 0.2 \text{ kN/m}$
Soil in front of wall	$W_{p_f} = \gamma_{f_d} \times l_{toe} \times d_{cover} \times \gamma_{mb} = 3.8 \text{ kN/m}$
Total vertical load	$W_{total_f} = W_{wall_f} + W_{base_f} + W_{sur_f} + W_{m_w_f} + W_{m_s_f} + W_{p_f} = 79.9 \text{ kN/m}$

Factored horizontal at-rest forces on wall

Surcharge	$F_{sur_f} = \gamma_{f_l} \times K_0 \times \text{Surcharge} \times h_{eff} = 5.1 \text{ kN/m}$
Moist backfill above water table	$F_{m_a_f} = \gamma_{f_e} \times 0.5 \times K_0 \times \gamma_m \times (h_{eff} - h_{water})^2 = 39.7 \text{ kN/m}$
Total horizontal load	$F_{total_f} = F_{sur_f} + F_{m_a_f} = 44.8 \text{ kN/m}$
Passive resistance of soil in front of wall	$F_{p_f} = \gamma_{f_e} \times 0.5 \times K_p \times \cos(\delta_b) \times (d_{cover} + t_{base} + d_{ds} - d_{exc})^2 \times \gamma_{mb} = 3.1 \text{ kN/m}$

Factored overturning moments

Surcharge	$M_{sur_f} = F_{sur_f} \times (h_{eff} - 2 \times d_{ds}) / 2 = 6.3 \text{ kNm/m}$
Moist backfill above water table	$M_{m_a_f} = F_{m_a_f} \times (h_{eff} + 2 \times h_{water} - 3 \times d_{ds}) / 3 = 32.9 \text{ kNm/m}$
Total overturning moment	$M_{ot_f} = M_{sur_f} + M_{m_a_f} = 39.2 \text{ kNm/m}$

Restoring moments

Wall stem	$M_{wall_f} = W_{wall_f} \times (l_{toe} + t_{wall} / 2) = 56.4 \text{ kNm/m}$
Wall base	$M_{base_f} = W_{base_f} \times l_{base} / 2 = 22.8 \text{ kNm/m}$
Surcharge	$M_{sur_f} = W_{sur_f} \times (l_{base} - l_{heel} / 2) = 3.4 \text{ kNm/m}$
Moist backfill	$M_{m_r_f} = (W_{m_w_f} \times (l_{base} - l_{heel} / 2) + W_{m_s_f} \times (l_{base} - l_{heel} / 3)) = 48.1 \text{ kNm/m}$
Soil in front of wall	$M_{p_r_f} = W_{p_f} \times l_{toe} / 2 = 2.8 \text{ kNm/m}$
Total restoring moment	$M_{rest_f} = M_{wall_f} + M_{base_f} + M_{sur_f} + M_{m_r_f} + M_{p_r_f} = 133.6 \text{ kNm/m}$

Factored bearing pressure

Total moment for bearing	$M_{total_f} = M_{rest_f} - M_{ot_f} = 94.4 \text{ kNm/m}$
Total vertical reaction	$R_f = W_{total_f} = 79.9 \text{ kN/m}$
Distance to reaction	$x_{bar_f} = M_{total_f} / R_f = 1182 \text{ mm}$
Eccentricity of reaction	$e_f = \text{abs}((l_{base} / 2) - x_{bar_f}) = 7 \text{ mm}$

Reaction acts within middle third of base

Bearing pressure at toe	$p_{toe_f} = (R_f / l_{base}) - (6 \times R_f \times e_f / l_{base}^2) = 33.4 \text{ kN/m}^2$
Bearing pressure at heel	$p_{heel_f} = (R_f / l_{base}) + (6 \times R_f \times e_f / l_{base}^2) = 34.6 \text{ kN/m}^2$
Rate of change of base reaction	$\text{rate} = (p_{toe_f} - p_{heel_f}) / l_{base} = -0.49 \text{ kN/m}^2/\text{m}$
Bearing pressure at stem / toe	$p_{stem_toe_f} = \text{max}(p_{heel_f} + (\text{rate} \times (l_{heel} + t_{wall})), 0 \text{ kN/m}^2) = 34.1 \text{ kN/m}^2$
Bearing pressure at mid stem	$p_{stem_mid_f} = \text{max}(p_{heel_f} + (\text{rate} \times (l_{heel} + t_{wall} / 2)), 0 \text{ kN/m}^2) = 34.3 \text{ kN/m}^2$
Bearing pressure at stem / heel	$p_{stem_heel_f} = \text{max}(p_{heel_f} + (\text{rate} \times l_{heel}), 0 \text{ kN/m}^2) = 34.4 \text{ kN/m}^2$

Barratt Associates Ltd Barratt Associates Civil & Structural Engineering Consultants info@barratt-associates.co.uk 07946 065051	Project				Job Ref.	
	5 Dyffryn Road, Pontardawe				202106	
	Section				Sheet no./rev.	
	Structural Calculations				9	
	Calc. by	Date	Chk'd by	Date	App'd by	Date
	RD	29/06/2020	IL	29/06/2020	BA	29/06/2020

Design of reinforced concrete retaining wall toe (BS 8002:1994)

Material properties

Characteristic strength of concrete $f_{cu} = 35 \text{ N/mm}^2$

Characteristic strength of reinforcement $f_y = 500 \text{ N/mm}^2$

Base details

Minimum area of reinforcement $k = 0.13 \%$

Cover to reinforcement in toe $c_{toe} = 50 \text{ mm}$

Calculate shear for toe design

Shear from bearing pressure $V_{toe_bear} = (p_{toe_f} + p_{stem_toe_f}) \times l_{toe} / 2 = 50.7 \text{ kN/m}$

Shear from weight of base $V_{toe_wt_base} = \gamma_{f_d} \times \gamma_{base} \times l_{toe} \times t_{base} = 12.4 \text{ kN/m}$


Total shear for toe design $V_{toe} = V_{toe_bear} - V_{toe_wt_base} = 38.3 \text{ kN/m}$

Calculate moment for toe design

Moment from bearing pressure $M_{toe_bear} = (2 \times p_{toe_f} + p_{stem_mid_f}) \times (l_{toe} + t_{wall} / 2)^2 / 6 = 50.1 \text{ kNm/m}$

Moment from weight of base $M_{toe_wt_base} = (\gamma_{f_d} \times \gamma_{base} \times t_{base} \times (l_{toe} + t_{wall} / 2)^2 / 2) = 12.3 \text{ kNm/m}$

Total moment for toe design $M_{toe} = M_{toe_bear} - M_{toe_wt_base} = 37.8 \text{ kNm/m}$

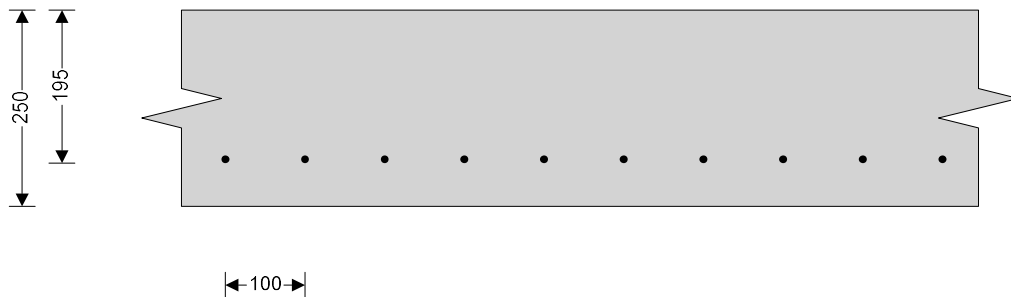

Check toe in bending

Width of toe $b = 1000 \text{ mm/m}$

Depth of reinforcement $d_{toe} = t_{base} - c_{toe} - (\phi_{toe} / 2) = 195.0 \text{ mm}$

Constant $K_{toe} = M_{toe} / (b \times d_{toe}^2 \times f_{cu}) = 0.028$

Compression reinforcement is not required

Lever arm $z_{toe} = \min(0.5 + \sqrt{(0.25 - (\min(K_{toe}, 0.225) / 0.9))}, 0.95) \times d_{toe}$

$z_{toe} = 185 \text{ mm}$

Area of tension reinforcement required $A_{s_toe_des} = M_{toe} / (0.87 \times f_y \times z_{toe}) = 469 \text{ mm}^2/\text{m}$

Minimum area of tension reinforcement $A_{s_toe_min} = k \times b \times t_{base} = 325 \text{ mm}^2/\text{m}$

Area of tension reinforcement required $A_{s_toe_req} = \text{Max}(A_{s_toe_des}, A_{s_toe_min}) = 469 \text{ mm}^2/\text{m}$

Reinforcement provided

B785 mesh

Area of reinforcement provided

$A_{s_toe_prov} = 785 \text{ mm}^2/\text{m}$

PASS - Reinforcement provided at the retaining wall toe is adequate

Check shear resistance at toe

Design shear stress $v_{toe} = V_{toe} / (b \times d_{toe}) = 0.196 \text{ N/mm}^2$

Allowable shear stress $v_{adm} = \min(0.8 \times \sqrt{f_{cu} / 1 \text{ N/mm}^2}, 5) \times 1 \text{ N/mm}^2 = 4.733 \text{ N/mm}^2$

PASS - Design shear stress is less than maximum shear stress

From BS8110:Part 1:1997 – Table 3.8

Design concrete shear stress

$v_{c_toe} = 0.625 \text{ N/mm}^2$

$v_{toe} < v_{c_toe}$ - No shear reinforcement required

Barratt Associates Ltd Barratt Associates Civil & Structural Engineering Consultants info@barratt-associates.co.uk 07946 065051	Project				Job Ref.	
	5 Dyffryn Road, Pontardawe				202106	
	Section				Sheet no./rev.	
	Structural Calculations				10	
Calc. by	Date	Chk'd by	Date	App'd by	Date	
RD	29/06/2020	IL	29/06/2020	BA	29/06/20201	

Design of reinforced concrete retaining wall heel (BS 8002:1994)

Material properties

Characteristic strength of concrete $f_{cu} = 35 \text{ N/mm}^2$

Characteristic strength of reinforcement $f_y = 500 \text{ N/mm}^2$

Base details

Minimum area of reinforcement $k = 0.13 \%$

Cover to reinforcement in heel $C_{heel} = 50 \text{ mm}$

Calculate shear for heel design

Shear from bearing pressure $V_{heel_bear} = (p_{heel_f} + p_{stem_heel_f}) \times l_{heel} / 2 = 13.8 \text{ kN/m}$

Shear from weight of base $V_{heel_wt_base} = \gamma_{f_d} \times \gamma_{base} \times l_{heel} \times t_{base} = 3.3 \text{ kN/m}$

Shear from weight of moist backfill $V_{heel_wt_m} = W_{m_w_f} + W_{m_s_f} = 22.4 \text{ kN/m}$

Shear from surcharge $V_{heel_sur} = W_{sur_f} = 1.6 \text{ kN/m}$

Total shear for heel design $V_{heel} = -V_{heel_bear} + V_{heel_wt_base} + V_{heel_wt_m} + V_{heel_sur} = 13.5 \text{ kN/m}$

Calculate moment for heel design

Moment from bearing pressure $M_{heel_bear} = (2 \times p_{heel_f} + p_{stem_mid_f}) \times (l_{heel} + t_{wall} / 2)^2 / 6 = 6.7 \text{ kNm/m}$


Moment from weight of base $M_{heel_wt_base} = (\gamma_{f_d} \times \gamma_{base} \times t_{base} \times (l_{heel} + t_{wall} / 2)^2 / 2) = 1.6 \text{ kNm/m}$

Moment from weight of moist backfill $M_{heel_wt_m} = W_{m_w_f} \times (l_{heel} + t_{wall}) / 2 + W_{m_s_f} \times (2 \times l_{heel} / 3 + t_{wall} / 2) = 9.5 \text{ kNm/m}$

Moment from surcharge $M_{heel_sur} = W_{sur_f} \times (l_{heel} + t_{wall}) / 2 = 0.7 \text{ kNm/m}$

Total moment for heel design $M_{heel} = -M_{heel_bear} + M_{heel_wt_base} + M_{heel_wt_m} + M_{heel_sur} = 5.1 \text{ kNm/m}$

←100→

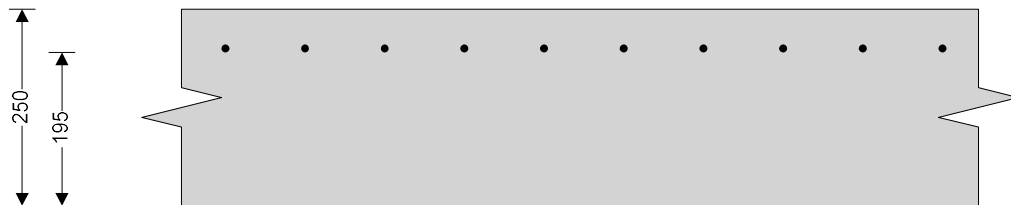

Check heel in bending

Width of heel $b = 1000 \text{ mm/m}$

Depth of reinforcement $d_{heel} = t_{base} - C_{heel} - (\phi_{heel} / 2) = 195.0 \text{ mm}$

Constant $K_{heel} = M_{heel} / (b \times d_{heel}^2 \times f_{cu}) = 0.004$

Compression reinforcement is not required

Lever arm $Z_{heel} = \min(0.5 + \sqrt{(0.25 - (\min(K_{heel}, 0.225) / 0.9))}, 0.95) \times d_{heel}$

$Z_{heel} = 185 \text{ mm}$

Area of tension reinforcement required $A_{s_heel_des} = M_{heel} / (0.87 \times f_y \times Z_{heel}) = 63 \text{ mm}^2/\text{m}$

Minimum area of tension reinforcement $A_{s_heel_min} = k \times b \times t_{base} = 325 \text{ mm}^2/\text{m}$

Area of tension reinforcement required $A_{s_heel_req} = \max(A_{s_heel_des}, A_{s_heel_min}) = 325 \text{ mm}^2/\text{m}$

Reinforcement provided

B785 mesh

Area of reinforcement provided

$A_{s_heel_prov} = 785 \text{ mm}^2/\text{m}$

PASS - Reinforcement provided at the retaining wall heel is adequate

Check shear resistance at heel

Design shear stress $V_{heel} = V_{heel} / (b \times d_{heel}) = 0.069 \text{ N/mm}^2$

Allowable shear stress $V_{adm} = \min(0.8 \times \sqrt{f_{cu}} / 1 \text{ N/mm}^2, 5) \times 1 \text{ N/mm}^2 = 4.733 \text{ N/mm}^2$

PASS - Design shear stress is less than maximum shear stress

Barratt Associates Ltd Barratt Associates Civil & Structural Engineering Consultants info@barratt-associates.co.uk 07946 065051	Project		5 Dyffryn Road, Pontardawe		Job Ref.		202106
	Section		Structural Calculations		Sheet no./rev.		11
	Calc. by	Date	Chk'd by	Date	App'd by	Date	
	RD	29/06/2020	IL	29/06/2020	BA	29/06/2020	


From BS8110:Part 1:1997 – Table 3.8

Design concrete shear stress

$$V_{c_heel} = 0.625 \text{ N/mm}^2$$

$V_{heel} < V_{c_heel}$ - No shear reinforcement required

Design of cavity reinforced masonry retaining wall stem - BS5628-2:2000

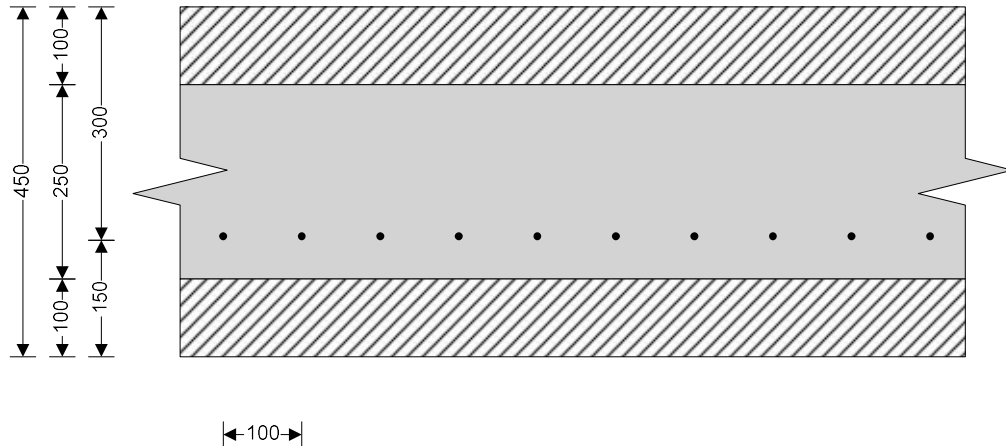

Wall details

Thickness of outer leaf of wall

$$t_{outer} = 100 \text{ mm}$$

Thickness of inner leaf of wall

$$t_{inner} = 100 \text{ mm}$$

Thickness of reinforced cavity

$$t_{cavity} = t_{wall} - t_{outer} - t_{inner} = 250 \text{ mm}$$

Depth of stem reinforcement

$$d_{stem} = 300 \text{ mm}$$

Masonry details

Masonry type

Aggregate concrete blocks no voids

Compressive strength of units

$$p_{unit} = 7.3 \text{ N/mm}^2$$

Mortar designation

(ii)

Category of manufacturing control of units

Category II

Partial safety factor for material strength

$$\gamma_{mm} = 2.3$$

Characteristic compressive strength of masonry

Least horizontal dimension of masonry units

$$b_{unit} = 100.0 \text{ mm}$$

Height of masonry units

$$h_{unit} = 215.0 \text{ mm}$$

Ratio of height to least horizontal dimension

$$\text{ratio} = h_{unit} / b_{unit} = 2.2$$

From BS5628:2 Table 3d, mortar ii

Characteristic compressive strength

$$f_k = 6.4 \text{ N/mm}^2$$

Factored horizontal at-rest forces on stem

Surcharge

$$F_{s_sur_f} = \gamma_{f_l} \times K_0 \times \text{Surcharge} \times (h_{eff} - t_{base} - d_{ds}) = 4.6 \text{ kN/m}$$

Moist backfill above water table

$$F_{s_m_a_f} = 0.5 \times \gamma_{f_e} \times K_0 \times \gamma_m \times (h_{eff} - t_{base} - d_{ds} - h_{sat})^2 = 32.1 \text{ kN/m}$$

Calculate shear for stem design

Shear at base of stem

$$V_{stem} = F_{s_sur_f} + F_{s_m_a_f} = 36.7 \text{ kN/m}$$

Calculate moment for stem design

Surcharge

$$M_{s_sur} = F_{s_sur_f} \times (h_{stem} + t_{base}) / 2 = 5.6 \text{ kNm/m}$$

Moist backfill above water table

$$M_{s_m_a} = F_{s_m_a_f} \times (2 \times h_{sat} + h_{eff} - d_{ds} + t_{base} / 2) / 3 = 28 \text{ kNm/m}$$

Total moment for stem design

$$M_{stem} = M_{s_sur} + M_{s_m_a} = 33.6 \text{ kNm/m}$$

Check maximum design moment for wall stem

Width of wall

$$b = 1000 \text{ mm/m}$$

Barratt Associates Ltd Barratt Associates Civil & Structural Engineering Consultants info@barratt-associates.co.uk 07946 065051	Project				Job Ref.	
	5 Dyffryn Road, Pontardawe				202106	
	Section				Sheet no./rev.	
	Structural Calculations				12	
	Calc. by	Date	Chk'd by	Date	App'd by	Date
	RD	29/06/2020	IL	29/06/2020	BA	29/06/2020

Maximum design moment

$$M_{d_stem} = 0.4 \times f_k \times b \times d_{stem}^2 / \gamma_{mm} = \mathbf{100.2 \text{ kNm/m}}$$

PASS - Applied moment is less than maximum design moment

Check wall stem in bending

Moment of resistance factor

$$Q = M_{stem} / d_{stem}^2 = \mathbf{0.373 \text{ N/mm}^2}$$

$$Q = 2 \times c \times (1 - c) \times f_k / \gamma_{mm}$$

Lever arm factor

$$c = \mathbf{0.928}$$

Lever arm

$$z_{stem} = \min(0.95, c) \times d_{stem} = \mathbf{278.3 \text{ mm}}$$

Area of tension reinforcement required

$$A_{s_stem_des} = M_{stem} \times \gamma_{ms} / (f_y \times z_{stem}) = \mathbf{277 \text{ mm}^2/\text{m}}$$

Minimum area of tension reinforcement

$$A_{s_stem_min} = k \times b \times t_{wall} = \mathbf{585 \text{ mm}^2/\text{m}}$$

Area of tension reinforcement required

$$A_{s_stem_req} = \text{Max}(A_{s_stem_des}, A_{s_stem_min}) = \mathbf{585 \text{ mm}^2/\text{m}}$$

Reinforcement provided

B785 mesh

Area of reinforcement provided

$$A_{s_stem_prov} = \pi \times \phi_{stem}^2 / (4 \times s_{stem}) = \mathbf{785 \text{ mm}^2/\text{m}}$$

PASS - Reinforcement provided at the retaining wall stem is adequate

Check shear resistance at wall stem

Design shear stress

$$V_{stem} = V_{stem} / (b \times d_{stem}) = \mathbf{0.122 \text{ N/mm}^2}$$

Basic characteristic shear strength of masonry

$$f_{vbas} = \min[0.35 + (17.5 \times A_{s_stem_prov} / (b \times d_{stem})), 0.7] \times 1 \text{ N/mm}^2$$

$$f_{vbas} = \mathbf{0.396 \text{ N/mm}^2}$$

Shear span

$$a = M_{stem} / V_{stem} = \mathbf{914.2 \text{ mm}}$$

Characteristic shear strength of masonry

$$f_v = \text{Min}(f_{vbas} \times \max(2.5 - 0.25 \times (a / d_{stem}), 1), 1.75 \text{ N/mm}^2)$$

$$f_v = \mathbf{0.688 \text{ N/mm}^2}$$

Allowable shear stress

$$V_{adm} = f_v / \gamma_{mv} = \mathbf{0.344 \text{ N/mm}^2}$$

PASS - Design shear stress is less than maximum shear stress

Check limiting dimensions

Limiting span/effective depth ratio

$$\text{ratio}_{\max} = \mathbf{18.00}$$

Actual span/effective depth ratio

$$\text{ratio}_{\text{act}} = (h_{stem} + d_{stem} / 2) / d_{stem} = \mathbf{7.83}$$

PASS - Span to depth ratio is acceptable

Axial load check

Factored axial load on wall

$$N_{wall} = ([t_{wall} \times h_{stem} \times \gamma_{wall} + W_{dead}] \times \gamma_{f_d}) + (W_{live} \times \gamma_{f_l}) = \mathbf{32.7 \text{ kN/m}}$$


Limiting axial load

$$N_{limit} = 0.1 \times f_k \times t_{wall} = \mathbf{288.0 \text{ kN/m}}$$

Applied axial load may be ignored - calculations valid

Barratt Associates Ltd Barratt Associates Civil & Structural Engineering Consultants info@barratt-associates.co.uk 07946 065051	Project				Job Ref.	
	5 Dyffryn Road, Pontardawe				202106	
	Section				Sheet no./rev.	
	Structural Calculations				13	
	Calc. by	Date	Chk'd by	Date	App'd by	Date
	RD	29/06/2020	IL	29/06/2020	BA	29/06/2020

Indicative retaining wall reinforcement diagram

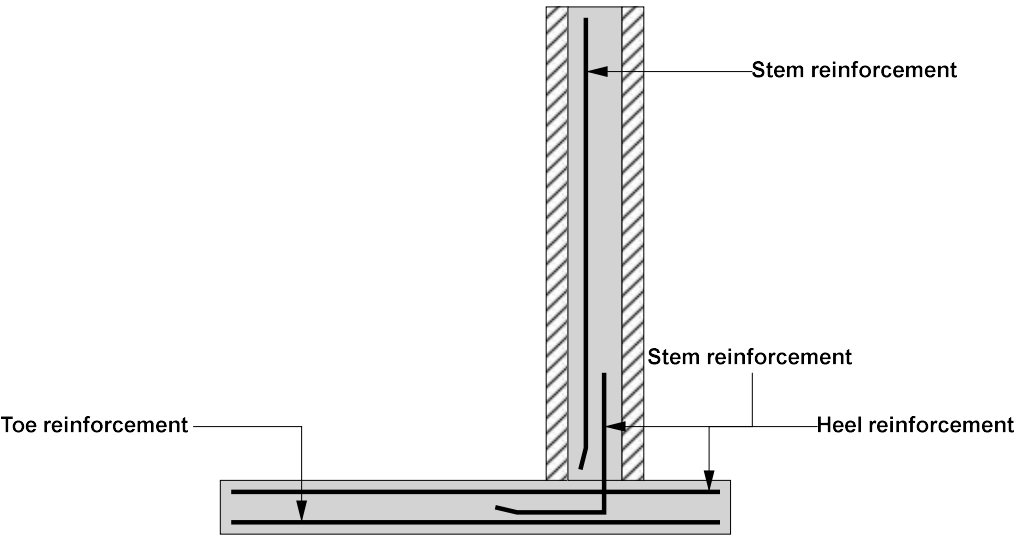

- Toe mesh - B785 - (785 mm²/m)
- Heel mesh - B785 - (785 mm²/m)
- Stem mesh - B785 - (785 mm²/m)