


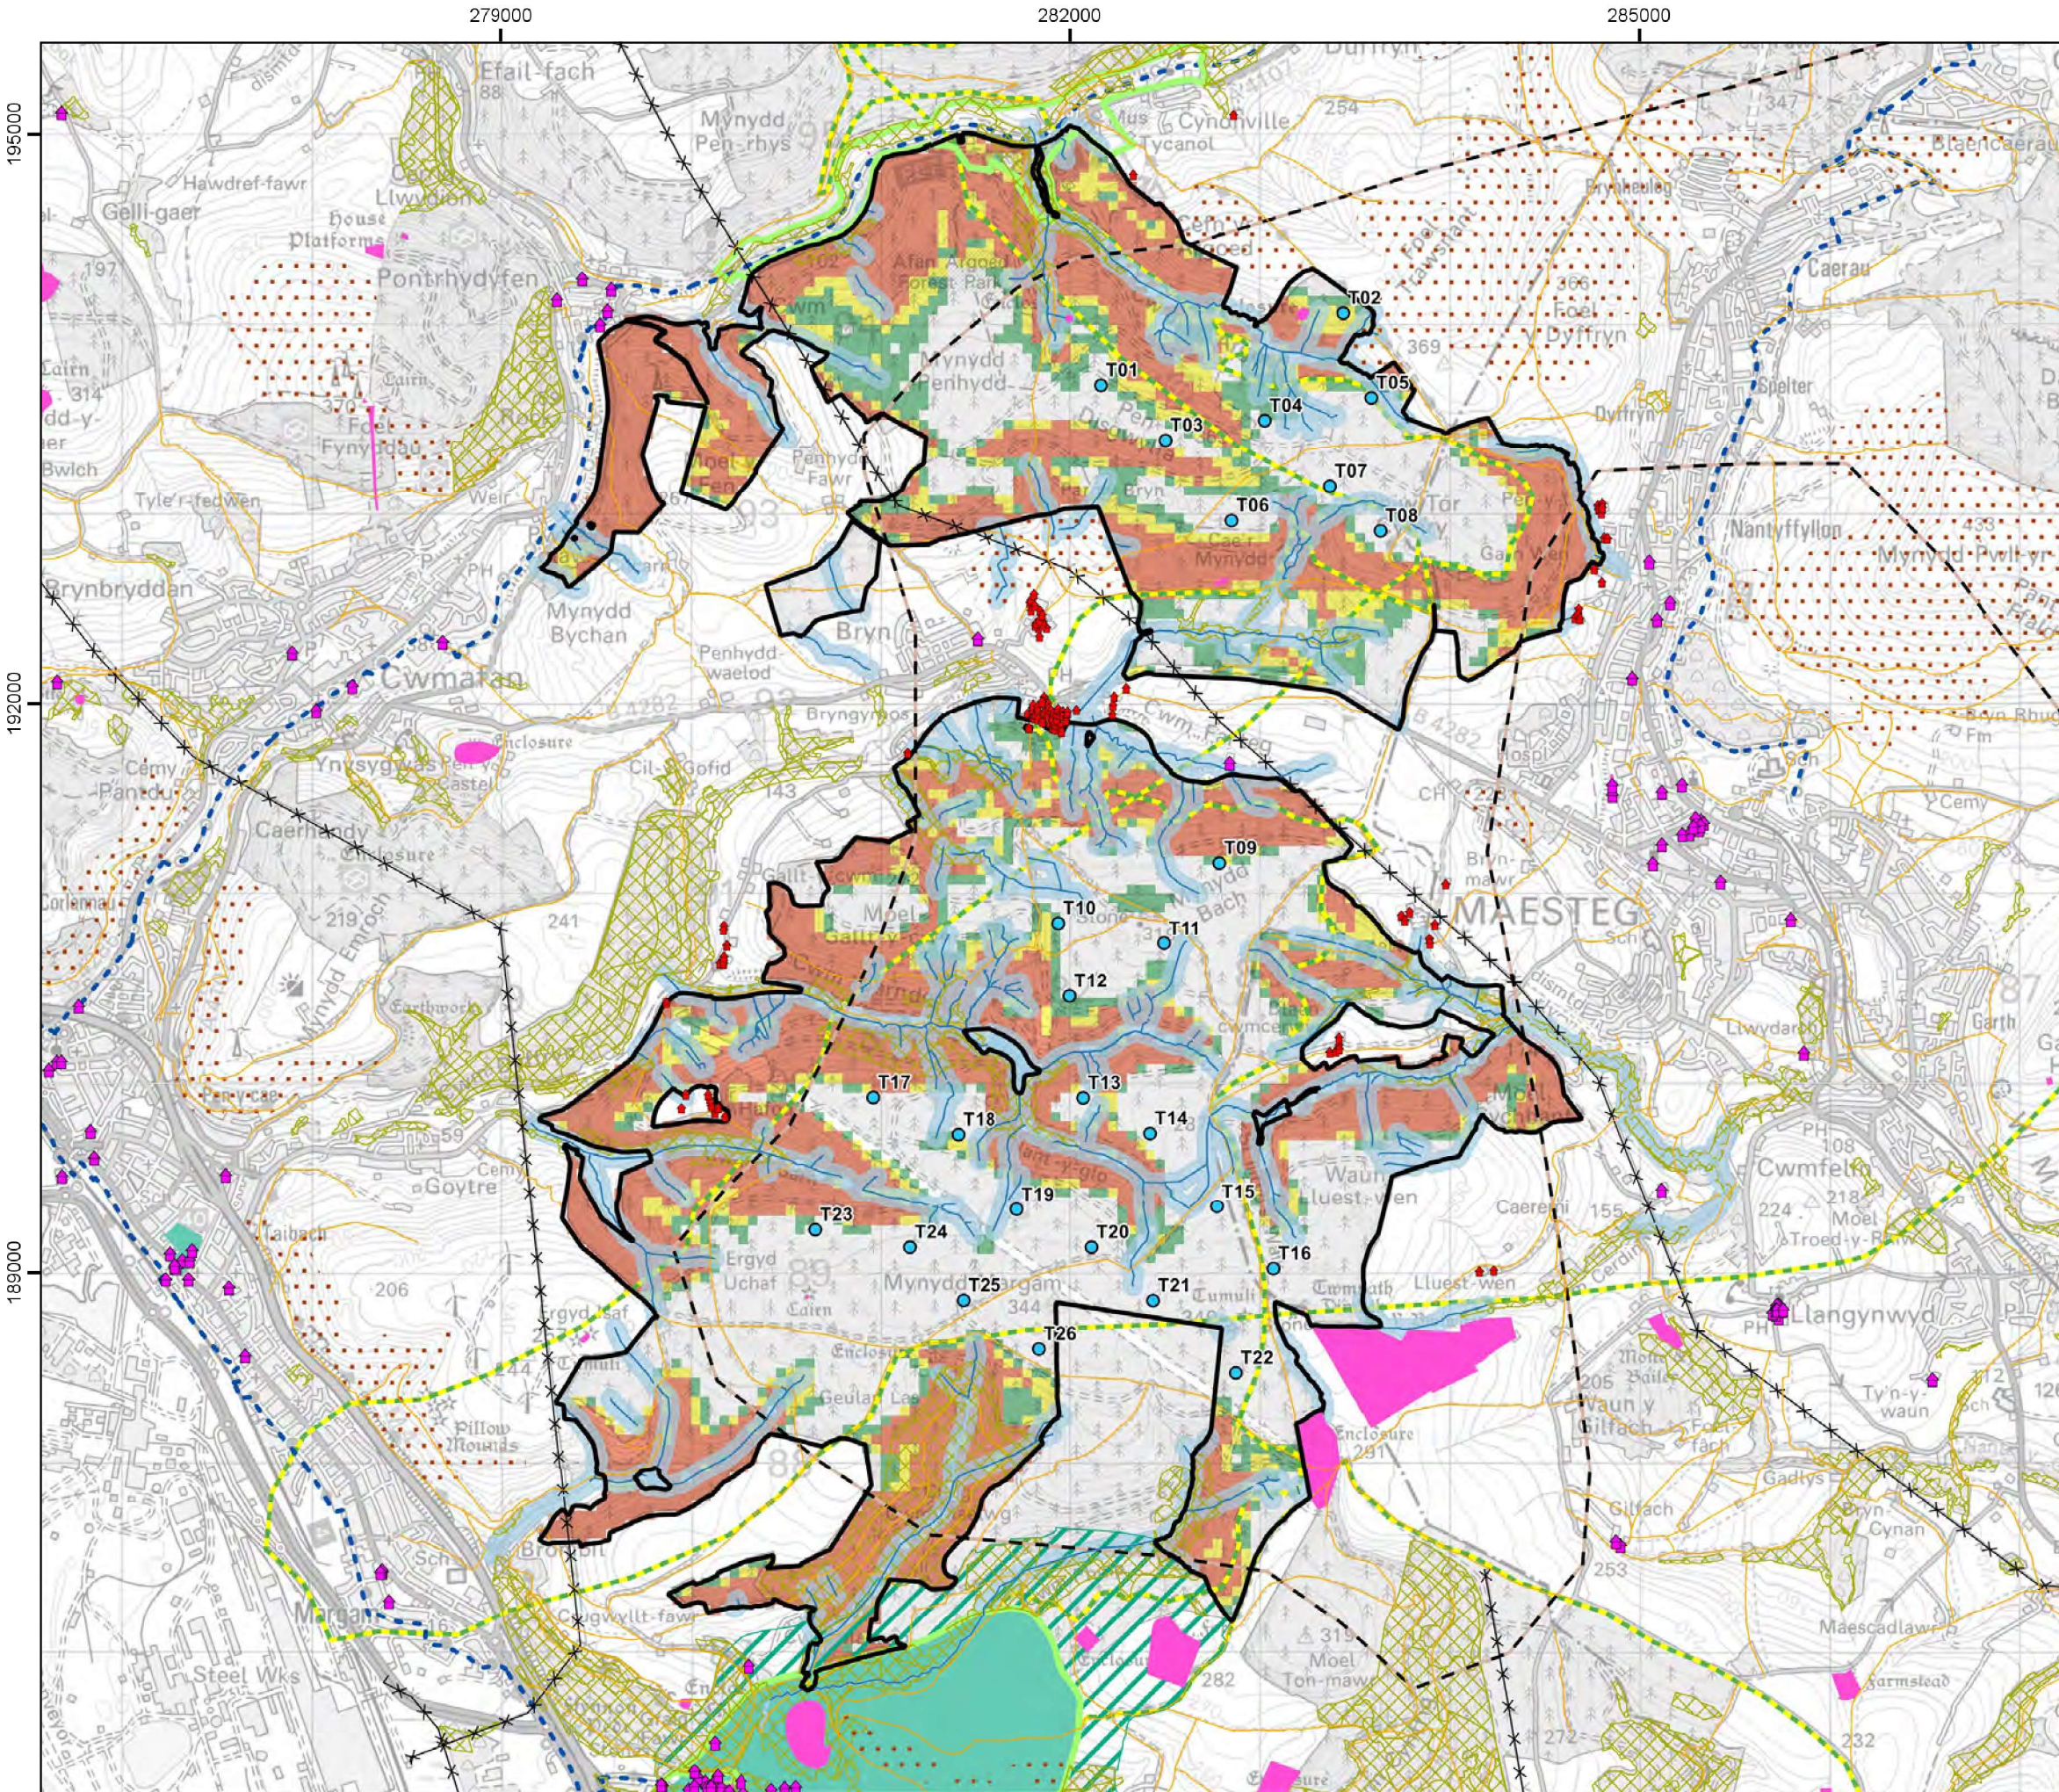

Project:
**Y Bryn Wind Farm, Neath
Port Talbot/Bridgend**

Title:
**Figure 3.1: Constraints to Site
Design**

Key

- Site boundary
- Proposed turbine
- Potential noise sensitive property within 1.2 km of nearest turbine
- Watercourse
- 50 m buffer from watercourse or body
- National Cycle Network (5)
- Long distance footpath
- Public Right of Way (1)
- 13 2kV, 275 kV and 400 kV Electricity power line (4)
- TAN 8 SSAs 2005 (3)
- Open Access Wales (1)
- Scheduled Monument (2)
- Listed building (2)
- Ancient Woodland Inventory (2)
- Country park (1)
- Designed Parks & Gardens (2)
- Parks and Gardens (Essential Settings) (2)

Slope

- >8° - 10°
- >10° - 12°
- > 12°

Contains public sector information licensed under the Open Government Licence v3.0. Source Data reproduced with the permission of (1) NRW (2) CADW (3) Welsh Government (4) NGET (5) Sustrans
© Crown Copyright 2020. All rights reserved. Ordnance Survey Licence 0100031673.

Scale @ A3: 1:35,000
Coordinate System: British National Grid

0 0.5 1 1.5 2 km

N

Date: 09-12-20 Prepared by: AB Checked by: JS

Ref: GB201891_M_020_B Layout: 010920_26t_A

Drawing by:
The Natural Power Consultants Limited
Harbour House,
Y Lanfa,
Aberystwyth.

natural power

Coriolis Energy

ESB

Notes: a) Information on this plan is directly reproduced from digital and other material from different sources. Minor discrepancies may therefore occur. Where further clarification is considered necessary, this is noted through the use of text boxes on the plan itself. b) For the avoidance of doubt and unless otherwise stated: 1. this plan should be used for identification purposes only, unless otherwise stated in accompanying documentation. 2. The Natural Power Consultants Limited accepts no responsibility for the accuracy of data supplied by third parties. 3. The Natural Power Consultants Limited accepts no liability for any use which is made of this plan by a party other than its client. No third party who gains access to this plan shall have any claim against The Natural Power Consultants Limited in respect of its contents. 4. Where a line or feature recorded in the key of this plan is also shown as a line or feature by the Ordnance Survey, and that line or feature is located in a different position on the ground than shown by the Ordnance Survey, then the line or feature shall be deemed to follow the position as existing on the ground. 4. Where a line recorded in the key demarcates a boundary on this plan, the boundary edge is the outside edge of the line. 5. Where a line or feature recorded in the key of this plan is also shown as a line or feature by the Ordnance Survey, and that line or feature is located in a different position on the ground than shown by the Ordnance Survey, then the line or feature shall be deemed to follow the position as existing on the ground.