


Lighting Legend

- A
- 80W 9974 Lumens 4000K LED fitting to be mounted on an 8m column.
-
- A
- As above but twin head.
-
- B
- 150W 21898 lumens 4000K LED Floodlight to be mounted on an 8m column.
-
- C
- 38W 5068 lumens 4000K LED Fitting to be mounted on a 4m column.
-
- C
- As above but twin head.
-
- D
- 150W 21898 lumens 4000K LED Floodlight to be Building mounted at a height of 8m.

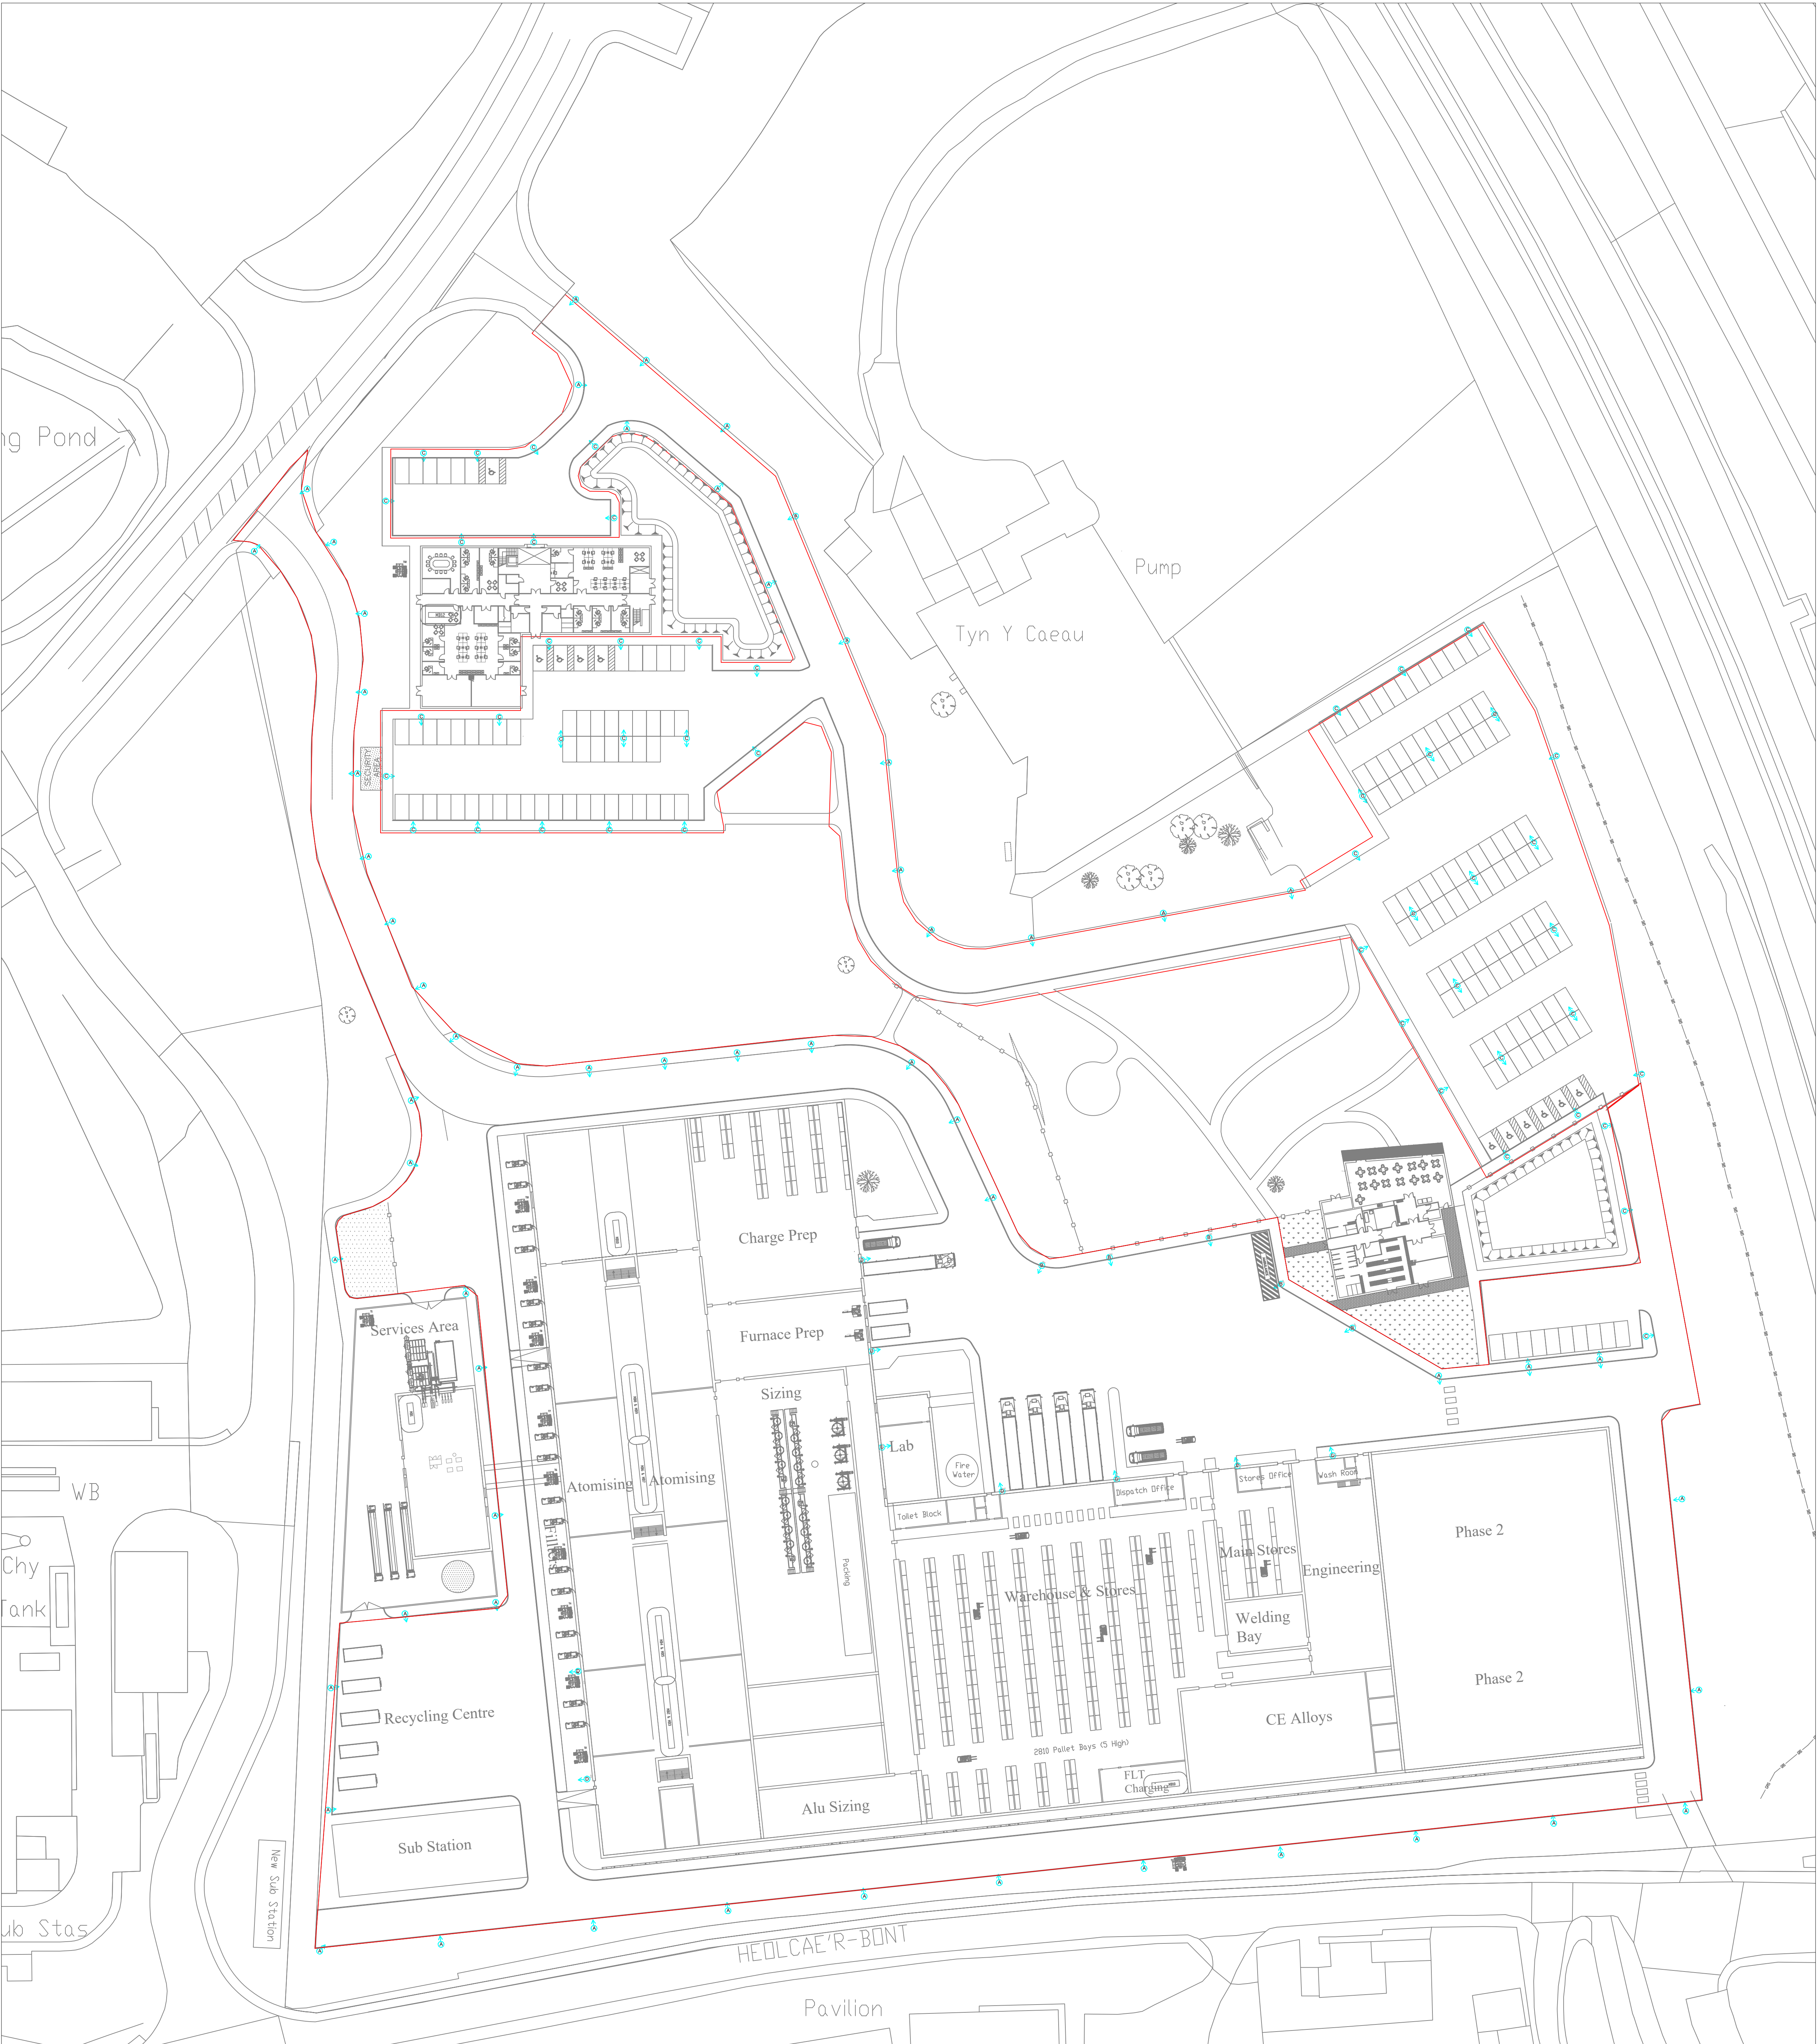

Do not scale this drawing or the computer digital data.
Lead Consultant to be notified of any discrepancies
in figured dimensions.
Contractors must check all site dimensions.
This drawing is copyright and is for use on this site only.

This Drawing shall be used for pricing purposes and to highlight
extent of works only. This drawing shall not be used for installation
purposes. Contractor shall provide their own coordinated working
drawings prior to start on site.

- Notes**
All installations and components shall comply with the current
Requirements of:-
- The IET Regulations (Requirements for Electrical Installations)
(BS7671:2008) - Latest edition.
- The Electricity at Work Regulations 1989.
- The Electricity Supply (Amendment) Regulations 2000.
- Health and Safety at Work Act etc 1974.
- All relevant parts of the Current Edition of the Building Regulations (including
CDDA).
- All British Standards & Codes of Practice.
1. All external lighting to be controlled from a PEC, timer and override mounted in
a convenient location.

1.	Layout updated to suit revised architects layout.	RB	Jan'22	PM
Ref	Revision	By	Date	Checked

For Comment

Purpose of Issue

10 Pentepoeth Road
Morriston, Swansea
SA6 5AB
Tel: 01792 792323
Fax: 01792 792339



Client



Project
Development Site,
Port Talbot.

Drawn RB	Checked WC	Authorised PM	Original Scale @ A0 1:500
Date Dec'21	Date Dec'21	Date Dec'21	

Title
External Lighting Column Positions.