

Structural Calculation

Haul Y Bryn
Graig Y Tewgoed

Important Note

All Calculation should be checked by Building control officer for Approval.

All measurement to be carried out by the Contractor and agreed by the Engineer Prior ordering the Steel.

Retaining Wall Design

Wall height = 2.8m

Angle of fill above wall = 10 degrees

Wall details is

100mm outer skin Blockwork

200mm reinforced concrete cavity infill


100mm inner skin Blockwork

see detailed computer output and drawing.

Project				Job no.	
Haul Y Bryn Graig Y Tewgoed				Start page no./Revision	
Calcs for				1	
Retaining wall					
Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date

RETAINING WALL ANALYSIS (BS 8002:1994)

TEDDS calculation version 1.2.01.08

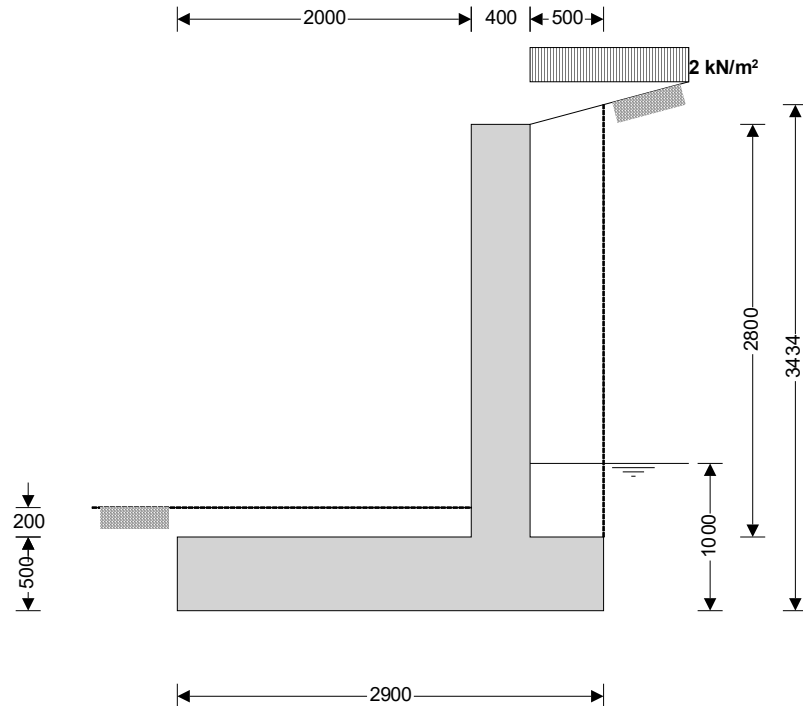

Wall details

Retaining wall type
Height of retaining wall stem
Thickness of wall stem
Length of toe
Length of heel
Overall length of base
Thickness of base
Depth of downstand
Position of downstand
Thickness of downstand
Height of retaining wall
Depth of cover in front of wall
Depth of unplanned excavation
Height of ground water behind wall
Height of saturated fill above base
Density of wall construction
Density of base construction
Angle of rear face of wall
Angle of soil surface behind wall
Effective height at virtual back of wall

Unpropped cantilever

$h_{\text{stem}} = 2800 \text{ mm}$
 $t_{\text{wall}} = 400 \text{ mm}$
 $l_{\text{toe}} = 2000 \text{ mm}$
 $l_{\text{heel}} = 500 \text{ mm}$
 $l_{\text{base}} = l_{\text{toe}} + l_{\text{heel}} + t_{\text{wall}} = 2900 \text{ mm}$
 $t_{\text{base}} = 500 \text{ mm}$
 $d_{\text{ds}} = 0 \text{ mm}$
 $l_{\text{ds}} = 1900 \text{ mm}$
 $t_{\text{ds}} = 500 \text{ mm}$
 $h_{\text{wall}} = h_{\text{stem}} + t_{\text{base}} + d_{\text{ds}} = 3300 \text{ mm}$
 $d_{\text{cover}} = 200 \text{ mm}$
 $d_{\text{exc}} = 0 \text{ mm}$
 $h_{\text{water}} = 1000 \text{ mm}$
 $h_{\text{sat}} = \max(h_{\text{water}} - t_{\text{base}} - d_{\text{ds}}, 0 \text{ mm}) = 500 \text{ mm}$
 $\gamma_{\text{wall}} = 23.6 \text{ kN/m}^3$
 $\gamma_{\text{base}} = 23.6 \text{ kN/m}^3$
 $\alpha = 90.0 \text{ deg}$
 $\beta = 15.0 \text{ deg}$
 $h_{\text{eff}} = h_{\text{wall}} + l_{\text{heel}} \times \tan(\beta) = 3434 \text{ mm}$

Retained material details

Mobilisation factor
Moist density of retained material

$M = 1.5$
 $\gamma_m = 18.0 \text{ kN/m}^3$

Project				Job no.	
Haul Y Bryn Graig Y Tewgoed					
Calcs for				Start page no./Revision	
Retaining wall				2	
Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date

Saturated density of retained material $\gamma_s = 21.0 \text{ kN/m}^3$

Design shear strength $\phi' = 25.8 \text{ deg}$

Angle of wall friction $\delta = 19.9 \text{ deg}$

Base material details

Moist density $\gamma_{mb} = 21.0 \text{ kN/m}^3$

Design shear strength $\phi'_b = 25.8 \text{ deg}$

Design base friction $\delta_b = 19.9 \text{ deg}$

Allowable bearing pressure $P_{\text{bearing}} = 100 \text{ kN/m}^2$

Using Coulomb theory

Active pressure coefficient for retained material

$$K_a = \sin(\alpha + \phi')^2 / (\sin(\alpha)^2 \times \sin(\alpha - \delta) \times [1 + \sqrt{(\sin(\phi' + \delta) \times \sin(\phi' - \beta) / (\sin(\alpha - \delta) \times \sin(\alpha + \beta)))})^2) = 0.450$$

Passive pressure coefficient for base material

$$K_p = \sin(90 - \phi'_b)^2 / (\sin(90 - \delta_b) \times [1 - \sqrt{(\sin(\phi'_b + \delta_b) \times \sin(\phi'_b) / (\sin(90 + \delta_b)))})^2) = 4.785$$

At-rest pressure

At-rest pressure for retained material $K_0 = 1 - \sin(\phi') = 0.565$

Loading details

Surcharge load on plan Surcharge = **1.5 kN/m²**

Applied vertical dead load on wall $W_{\text{dead}} = 0.0 \text{ kN/m}$


Applied vertical live load on wall $W_{\text{live}} = 0.0 \text{ kN/m}$

Position of applied vertical load on wall $l_{\text{load}} = 0 \text{ mm}$

Applied horizontal dead load on wall $F_{\text{dead}} = 0.0 \text{ kN/m}$

Applied horizontal live load on wall $F_{\text{live}} = 0.0 \text{ kN/m}$

Height of applied horizontal load on wall $h_{\text{load}} = 0 \text{ mm}$

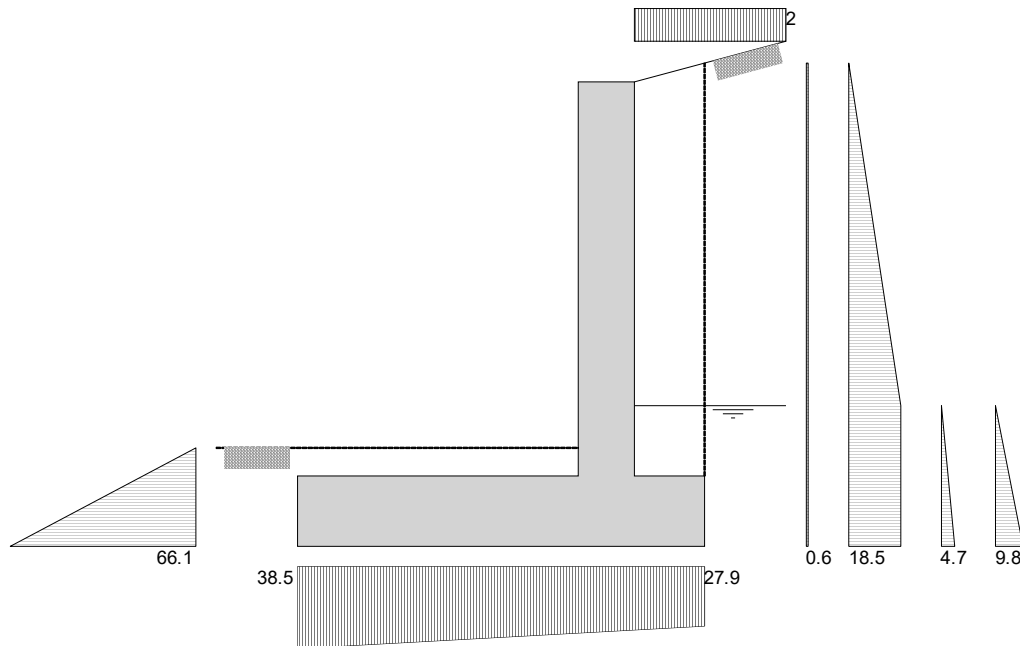

Loads shown in kN/m, pressures shown in kN/m²

Vertical forces on wall

Wall stem $W_{\text{wall}} = h_{\text{stem}} \times t_{\text{wall}} \times \gamma_{\text{wall}} = 26.4 \text{ kN/m}$

Wall base $W_{\text{base}} = l_{\text{base}} \times t_{\text{base}} \times \gamma_{\text{base}} = 34.2 \text{ kN/m}$

Project				Job no.	
Haul Y Bryn Graig Y Tewgoed					
Calcs for				Start page no./Revision	
Retaining wall				3	
Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date

Surcharge

$$W_{sur} = \text{Surcharge} * l_{heel} = \mathbf{0.8 \text{ kN/m}}$$

Moist backfill to top of wall

$$W_{m_w} = l_{heel} * (h_{stem} - h_{sat}) * \gamma_m = \mathbf{20.7 \text{ kN/m}}$$

Moist backfill above top of wall

$$W_{m_s} = 0.5 * l_{heel}^2 * \tan(\beta) * \gamma_m = \mathbf{0.6 \text{ kN/m}}$$

Saturated backfill

$$W_s = l_{heel} * h_{sat} * \gamma_s = \mathbf{5.3 \text{ kN/m}}$$

Soil in front of wall

$$W_p = l_{toe} * d_{cover} * \gamma_{mb} = \mathbf{8.4 \text{ kN/m}}$$

Total vertical load

$$W_{total} = W_{wall} + W_{base} + W_{sur} + W_{m_w} + W_{m_s} + W_s + W_p = \mathbf{96.4 \text{ kN/m}}$$

Horizontal forces on wall

Surcharge

$$F_{sur} = K_a * \cos(90 - \alpha + \delta) * \text{Surcharge} * h_{eff} = \mathbf{2.2 \text{ kN/m}}$$

Moist backfill above water table

$$F_{m_a} = 0.5 * K_a * \cos(90 - \alpha + \delta) * \gamma_m * (h_{eff} - h_{water})^2 = \mathbf{22.6 \text{ kN/m}}$$

Moist backfill below water table

$$F_{m_b} = K_a * \cos(90 - \alpha + \delta) * \gamma_m * (h_{eff} - h_{water}) * h_{water} = \mathbf{18.5 \text{ kN/m}}$$

Saturated backfill

$$F_s = 0.5 * K_a * \cos(90 - \alpha + \delta) * (\gamma_s - \gamma_{water}) * h_{water}^2 = \mathbf{2.4 \text{ kN/m}}$$

Water

$$F_{water} = 0.5 * h_{water}^2 * \gamma_{water} = \mathbf{4.9 \text{ kN/m}}$$

Total horizontal load

$$F_{total} = F_{sur} + F_{m_a} + F_{m_b} + F_s + F_{water} = \mathbf{50.5 \text{ kN/m}}$$

Calculate stability against sliding

Passive resistance of soil in front of wall

$$F_p = 0.5 * K_p * \cos(\delta_b) * (d_{cover} + t_{base} + d_{ds} - d_{exc})^2 * \gamma_{mb} = \mathbf{23.2 \text{ kN/m}}$$

Resistance to sliding

$$F_{res} = F_p + (W_{total} - W_{sur} - W_p) * \tan(\delta_b) = \mathbf{54.7 \text{ kN/m}}$$

PASS - Resistance force is greater than sliding force

Overturning moments

Surcharge

$$M_{sur} = F_{sur} * (h_{eff} - 2 * d_{ds}) / 2 = \mathbf{3.7 \text{ kNm/m}}$$

Moist backfill above water table

$$M_{m_a} = F_{m_a} * (h_{eff} + 2 * h_{water} - 3 * d_{ds}) / 3 = \mathbf{40.9 \text{ kNm/m}}$$

Moist backfill below water table

$$M_{m_b} = F_{m_b} * (h_{water} - 2 * d_{ds}) / 2 = \mathbf{9.3 \text{ kNm/m}}$$

Saturated backfill

$$M_s = F_s * (h_{water} - 3 * d_{ds}) / 3 = \mathbf{0.8 \text{ kNm/m}}$$

Water

$$M_{water} = F_{water} * (h_{water} - 3 * d_{ds}) / 3 = \mathbf{1.6 \text{ kNm/m}}$$

Total overturning moment

$$M_{ot} = M_{sur} + M_{m_a} + M_{m_b} + M_s + M_{water} = \mathbf{56.3 \text{ kNm/m}}$$

Restoring moments

Wall stem

$$M_{wall} = W_{wall} * (l_{toe} + t_{wall} / 2) = \mathbf{58.2 \text{ kNm/m}}$$

Wall base

$$M_{base} = W_{base} * l_{base} / 2 = \mathbf{49.6 \text{ kNm/m}}$$

Moist backfill

$$M_{m_r} = (W_{m_w} * (l_{base} - l_{heel} / 2) + W_{m_s} * (l_{base} - l_{heel} / 3)) = \mathbf{56.5 \text{ kNm/m}}$$

Saturated backfill

$$M_{s_r} = W_s * (l_{base} - l_{heel} / 2) = \mathbf{13.9 \text{ kNm/m}}$$

Total restoring moment

$$M_{rest} = M_{wall} + M_{base} + M_{m_r} + M_{s_r} = \mathbf{178.2 \text{ kNm/m}}$$

Check stability against overturning

Total overturning moment

$$M_{ot} = \mathbf{56.3 \text{ kNm/m}}$$

Total restoring moment

$$M_{rest} = \mathbf{178.2 \text{ kNm/m}}$$

PASS - Restoring moment is greater than overturning moment

Check bearing pressure

Surcharge

$$M_{sur_r} = W_{sur} * (l_{base} - l_{heel} / 2) = \mathbf{2 \text{ kNm/m}}$$

Soil in front of wall

$$M_{p_r} = W_p * l_{toe} / 2 = \mathbf{8.4 \text{ kNm/m}}$$

Total moment for bearing

$$M_{total} = M_{rest} - M_{ot} + M_{sur_r} + M_{p_r} = \mathbf{132.3 \text{ kNm/m}}$$

Total vertical reaction

$$R = W_{total} = \mathbf{96.4 \text{ kN/m}}$$

Distance to reaction

$$x_{bar} = M_{total} / R = \mathbf{1373 \text{ mm}}$$

Eccentricity of reaction

$$e = \text{abs}((l_{base} / 2) - x_{bar}) = \mathbf{77 \text{ mm}}$$

Reaction acts within middle third of base

Bearing pressure at toe

$$p_{toe} = (R / l_{base}) + (6 * R * e / l_{base}^2) = \mathbf{38.5 \text{ kN/m}^2}$$

Bearing pressure at heel

$$p_{heel} = (R / l_{base}) - (6 * R * e / l_{base}^2) = \mathbf{27.9 \text{ kN/m}^2}$$

PASS - Maximum bearing pressure is less than allowable bearing pressure

Project				Job no.	
Haul Y Bryn Graig Y Tewgoed					
Calcs for				Start page no./Revision	
Retaining wall				4	
Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date

RETAINING WALL DESIGN (BS 8002:1994)

TEDDS calculation version 1.2.01.08

Ultimate limit state load factors

Dead load factor	$\gamma_{f_d} = 1.4$
Live load factor	$\gamma_{f_l} = 1.6$
Earth and water pressure factor	$\gamma_{f_e} = 1.4$

Factored vertical forces on wall

Wall stem	$W_{wall_f} = \gamma_{f_d} * h_{stem} * t_{wall} * \gamma_{wall} = 37 \text{ kN/m}$
Wall base	$W_{base_f} = \gamma_{f_d} * l_{base} * t_{base} * \gamma_{base} = 47.9 \text{ kN/m}$
Surcharge	$W_{sur_f} = \gamma_{f_l} * \text{Surcharge} * l_{heel} = 1.2 \text{ kN/m}$
Moist backfill to top of wall	$W_{m_w_f} = \gamma_{f_d} * l_{heel} * (h_{stem} - h_{sat}) * \gamma_m = 29 \text{ kN/m}$
Moist backfill above top of wall	$W_{m_s_f} = \gamma_{f_d} * 0.5 * l_{heel}^2 * \tan(\beta) * \gamma_m = 0.8 \text{ kN/m}$
Saturated backfill	$W_{s_f} = \gamma_{f_d} * l_{heel} * h_{sat} * \gamma_s = 7.3 \text{ kN/m}$
Soil in front of wall	$W_{p_f} = \gamma_{f_d} * l_{toe} * d_{cover} * \gamma_{mb} = 11.8 \text{ kN/m}$
Total vertical load	$W_{total_f} = W_{wall_f} + W_{base_f} + W_{sur_f} + W_{m_w_f} + W_{m_s_f} + W_{s_f} + W_{p_f} = 135 \text{ kN/m}$

Factored horizontal at-rest forces on wall

Surcharge	$F_{sur_f} = \gamma_{f_l} * K_0 * \text{Surcharge} * h_{eff} = 4.7 \text{ kN/m}$
Moist backfill above water table	$F_{m_a_f} = \gamma_{f_e} * 0.5 * K_0 * \gamma_m * (h_{eff} - h_{water})^2 = 42.2 \text{ kN/m}$
Moist backfill below water table	$F_{m_b_f} = \gamma_{f_e} * K_0 * \gamma_m * (h_{eff} - h_{water}) * h_{water} = 34.6 \text{ kN/m}$
Saturated backfill	$F_{s_f} = \gamma_{f_e} * 0.5 * K_0 * (\gamma_s - \gamma_{water}) * h_{water}^2 = 4.4 \text{ kN/m}$
Water	$F_{water_f} = \gamma_{f_e} * 0.5 * h_{water}^2 * \gamma_{water} = 6.9 \text{ kN/m}$
Total horizontal load	$F_{total_f} = F_{sur_f} + F_{m_a_f} + F_{m_b_f} + F_{s_f} + F_{water_f} = 92.7 \text{ kN/m}$
Passive resistance of soil in front of wall	$F_{p_f} = \gamma_{f_e} * 0.5 * K_p * \cos(\delta_b) * (d_{cover} + t_{base} + d_{ds} - d_{exc})^2 * \gamma_{mb} = 32.4 \text{ kN/m}$

Factored overturning moments

Surcharge	$M_{sur_f} = F_{sur_f} * (h_{eff} - 2 * d_{ds}) / 2 = 8 \text{ kNm/m}$
Moist backfill above water table	$M_{m_a_f} = F_{m_a_f} * (h_{eff} + 2 * h_{water} - 3 * d_{ds}) / 3 = 76.4 \text{ kNm/m}$
Moist backfill below water table	$M_{m_b_f} = F_{m_b_f} * (h_{water} - 2 * d_{ds}) / 2 = 17.3 \text{ kNm/m}$
Saturated backfill	$M_{s_f} = F_{s_f} * (h_{water} - 3 * d_{ds}) / 3 = 1.5 \text{ kNm/m}$
Water	$M_{water_f} = F_{water_f} * (h_{water} - 3 * d_{ds}) / 3 = 2.3 \text{ kNm/m}$
Total overturning moment	$M_{ot_f} = M_{sur_f} + M_{m_a_f} + M_{m_b_f} + M_{s_f} + M_{water_f} = 105.4 \text{ kNm/m}$

Restoring moments

Wall stem	$M_{wall_f} = W_{wall_f} * (l_{toe} + t_{wall} / 2) = 81.4 \text{ kNm/m}$
Wall base	$M_{base_f} = W_{base_f} * l_{base} / 2 = 69.5 \text{ kNm/m}$
Surcharge	$M_{sur_r_f} = W_{sur_f} * (l_{base} - l_{heel} / 2) = 3.2 \text{ kNm/m}$
Moist backfill	$M_{m_r_f} = (W_{m_w_f} * (l_{base} - l_{heel} / 2) + W_{m_s_f} * (l_{base} - l_{heel} / 3)) = 79.1 \text{ kNm/m}$
Saturated backfill	$M_{s_r_f} = W_{s_f} * (l_{base} - l_{heel} / 2) = 19.5 \text{ kNm/m}$
Soil in front of wall	$M_{p_r_f} = W_{p_f} * l_{toe} / 2 = 11.8 \text{ kNm/m}$
Total restoring moment	$M_{rest_f} = M_{wall_f} + M_{base_f} + M_{sur_r_f} + M_{m_r_f} + M_{s_r_f} + M_{p_r_f} = 264.4 \text{ kNm/m}$

Factored bearing pressure

Total moment for bearing	$M_{total_f} = M_{rest_f} - M_{ot_f} = 159 \text{ kNm/m}$
Total vertical reaction	$R_f = W_{total_f} = 135.0 \text{ kN/m}$
Distance to reaction	$x_{bar_f} = M_{total_f} / R_f = 1177 \text{ mm}$
Eccentricity of reaction	$e_f = \text{abs}((l_{base} / 2) - x_{bar_f}) = 273 \text{ mm}$

Reaction acts within middle third of base

Project				Job no.	
Haul Y Bryn Graig Y Tewgoed				Start page no./Revision	
Calcs for				5	
Retaining wall					
Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date

Bearing pressure at toe	$p_{toe_f} = (R_f / l_{base}) + (6 * R_f * e_f / l_{base}^2) = 72.9 \text{ kN/m}^2$
Bearing pressure at heel	$p_{heel_f} = (R_f / l_{base}) - (6 * R_f * e_f / l_{base}^2) = 20.3 \text{ kN/m}^2$
Rate of change of base reaction	$rate = (p_{toe_f} - p_{heel_f}) / l_{base} = 18.13 \text{ kN/m}^2/\text{m}$
Bearing pressure at stem / toe	$p_{stem_toe_f} = \max(p_{toe_f} - (rate * l_{toe}), 0 \text{ kN/m}^2) = 36.6 \text{ kN/m}^2$
Bearing pressure at mid stem	$p_{stem_mid_f} = \max(p_{toe_f} - (rate * (l_{toe} + t_{wall} / 2)), 0 \text{ kN/m}^2) = 33 \text{ kN/m}^2$
Bearing pressure at stem / heel	$p_{stem_heel_f} = \max(p_{toe_f} - (rate * (l_{toe} + t_{wall})), 0 \text{ kN/m}^2) = 29.3 \text{ kN/m}^2$

Design of reinforced concrete retaining wall toe (BS 8002:1994)

Material properties

Characteristic strength of concrete	$f_{cu} = 40 \text{ N/mm}^2$
Characteristic strength of reinforcement	$f_y = 500 \text{ N/mm}^2$

Base details


Minimum area of reinforcement	$k = 0.13 \%$
Cover to reinforcement in toe	$c_{toe} = 30 \text{ mm}$

Calculate shear for toe design

Shear from bearing pressure	$V_{toe_bear} = (p_{toe_f} + p_{stem_toe_f}) * l_{toe} / 2 = 109.5 \text{ kN/m}$
Shear from weight of base	$V_{toe_wt_base} = \gamma_{f_d} * \gamma_{base} * l_{toe} * t_{base} = 33 \text{ kN/m}$
Shear from weight of soil	$V_{toe_wt_soil} = w_{p_f} - (\gamma_{f_d} * \gamma_m * l_{toe} * d_{exc}) = 11.8 \text{ kN/m}$
Total shear for toe design	$V_{toe} = V_{toe_bear} - V_{toe_wt_base} - V_{toe_wt_soil} = 64.7 \text{ kN/m}$

Calculate moment for toe design

Moment from bearing pressure	$M_{toe_bear} = (2 * p_{toe_f} + p_{stem_mid_f}) * (l_{toe} + t_{wall} / 2)^2 / 6 = 144.1 \text{ kNm/m}$
Moment from weight of base	$M_{toe_wt_base} = (\gamma_{f_d} * \gamma_{base} * t_{base} * (l_{toe} + t_{wall} / 2)^2 / 2) = 40 \text{ kNm/m}$
Moment from weight of soil	$M_{toe_wt_soil} = (w_{p_f} - (\gamma_{f_d} * \gamma_m * l_{toe} * d_{exc})) * (l_{toe} + t_{wall}) / 2 = 14.1 \text{ kNm/m}$
Total moment for toe design	$M_{toe} = M_{toe_bear} - M_{toe_wt_base} - M_{toe_wt_soil} = 90.1 \text{ kNm/m}$

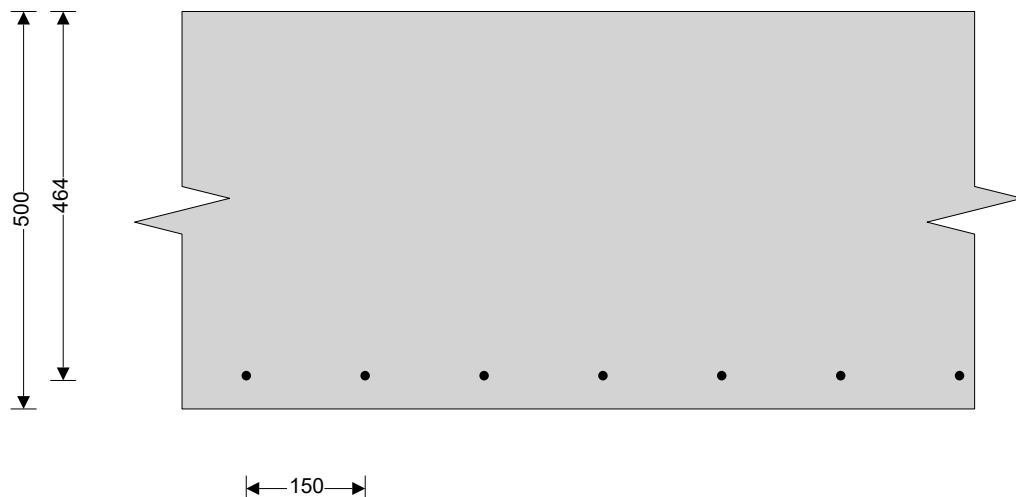

Check toe in bending

Width of toe	$b = 1000 \text{ mm/m}$
Depth of reinforcement	$d_{toe} = t_{base} - c_{toe} - (\phi_{toe} / 2) = 464.0 \text{ mm}$
Constant	$K_{toe} = M_{toe} / (b * d_{toe}^2 * f_{cu}) = 0.010$

Compression reinforcement is not required

Lever arm	$z_{toe} = \min(0.5 + \sqrt{(0.25 - (\min(K_{toe}, 0.225) / 0.9))}, 0.95) * d_{toe}$
	$z_{toe} = 441 \text{ mm}$
Area of tension reinforcement required	$A_{s_toe_des} = M_{toe} / (0.87 * f_y * z_{toe}) = 470 \text{ mm}^2/\text{m}$

Project				Job no.	
Haul Y Bryn Graig Y Tewgoed					
Calcs for				Start page no./Revision	
Retaining wall				6	
Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date

Minimum area of tension reinforcement

$$A_{s_toe_min} = k \times b \times t_{base} = \mathbf{650 \text{ mm}^2/m}$$

Area of tension reinforcement required

$$A_{s_toe_req} = \text{Max}(A_{s_toe_des}, A_{s_toe_min}) = \mathbf{650 \text{ mm}^2/m}$$

Reinforcement provided

12 mm dia.bars @ 150 mm centres

Area of reinforcement provided

$$A_{s_toe_prov} = \mathbf{754 \text{ mm}^2/m}$$

PASS - Reinforcement provided at the retaining wall toe is adequate

Check shear resistance at toe

Design shear stress

$$v_{toe} = V_{toe} / (b \times d_{toe}) = \mathbf{0.139 \text{ N/mm}^2}$$

Allowable shear stress

$$v_{adm} = \min(0.8 \times \sqrt{f_{cu}} / 1 \text{ N/mm}^2, 5) \times 1 \text{ N/mm}^2 = \mathbf{5.000 \text{ N/mm}^2}$$

PASS - Design shear stress is less than maximum shear stress

From BS8110:Part 1:1997 – Table 3.8

Design concrete shear stress

$$v_{c_toe} = \mathbf{0.403 \text{ N/mm}^2}$$

$v_{toe} < v_{c_toe}$ - No shear reinforcement required

Design of reinforced concrete retaining wall heel (BS 8002:1994)

Material properties

Characteristic strength of concrete

$$f_{cu} = \mathbf{40 \text{ N/mm}^2}$$

Characteristic strength of reinforcement

$$f_y = \mathbf{500 \text{ N/mm}^2}$$

Base details

Minimum area of reinforcement

$$k = \mathbf{0.13 \%}$$

Cover to reinforcement in heel

$$c_{heel} = \mathbf{30 \text{ mm}}$$

Calculate shear for heel design

Shear from bearing pressure

$$V_{heel_bear} = (p_{heel_f} + p_{stem_heel_f}) \times l_{heel} / 2 = \mathbf{12.4 \text{ kN/m}}$$

Shear from weight of base

$$V_{heel_wt_base} = \gamma_{f_d} \times \gamma_{base} \times l_{heel} \times t_{base} = \mathbf{8.3 \text{ kN/m}}$$

Shear from weight of moist backfill

$$V_{heel_wt_m} = w_{m_w_f} + w_{m_s_f} = \mathbf{29.8 \text{ kN/m}}$$

Shear from weight of saturated backfill

$$V_{heel_wt_s} = w_{s_f} = \mathbf{7.3 \text{ kN/m}}$$

Shear from surcharge

$$V_{heel_sur} = w_{sur_f} = \mathbf{1.2 \text{ kN/m}}$$

Total shear for heel design

$$V_{heel} = - V_{heel_bear} + V_{heel_wt_base} + V_{heel_wt_m} + V_{heel_wt_s} + V_{heel_sur} = \mathbf{34.2}$$

kN/m

Calculate moment for heel design

Moment from bearing pressure

$$M_{heel_bear} = (2 \times p_{heel_f} + p_{stem_mid_f}) \times (l_{heel} + t_{wall} / 2)^2 / 6 = \mathbf{6 \text{ kNm/m}}$$

Moment from weight of base

$$M_{heel_wt_base} = (\gamma_{f_d} \times \gamma_{base} \times t_{base} \times (l_{heel} + t_{wall} / 2)^2 / 2) = \mathbf{4 \text{ kNm/m}}$$

Moment from weight of moist backfill

$$M_{heel_wt_m} = w_{m_w_f} \times (l_{heel} + t_{wall}) / 2 + w_{m_s_f} \times (2 \times l_{heel} / 3 + t_{wall} / 2) = \mathbf{13.5}$$

kNm/m

Moment from weight of saturated backfill

$$M_{heel_wt_s} = w_{s_f} \times (l_{heel} + t_{wall}) / 2 = \mathbf{3.3 \text{ kNm/m}}$$

Moment from surcharge


$$M_{heel_sur} = w_{sur_f} \times (l_{heel} + t_{wall}) / 2 = \mathbf{0.5 \text{ kNm/m}}$$

Total moment for heel design

$$M_{heel} = - M_{heel_bear} + M_{heel_wt_base} + M_{heel_wt_m} + M_{heel_wt_s} + M_{heel_sur} = \mathbf{15.4}$$

kNm/m

Project				Job no.	
Haul Y Bryn Graig Y Tewgoed				Start page no./Revision	
Retaining wall				7	
Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date

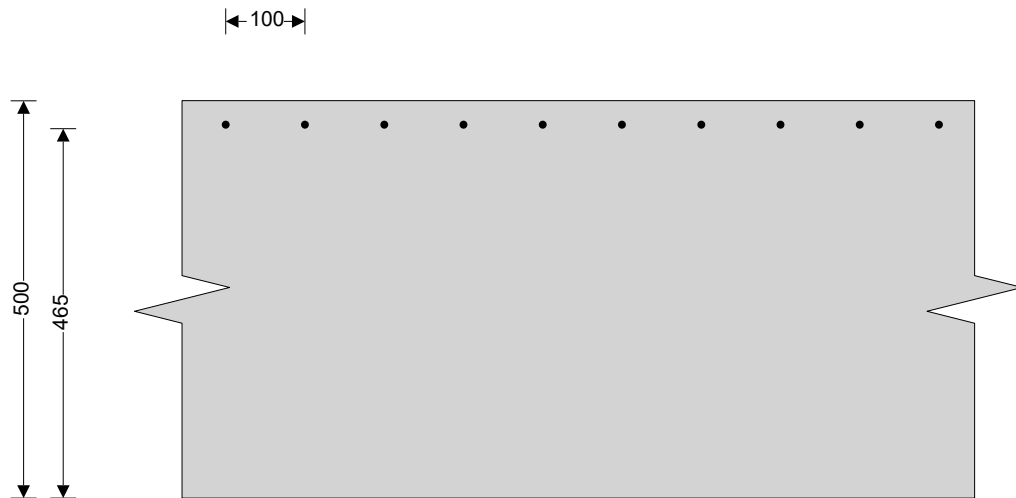

Check heel in bending

Width of heel

$$b = 1000 \text{ mm/m}$$

Depth of reinforcement

$$d_{\text{heel}} = t_{\text{base}} - c_{\text{heel}} - (\phi_{\text{heel}} / 2) = 465.0 \text{ mm}$$

Constant

$$K_{\text{heel}} = M_{\text{heel}} / (b \times d_{\text{heel}}^2 \times f_{\text{cu}}) = 0.002$$

Compression reinforcement is not required

Lever arm

$$Z_{\text{heel}} = \min(0.5 + \sqrt{(0.25 - (\min(K_{\text{heel}}, 0.225) / 0.9))}, 0.95) \times d_{\text{heel}}$$

$$Z_{\text{heel}} = 442 \text{ mm}$$

Area of tension reinforcement required

$$A_{\text{s_heel_des}} = M_{\text{heel}} / (0.87 \times f_y \times Z_{\text{heel}}) = 80 \text{ mm}^2/\text{m}$$

Minimum area of tension reinforcement

$$A_{\text{s_heel_min}} = k \times b \times t_{\text{base}} = 650 \text{ mm}^2/\text{m}$$

Area of tension reinforcement required

$$A_{\text{s_heel_req}} = \text{Max}(A_{\text{s_heel_des}}, A_{\text{s_heel_min}}) = 650 \text{ mm}^2/\text{m}$$

Reinforcement provided

B785 mesh

Area of reinforcement provided

$$A_{\text{s_heel_prov}} = 785 \text{ mm}^2/\text{m}$$

PASS - Reinforcement provided at the retaining wall heel is adequate

Check shear resistance at heel

Design shear stress

$$v_{\text{heel}} = V_{\text{heel}} / (b \times d_{\text{heel}}) = 0.074 \text{ N/mm}^2$$

Allowable shear stress

$$v_{\text{adm}} = \min(0.8 \times \sqrt{f_{\text{cu}} / 1 \text{ N/mm}^2}, 5) \times 1 \text{ N/mm}^2 = 5.000 \text{ N/mm}^2$$

PASS - Design shear stress is less than maximum shear stress

From BS8110:Part 1:1997 – Table 3.8


Design concrete shear stress

$$v_{\text{c_heel}} = 0.409 \text{ N/mm}^2$$

$v_{\text{heel}} < v_{\text{c_heel}}$ - No shear reinforcement required

Project Haul Y Bryn Graig Y Tewgoed				Job no.	
Calcs for Retaining wall				Start page no./Revision 8	
Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date

Design of cavity reinforced masonry retaining wall stem - BS5628-2:2000

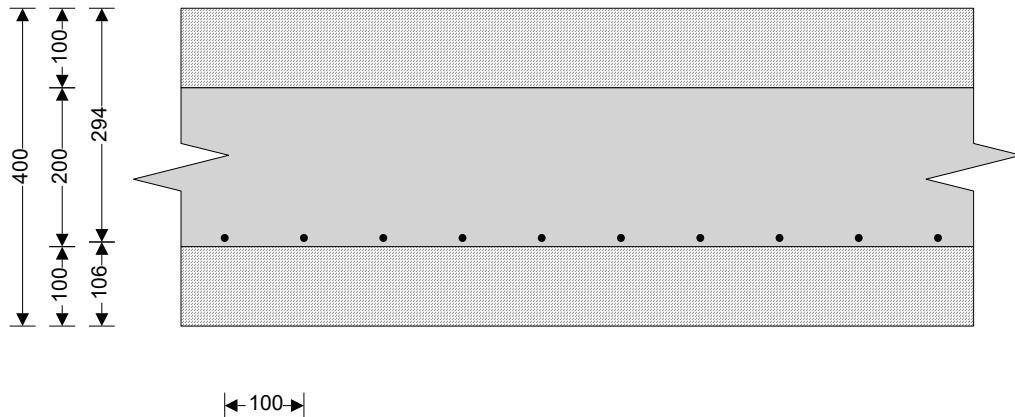

Wall details

Thickness of outer leaf of wall
Thickness of inner leaf of wall
Thickness of reinforced cavity
Depth of stem reinforcement

$t_{\text{outer}} = 100 \text{ mm}$
 $t_{\text{inner}} = 100 \text{ mm}$
 $t_{\text{cavity}} = t_{\text{wall}} - t_{\text{outer}} - t_{\text{inner}} = 200 \text{ mm}$
 $d_{\text{stem}} = 294 \text{ mm}$

Masonry details

Masonry type
Compressive strength of units
Mortar designation
Category of manufacturing control of units
Partial safety factor for material strength

Aggregate concrete blocks no voids
 $p_{\text{unit}} = 10.0 \text{ N/mm}^2$
(ii)
Normal
 $\gamma_{\text{mm}} = 2.3$

Characteristic compressive strength of masonry

Least horizontal dimension of masonry units
Height of masonry units
Ratio of height to least horizontal dimension
From BS5628:2 Table 3d, mortar ii
Characteristic compressive strength

$b_{\text{unit}} = 100.0 \text{ mm}$
 $h_{\text{unit}} = 215.0 \text{ mm}$
 $\text{ratio} = h_{\text{unit}} / b_{\text{unit}} = 2.2$
 $f_k = 8.1 \text{ N/mm}^2$

Factored horizontal at-rest forces on stem

Surcharge
Moist backfill above water table
Moist backfill below water table
Saturated backfill
Water

$F_{s_sur_f} = \gamma_{f_l} * K_0 * \text{Surcharge} * (h_{\text{eff}} - t_{\text{base}} - d_{\text{ds}}) = 4 \text{ kN/m}$
 $F_{s_m_a_f} = 0.5 * \gamma_{f_e} * K_0 * \gamma_m * (h_{\text{eff}} - t_{\text{base}} - d_{\text{ds}} - h_{\text{sat}})^2 = 42.2 \text{ kN/m}$
 $F_{s_m_b_f} = \gamma_{f_e} * K_0 * \gamma_m * (h_{\text{eff}} - t_{\text{base}} - d_{\text{ds}} - h_{\text{sat}}) * h_{\text{sat}} = 17.3 \text{ kN/m}$
 $F_{s_s_f} = 0.5 * \gamma_{f_e} * K_0 * (\gamma_s - \gamma_{\text{water}}) * h_{\text{sat}}^2 = 1.1 \text{ kN/m}$
 $F_{s_water_f} = 0.5 * \gamma_{f_e} * \gamma_{\text{water}} * h_{\text{sat}}^2 = 1.7 \text{ kN/m}$

Calculate shear for stem design

Shear at base of stem

$V_{\text{stem}} = F_{s_sur_f} + F_{s_m_a_f} + F_{s_m_b_f} + F_{s_s_f} + F_{s_water_f} = 66.3 \text{ kN/m}$

Calculate moment for stem design

Surcharge
Moist backfill above water table
Moist backfill below water table
Saturated backfill
Water
Total moment for stem design

$M_{s_sur} = F_{s_sur_f} * (h_{\text{stem}} + t_{\text{base}}) / 2 = 6.6 \text{ kNm/m}$
 $M_{s_m_a} = F_{s_m_a_f} * (2 * h_{\text{sat}} + h_{\text{eff}} - d_{\text{ds}} + t_{\text{base}} / 2) / 3 = 65.8 \text{ kNm/m}$
 $M_{s_m_b} = F_{s_m_b_f} * h_{\text{sat}} / 2 = 4.3 \text{ kNm/m}$
 $M_{s_s} = F_{s_s_f} * h_{\text{sat}} / 3 = 0.2 \text{ kNm/m}$
 $M_{s_water} = F_{s_water_f} * h_{\text{sat}} / 3 = 0.3 \text{ kNm/m}$
 $M_{\text{stem}} = M_{s_sur} + M_{s_m_a} + M_{s_m_b} + M_{s_s} + M_{s_water} = 77.2 \text{ kNm/m}$

Project				Job no.	
Haul Y Bryn Graig Y Tewgoed					
Calcs for				Start page no./Revision	
Retaining wall				9	
Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date

Check maximum design moment for wall stem

Width of wall

$$b = 1000 \text{ mm/m}$$

Maximum design moment

$$M_{d_stem} = 0.4 \times f_k \times b \times d_{stem}^2 / \gamma_{mm} = 122.4 \text{ kNm/m}$$

PASS - Applied moment is less than maximum design moment

Check wall stem in bending

Moment of resistance factor

$$Q = M_{stem} / d_{stem}^2 = 0.893 \text{ N/mm}^2$$

$$Q = 2 \times c \times (1 - c) \times f_k / \gamma_{mm}$$

Lever arm factor

$$c = 0.852$$

Lever arm

$$Z_{stem} = \min(0.95, c) \times d_{stem} = 250.5 \text{ mm}$$

Area of tension reinforcement required

$$A_{s_stem_des} = M_{stem} \times \gamma_{ms} / (f_y \times Z_{stem}) = 709 \text{ mm}^2/\text{m}$$

Minimum area of tension reinforcement

$$A_{s_stem_min} = k \times b \times t_{wall} = 520 \text{ mm}^2/\text{m}$$

Area of tension reinforcement required

$$A_{s_stem_req} = \text{Max}(A_{s_stem_des}, A_{s_stem_min}) = 709 \text{ mm}^2/\text{m}$$

Reinforcement provided

B785 mesh

Area of reinforcement provided

$$A_{s_stem_prov} = \pi \times \phi_{stem}^2 / (4 \times s_{stem}) = 785 \text{ mm}^2/\text{m}$$

PASS - Reinforcement provided at the retaining wall stem is adequate

Check shear resistance at wall stem

Design shear stress

$$V_{stem} = V_{stem} / (b \times d_{stem}) = 0.225 \text{ N/mm}^2$$

Basic characteristic shear strength of masonry

$$f_{vbas} = \min[0.35 + (17.5 \times A_{s_stem_prov} / (b \times d_{stem})), 0.7] \times 1 \text{ N/mm}^2$$

$$f_{vbas} = 0.397 \text{ N/mm}^2$$

Shear span

$$a = M_{stem} / V_{stem} = 1164.6 \text{ mm}$$

Characteristic shear strength of masonry

$$f_v = \text{Min}(f_{vbas} \times \max(2.5 - 0.25 \times (a / d_{stem}), 1), 1.75 \text{ N/mm}^2)$$

$$f_v = 0.599 \text{ N/mm}^2$$

Allowable shear stress

$$V_{adm} = f_v / \gamma_{mv} = 0.299 \text{ N/mm}^2$$

PASS - Design shear stress is less than maximum shear stress

Check limiting dimensions

Limiting span/effective depth ratio

$$\text{ratio}_{\max} = 18.00$$

Actual span/effective depth ratio

$$\text{ratio}_{\text{act}} = (h_{stem} + d_{stem} / 2) / d_{stem} = 10.02$$

PASS - Span to depth ratio is acceptable

Axial load check

Factored axial load on wall

$$N_{wall} = ([t_{wall} \times h_{stem} \times \gamma_{wall} + W_{dead}] \times \gamma_{f_d}) + (W_{live} \times \gamma_{f_l}) = 37.0 \text{ kN/m}$$


Limiting axial load

$$N_{limit} = 0.1 \times f_k \times t_{wall} = 325.7 \text{ kN/m}$$

Applied axial load may be ignored - calculations valid

Project				Job no.	
Haul Y Bryn Graig Y Tewgoed					
Calcs for				Start page no./Revision	
Retaining wall				10	
Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date

Indicative retaining wall reinforcement diagram

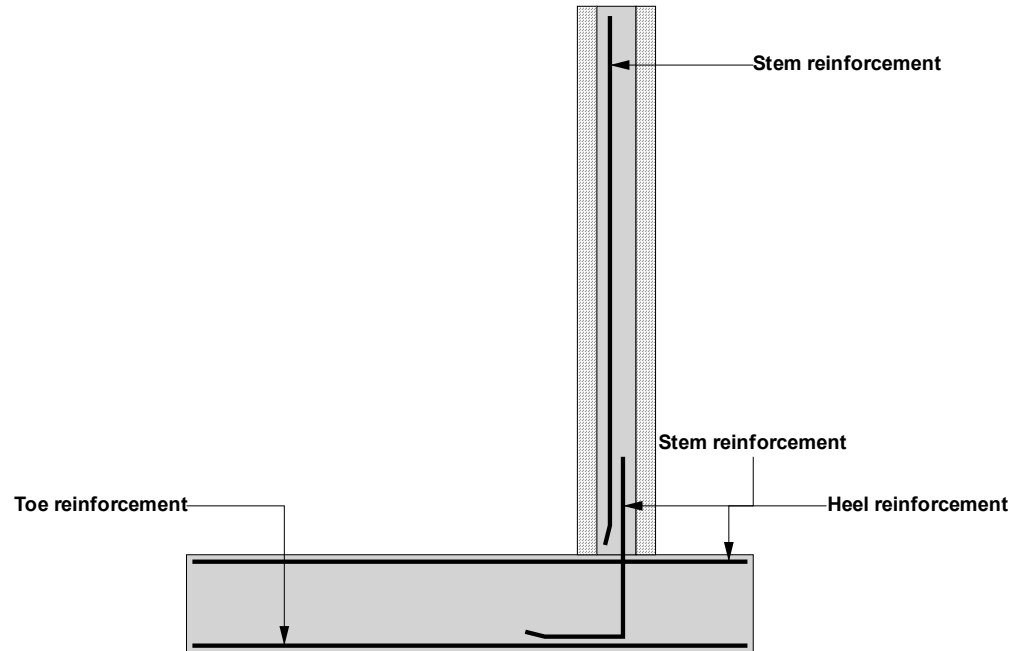

Toe bars - 12 mm dia.@ 150 mm centres - (754 mm²/m)

Heel mesh - B785 - (785 mm²/m)

Stem mesh - B785 - (785 mm²/m)

