



Serving the Midlands, South West and Wales

Contact Us

Mapping Enquiries:

All areas	0121 623 9780	All areas	0800 096 3080
-----------	---------------	-----------	---------------

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105

Date Requested: 22/02/2022

Job Reference: 24811615

Site Location: 284809 195159

Requested by: Miss Emily Wood

Your Scheme/Reference: Afan Valley 5


Exact Scales:

1:1250 Area or Circle dig site

1:500 Line dig site

IMPORTANT NOTICES


- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the Western Power

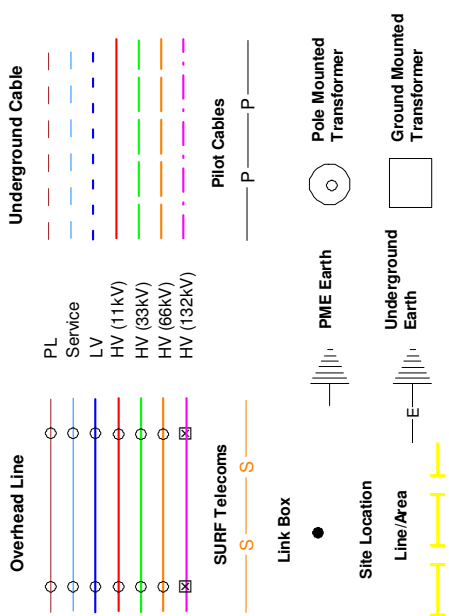

Crown Copyright © All Rights Reserved. Ordnance Survey Licence
 numbers: 100022488, 100024877 & 100021807.
 WPD Copyright: This copy has been made by or with the authority of
 Western Power Distribution (WPD) pursuant to Section 47 of the
 Copyright Designs and Patents Act 1988 unless that Act provides a relevant
 exception to copyright the copy must not be copied without the prior
 permission of the copyright owner



Warning: PDF designed for A3 colour print only with no page scaling.

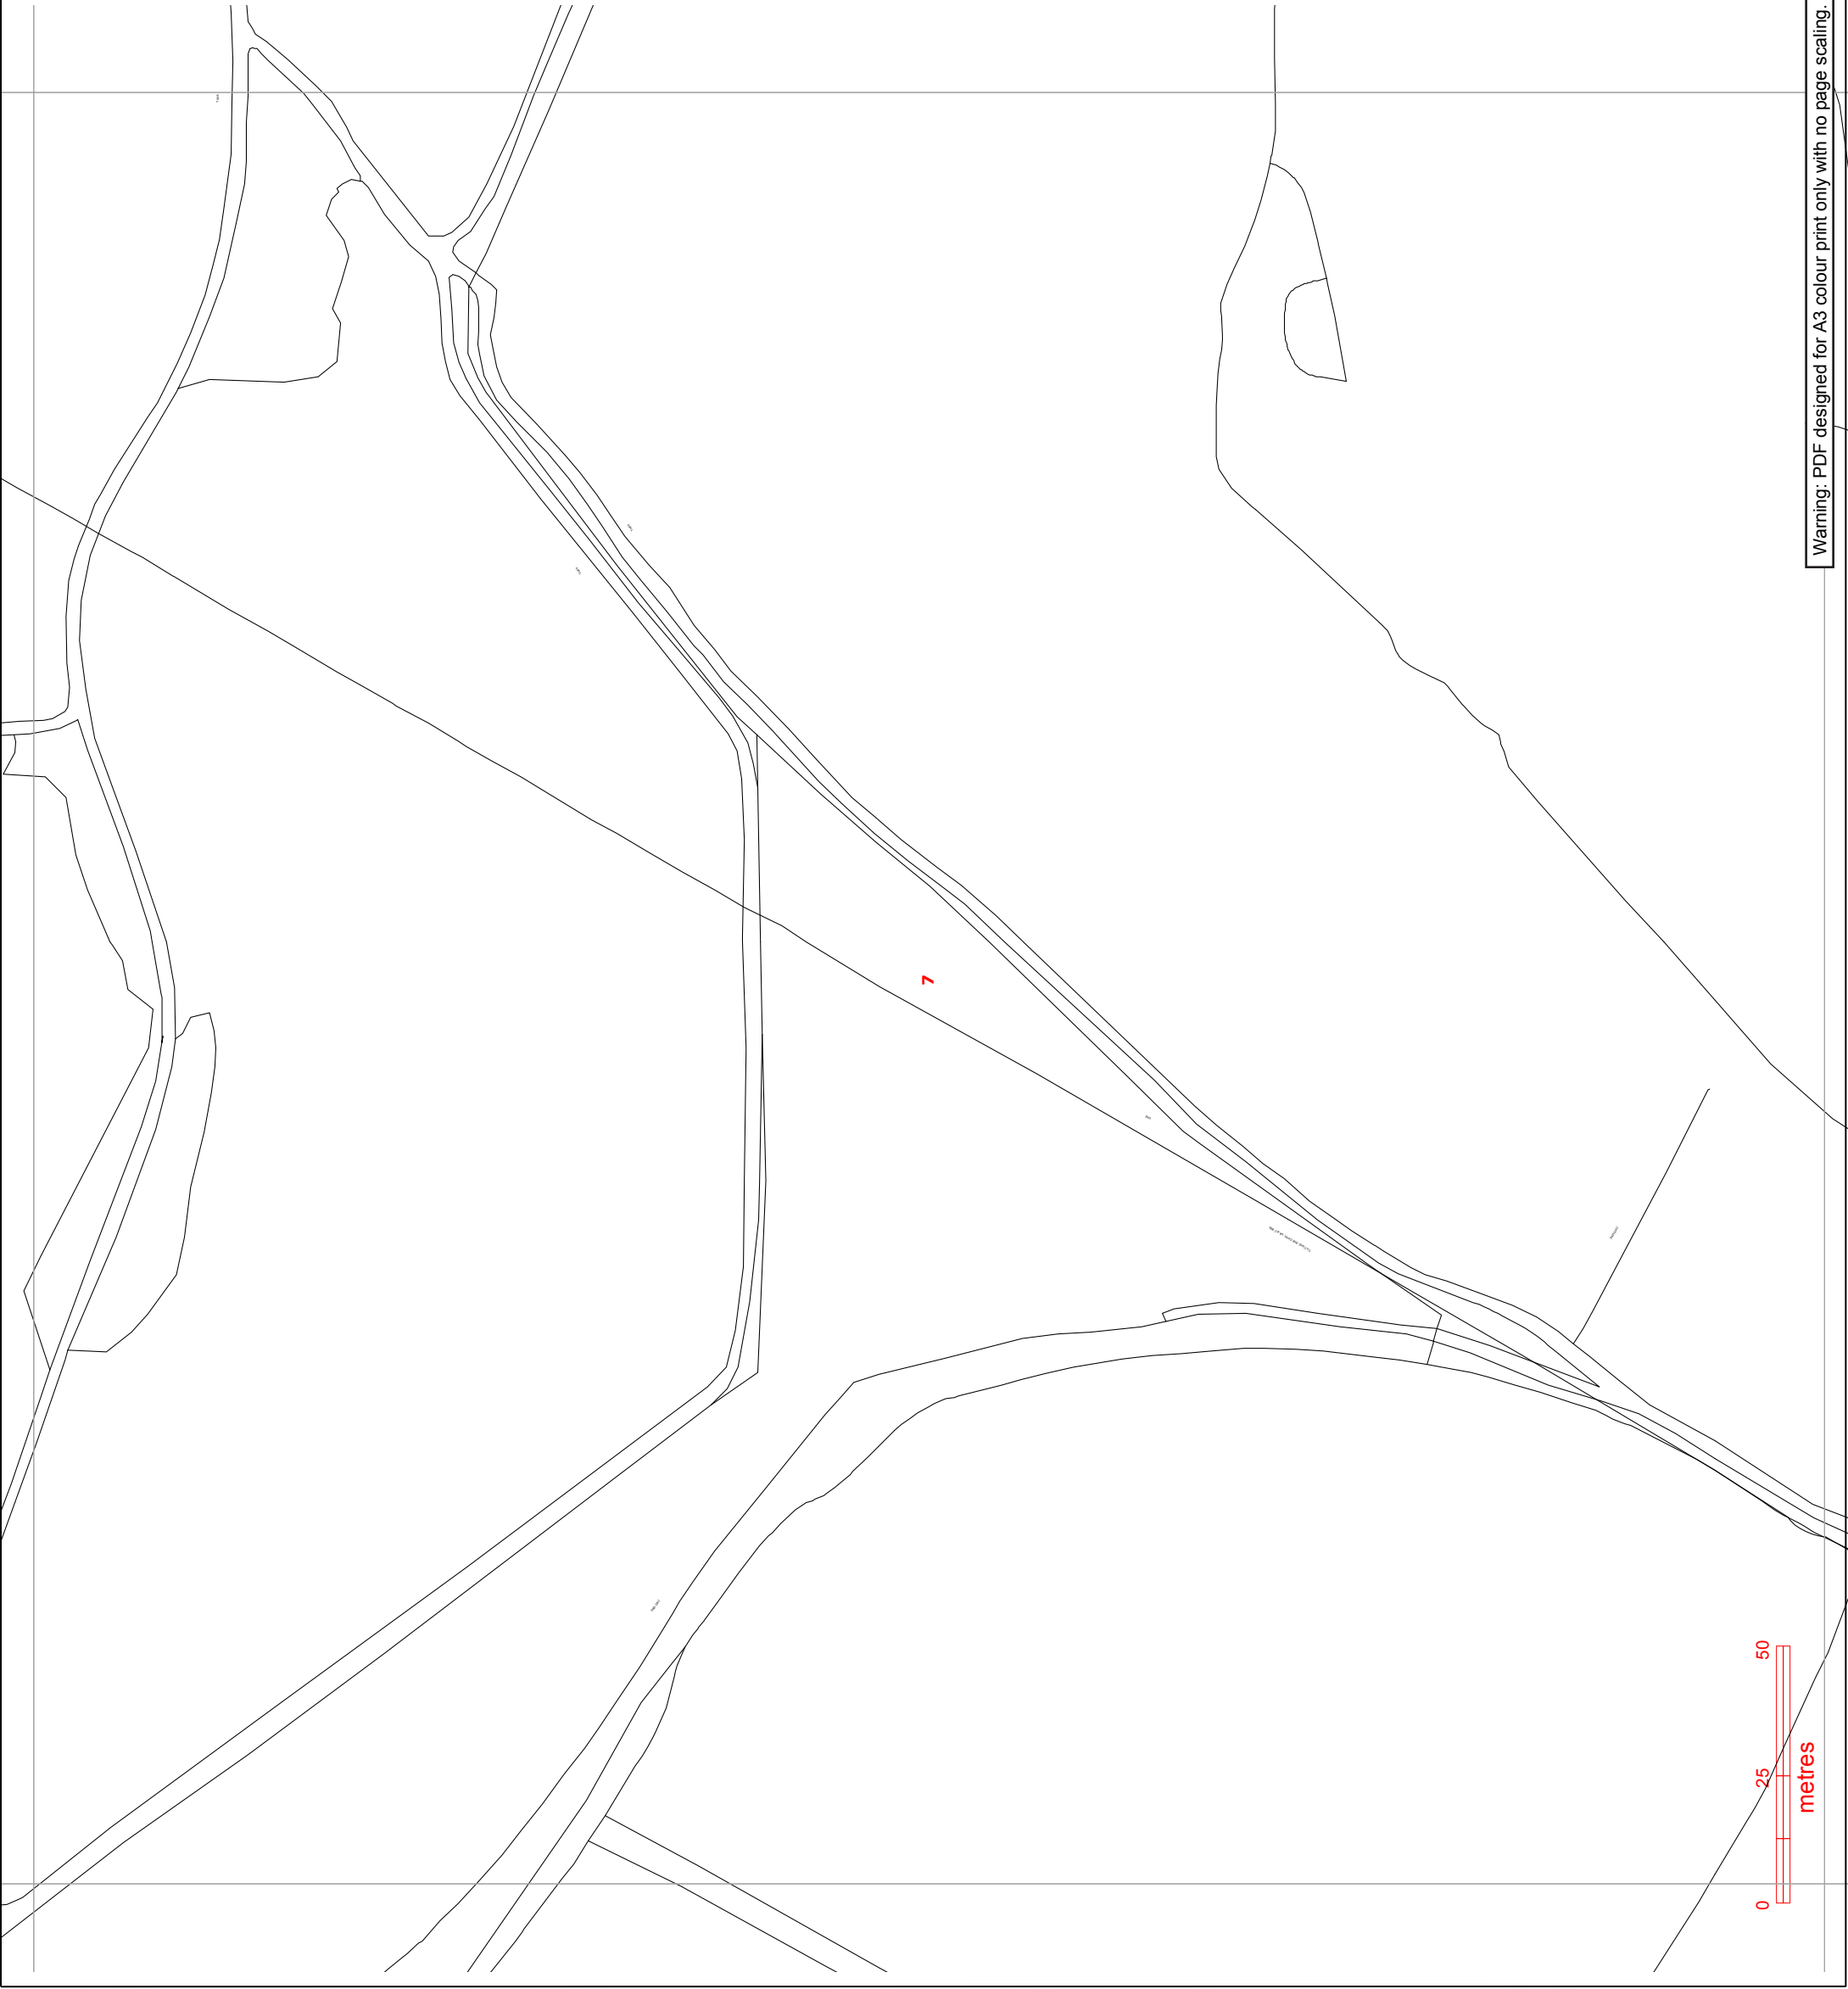

Warning: PDF designed for A3 colour print only with no page scaling.



WESTERN POWER

DISTRIBUTION

Serving the Midlands, South West and Wales

Contact Us

Mapping Enquiries: 0121 623 9780 All areas

General Enquiries: 0800 096 3080

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA

0800 6783 105

Date Requested: 22/02/2022

Job Reference: 24811615

Site Location: 284809 195159

Requested by: Miss Emily Wood

Your Scheme/Reference: Afan Valley 5

Exact Scales:
1:1250 Area or Circle dig site
1:500 Line dig site

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the Western Power Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

Overhead Line

○

○

○

○

○

○

□

PL

Service

LV

HV (11kV)

HV (33kV)

HV (66kV)

HV (132kV)

SURF Telecoms

S

S

Link Box

●

Site Location

—E—

Line/Area

—

—

Underground Cable

—

—

—

—

—

—

—

Pilot Cables

—

P

—

P

—

Pole Mounted Transformer

○

Ground Mounted Transformer

□

Underground Earth

—E—

Underground Earth


—

—

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 10002488, 100024877 & 100021807.

WPD Copyright: This copy has been made by or with the authority of Western Power Distribution (WPD) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner

Plans generated by DigSAFE Pro (tm) software provided by LinesearchbeforeUdig

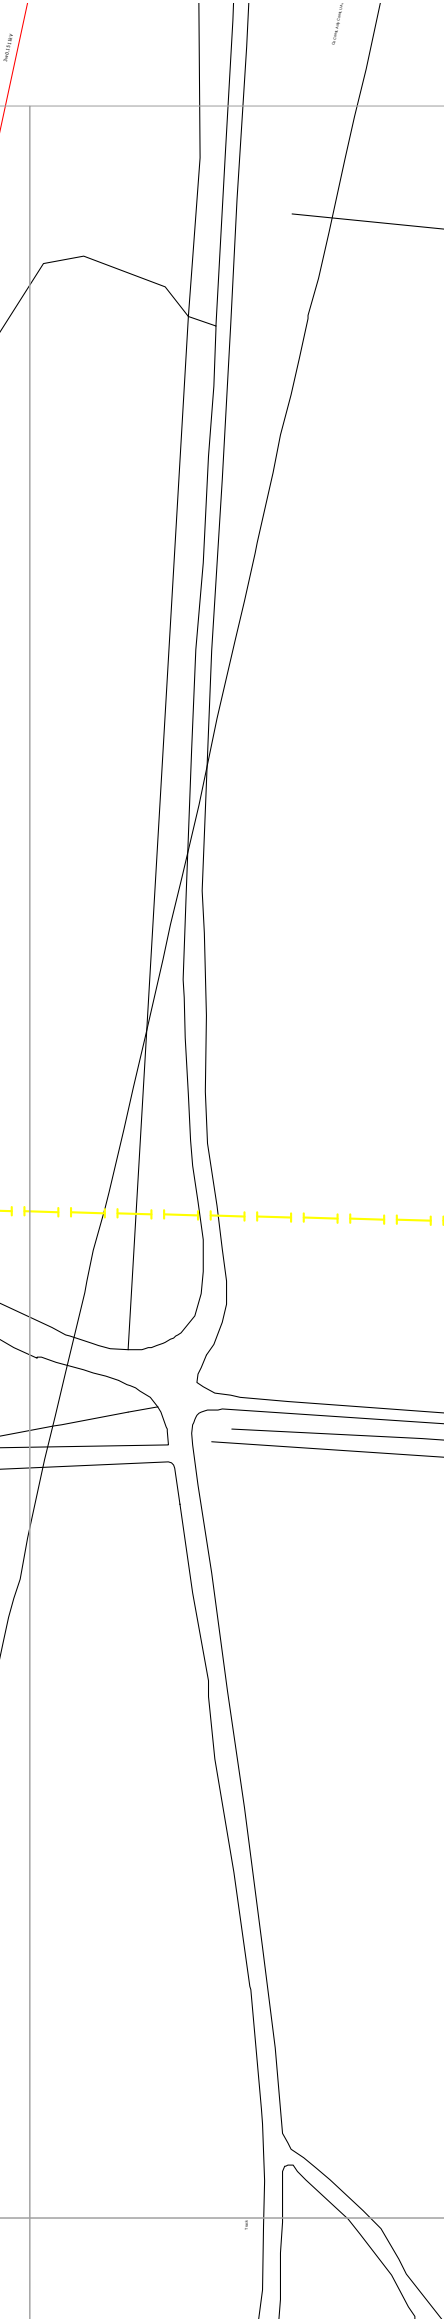

Contact Us

Mapping Enquiries:

All areas	0121 623 9780	All areas	0800 096 3080
-----------	---------------	-----------	---------------

0121 623 9780

**Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105**

Date Requested: 22/02/2022

Job Reference: 24811615

Site location: 284809 195159

Requested by: Miss Emily Wood

Requested by: Miss Emily Wood
Your Schema/Reference: Aftan Vallyav E

your science,


Exact Scales:

1:1250 Area or Circle dig site


- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.

- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the Western Power

- Advice should be sought from the Western Power Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

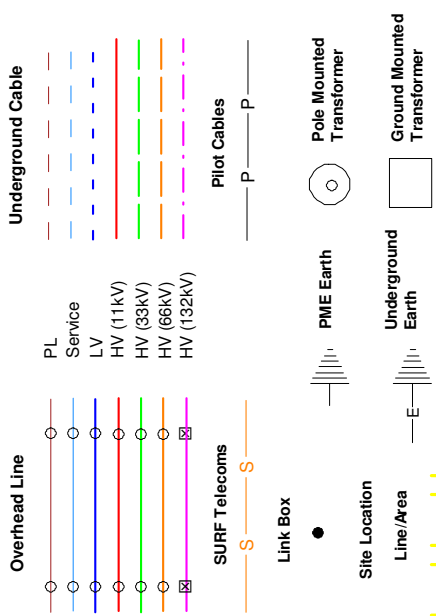

Crown Copyright © All Rights Reserved. Ordnance Survey Licence
 numbers: 100022488, 100024877 & 100021807.
 WPD Copyright: This copy has been made by or with the authority of
 Western Power Distribution (WPD) pursuant to Section 47 of the
 Copyright Designs and Patents Act 1988 unless that Act provides a relevant
 exception to copyright the copy must not be copied without the prior
 permission of the copyright owner

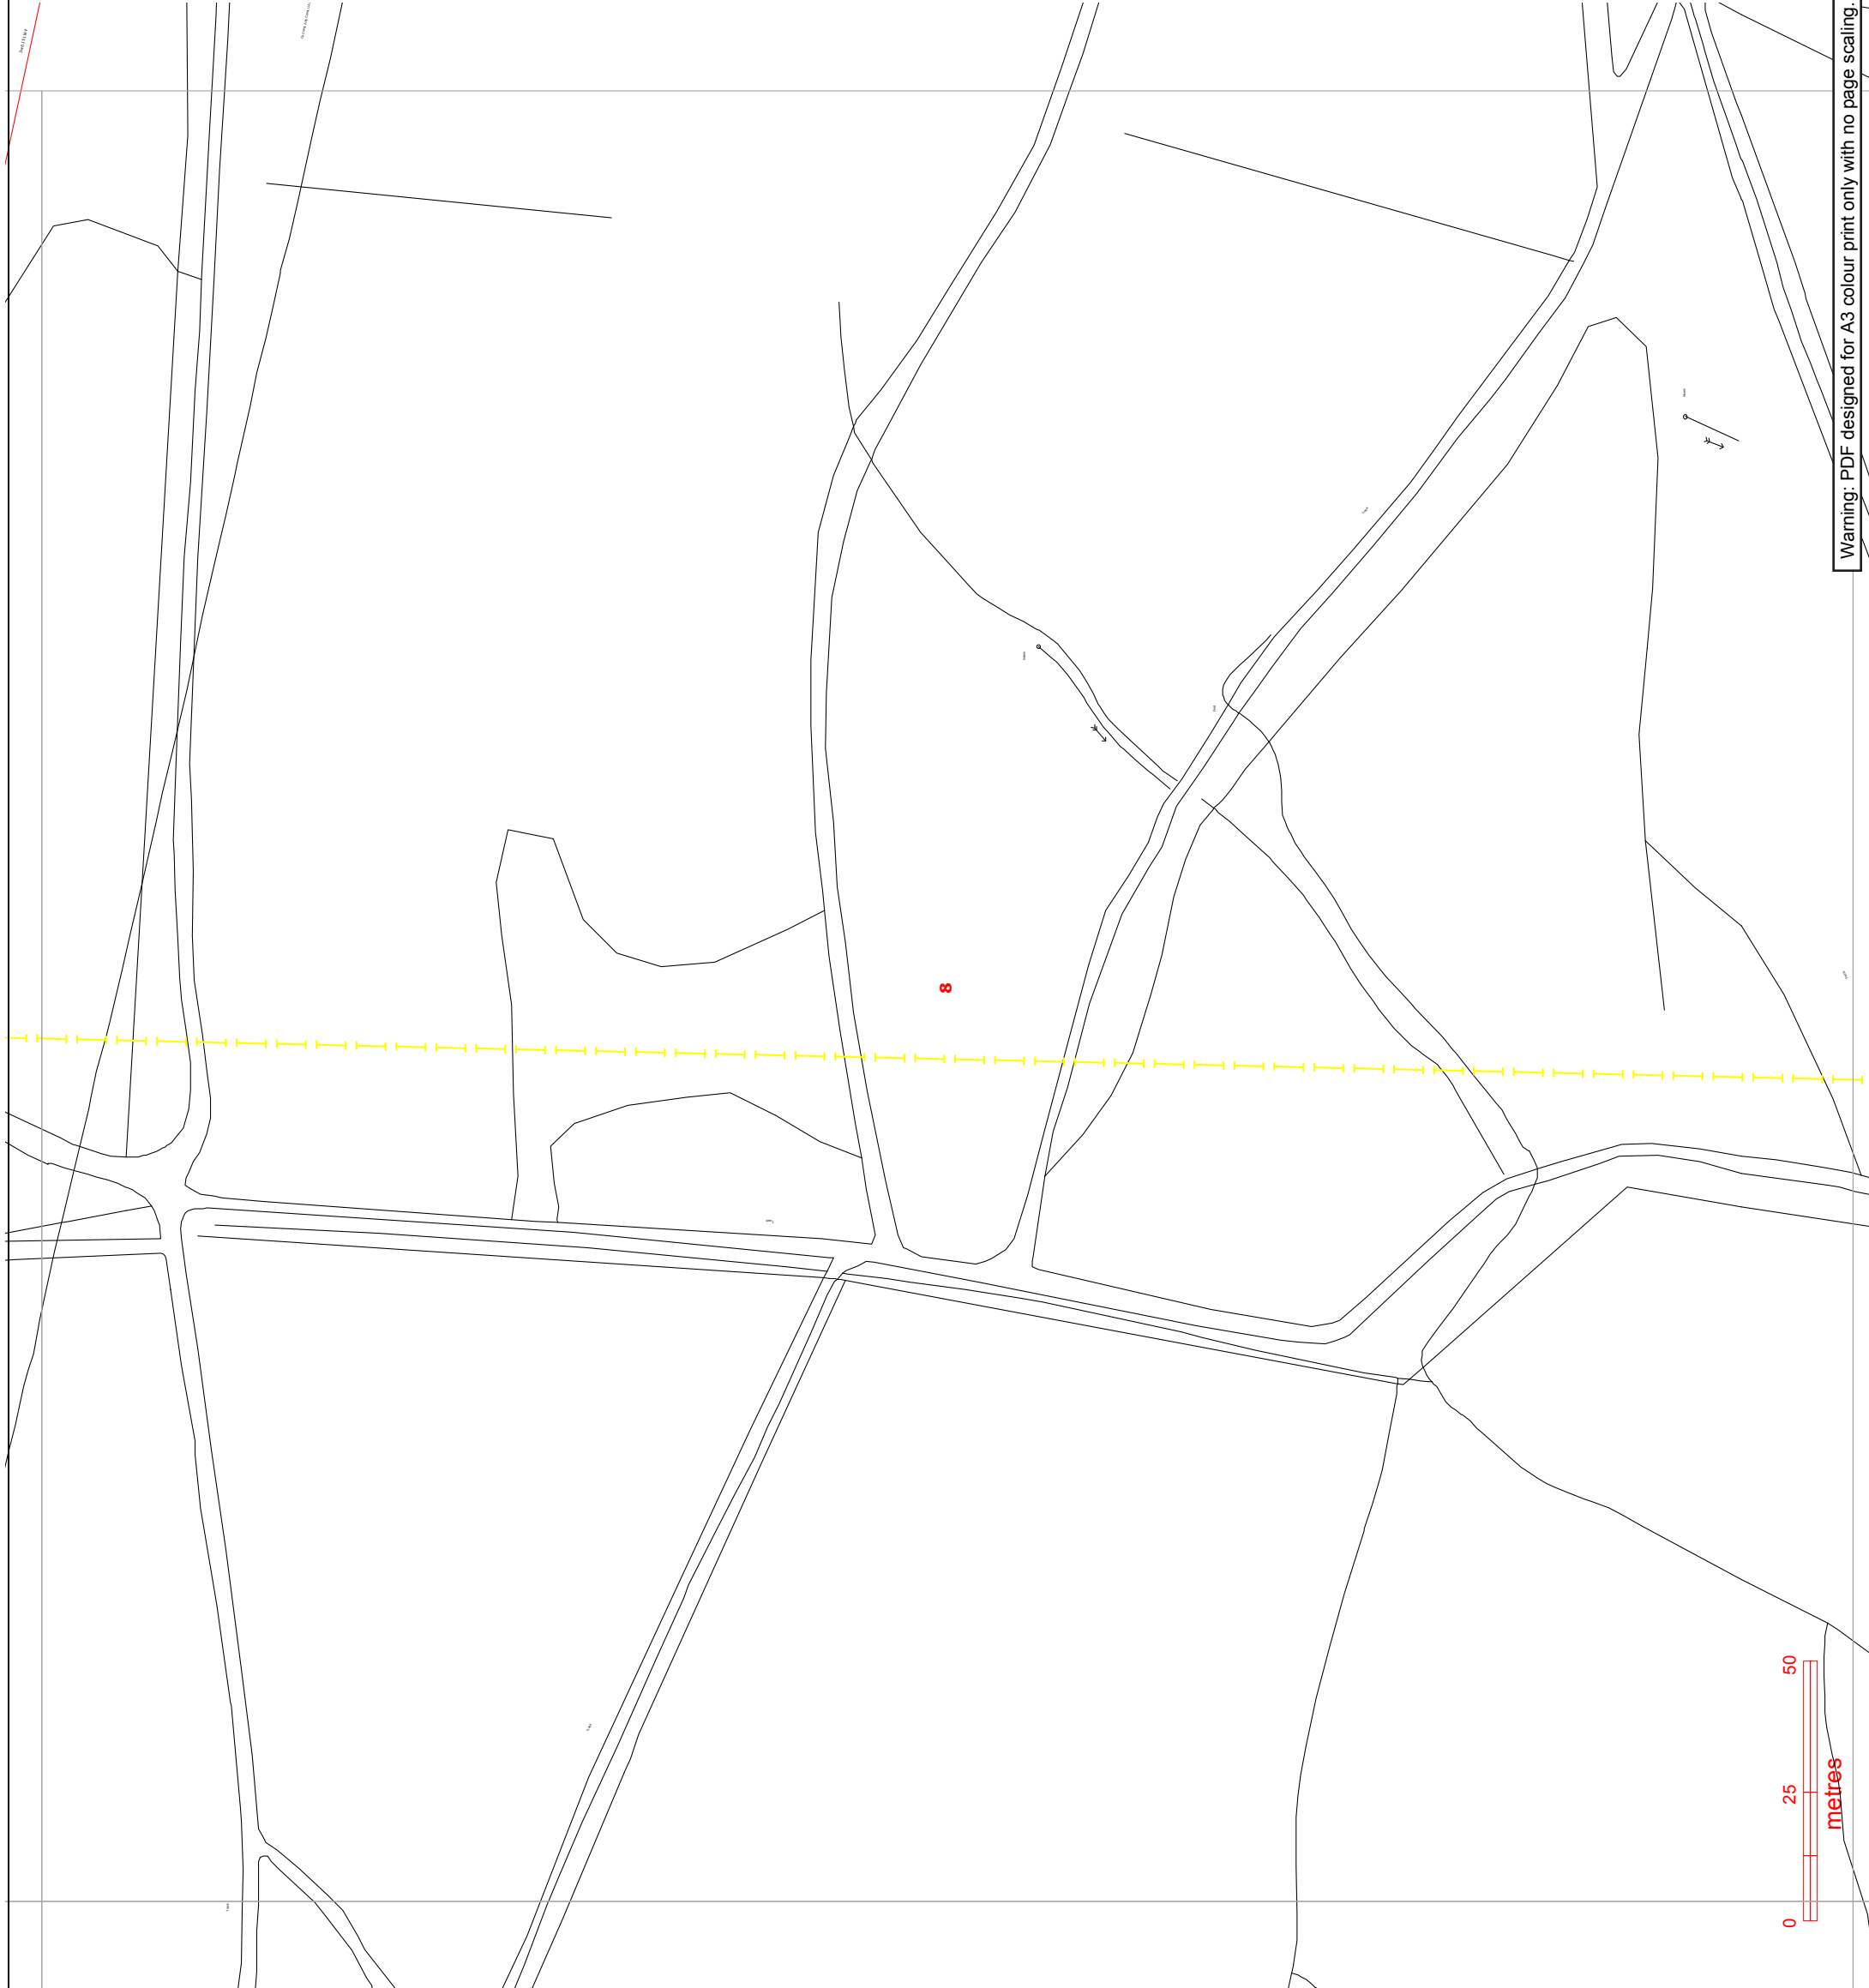


Warning: PDF designed for A3 colour print only with no page scaling.


Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105

T:1250 Area or Circle dig site

- Advice should be sought from the Western Power Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 0900 3080

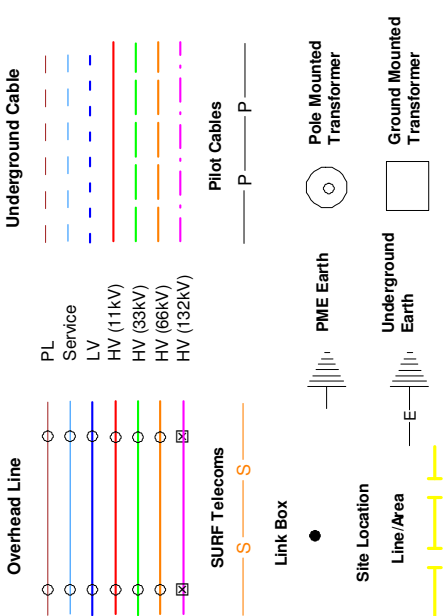


numbers: 100022488, 100024877 & 100021807.
 Crown Copyright © All Rights Reserved. Ordnance Survey Licence
 Western Power Distribution (WPD) pursuant to Section 47 of the
 Copyright Designs and Patents Act 1988 unless that Act provides a relevant
 exception to copyright the copy must not be copied without the prior
 permission of the copyright owner




Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA

1:1250 Area or Circle dig site

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools/ tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 09803080.

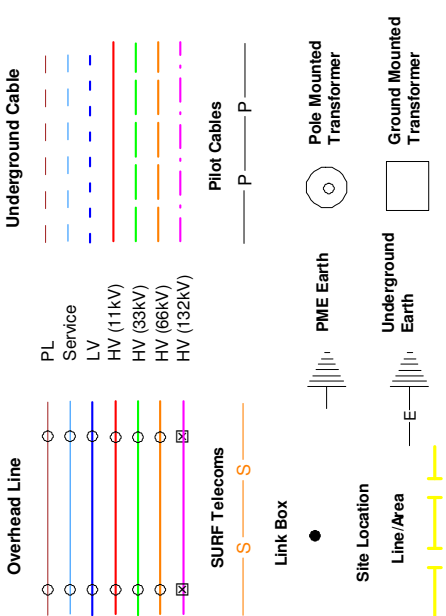

numbers: 100022488, 100024877 & 100021807.
Western Power Distribution (WPD) pursuant to Section 47 of the
Copyright Designs and Patents Act 1988 unless that Act provides a relevant
exception to copyright the copy must not be copied without the prior
permission of the copyright owner

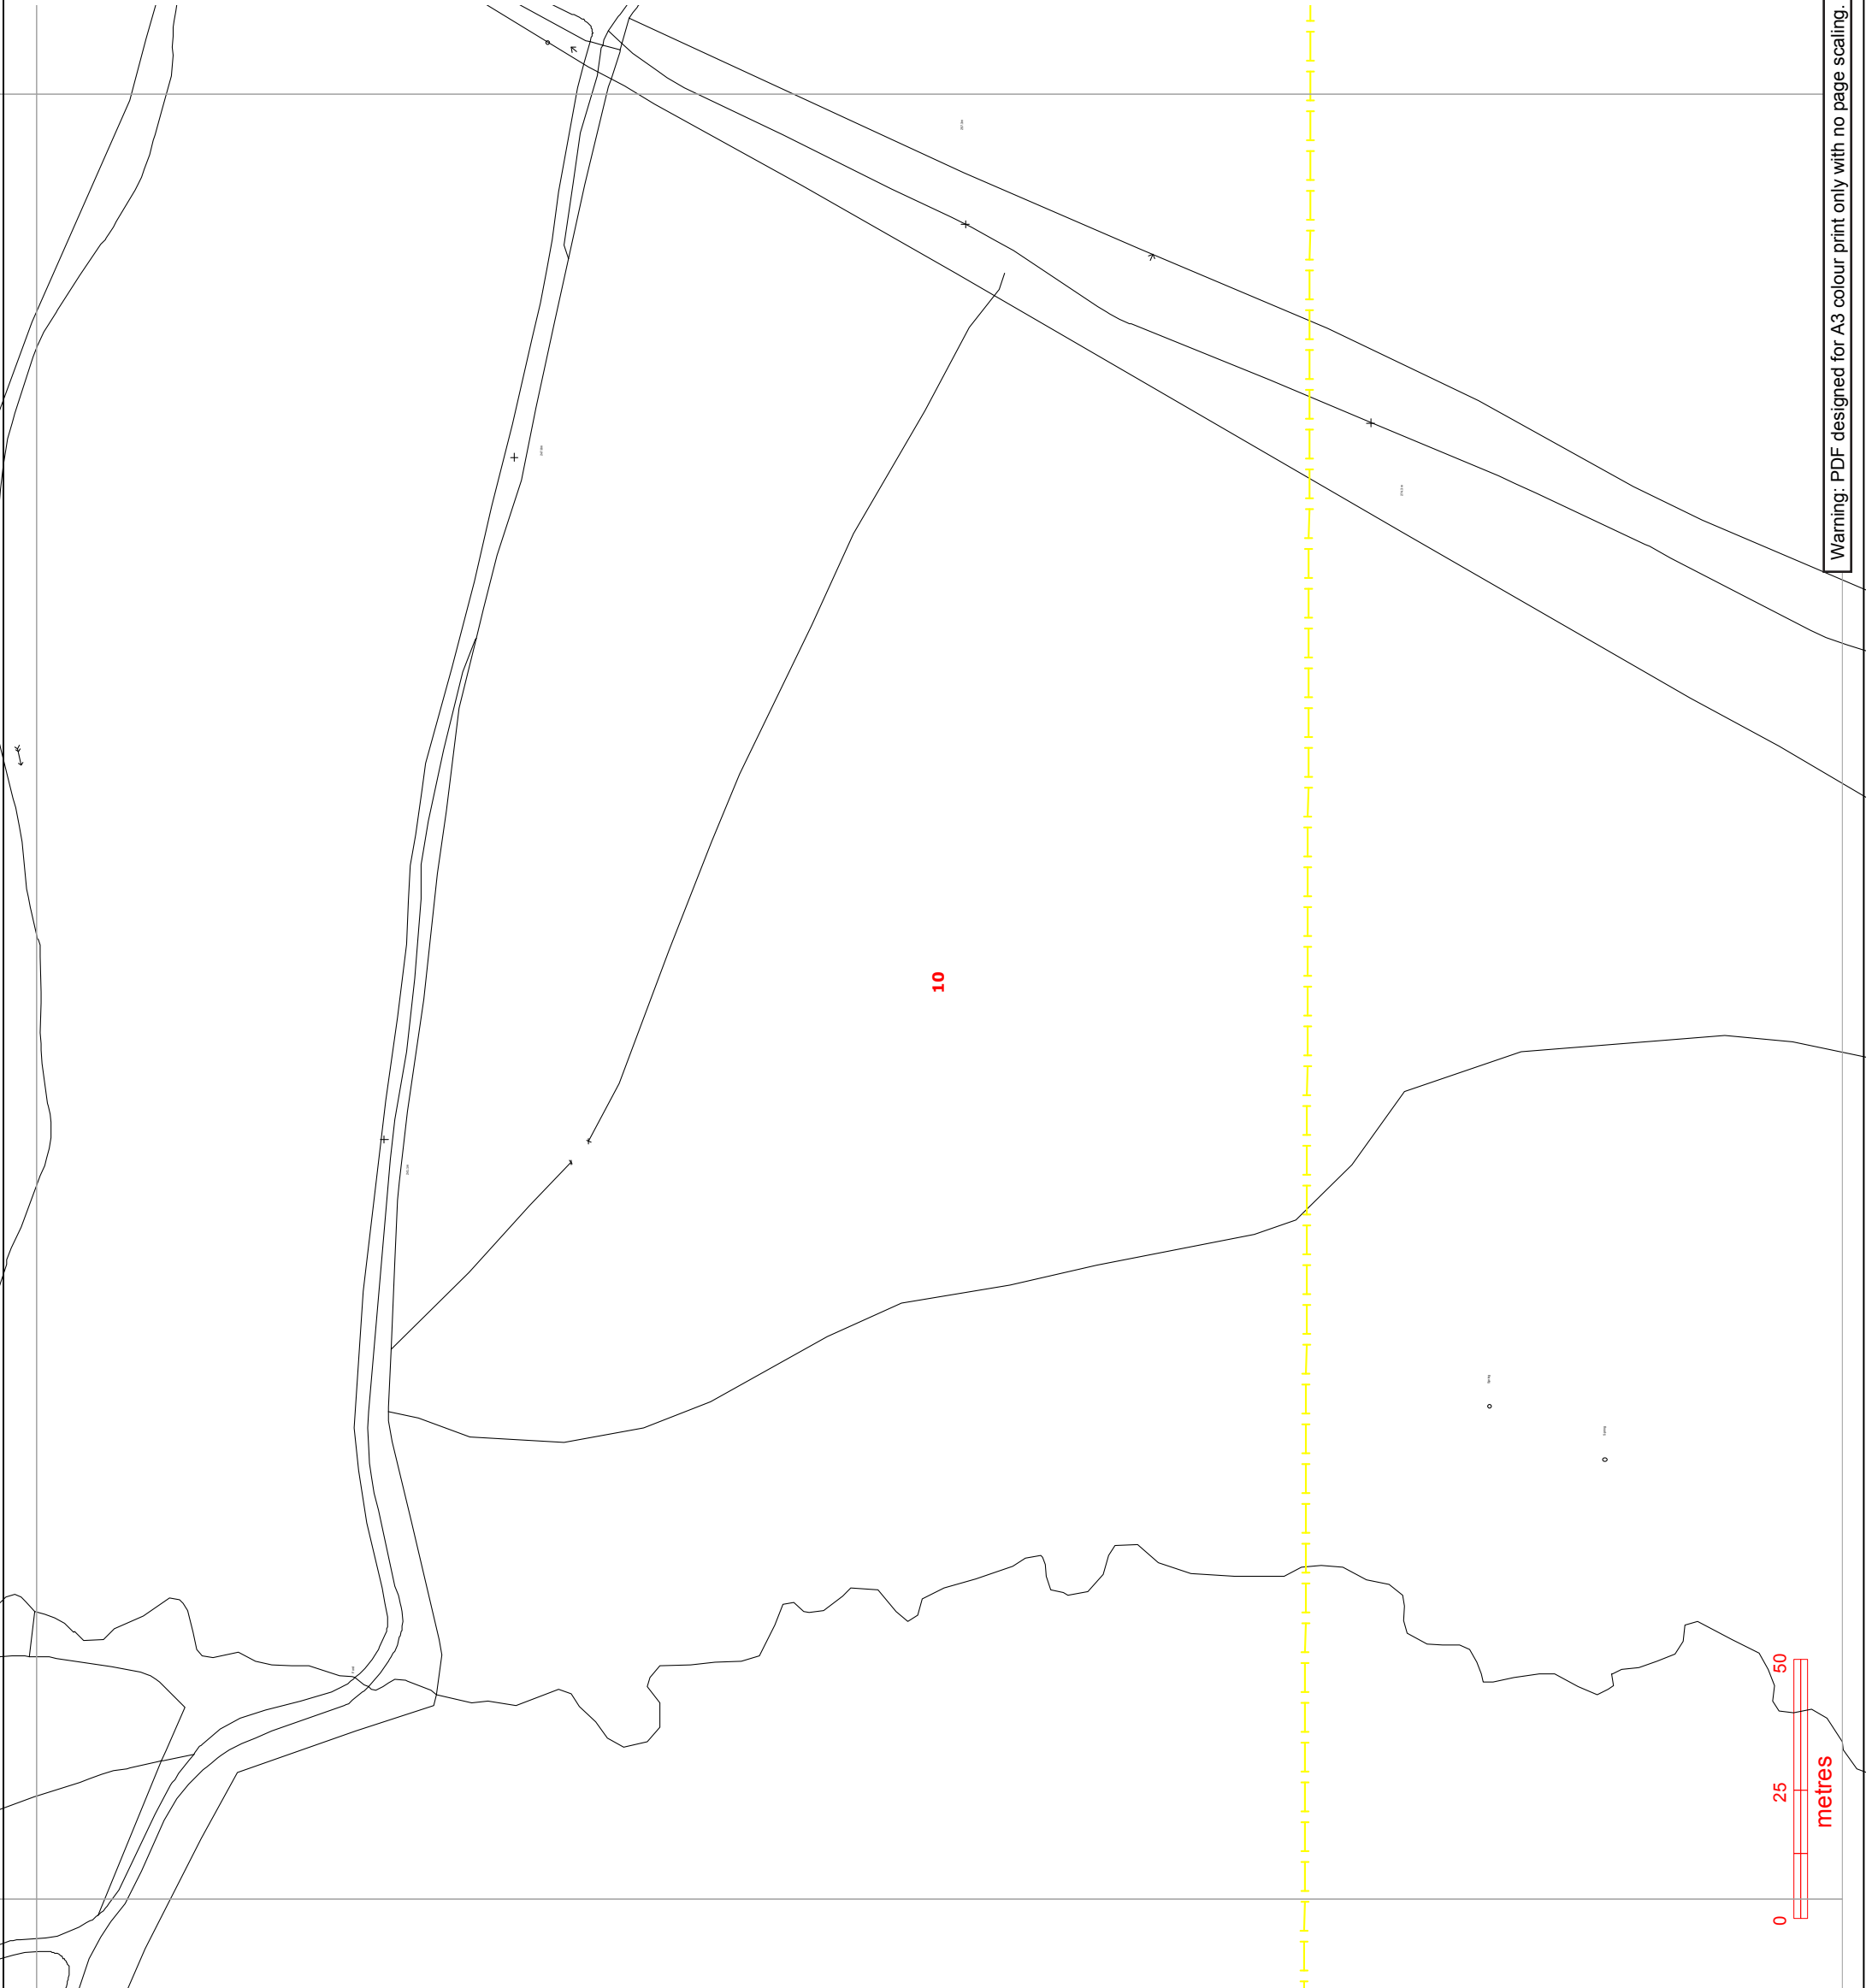


Warning: PDF designed for A3 colour print only with no page scaling.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105

1:1500 line dia cito

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.

- Advice should be sought from the Western Power Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines — 0800 096 3080

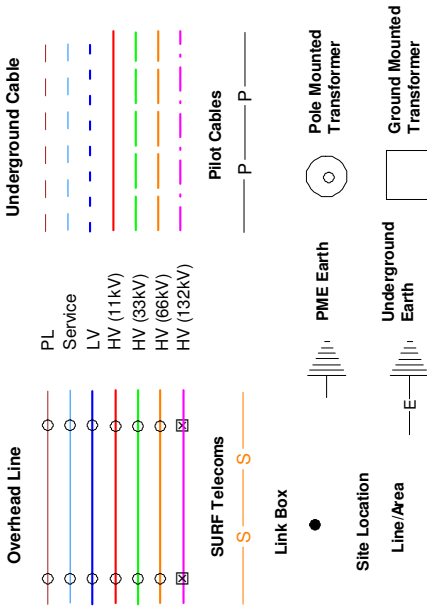

© Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022488, 100024877 & 100021807.




Warning: PDF designed for A3 colour print only with no page scaling.


Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105


U.S. 1250 Alled in Circle dig site

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the Western Power Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

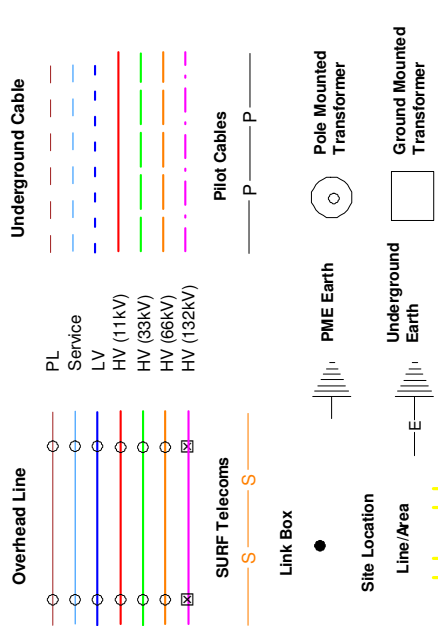

Crown Copyright © All Rights Reserved. Ordnance Survey Licence
 numbers: 100022488, 100024877 & 100021807.
 WPD Copyright: This copy has been made by or with the authority of
 Western Power Distribution (WPD) pursuant to Section 47 of the
 Copyright Designs and Patents Act 1988 unless that Act provides a relevant
 exception to copyright the copy must not be copied without the prior
 permission of the copyright owner

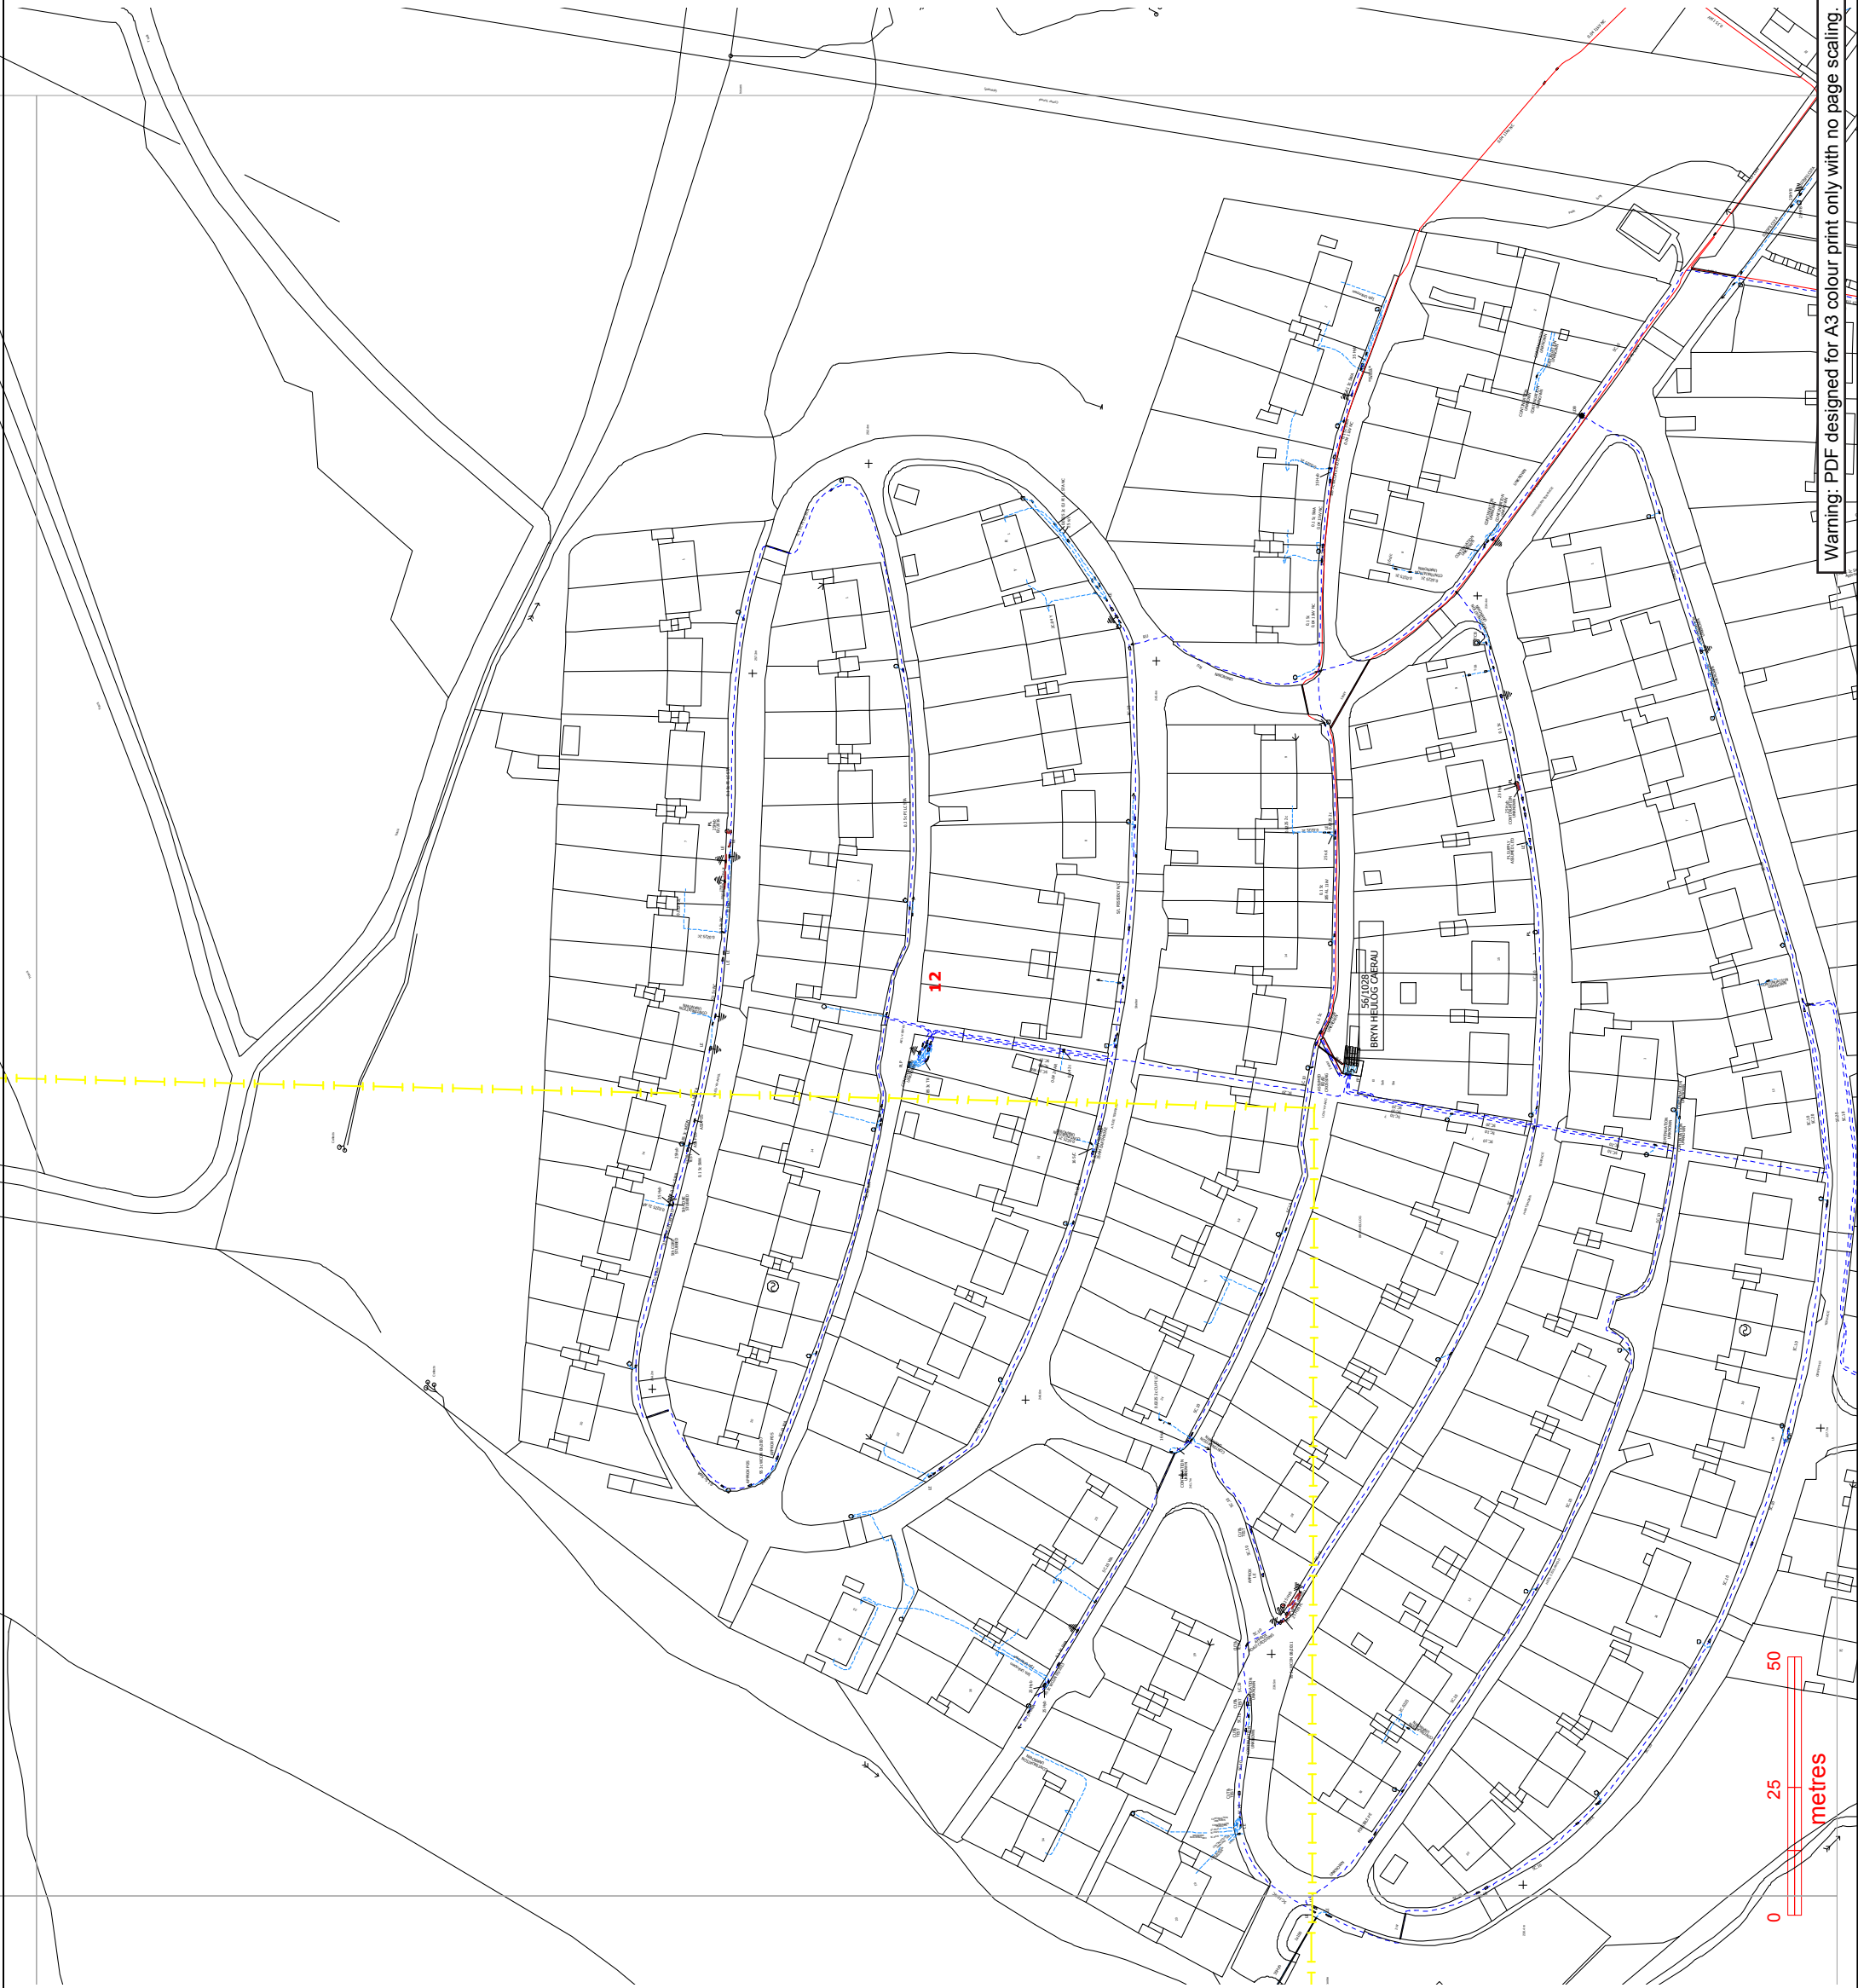

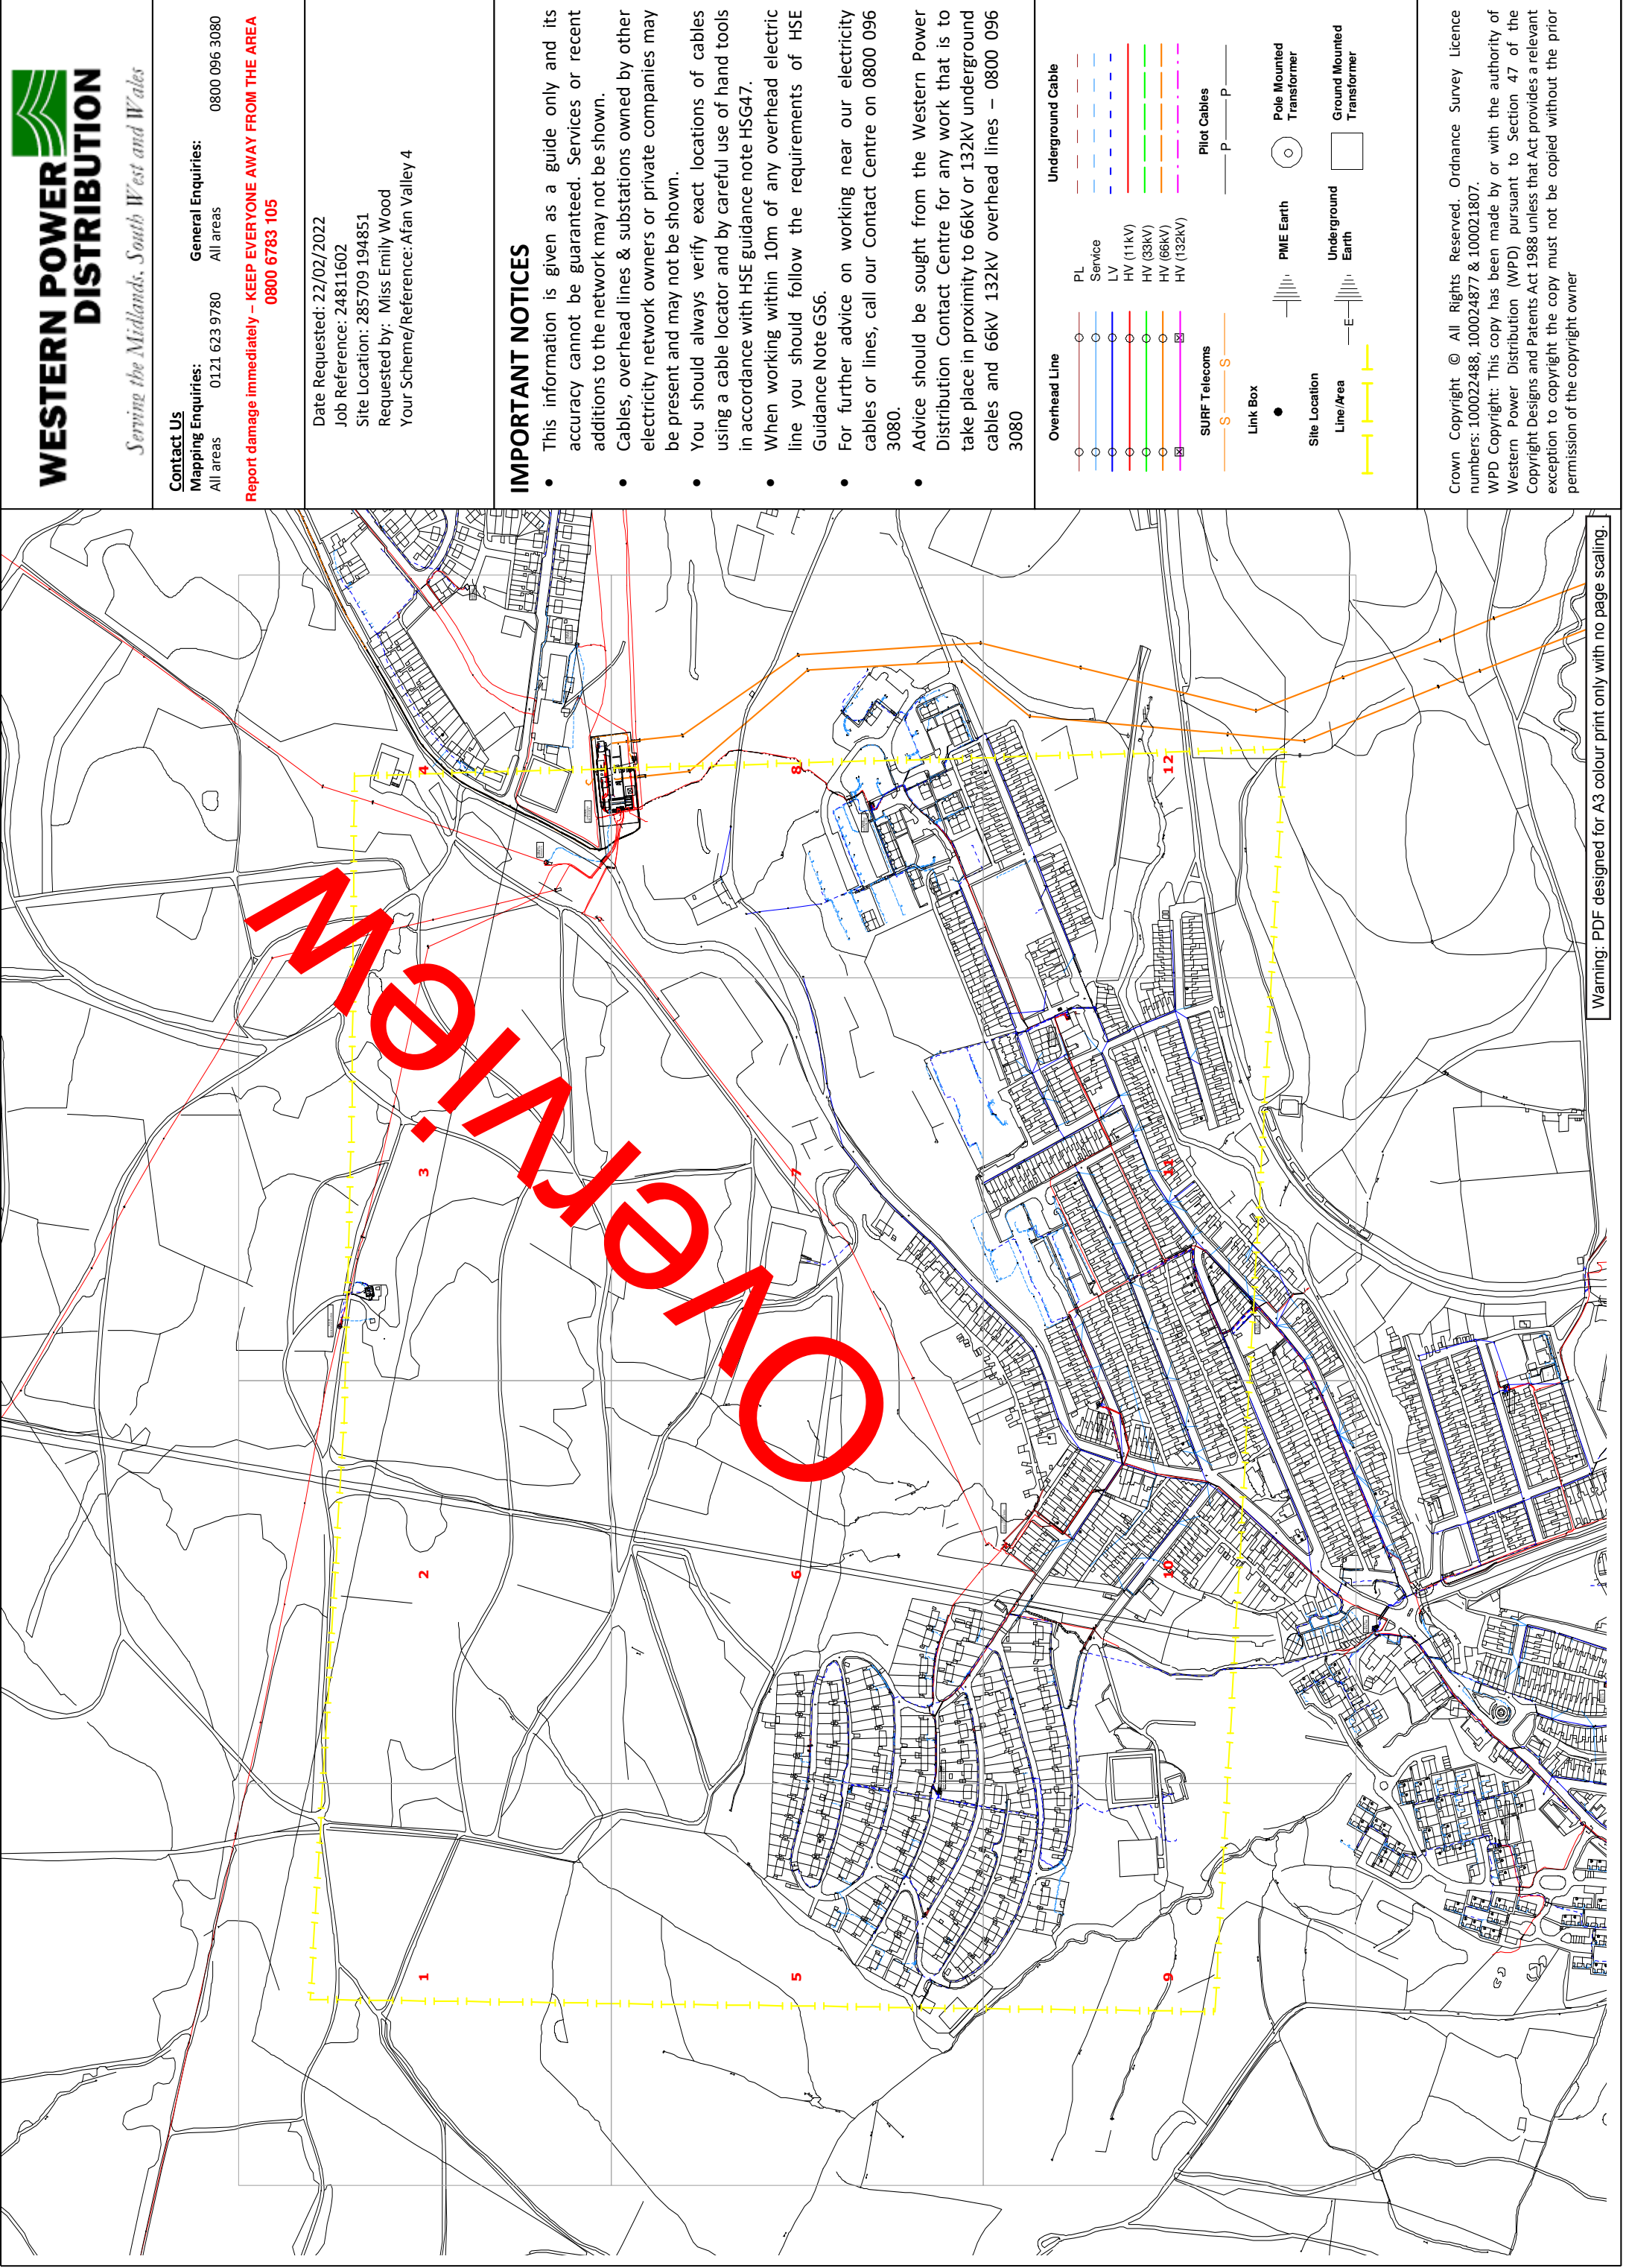



WESTERN POWER

DISTRIBUTION

Serving the Midlands, South West and Wales

Contact Us

Mapping Enquiries:

All areas

General Enquiries:

0121 623 9780

All areas

0800 096 3080

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA

0800 6783 105

Date Requested: 22/02/2022

Job Reference: 24811602

Site Location: 285709 194851

Requested by: Miss Emily Wood

Your Scheme/Reference: Afan Valley 4

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the Western Power Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

Overhead Line

○

PL

○

Service

○

LV

○

HV (11kV)

○

HV (33kV)

○

HV (66kV)

○

HV (132kV)

○

Underground Cable

SURF Telecoms

S

S

Pilot Cables

P

P

Link Box

●

Pole Mounted Transformer

○

Ground Mounted Transformer

□

Underground Earth

E

Site Location


—

Line/Area

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022488, 100024877 & 100021807.

WPD Copyright: This copy has been made by or with the authority of Western Power Distribution (WPD) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner

Plans generated by DigSAFE Pro (tm) software provided by LinesearchbeforeUdig

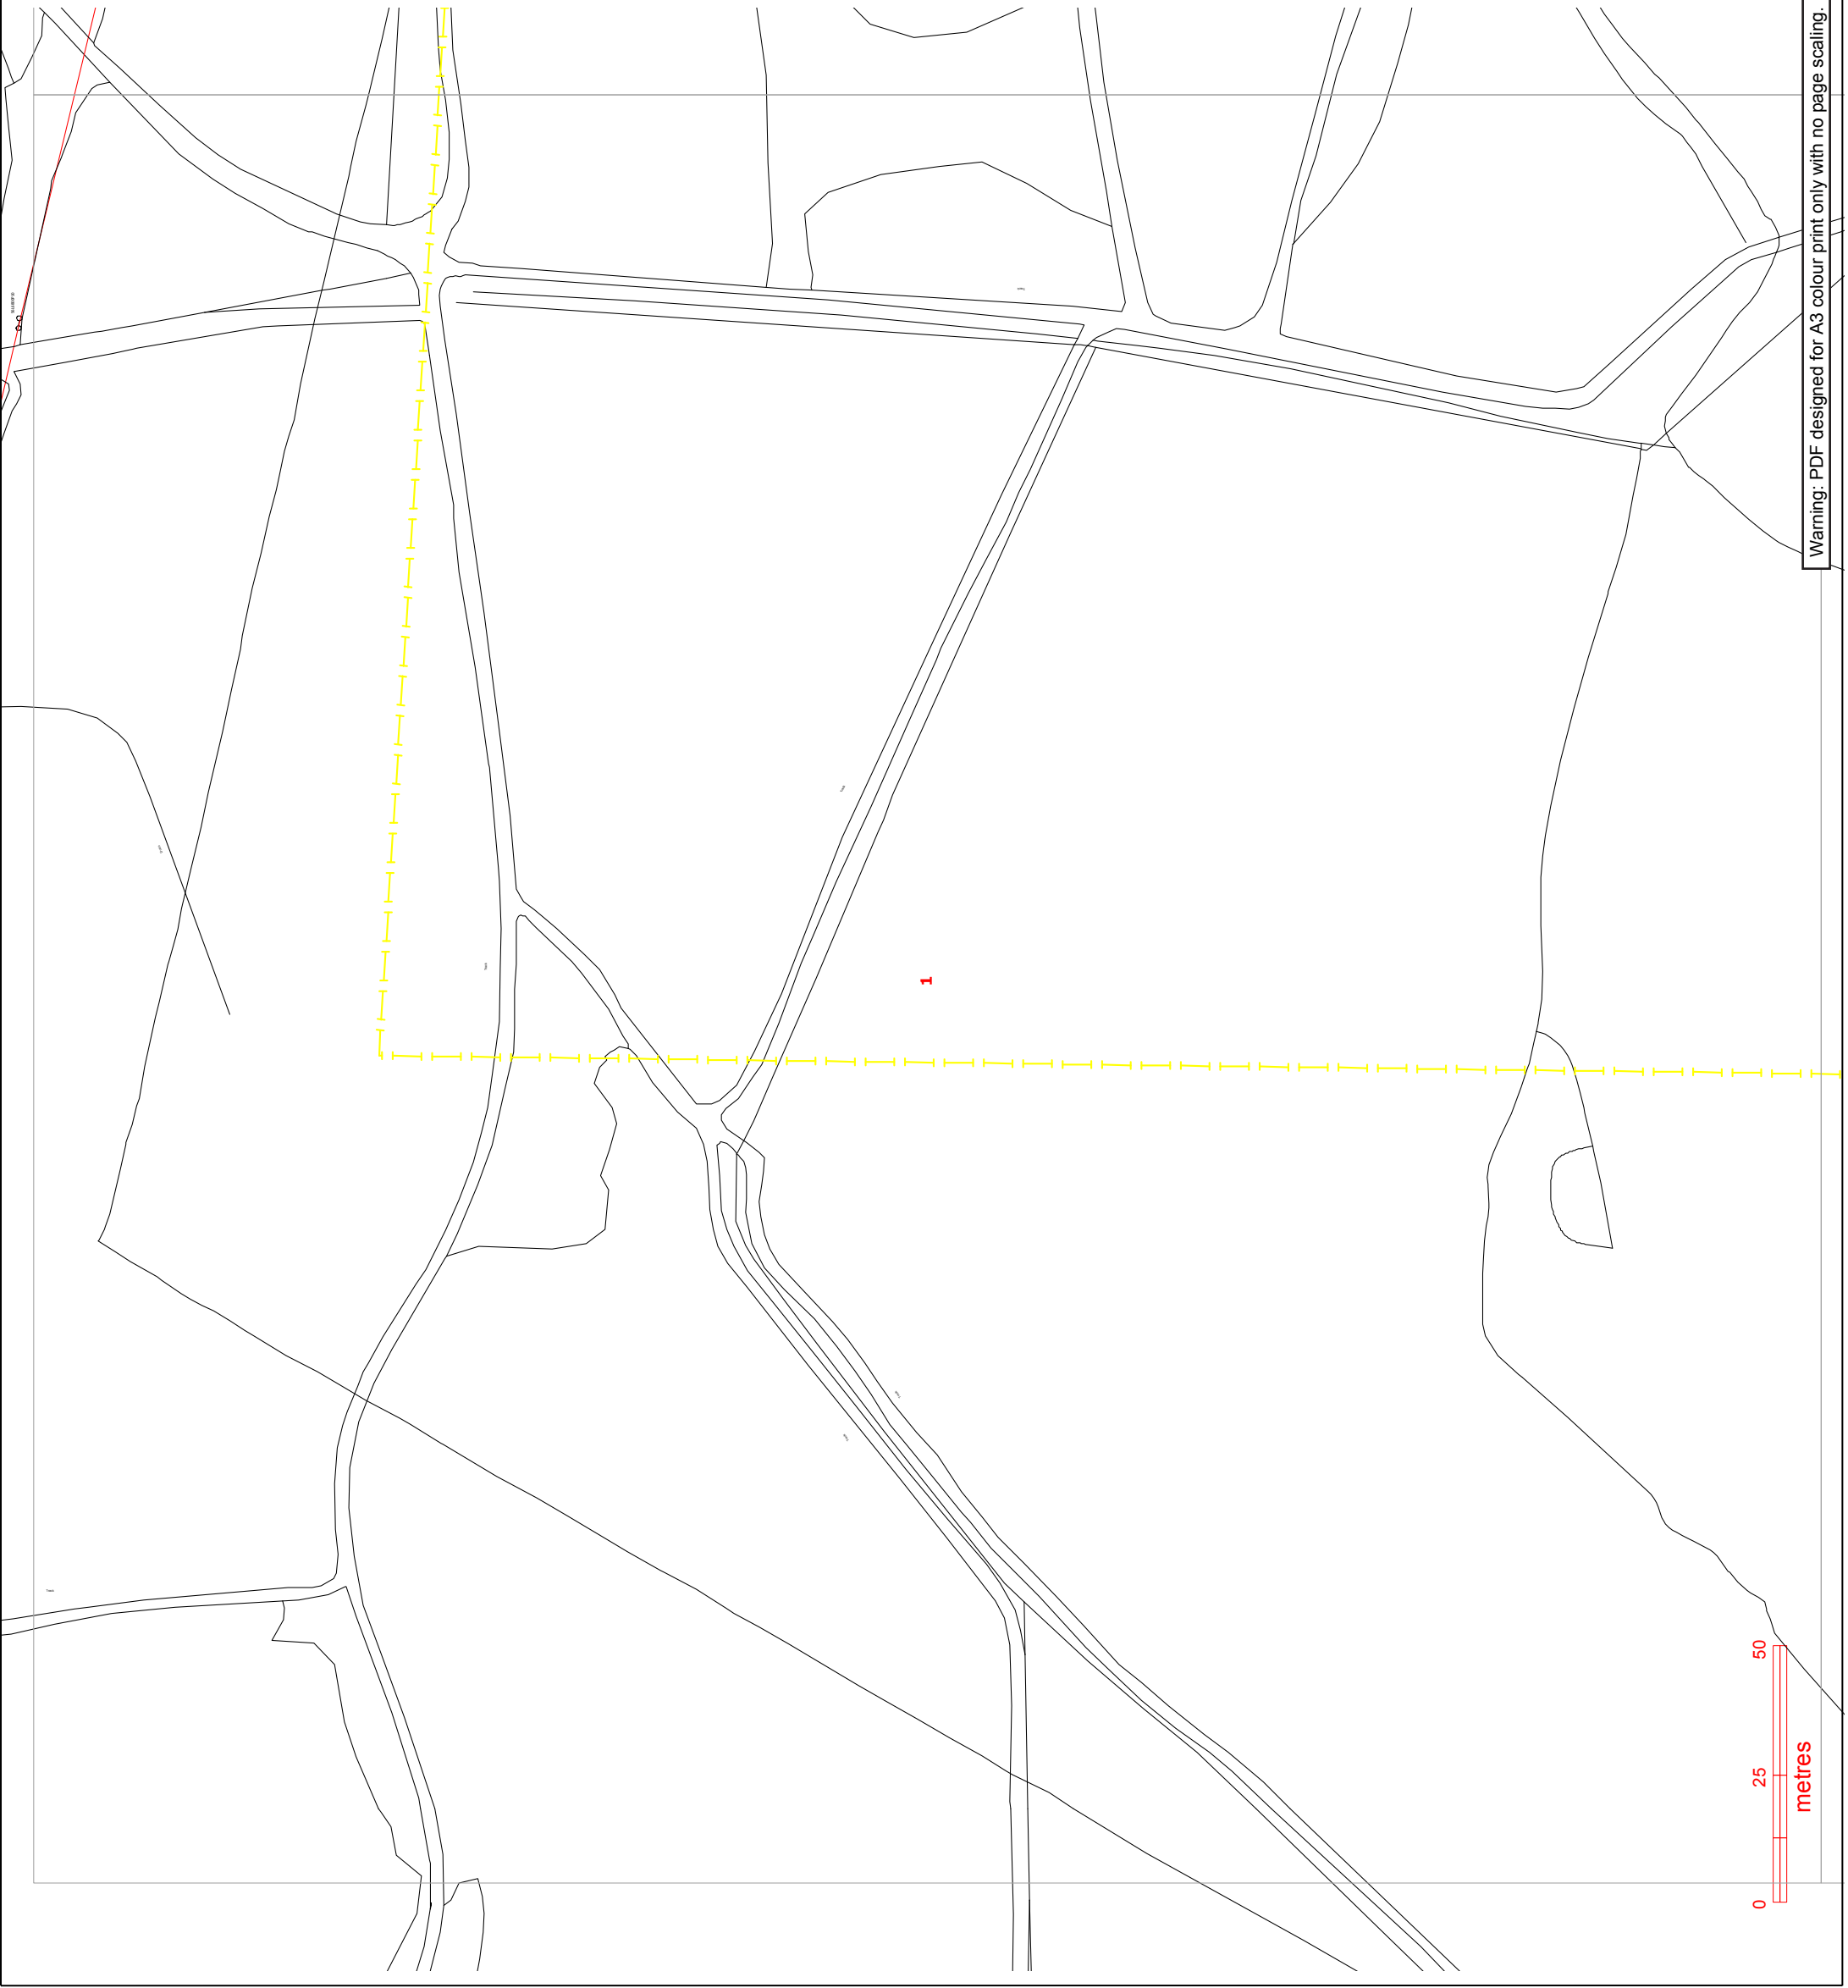



WESTERN POWER

DISTRIBUTION

Serving the Midlands, South West and Wales

Contact Us

Mapping Enquiries:
All areas0121 623 9780

General Enquiries:
All areas0800 096 3080

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105

Date Requested: 22/02/2022

Job Reference: 24811602

Site Location: 285709 194851


Requested by: Miss Emily Wood

Your Scheme/Reference: Afan Valley 4

Exact Scales:
1:1250 Area or Circle dig site
1:500 Line dig site

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the Western Power Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

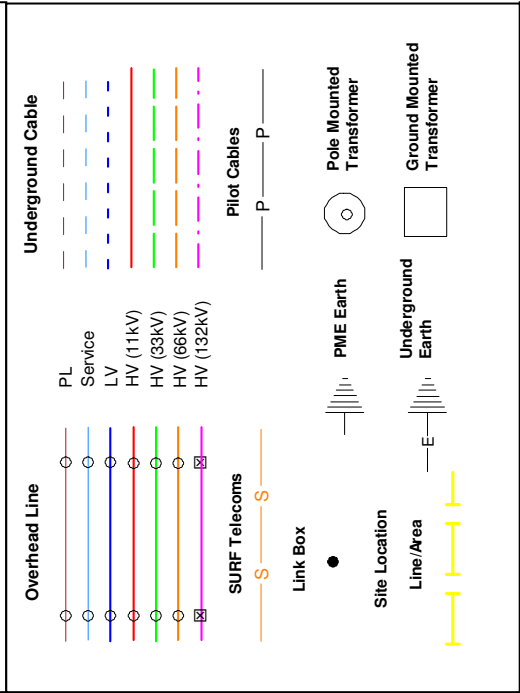

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 10002488, 100024877 & 100021807.
WPD Copyright: This copy has been made by or with the authority of Western Power Distribution (WPD) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner


0800 096 3080

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105


1:500 Line diagram


- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.

- Advice should be sought from the Western Power Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines — 0800 096 3080

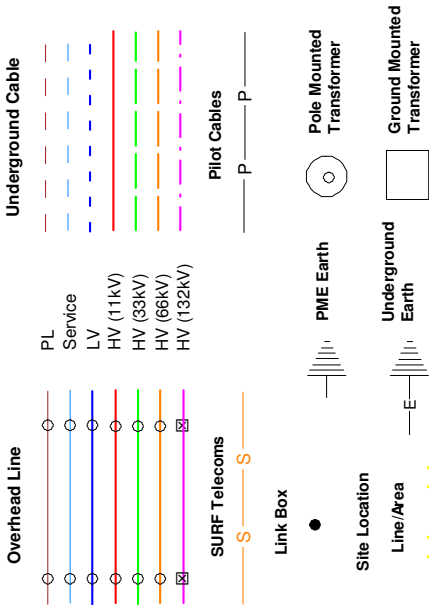

Crown Copyright © All Rights Reserved. Ordnance Survey Licence
 numbers: 100022488, 100024877 & 100021807.
 WPD Copyright: This copy has been made by or with the authority of
 Western Power Distribution (WPD) pursuant to Section 47 of the
 Copyright Designs and Patents Act 1988 unless that Act provides a relevant
 exception to copyright the copy must not be copied without the prior
 permission of the copyright owner

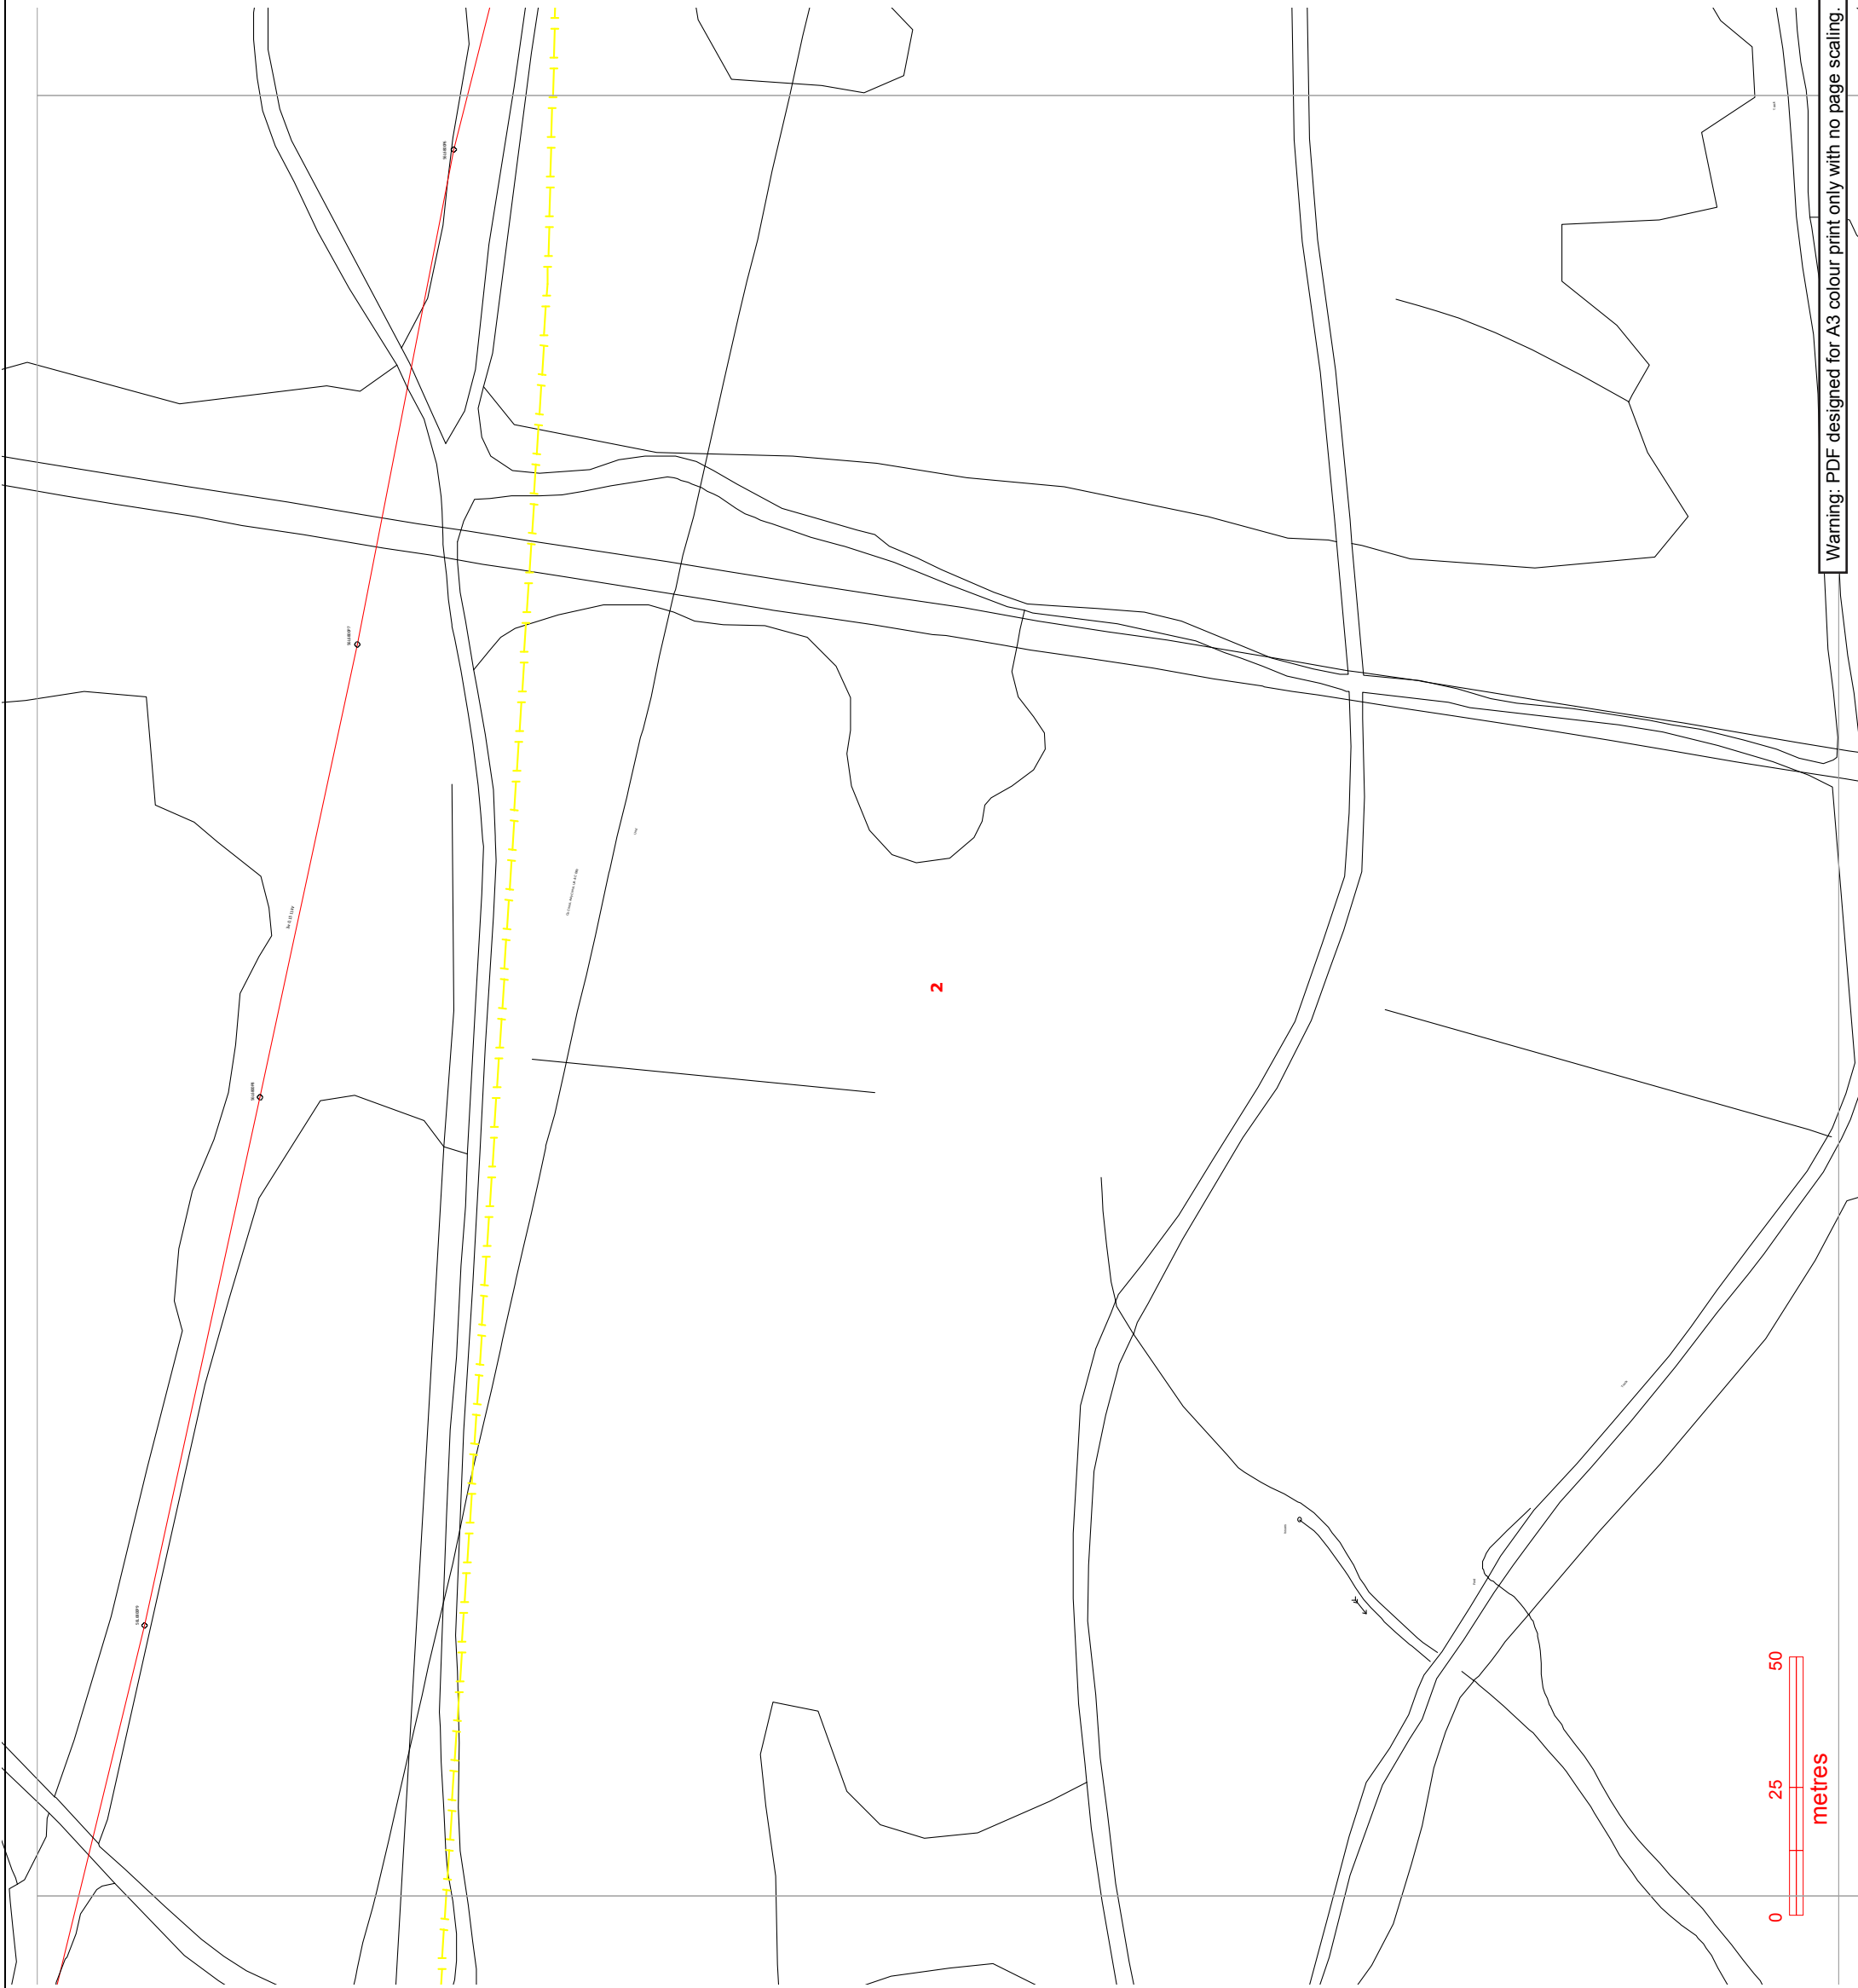





Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105

1:1250 Area or Circle dig site

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables/using a cable locator and by careful use of hand tools/ in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric/line you should follow the requirements of HSE/ Guidance Note GS6.
- For further advice on working near our electric/ cables or lines, call our Contact Centre on 0800 090/ 3080.
- Advice should be sought from the Western Power/ Distribution Contact Centre for any work that is to/ take place in proximity to 66kV or 132kV underground/ cables and 66kV 132kV overhead lines – 0800 090/ 3080

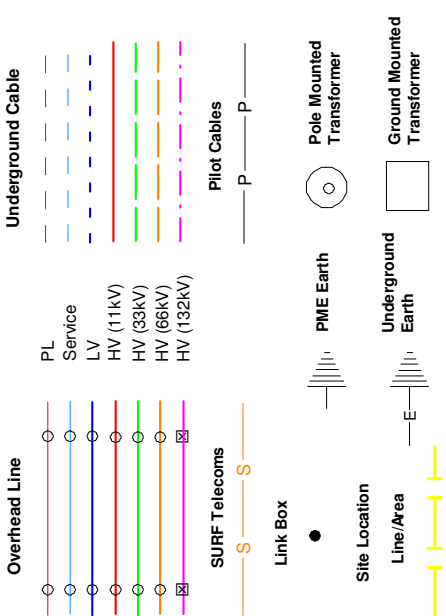

numbers: 100022488, 100024877 & 100021807.
Western Power Distribution (WPD) pursuant to Section 47 of the
Copyright Designs and Patents Act 1988 unless that Act provides a relevant
exception to copyright the copy must not be copied without the prior
permission of the copyright owner

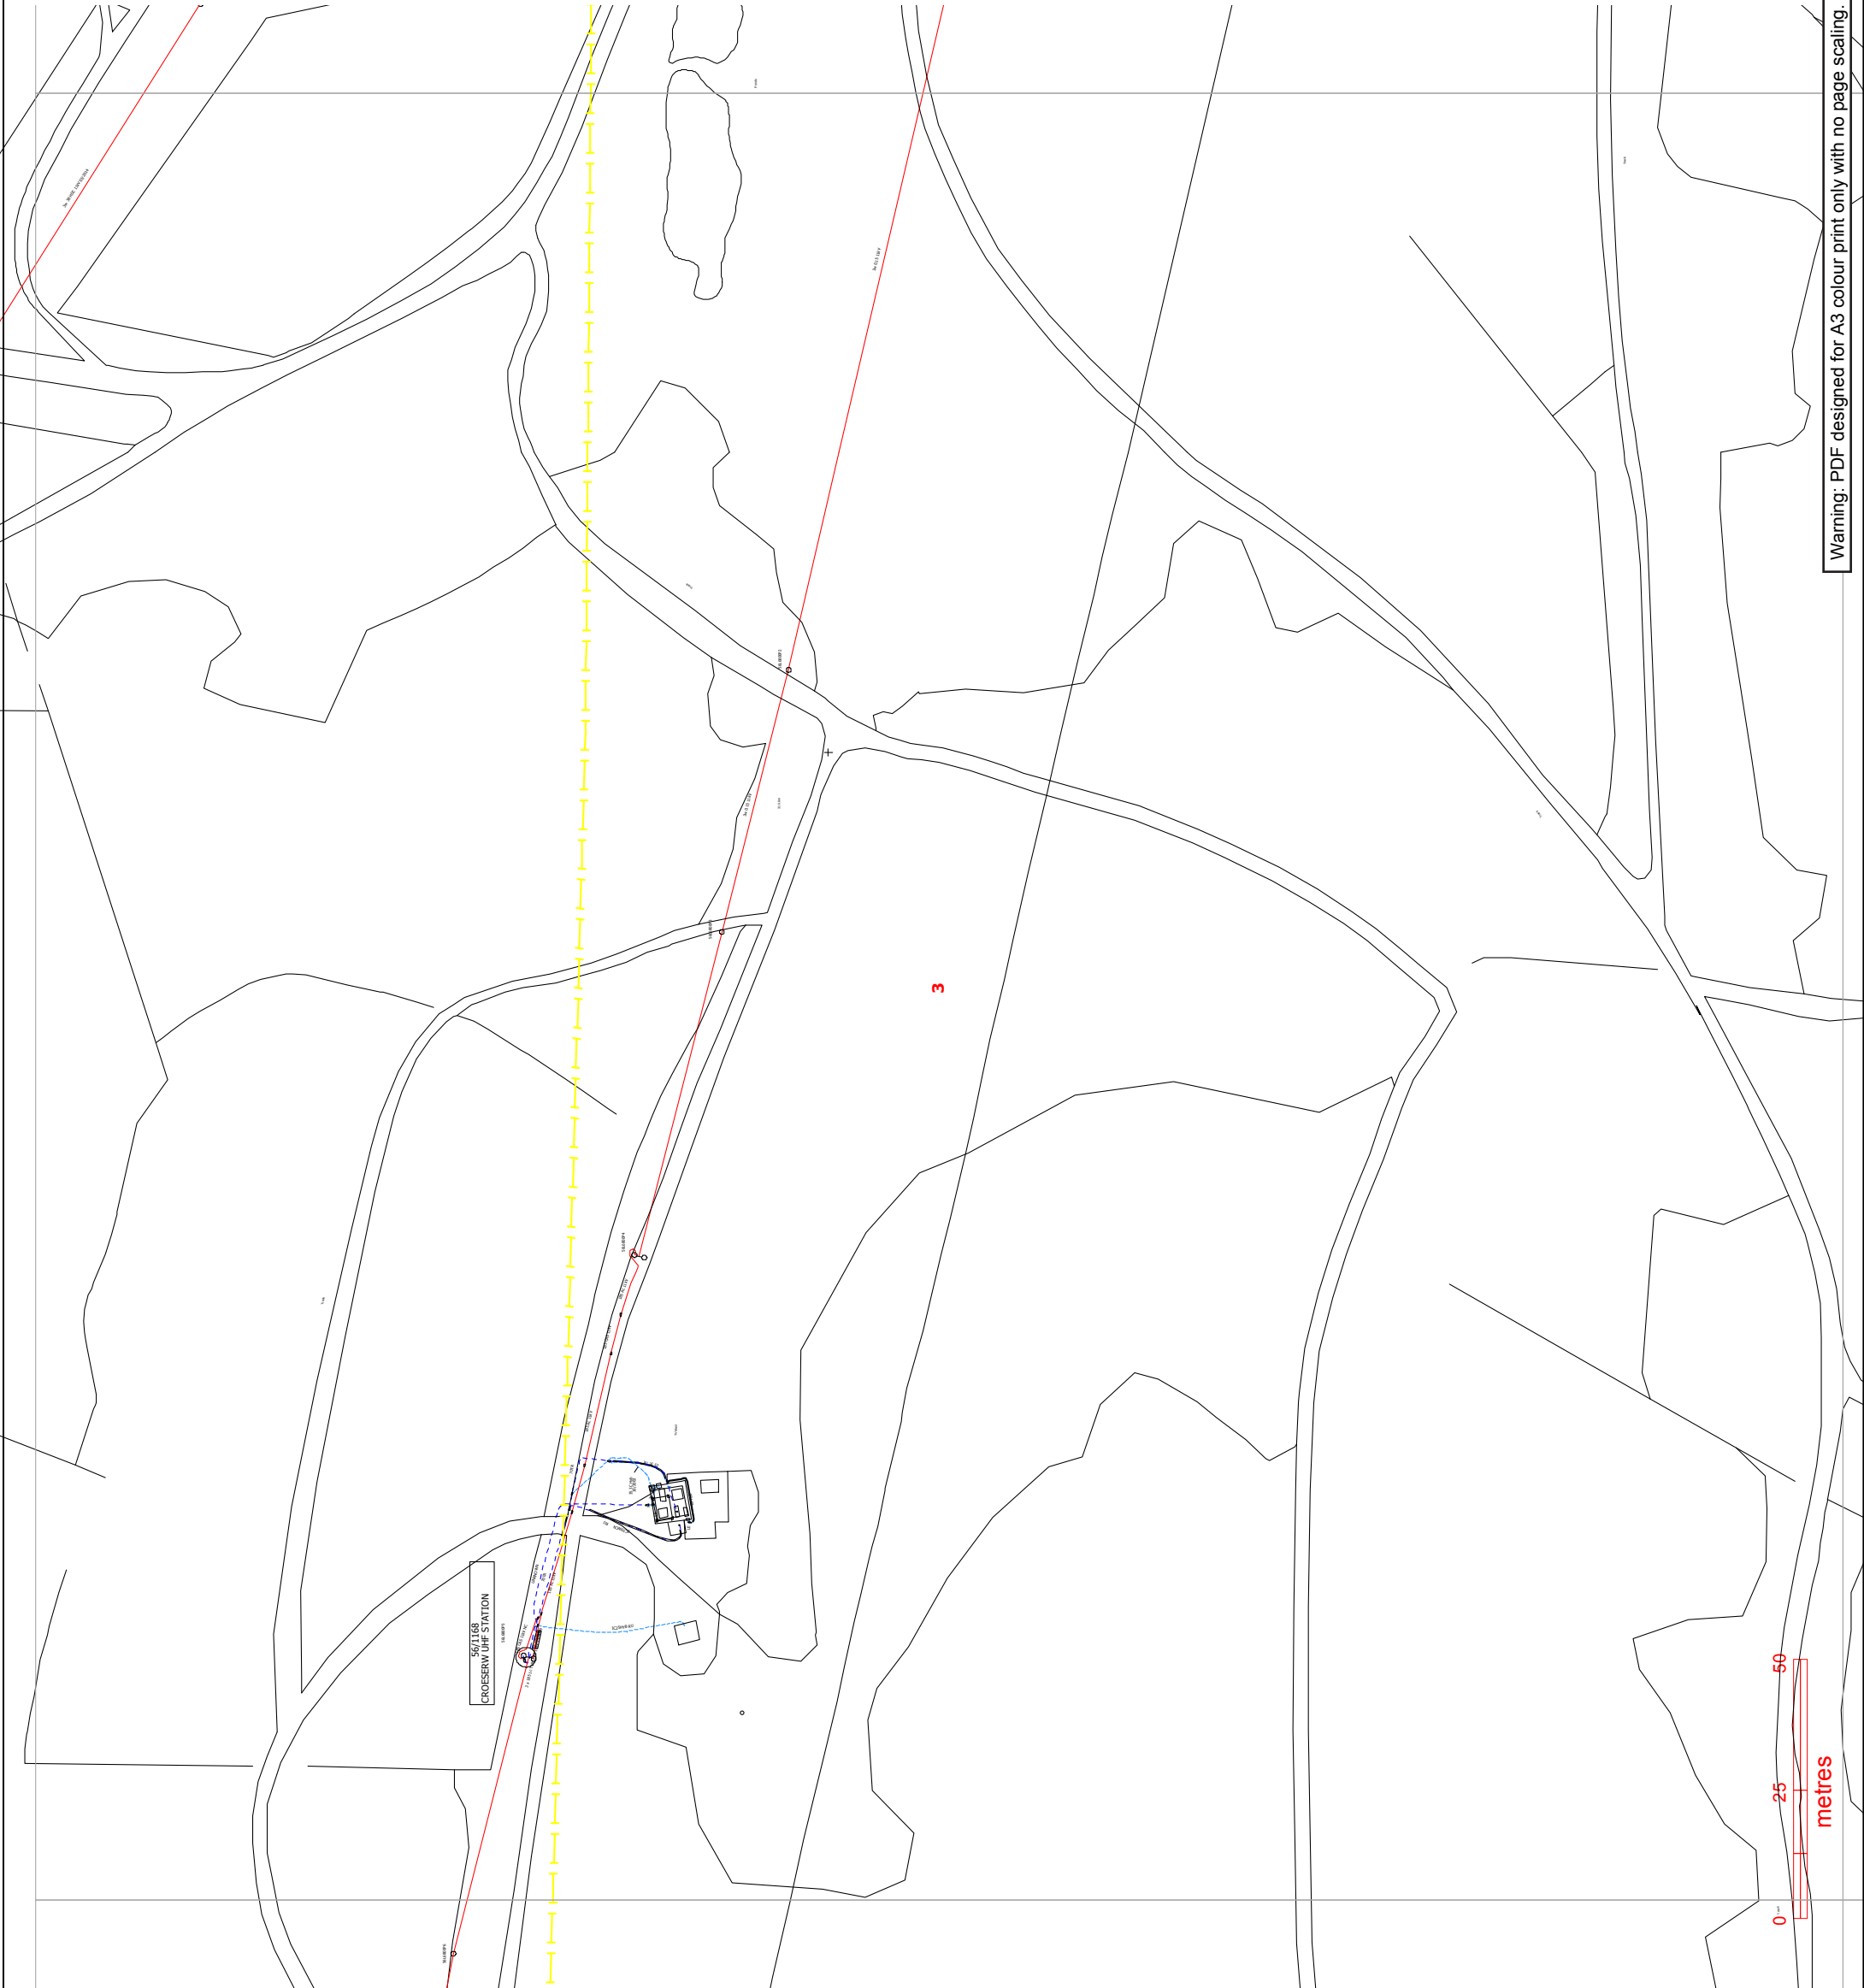


0800 096 3080


Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105


1:1250 Area or Circle dig site

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the Western Power

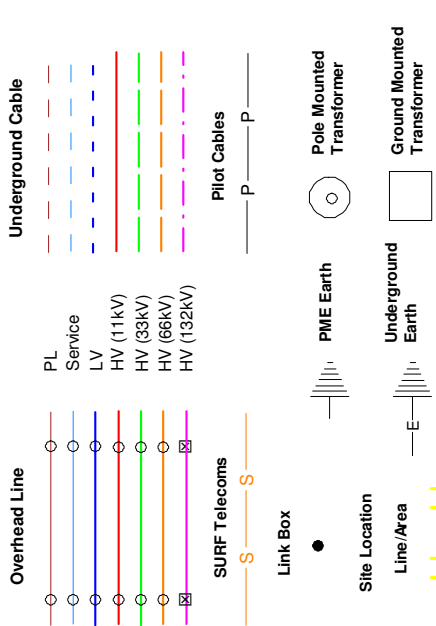

Crown Copyright © All Rights Reserved. Ordnance Survey Licence
 numbers: 100022488, 100024877 & 100021807.
 WPD Copyright: This copy has been made by or with the authority of
 Western Power Distribution (WPD) pursuant to Section 47 of the
 Copyright Designs and Patents Act 1988 unless that Act provides a relevant
 exception to copyright the copy must not be copied without the prior
 permission of the copyright owner

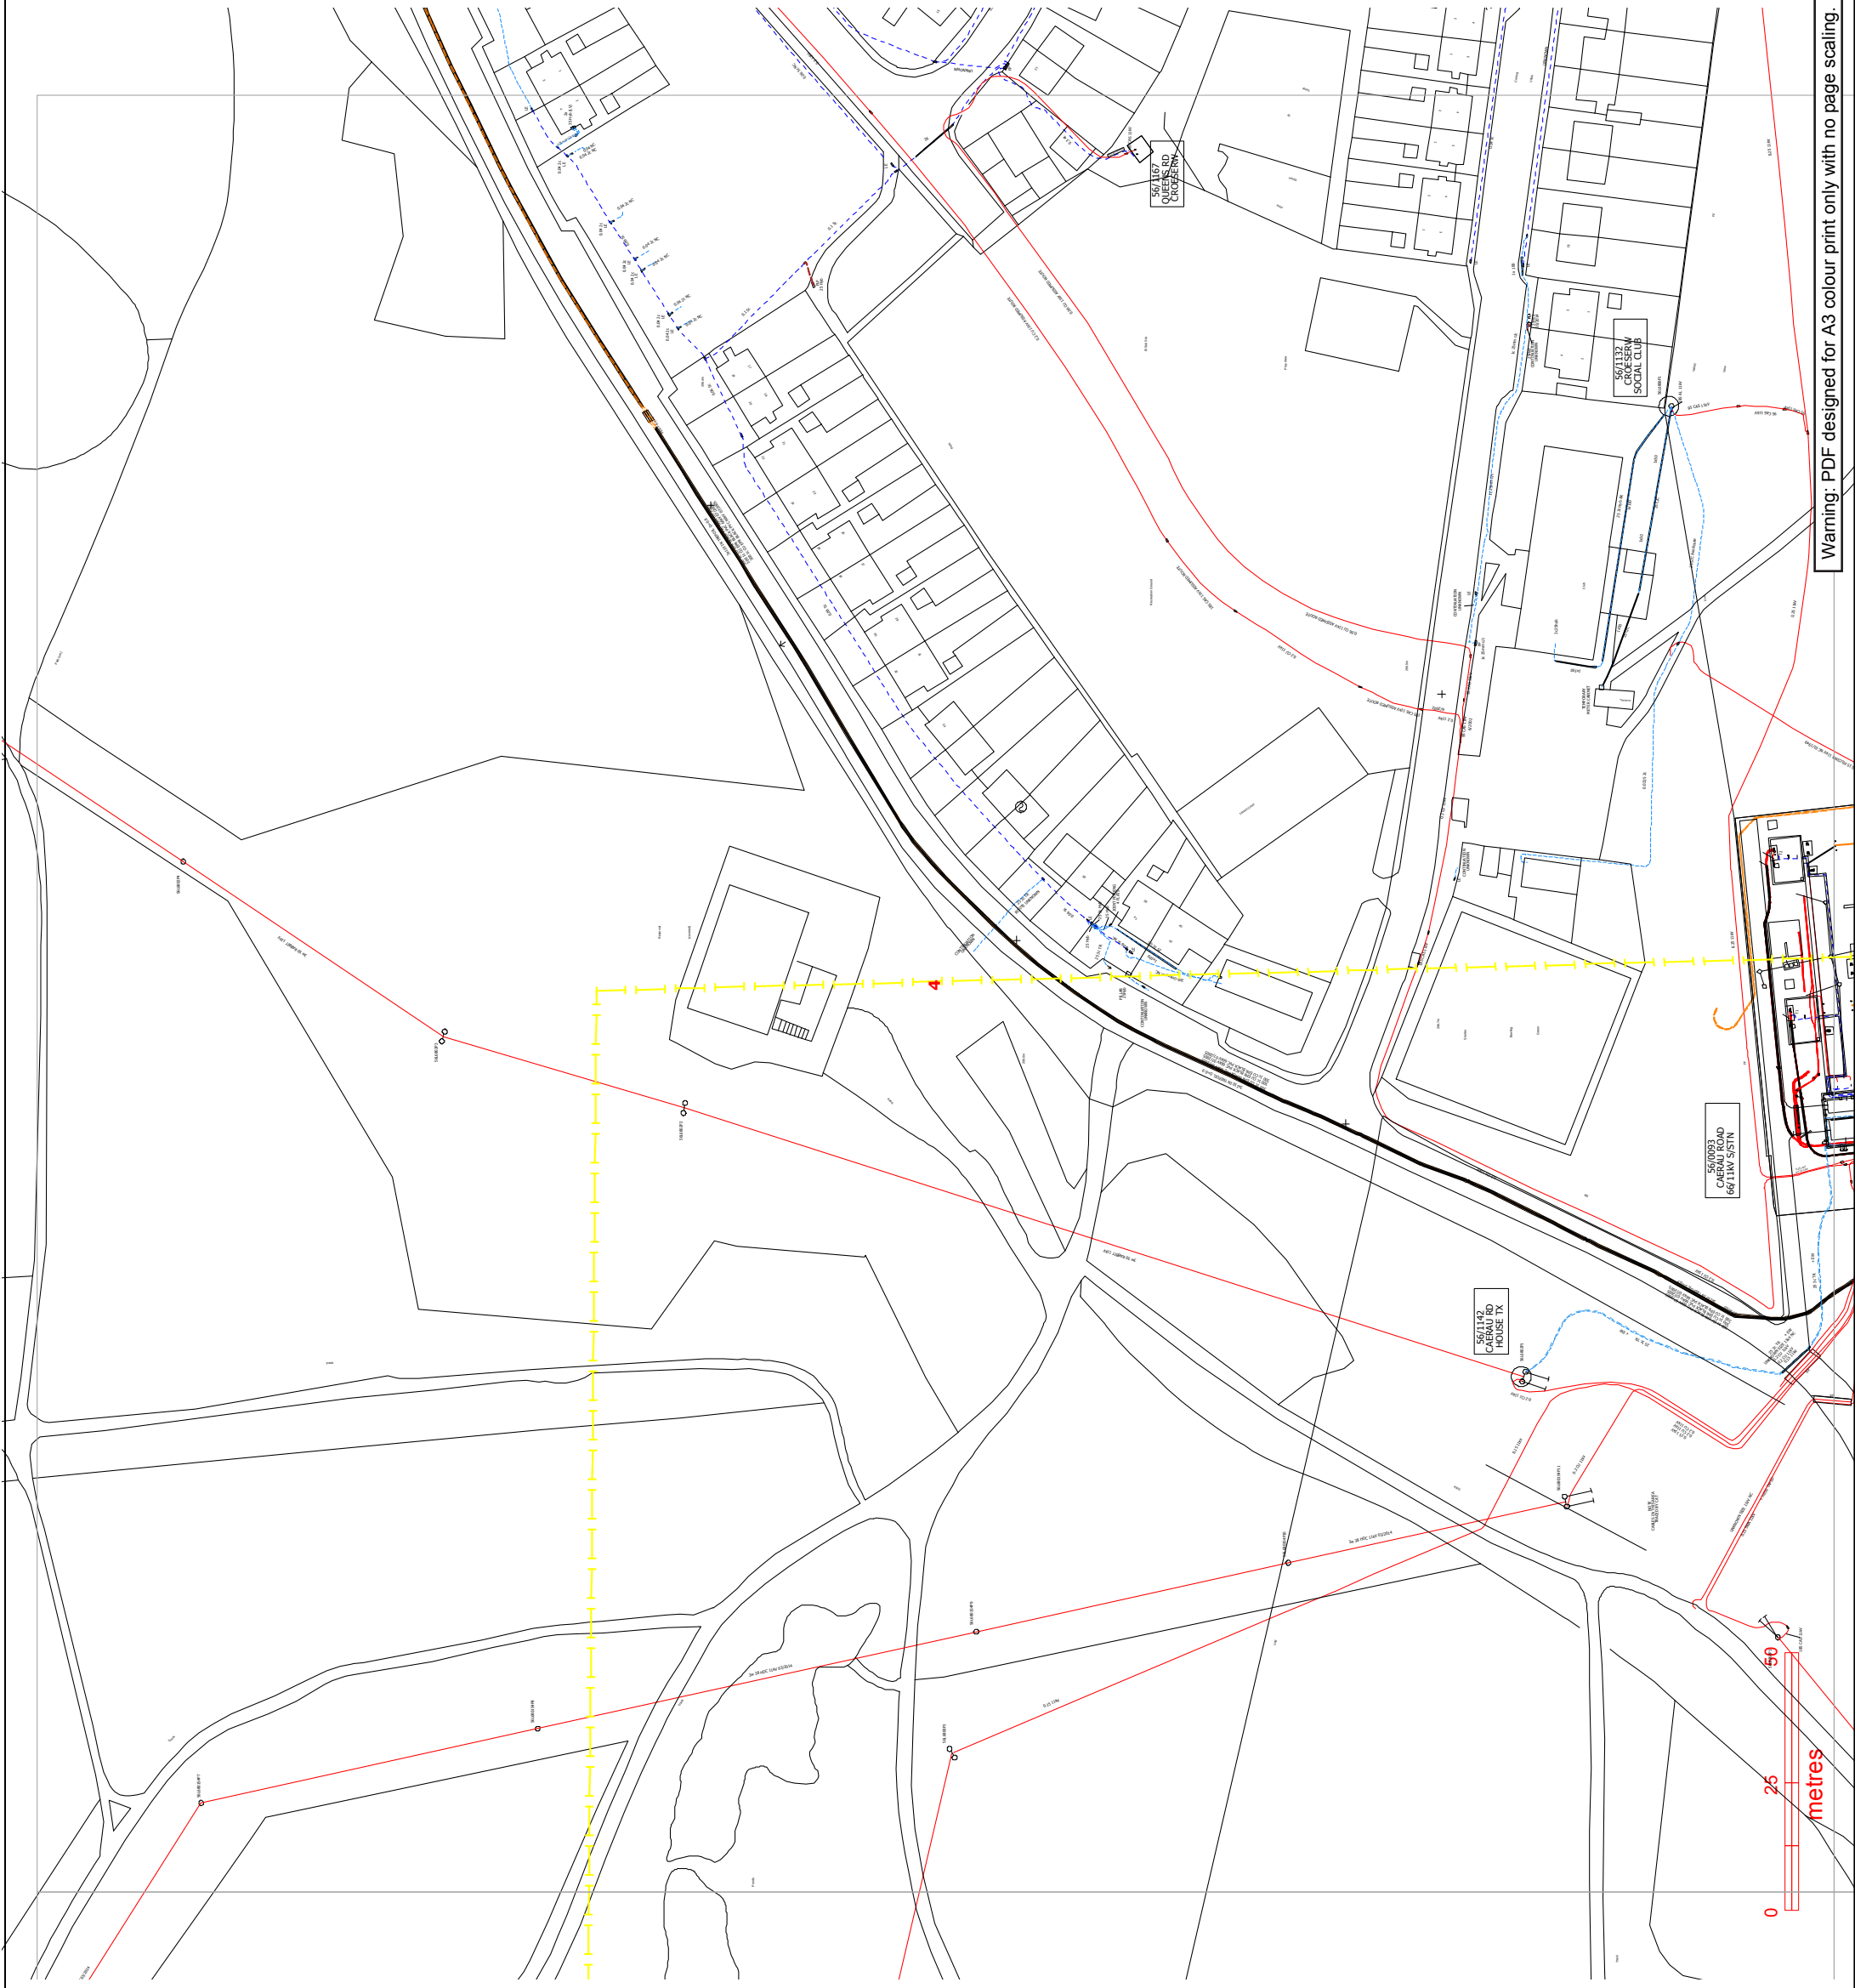



0800 096 3080

Date Requested: 22/02/2022

Job Reference: 24811602

Site Location: 285709 194851

Requested by: Miss Emily Wood


Your Scheme/Reference: Afan Vallev 4

Exact Scales:

1.1250 Area or Circle dig site


1.500 line dis site

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the Western Power

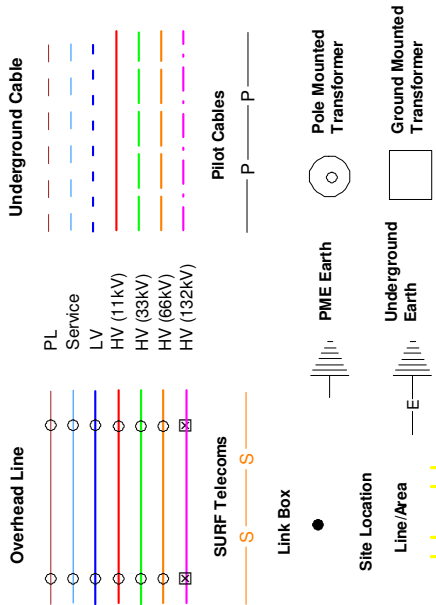

© Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022488, 100024877 & 100021807.



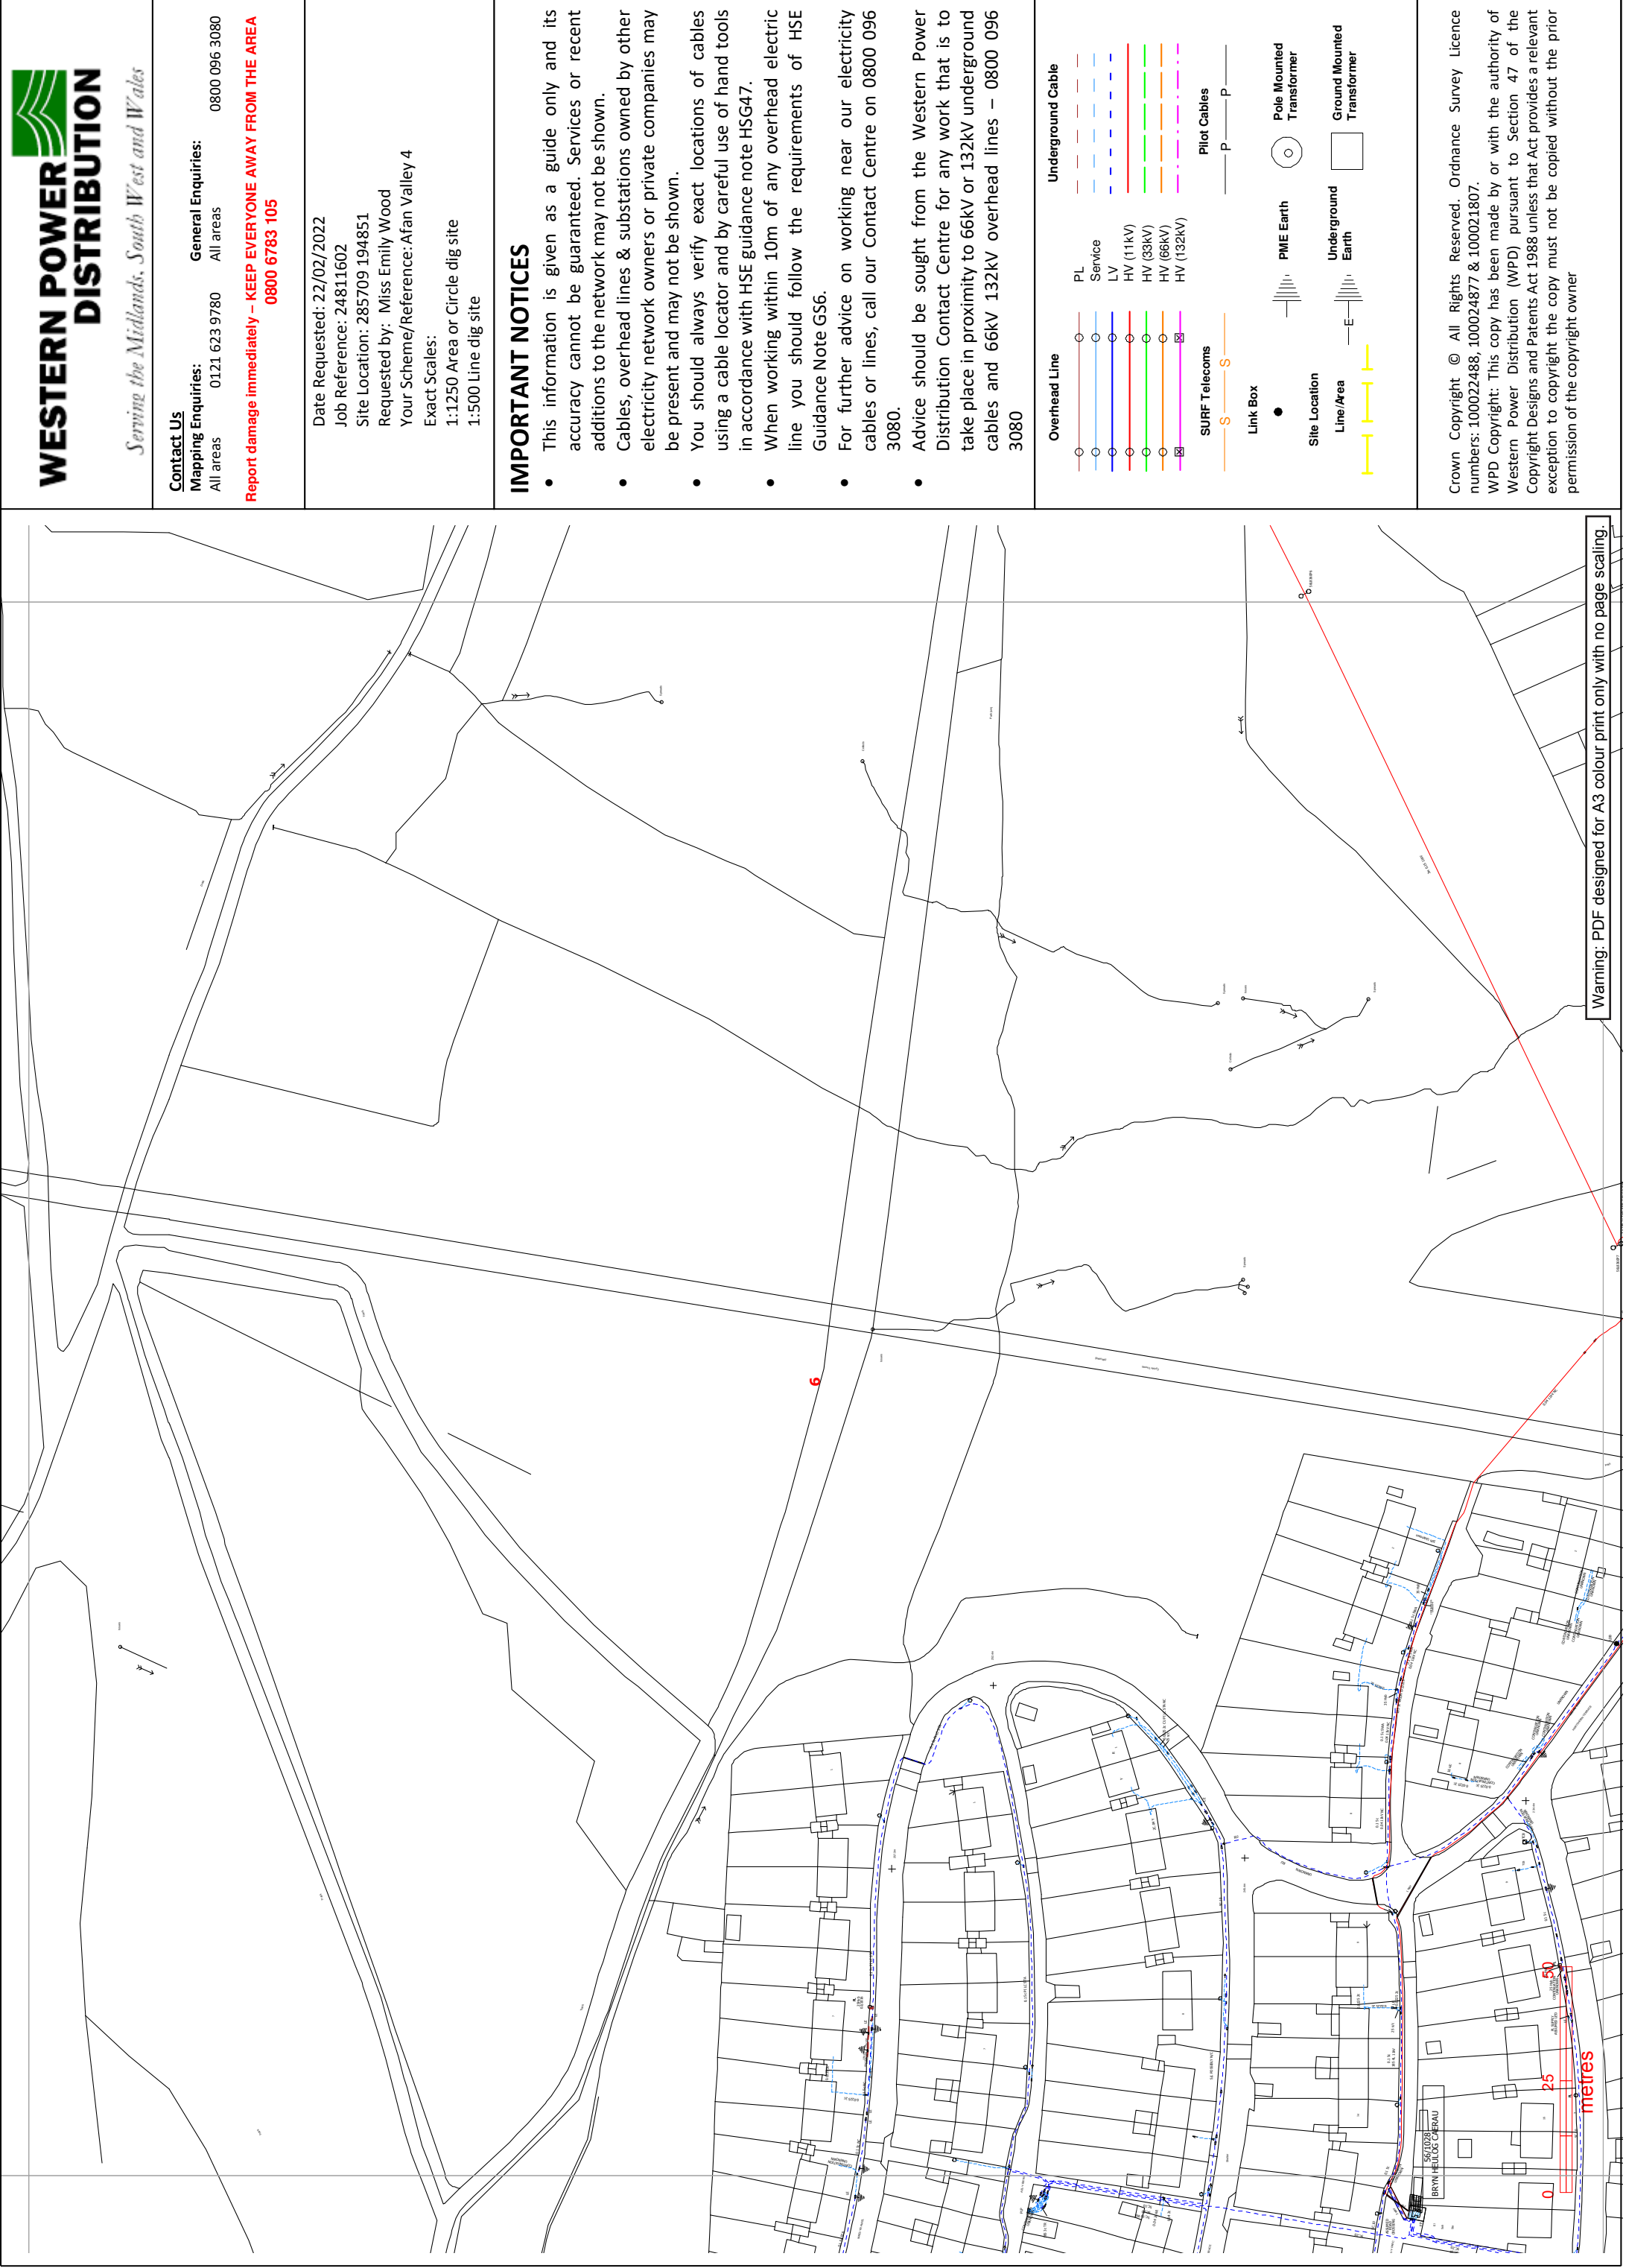



Serving the Midlands, South West and Wales

Contact Us

Mapping Enquiries:

All areas	0121 623 9780
-----------	---------------

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105

Date Requested: 22/02/2022

Job Reference: 24811602

Site Location: 285709 194851

Requested by: Miss Emily Wood

Requested by: Miss Emily Wood
Your Scheme/Reference: Afan Valley A


Two of the most common

Exact Scales:


1:1250 Area or Cir

IMPORTANT NOTICES


- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the Western Power

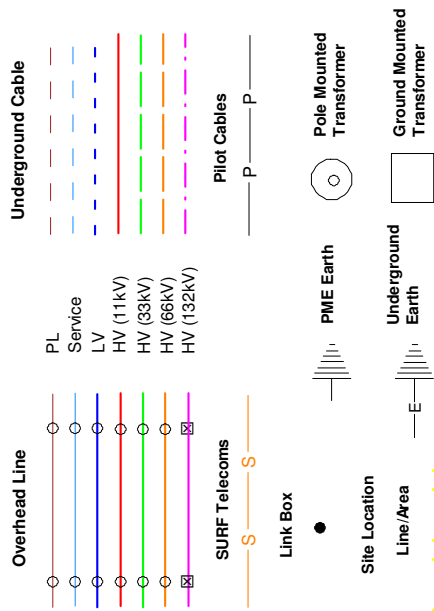

© Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022488, 100024877 & 100021807.

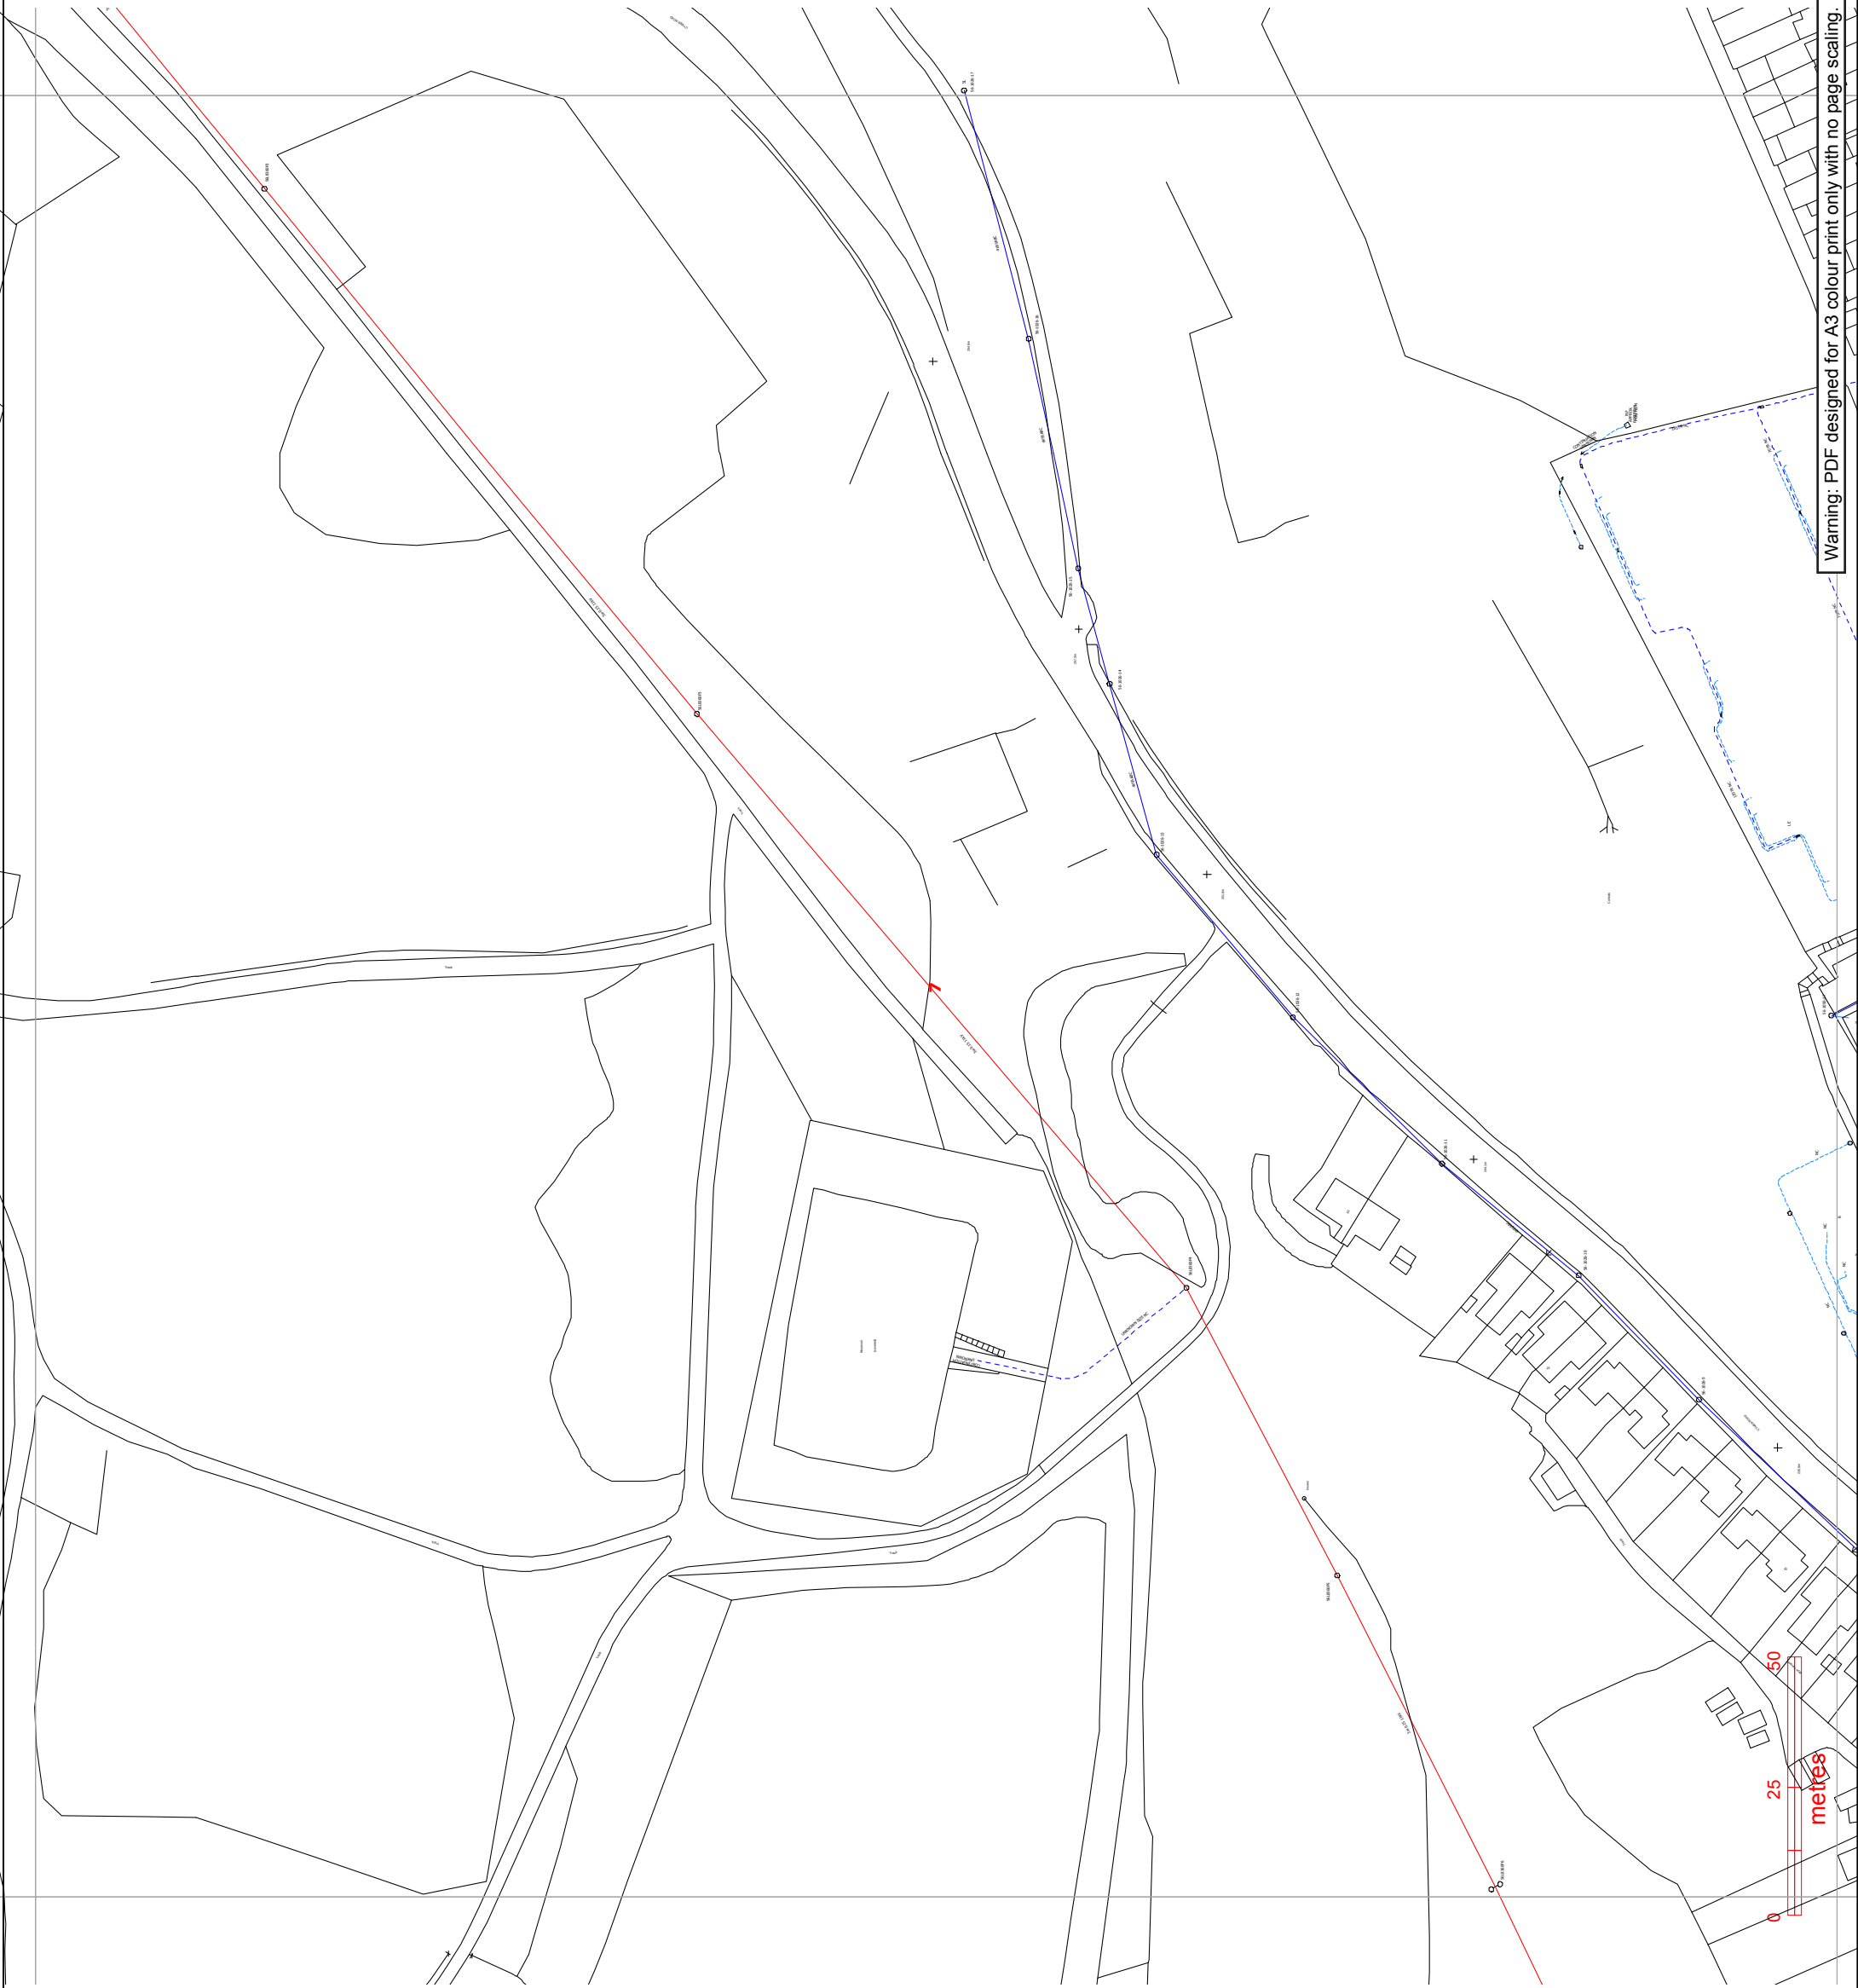


Warning: PDF designed for A3 colour print only with no page scaling.




Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105

I. 1230 Aired on Circle Kig site


- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables/using a cable locator and by careful use of hand tools/ in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric/line you should follow the requirements of HSE/ Guidance Note GS6.
- For further advice on working near our electric/ cables or lines, call our Contact Centre on 0800 090/ 3080.
- Advice should be sought from the Western Power/ Distribution Contact Centre for any work that is to/ take place in proximity to 66kV or 132kV underground/ cables and 66kV 132kV overhead lines – 0800 090/ 3080

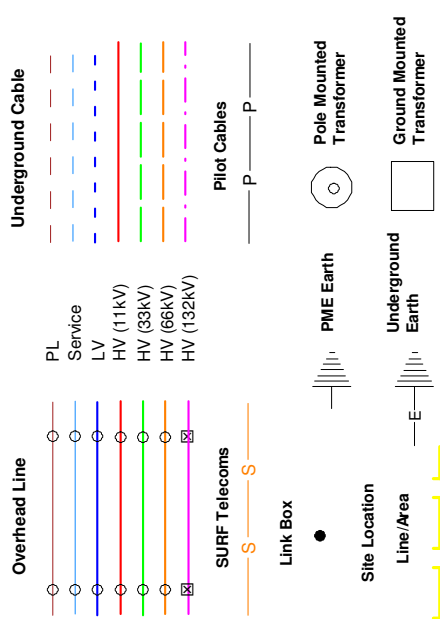

Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022488, 100024877 & 100021807.

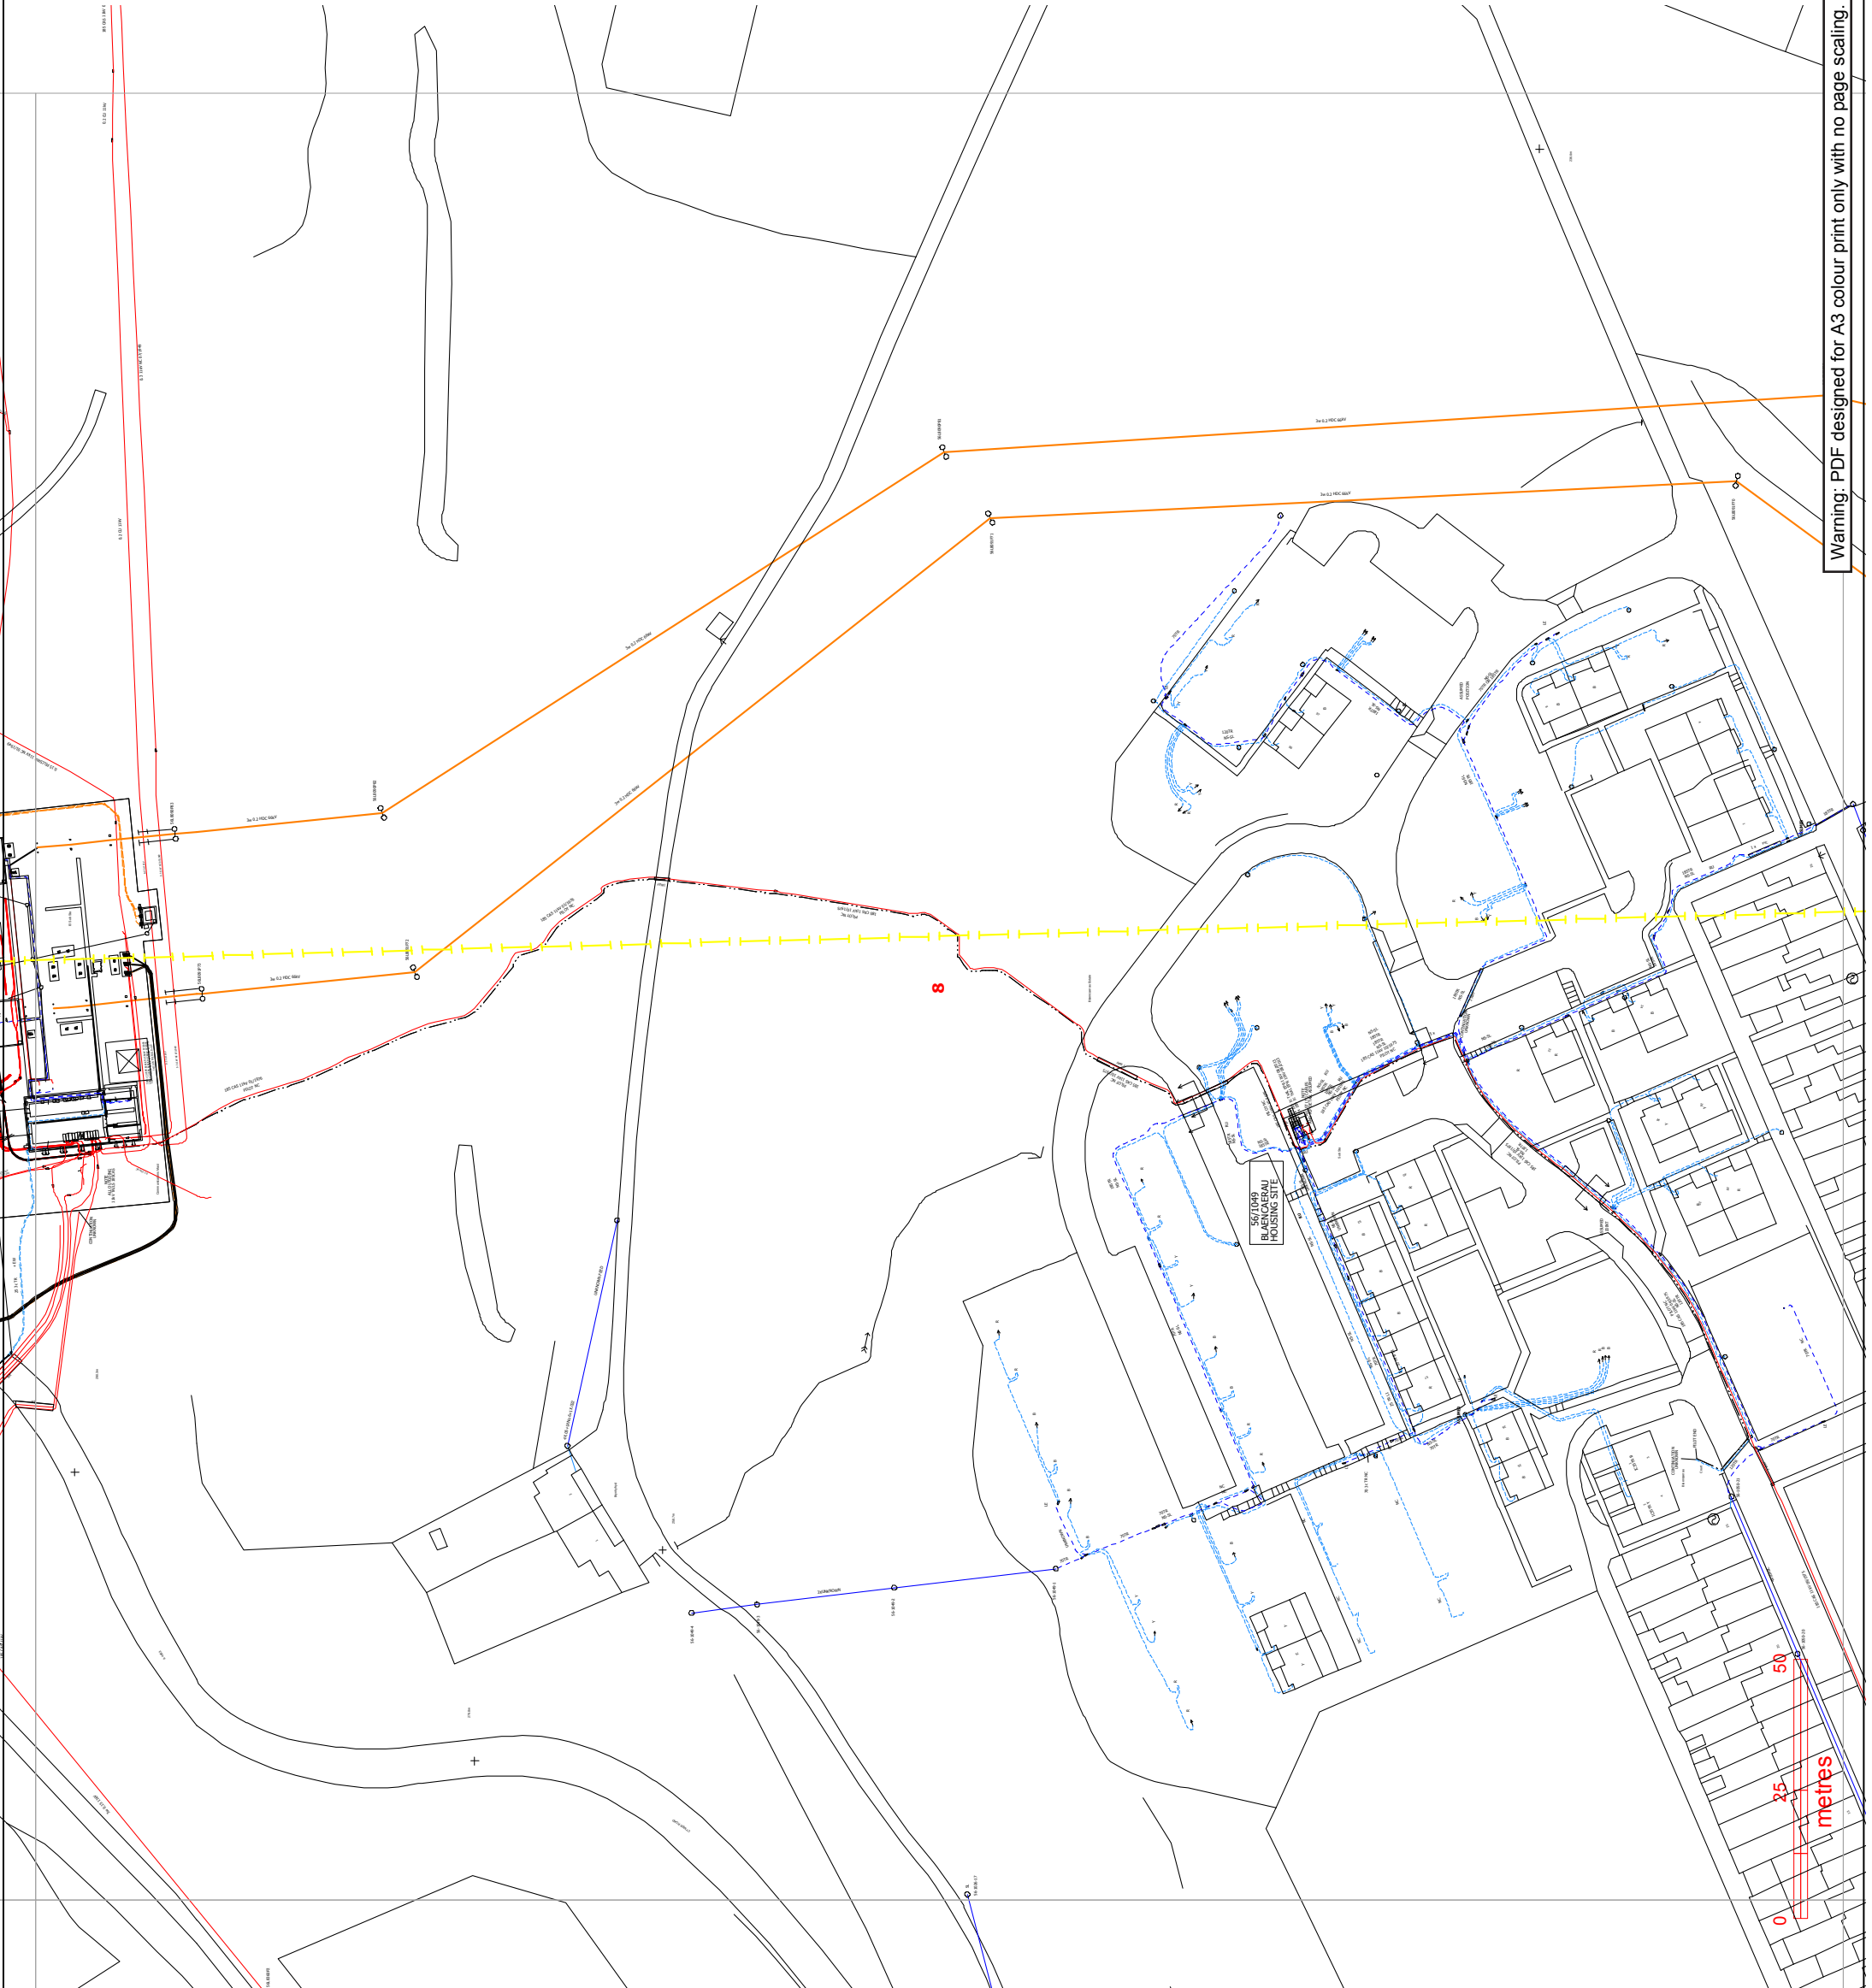

Warning: PDF designed for A3 colour print only with no page scaling.

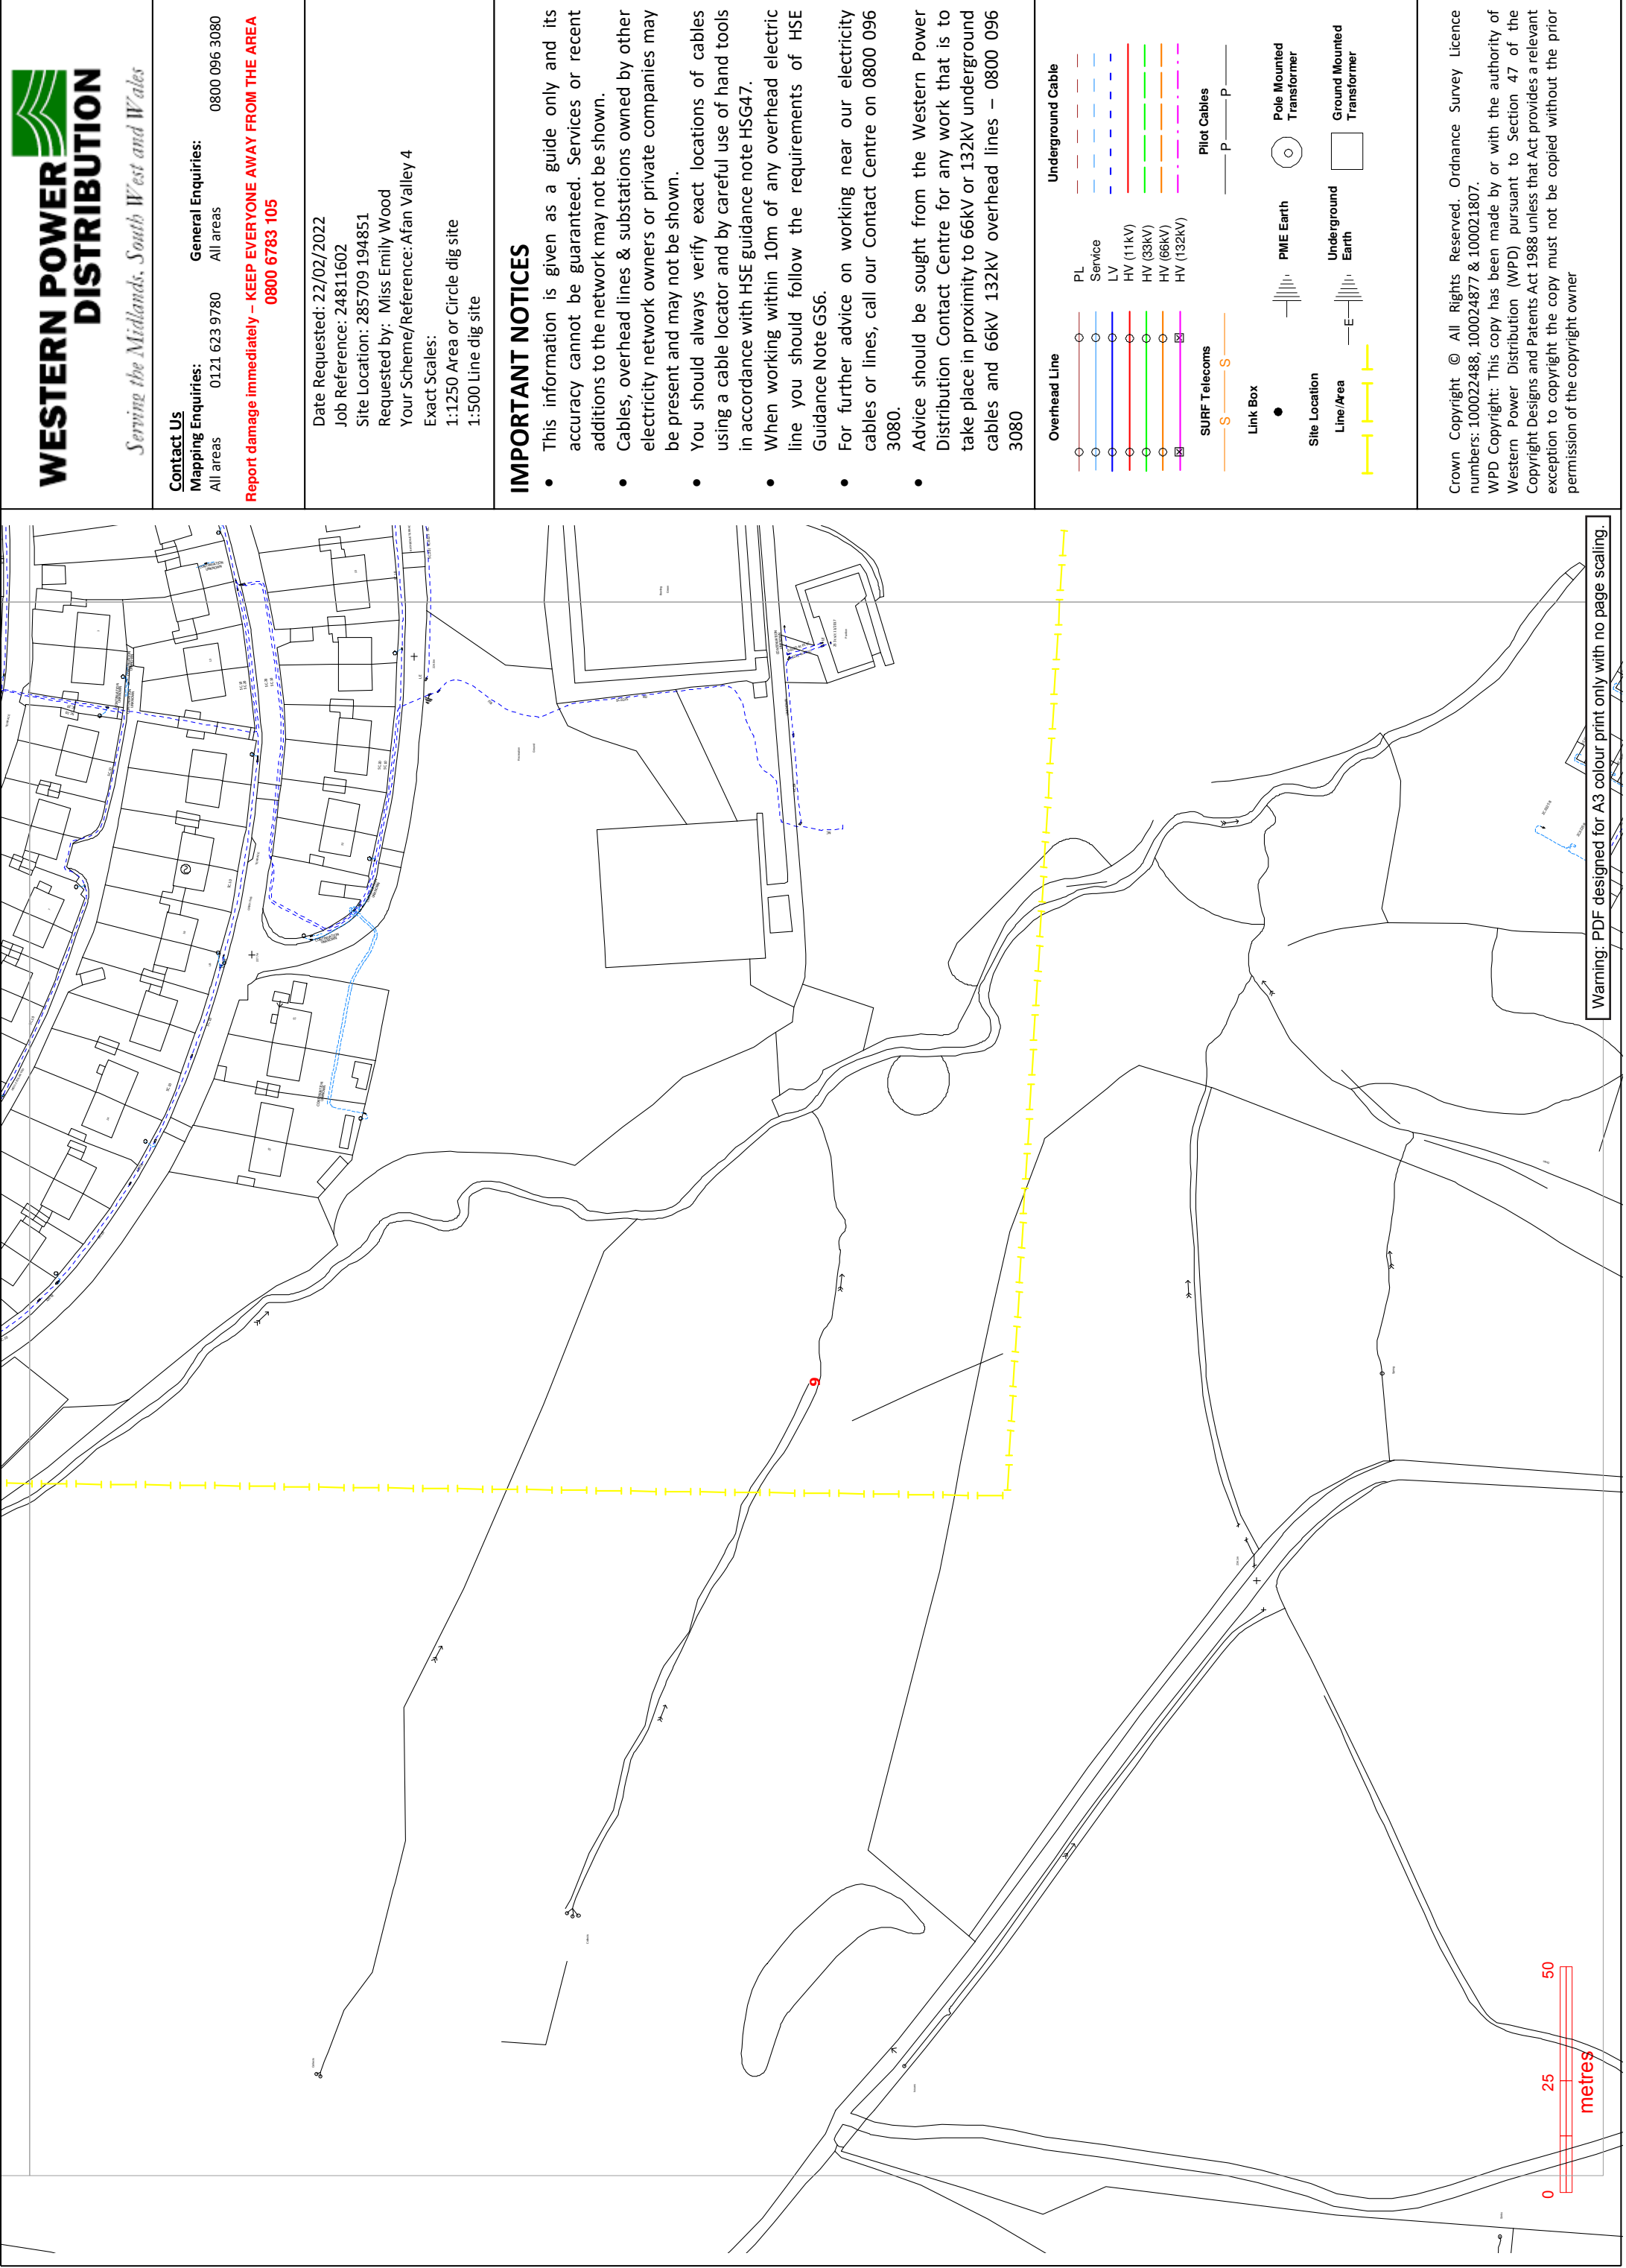



WESTERN POWER

DISTRIBUTION

Serving the Midlands, South West and Wales

Contact Us

Mapping Enquiries:
All areas

General Enquiries:
All areas

0121 623 9780

0800 096 3080

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105

Date Requested: 22/02/2022

Job Reference: 24811602

Site Location: 285709 194851

Requested by: Miss Emily Wood


Your Scheme/Reference: Afan Valley 4

Exact Scales:
1:1250 Area or Circle dig site
1:500 Line dig site


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the Western Power Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

Overhead Line




Underground Cable



SURF Telecoms



Pilot Cables



Link Box



PME Earth



Site Location



Ground Mounted Transformer



Underground Earth




Line/Area



Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 10002488, 100024877 & 100021807.

WPD Copyright: This copy has been made by or with the authority of Western Power Distribution (WPD) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner

Plans generated by DigSAFE Pro (tm) software provided by LinesearchbeforeUdig

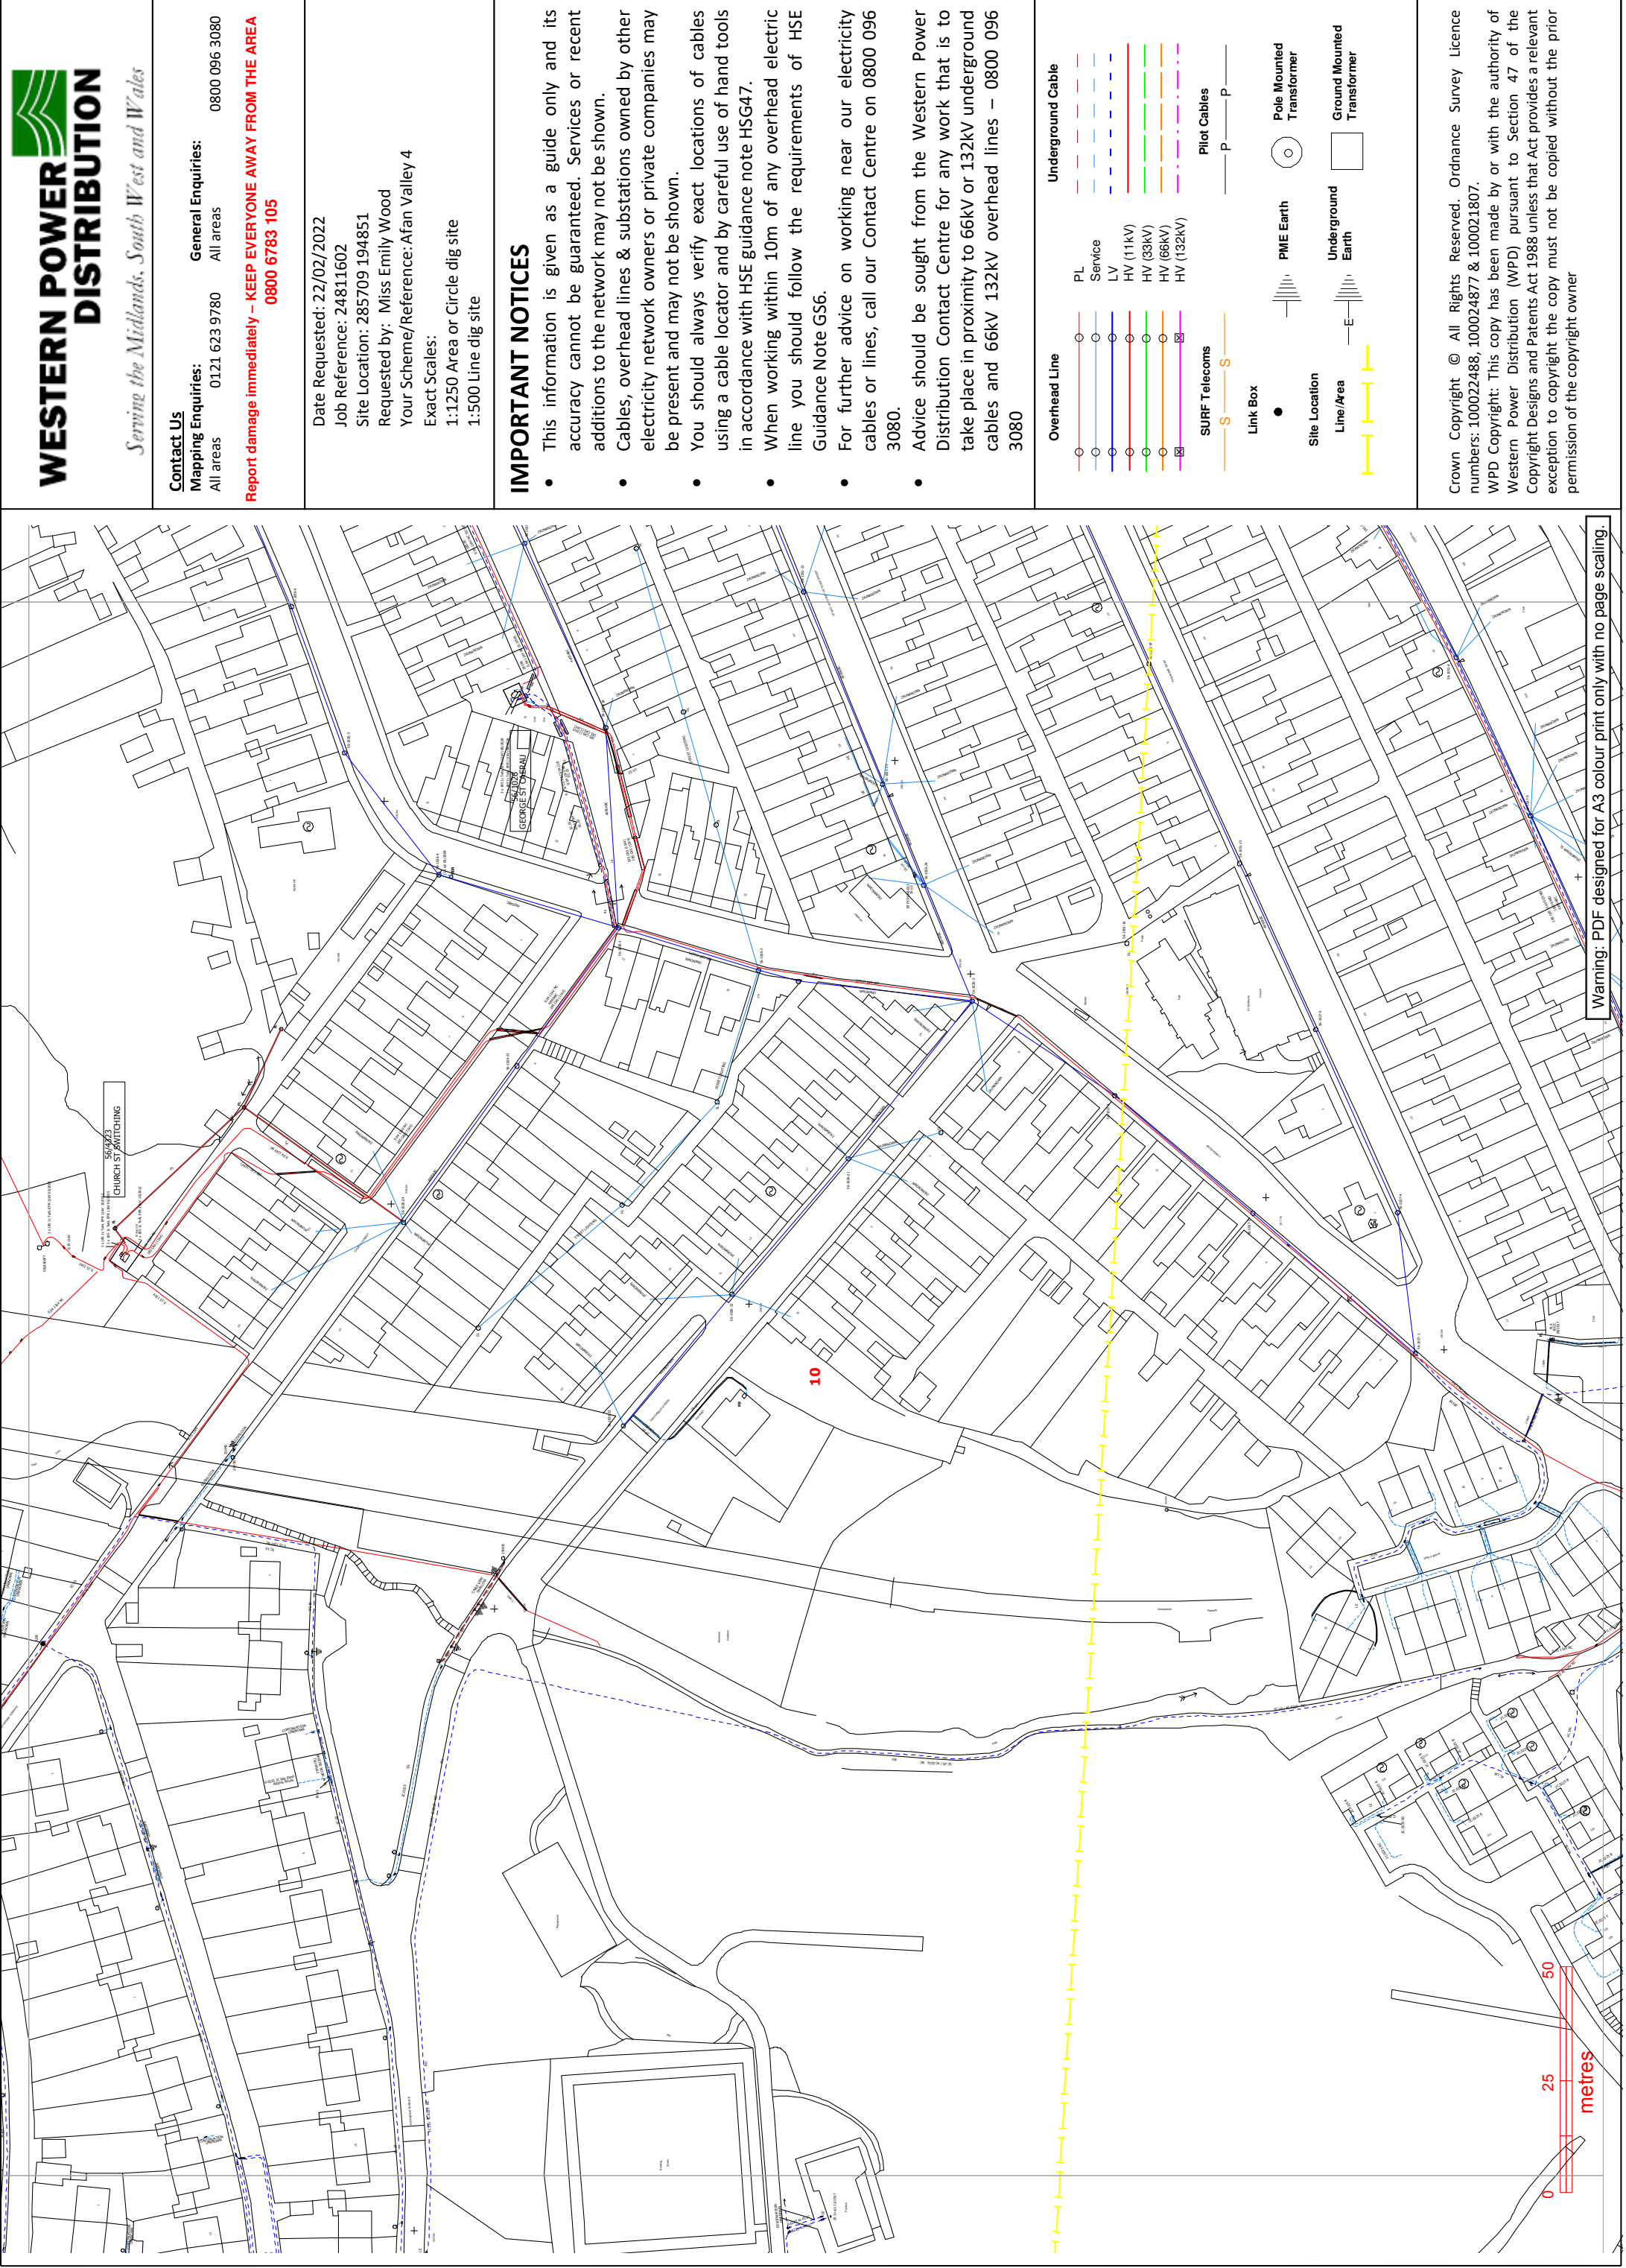

Warning: PDF designed for A3 colour print only with no page scaling.



WESTERN POWER

DISTRIBUTION

Serving the Midlands, South West and Wales

Contact Us

Mapping Enquiries:

All areas

General Enquiries:

All areas

0121 623 9780

0800 096 3080

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA

0800 6783 105

Date Requested: 22/02/2022

Job Reference: 24811602

Site Location: 285709 194851

Requested by: Miss Emily Wood

Your Scheme/Reference: Afan Valley 4

Exact Scales:

1:1250 Area or Circle dig site

1:500 Line dig site

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the Western Power Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

Overhead Line

PL

Service

LV

HV (11kV)

HV (33kV)

HV (66kV)

HV (132kV)

Underground Cable

PL

Service

LV

HV (11kV)

HV (33kV)

HV (66kV)

HV (132kV)

SURF Telecoms

S

S

Pilot Cables

P

P

Link Box

●

PME Earth

⊕

Pole Mounted Transformer

⊙

Site Location

●

Underground Earth

⊕

Ground Mounted Transformer

⊙

Line/Area

—

—

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022488, 100024877 & 100021807.


WPD Copyright: This copy has been made by or with the authority of Western Power Distribution (WPD) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner

Plans generated by DigSAFE Pro (tm) software provided by LinesearchbeforeUdig


Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105

1:1250 Area or Circle dig site


- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the Western Power Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

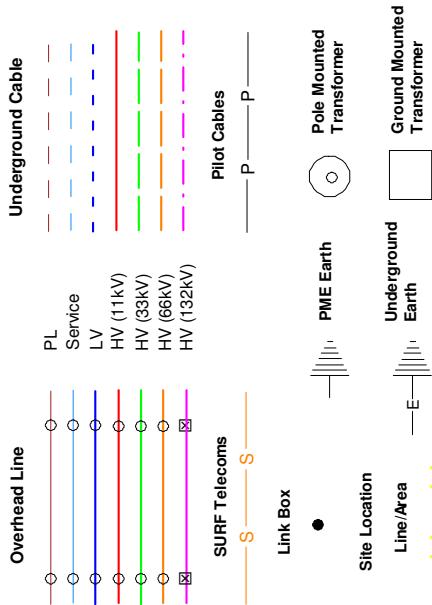

Crown Copyright © All Rights Reserved. Ordnance Survey Licence
 numbers: 100022488, 100024877 & 100021807.
 WPD Copyright: This copy has been made by or with the authority of
 Western Power Distribution (WPD) pursuant to Section 47 of the
 Copyright Designs and Patents Act 1988 unless that Act provides a relevant
 exception to copyright the copy must not be copied without the prior
 permission of the copyright owner

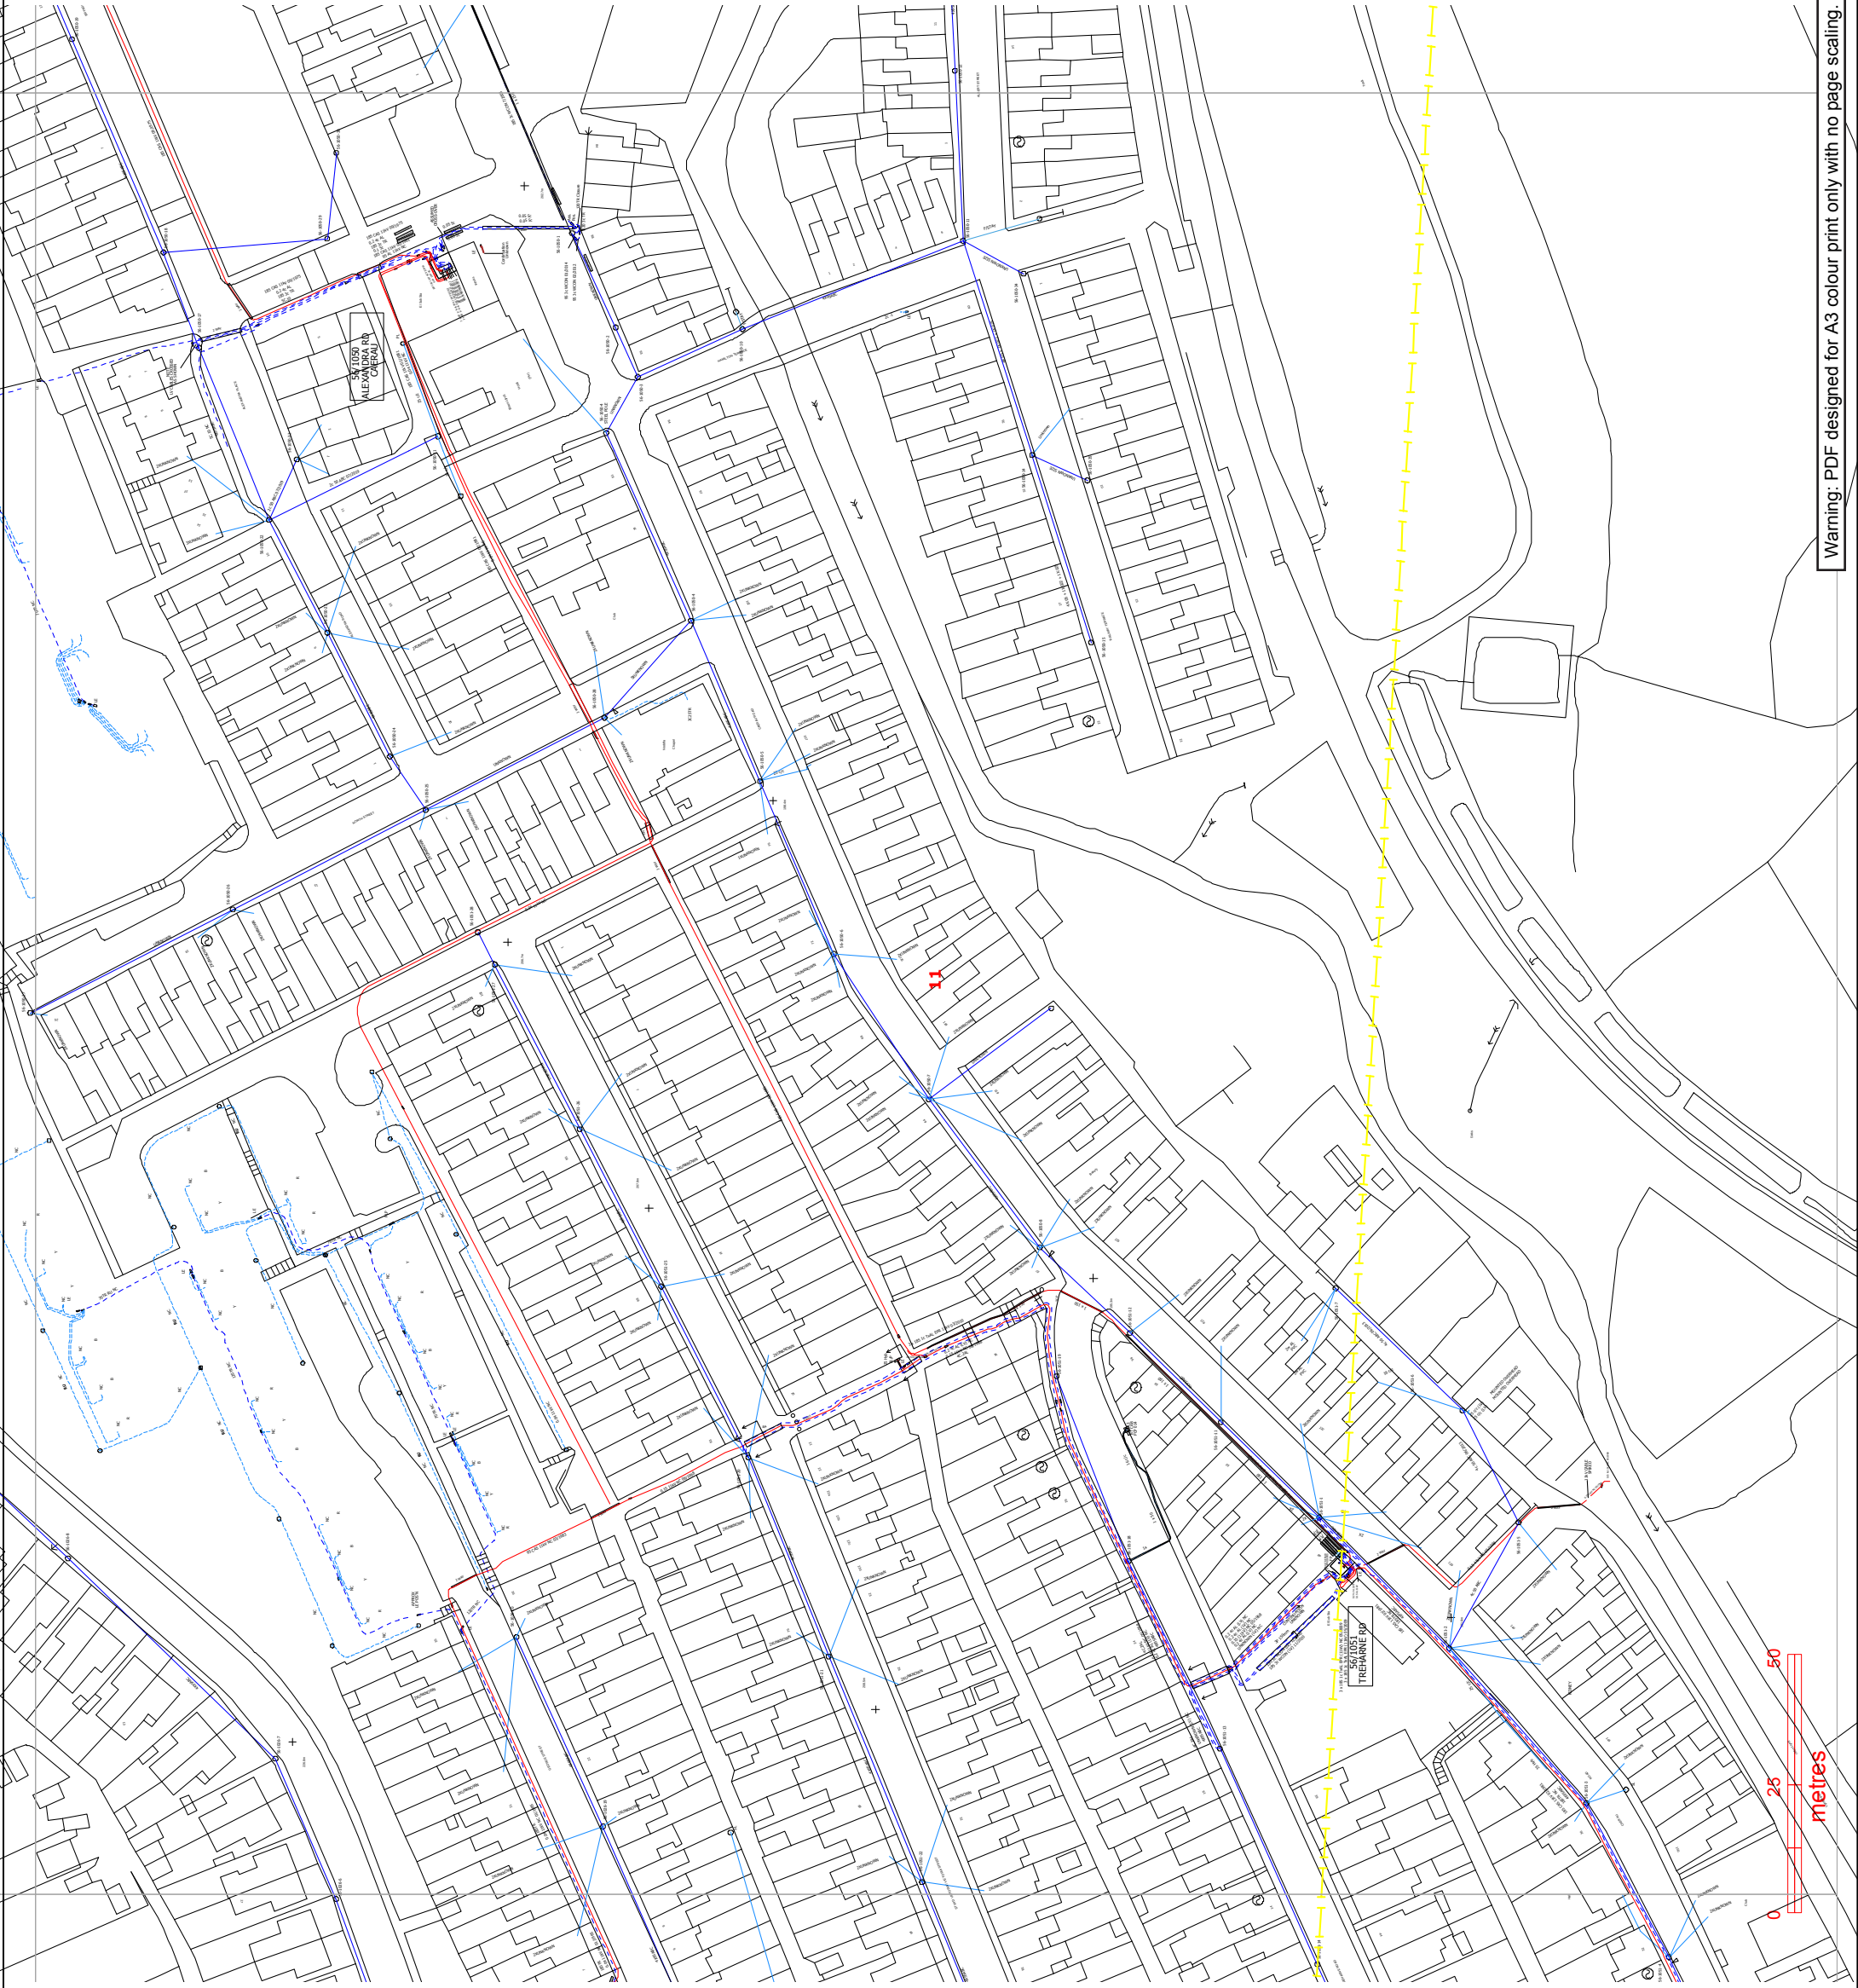

Warning: PDF designed for A3 colour print only with no page scaling.



Mapping Enquiries:

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105

Job Reference: 24811602


Requested by: Miss Emily Wood

Five of Cooper's


ALL INFORMATION CONTAINED HEREIN IS UNCLASSIFIED

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.


- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the Western Power

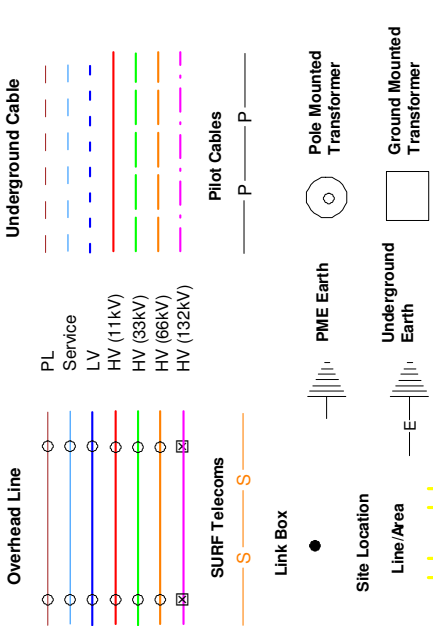


© Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022488, 100024877 & 100021807.

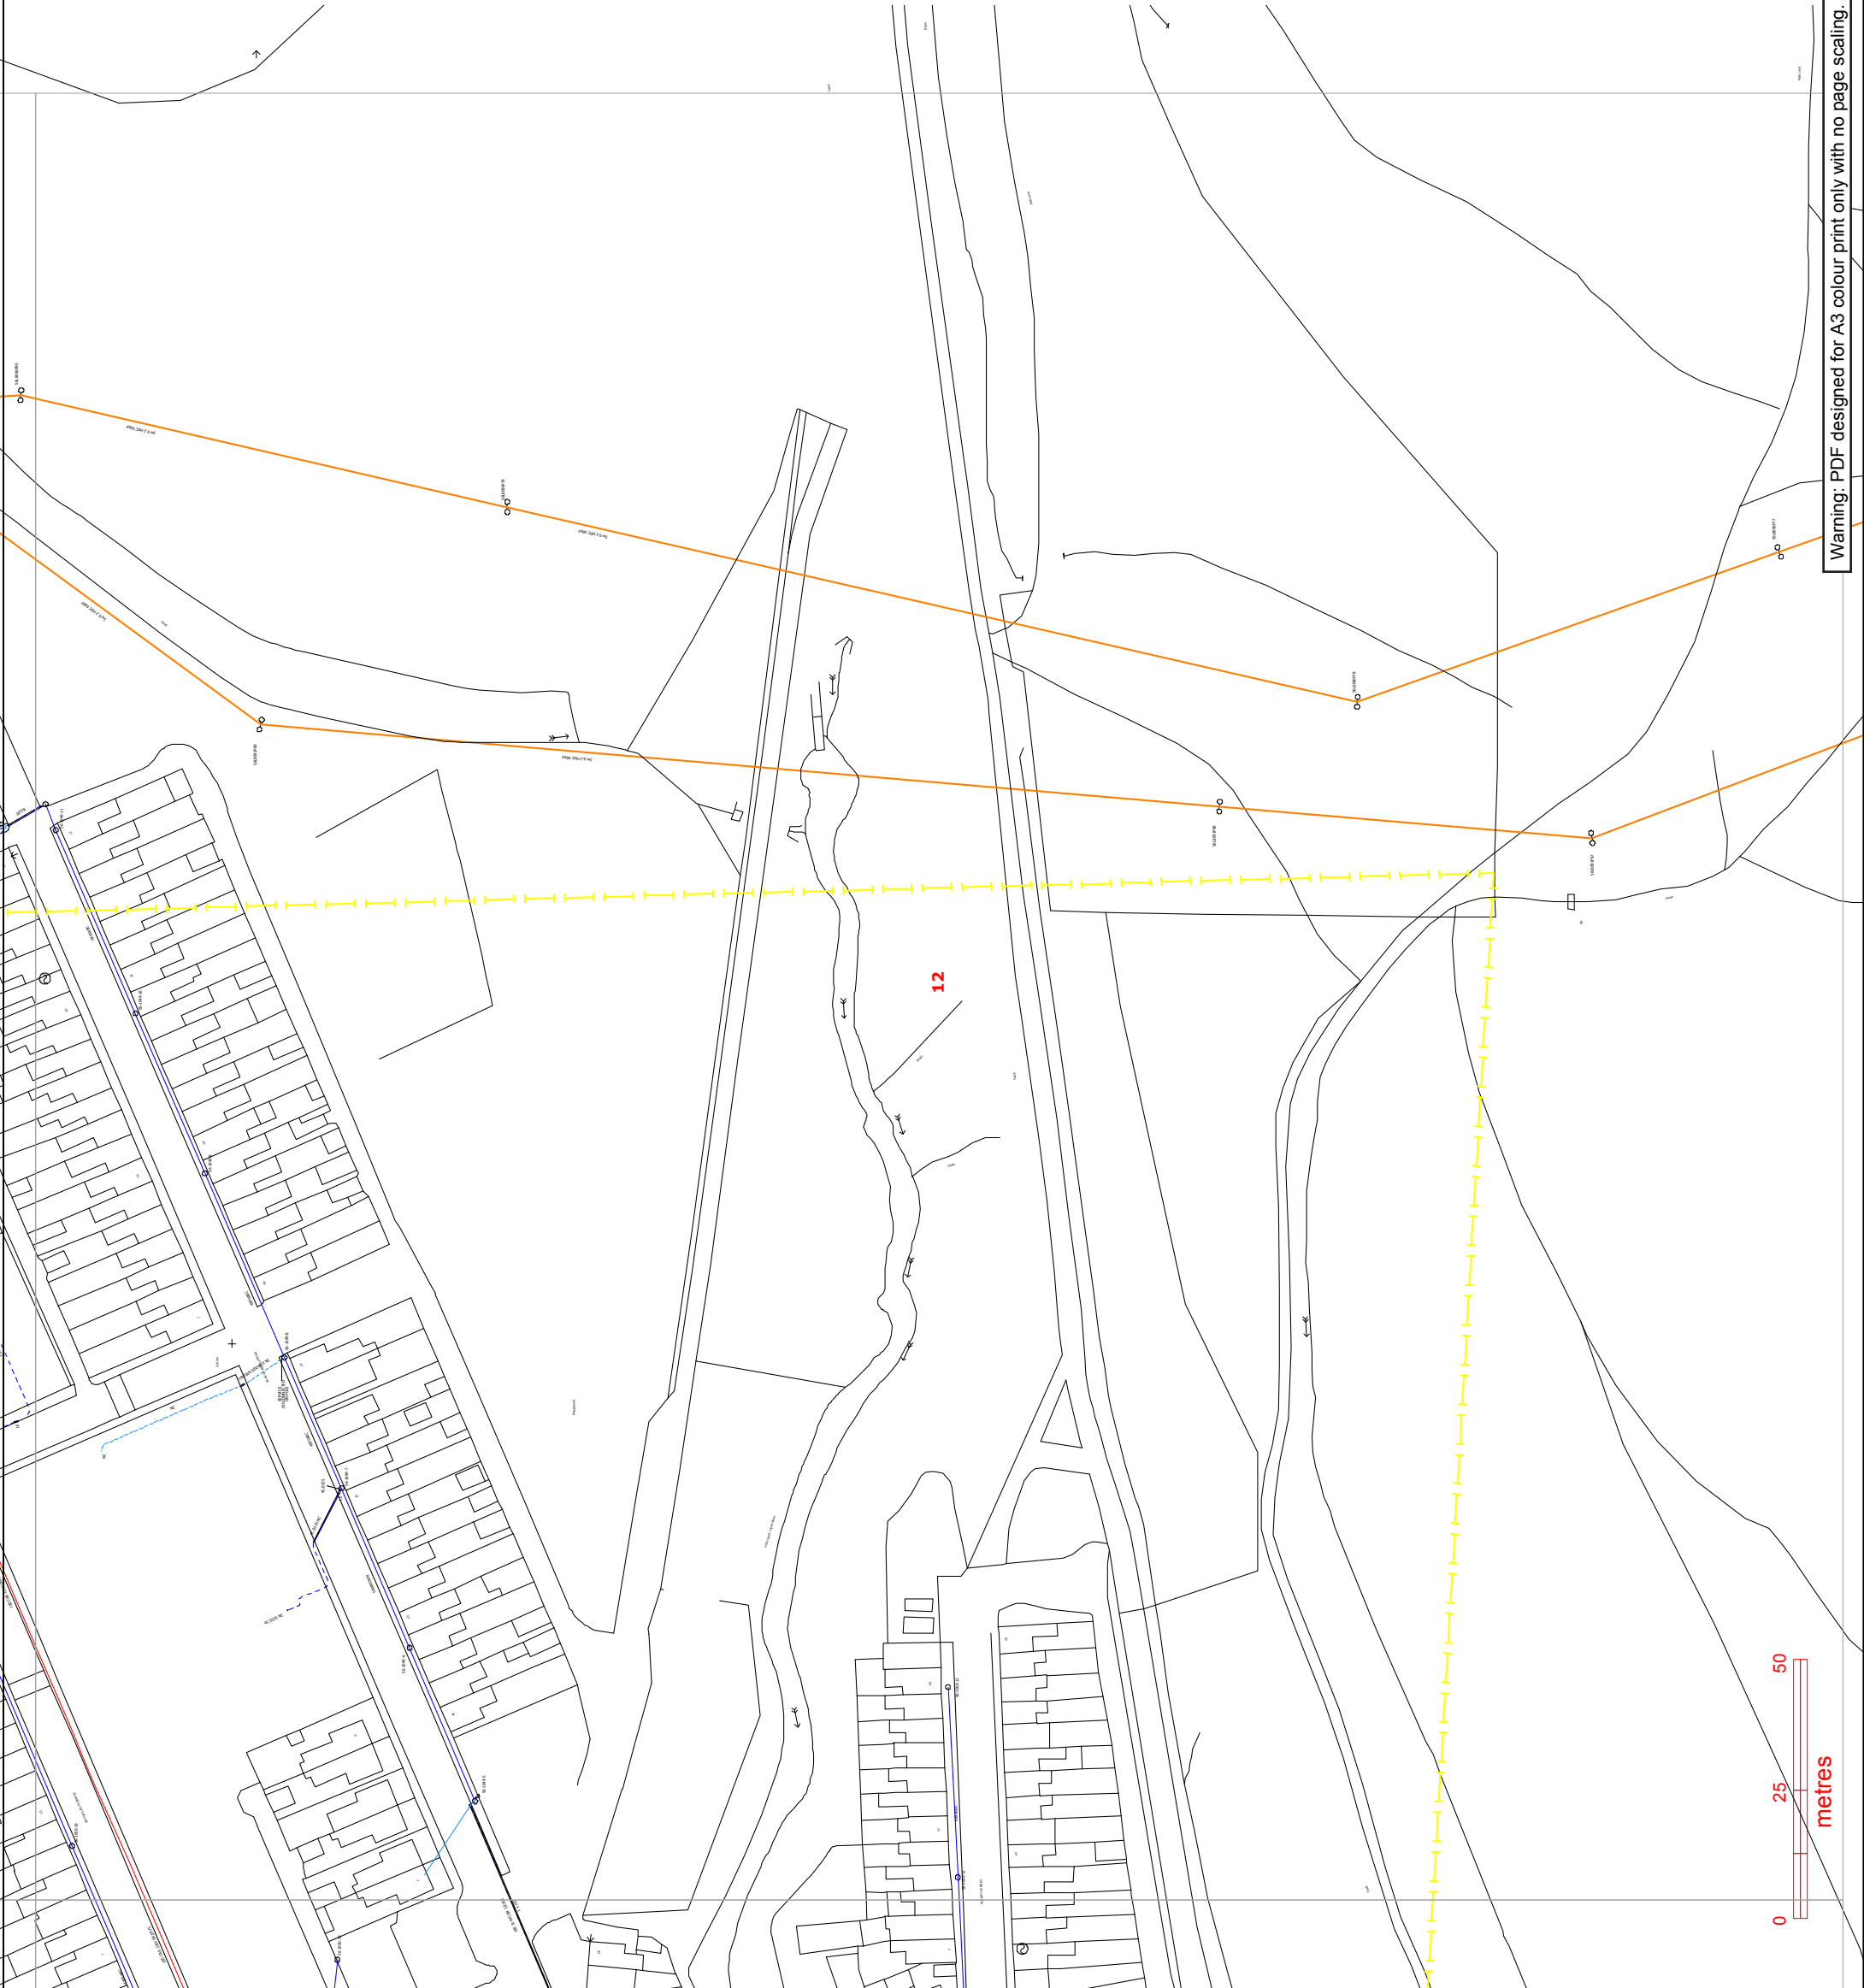

Warning: PDF designed for A3 colour print only with no page scaling.

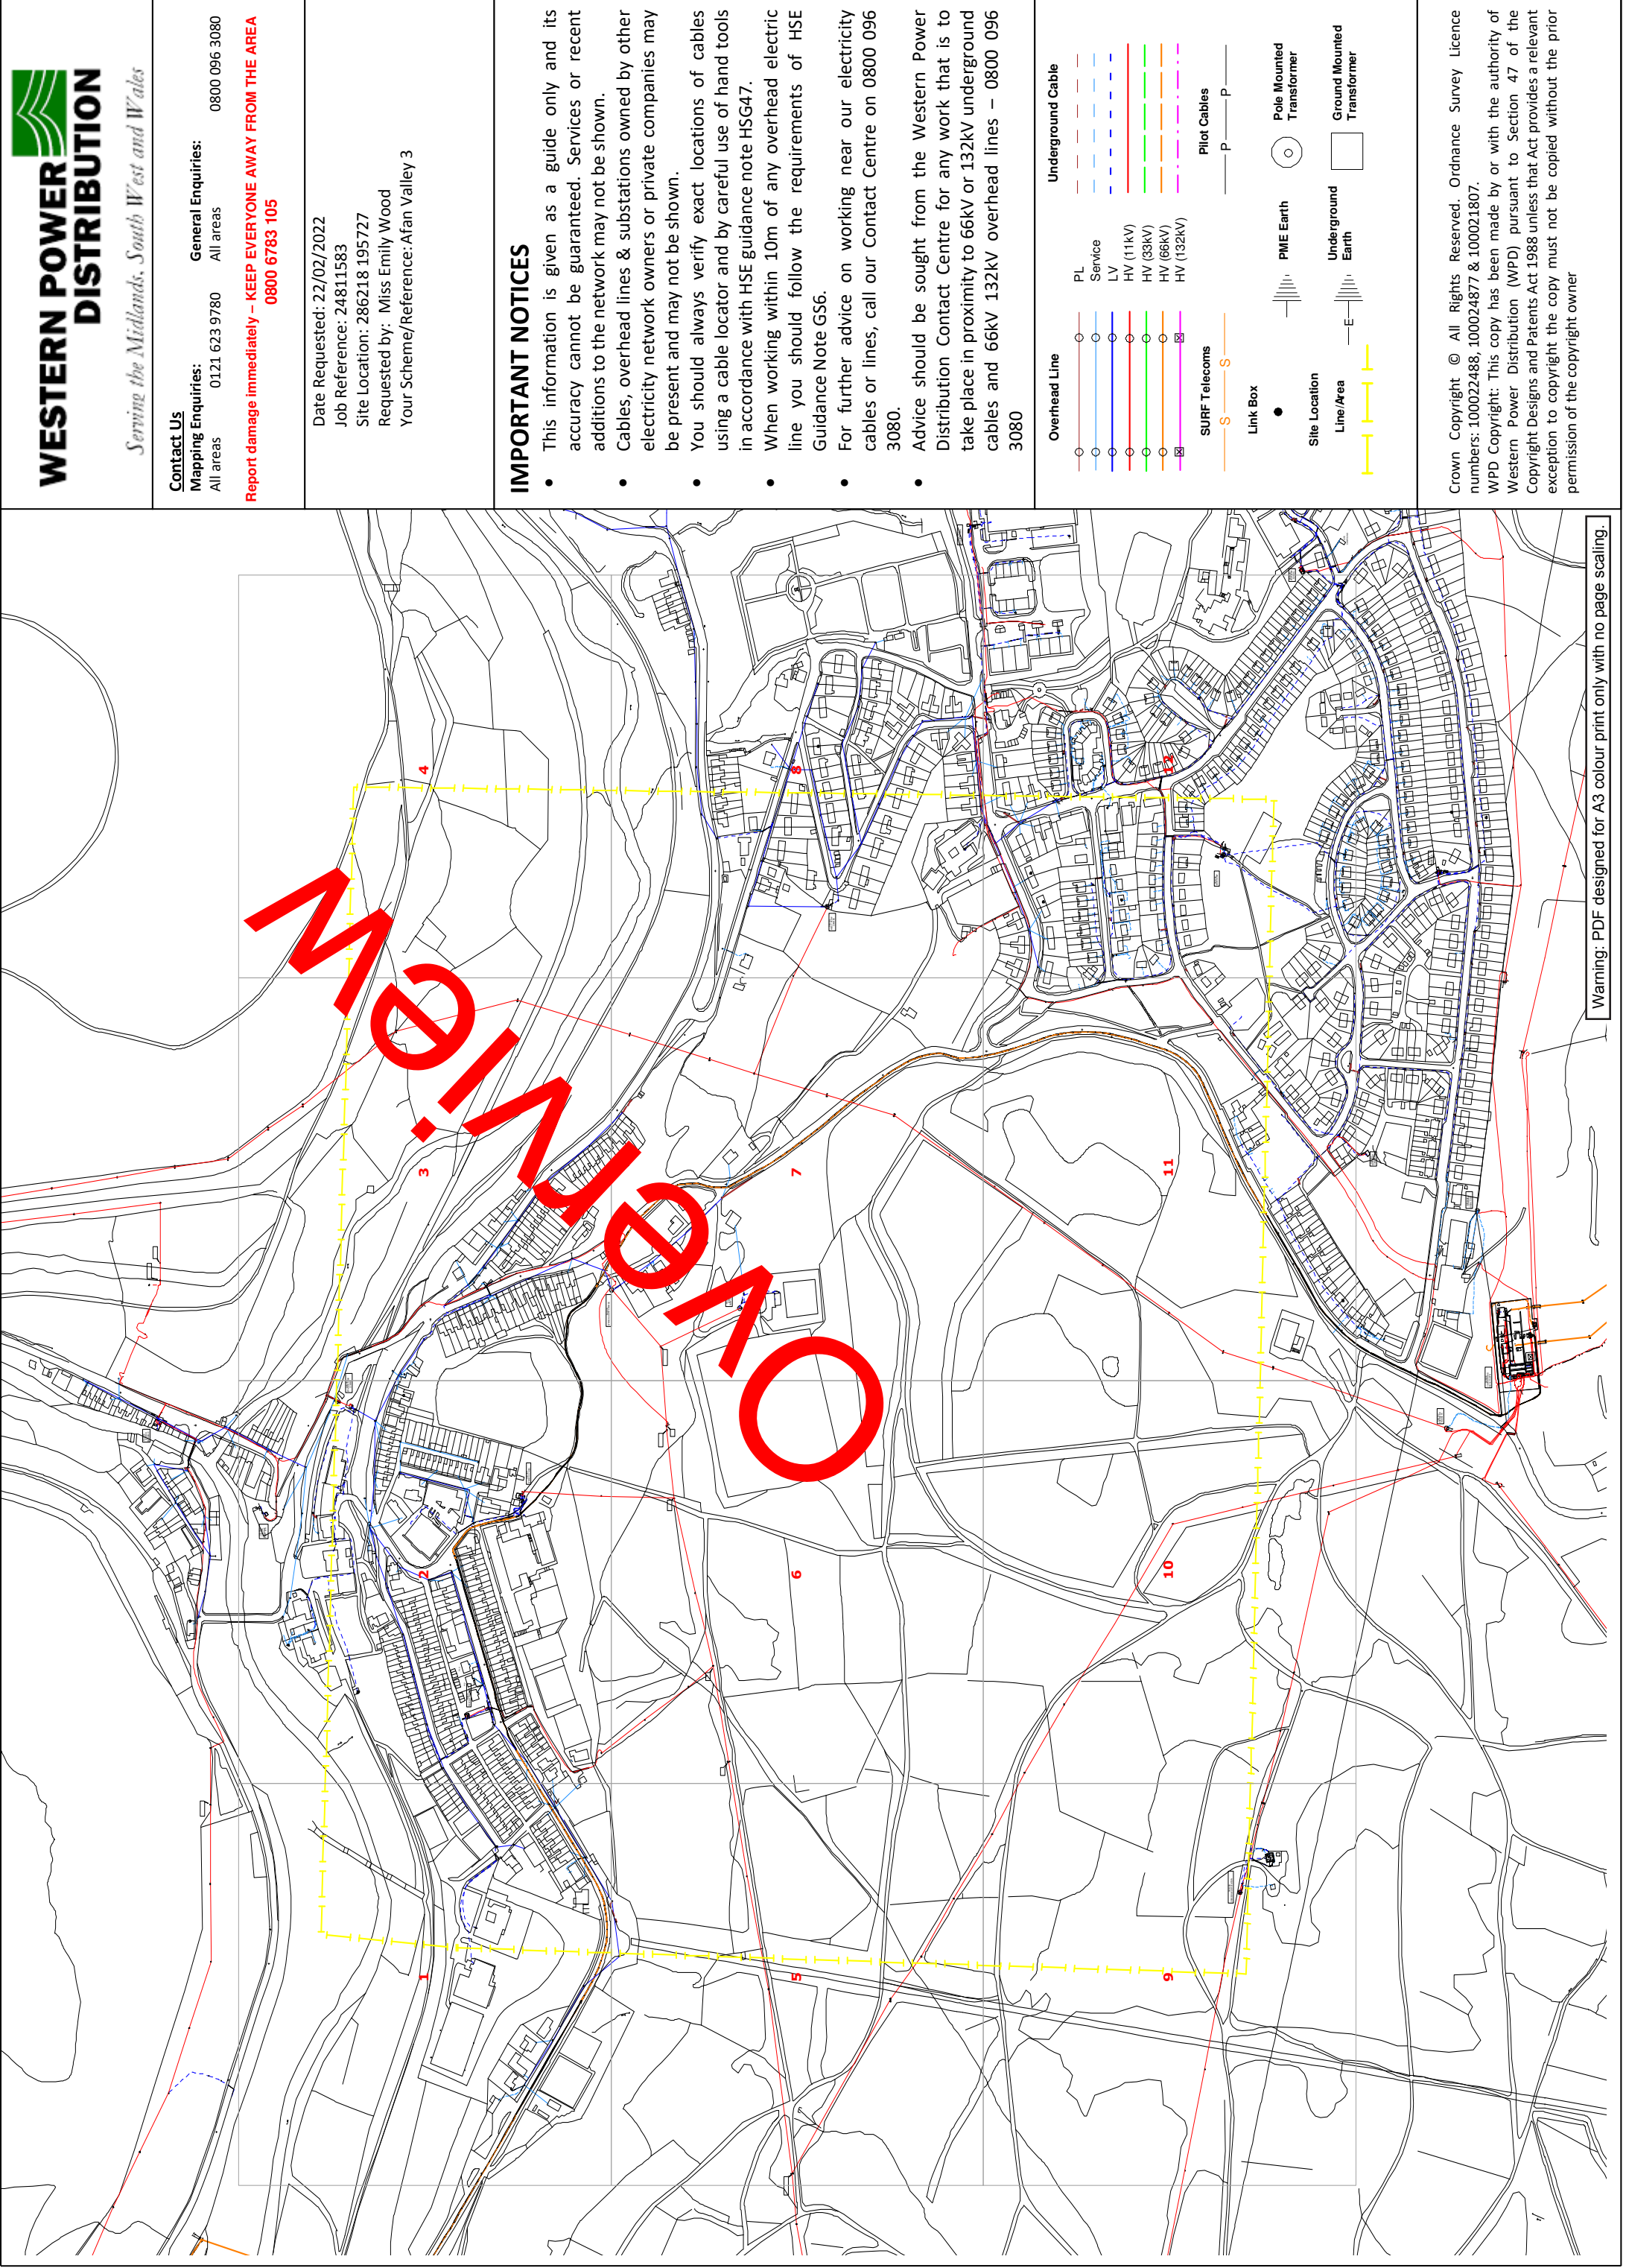

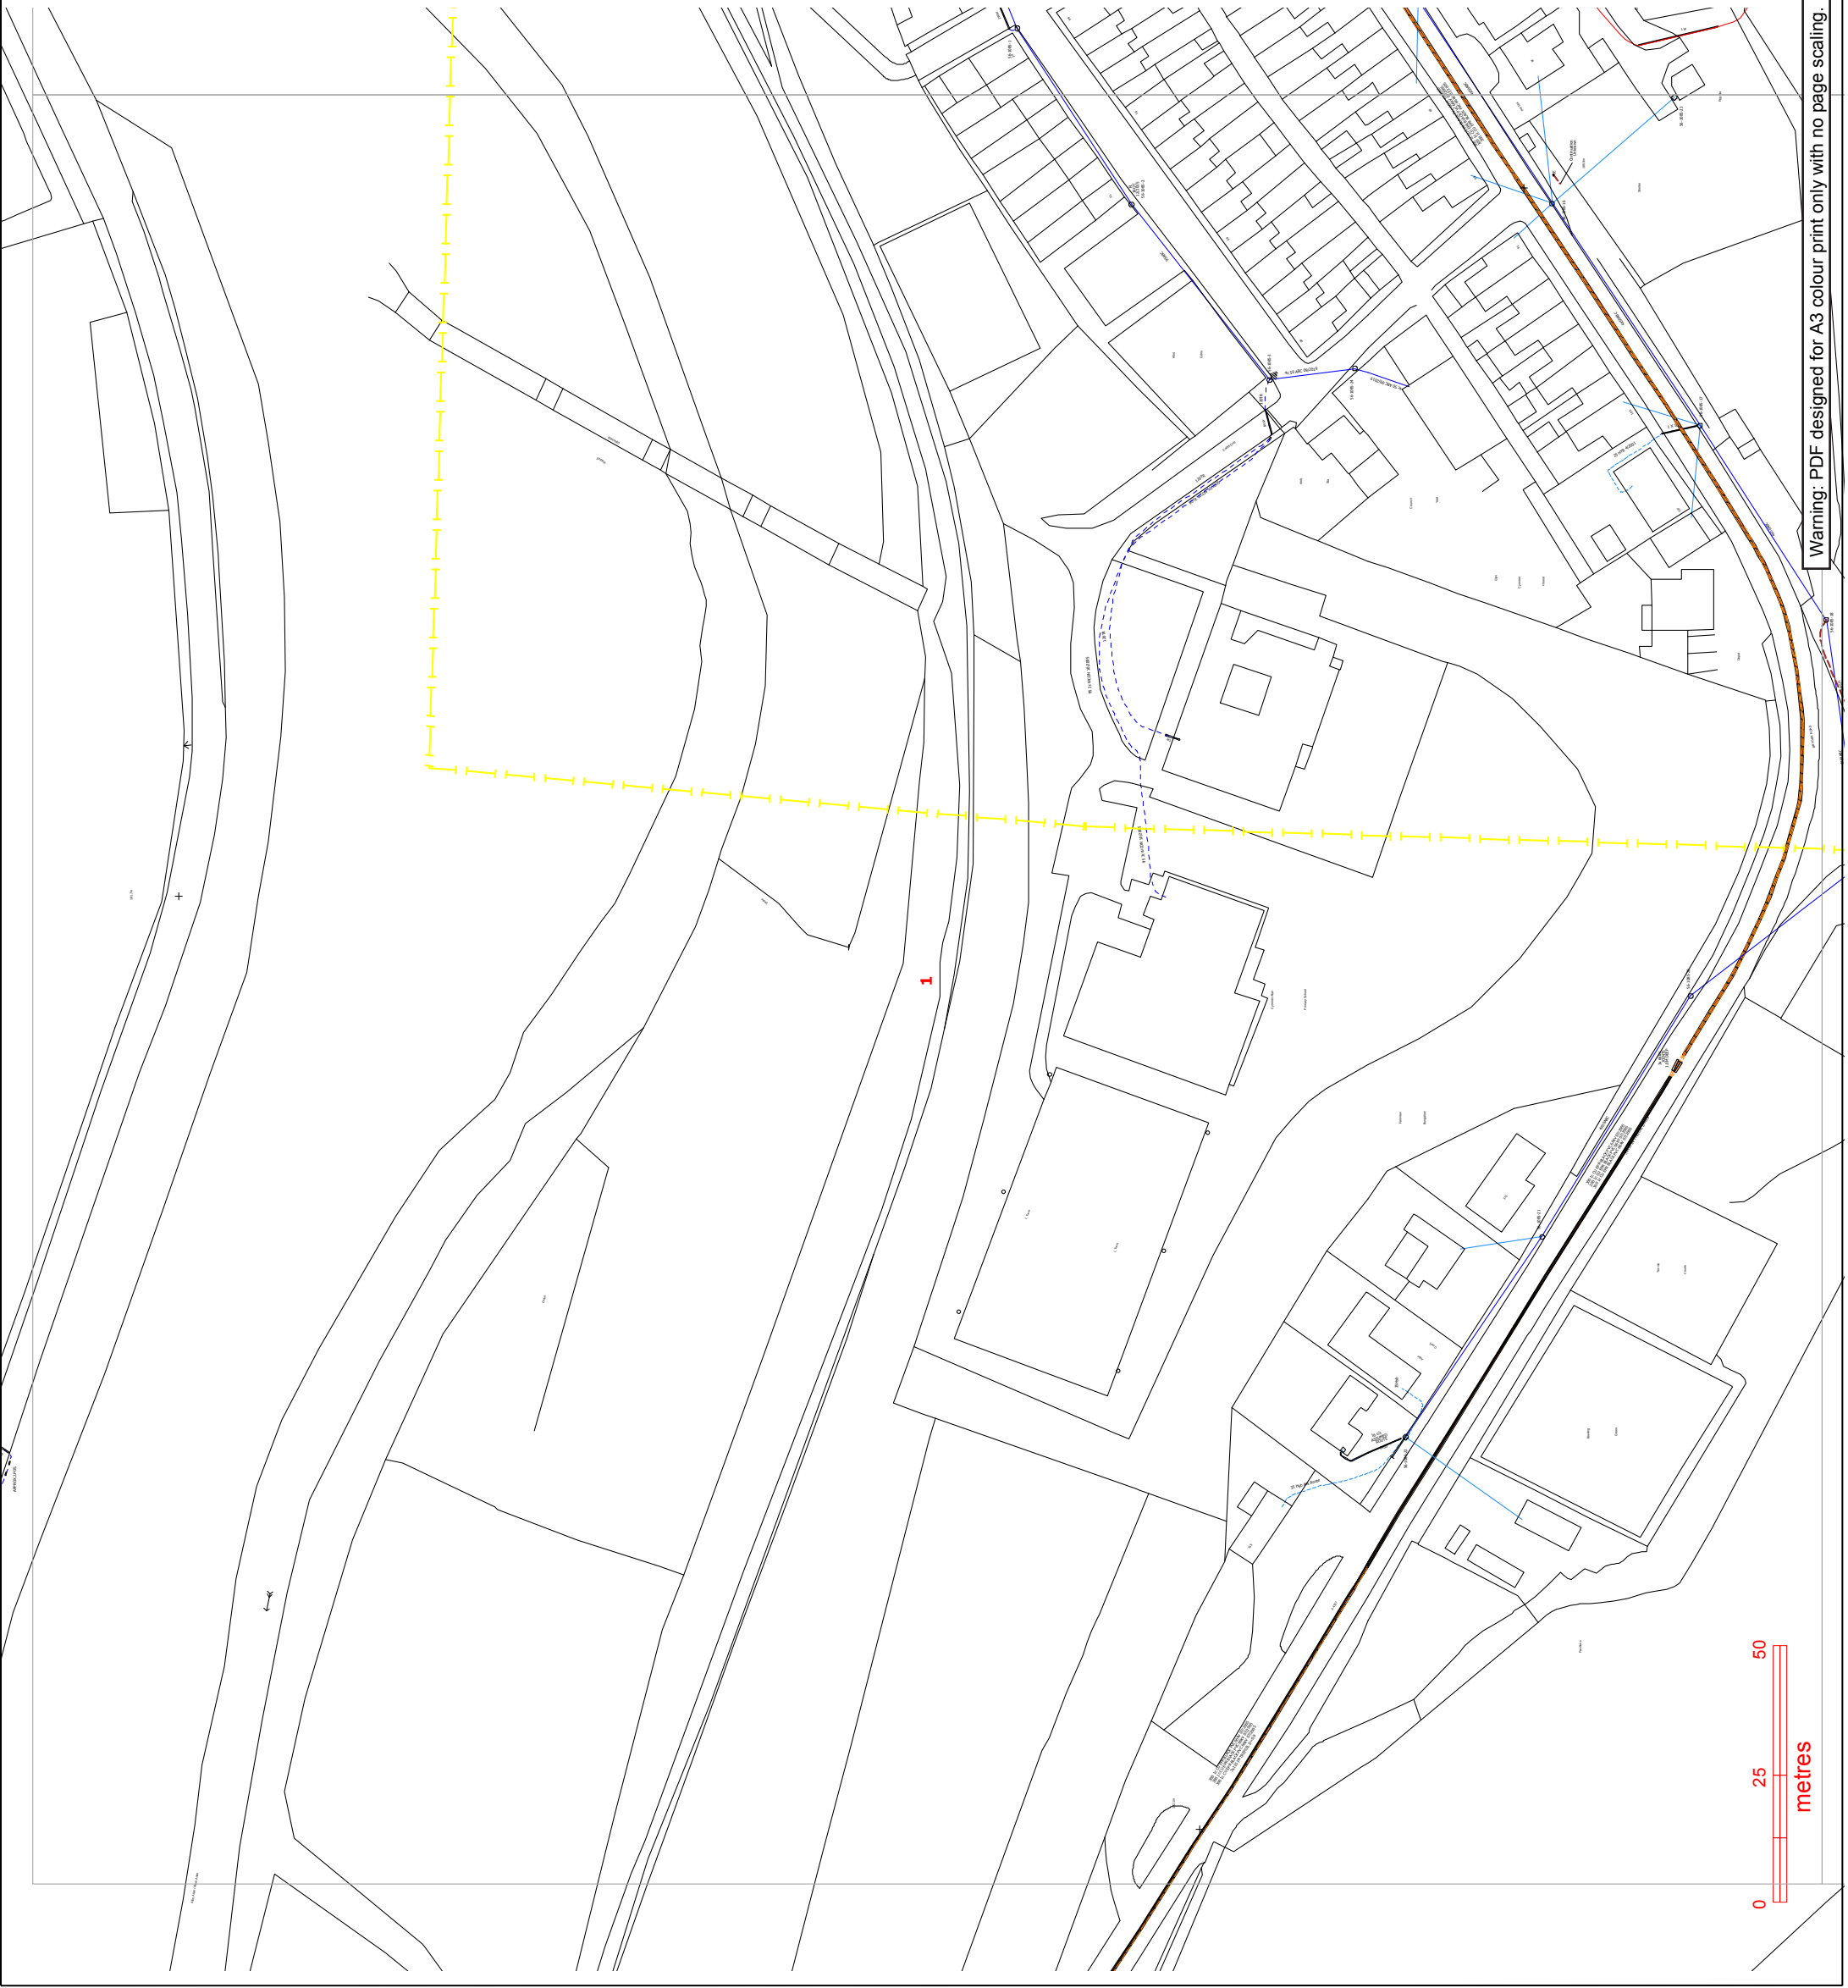

WESTERN POWER

DISTRIBUTION

Serving the Midlands, South West and Wales

Contact Us

Mapping Enquiries:

All areas

General Enquiries:

0121 623 9780

All areas

0800 096 3080

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA

0800 6783 105

Date Requested: 22/02/2022

Job Reference: 24811583

Site Location: 286218 195727

Requested by: Miss Emily Wood

Your Scheme/Reference: Afan Valley 3

Exact Scales:

1:1250 Area or Circle dig site

1:500 Line dig site

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the Western Power Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

Overhead Line

PL

Service

LV

HV (11kV)

HV (33kV)

HV (66kV)

HV (132kV)

Underground Cable

PL

Service

LV

HV (11kV)

HV (33kV)

HV (66kV)

HV (132kV)

SURF Telecoms

S

S

Pilot Cables

P

P

Link Box

●

Site Location

○

Line/Area

E

E

Pole Mounted Transformer

○


Ground Mounted Transformer

□

Underground Earth

—

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022488, 100024877 & 100021807.
WPD Copyright: This copy has been made by or with the authority of Western Power Distribution (WPD) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner

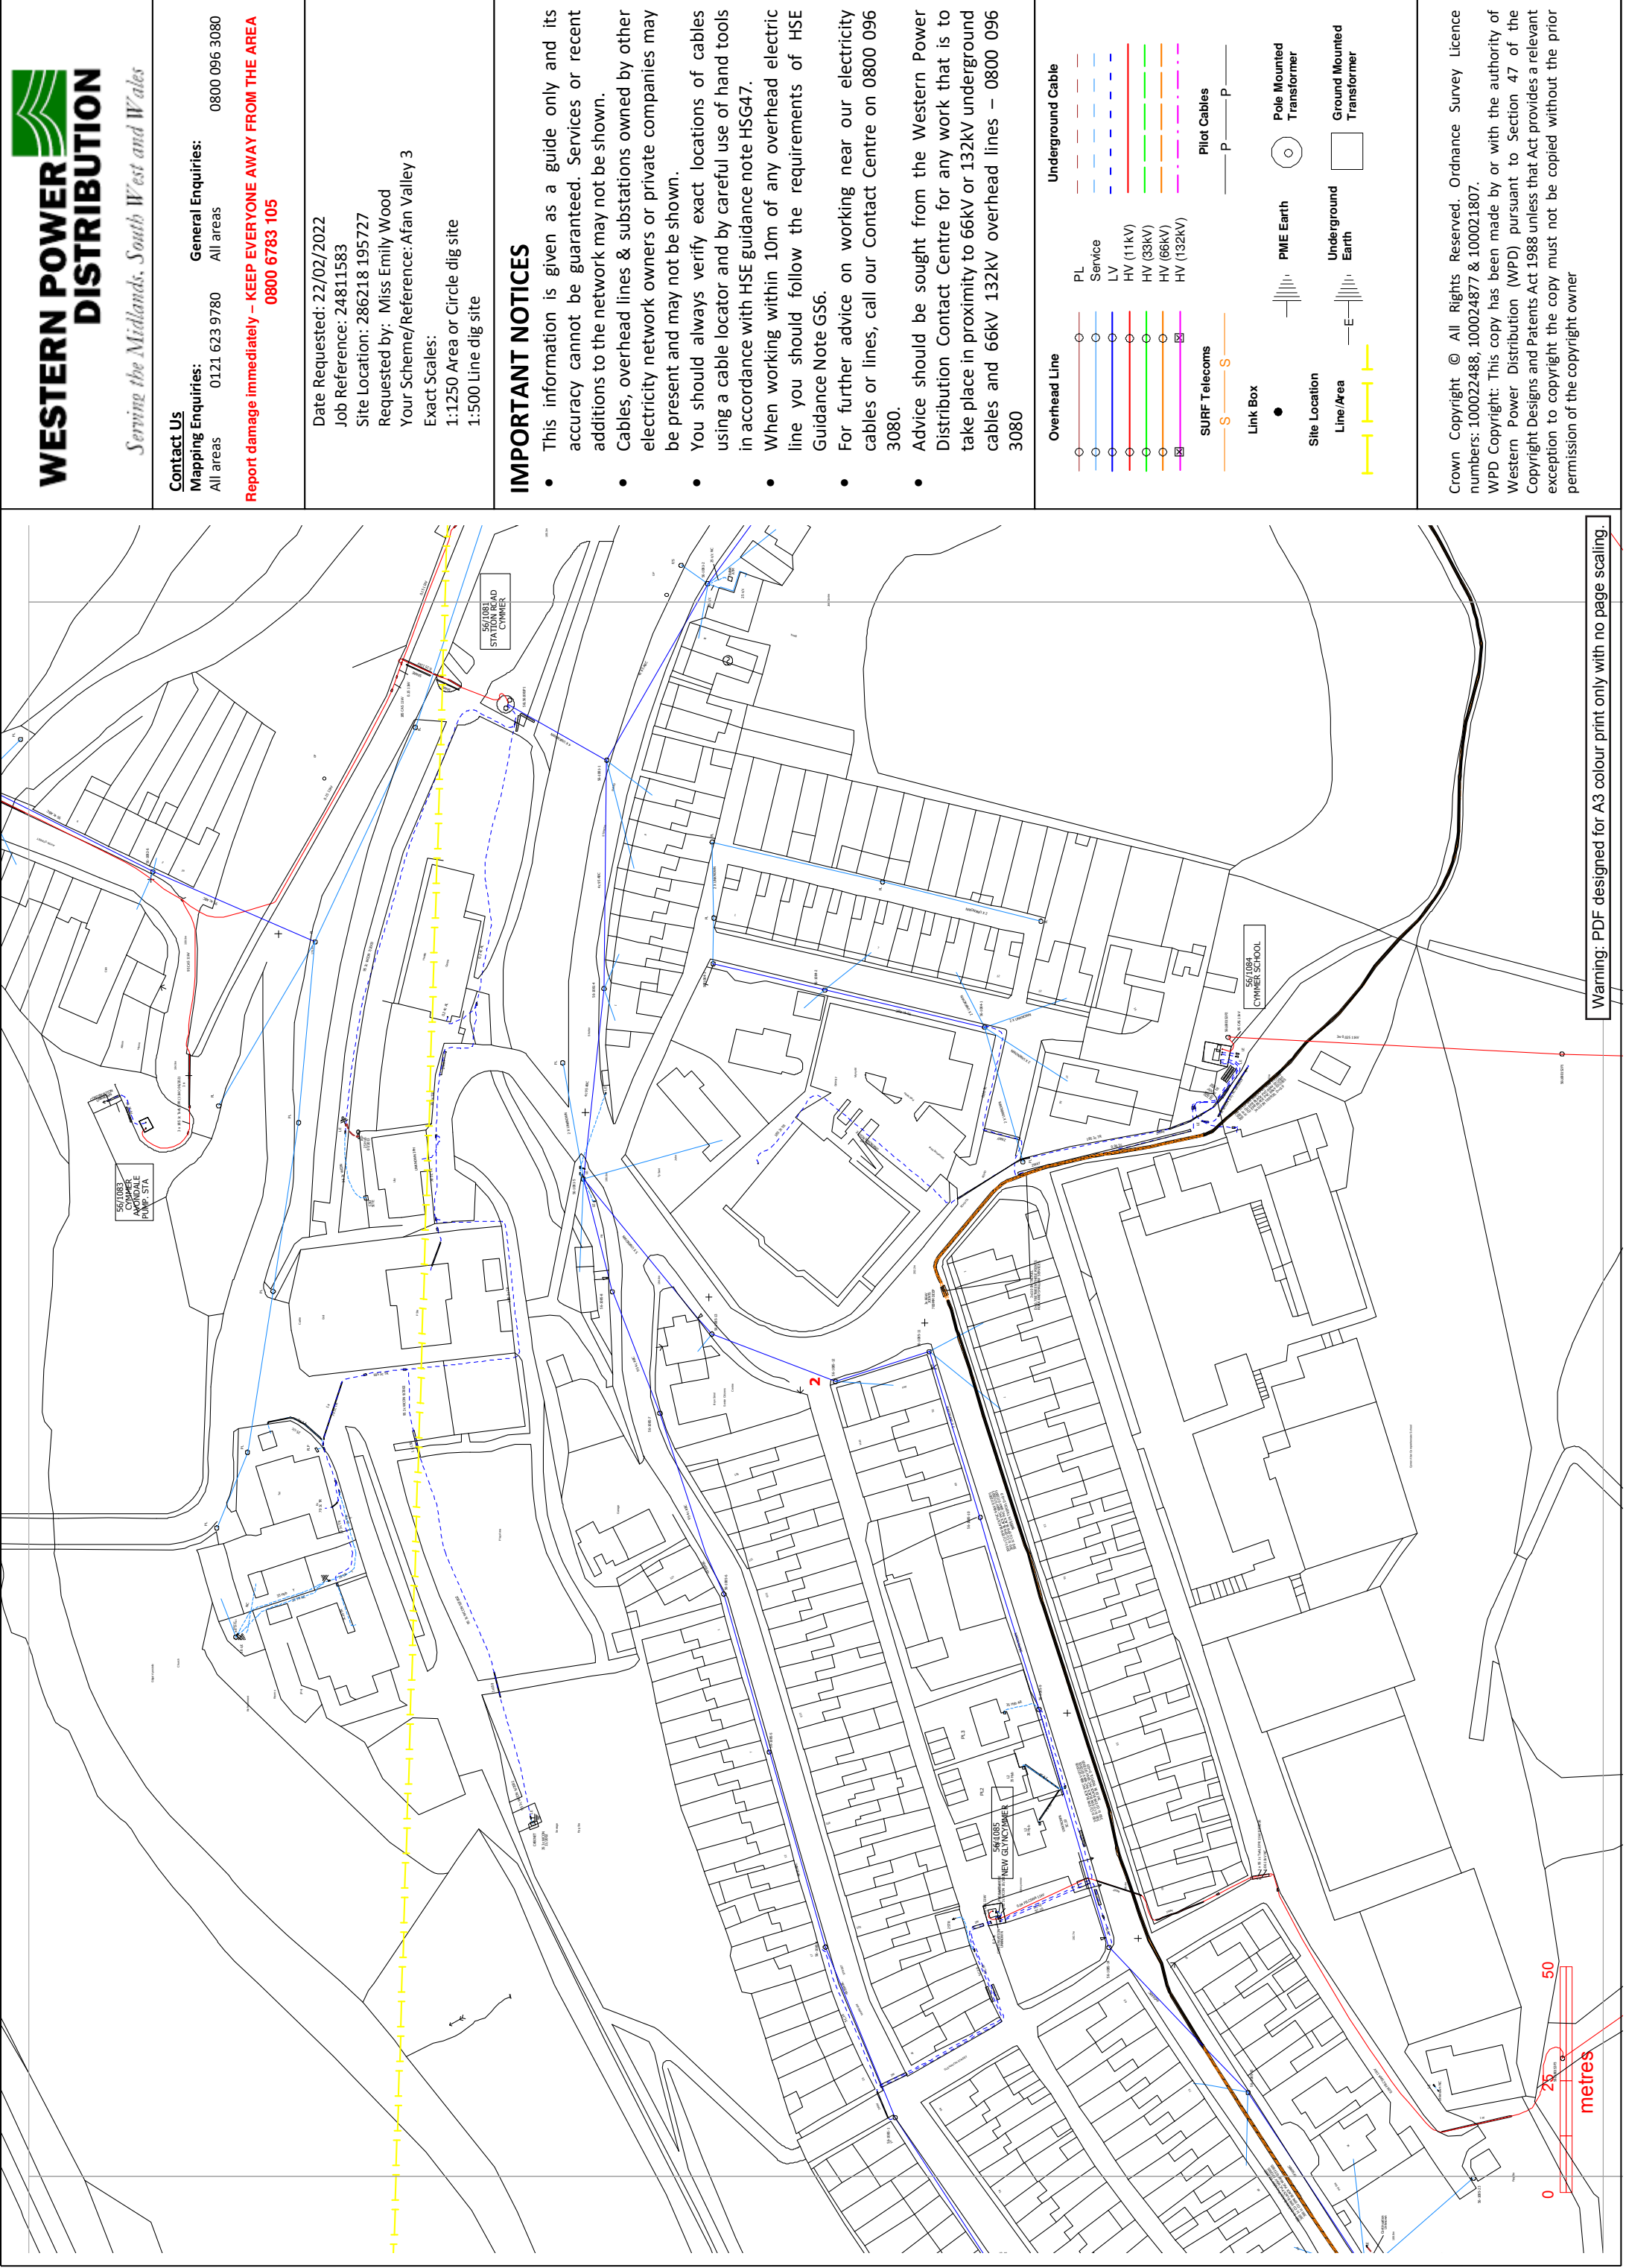



WESTERN POWER

DISTRIBUTION

Serving the Midlands, South West and Wales

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105

Date Requested: 22/02/2022

Job Reference: 24811583

Site Location: 286218 195727

Requested by: Miss Emily Wood

Your Scheme/Reference: Afan Valley 3

Exact Scales:
1:1250 Area or Circle dig site
1:500 Line dig site

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the Western Power Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

Overhead Line

PL

Service

LV

HV (11kV)

HV (33kV)

HV (66kV)

HV (132kV)

Underground Cable

PL

Service

LV

HV (11kV)

HV (33kV)

HV (66kV)

HV (132kV)

SURF Telecoms

S

S

Link Box

S

S

Site Location

PME Earth

Pole Mounted Transformer

Ground Mounted Transformer

Line/Area

Underground Earth

Line/Area

Pilot Cables

P

P

Underground Earth


E

E

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022488, 100024877 & 100021807.

WPD Copyright: This copy has been made by or with the authority of Western Power Distribution (WPD) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner

Plans generated by DigSAFE Pro (tm) software provided by LinesearchbeforeUdig

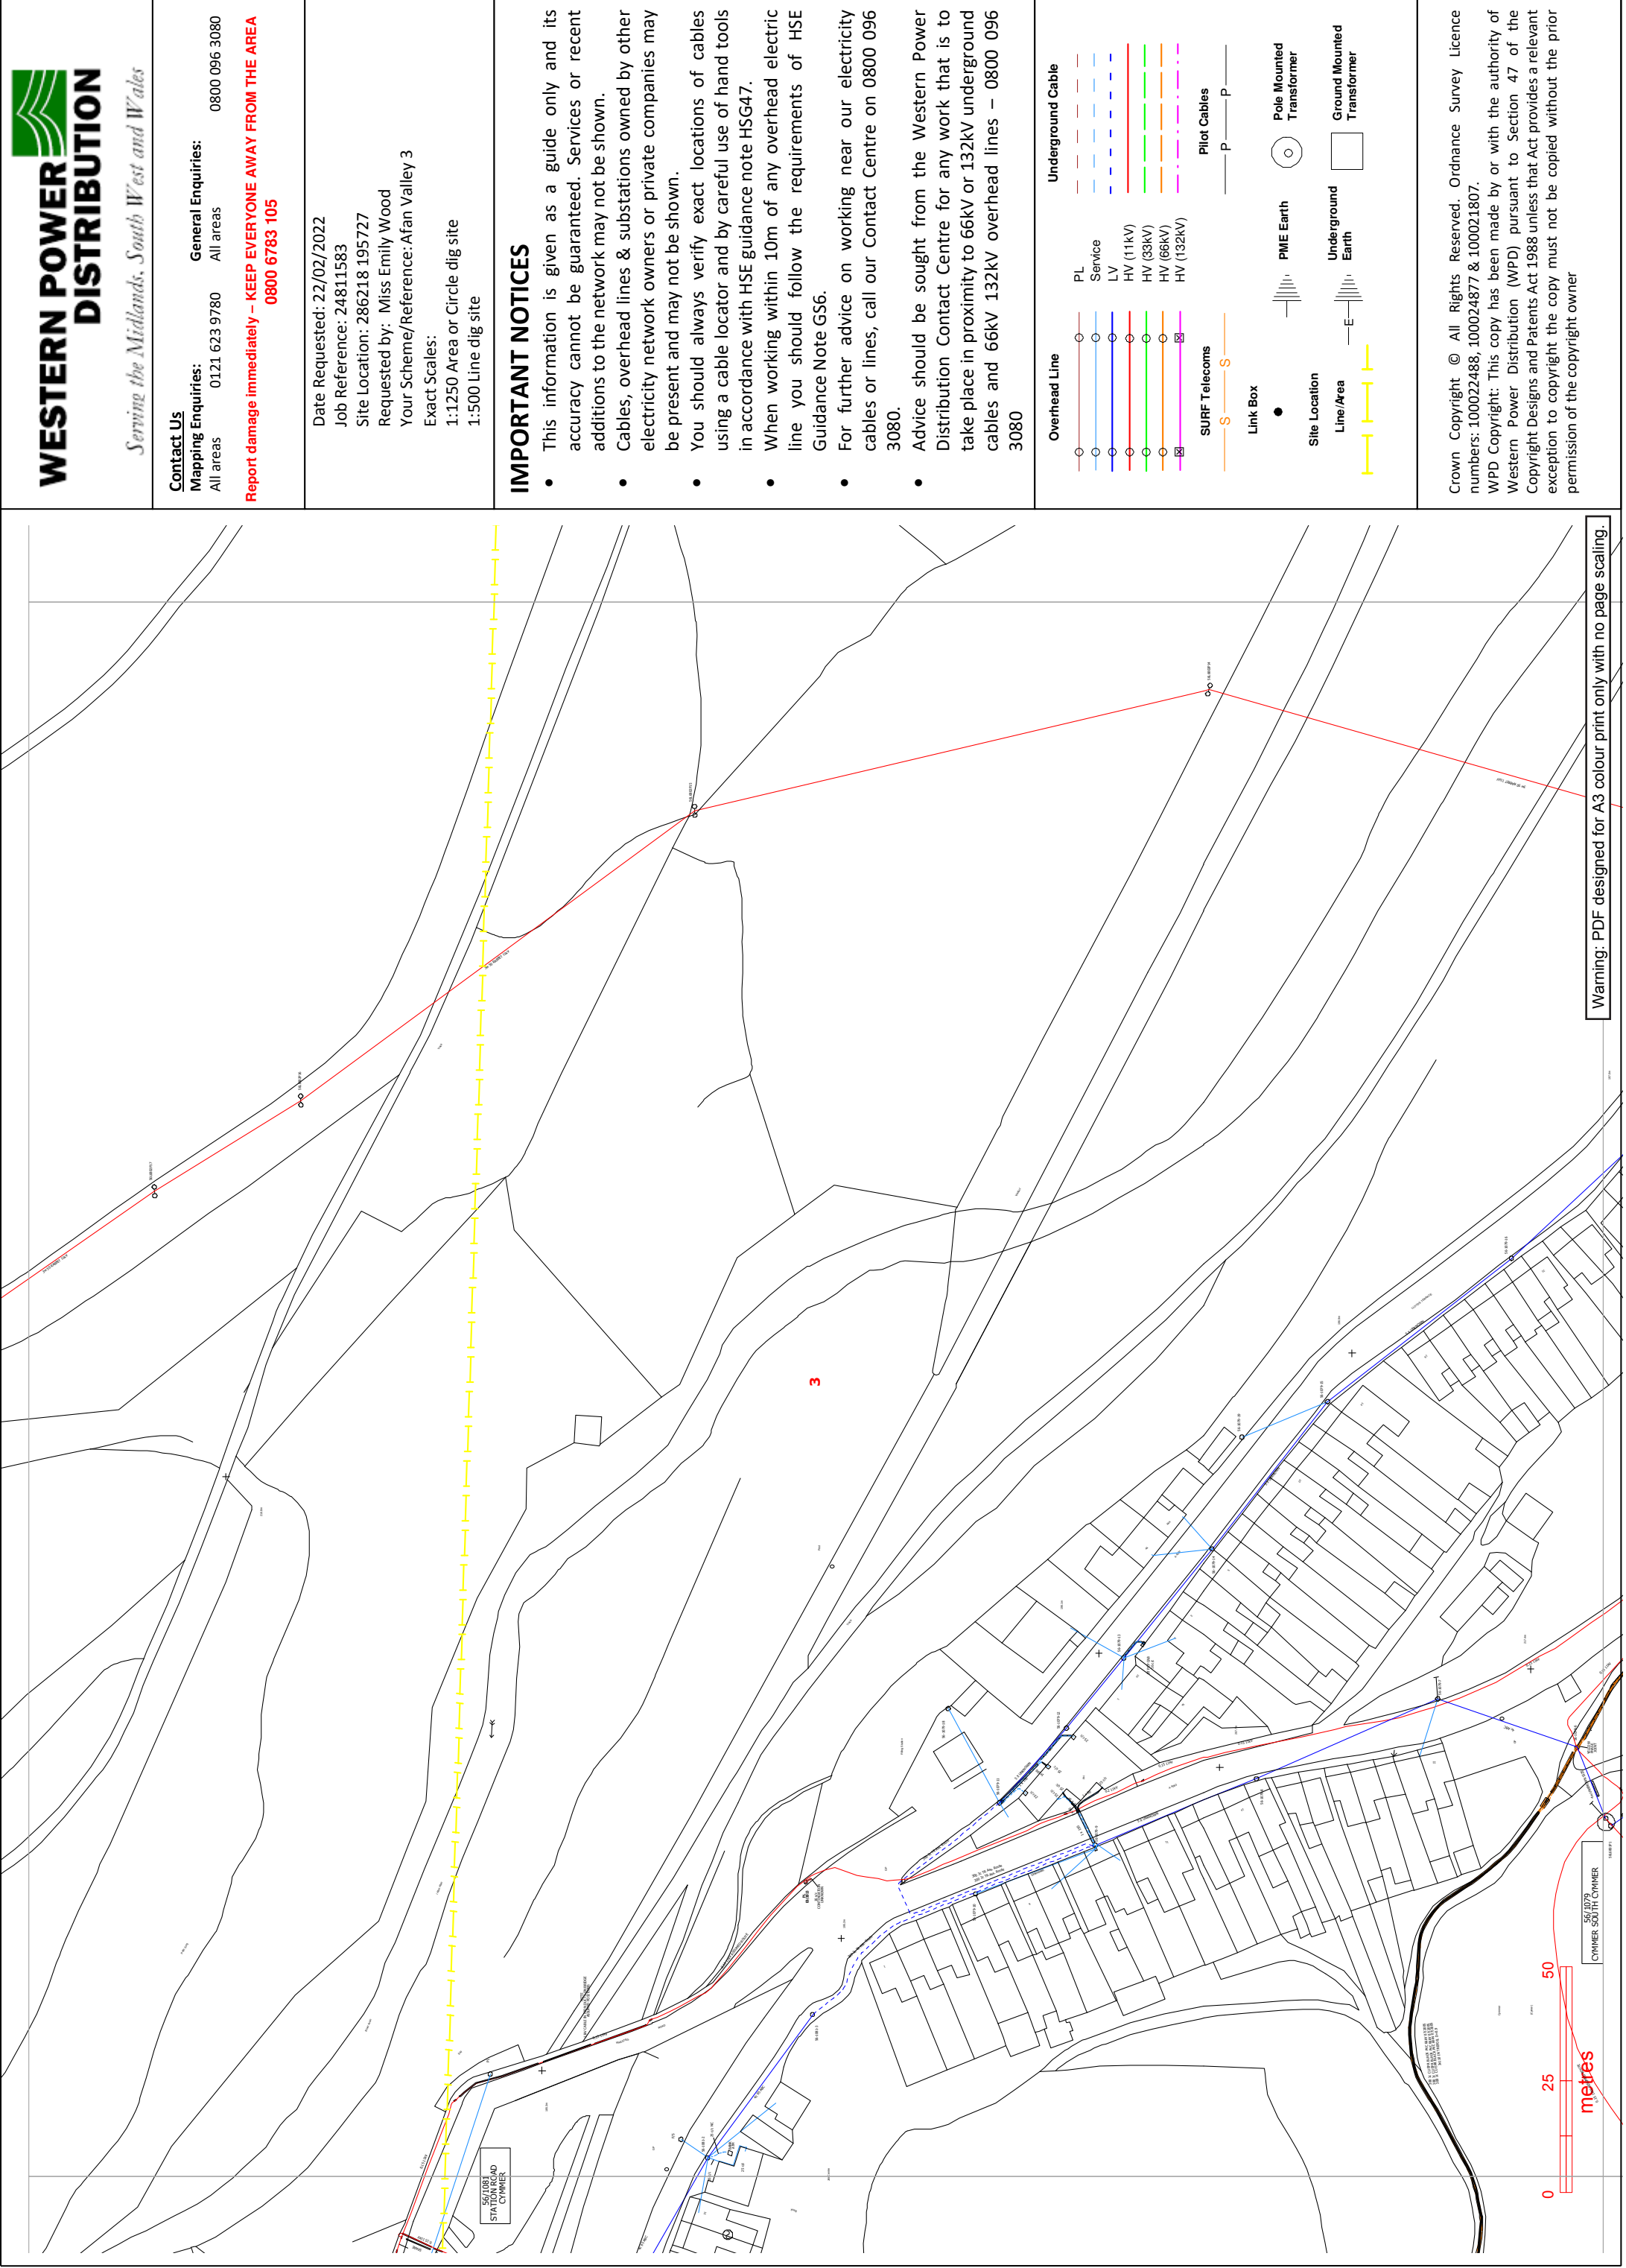





WESTERN POWER

DISTRIBUTION

Serving the Midlands, South West and Wales

Contact Us

Mapping Enquiries:
All areas

0121 623 9780

General Enquiries:
All areas

0800 096 3080

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105

Date Requested: 22/02/2022

Job Reference: 24811583


Site Location: 286218 195727


Requested by: Miss Emily Wood

Your Scheme/Reference: Afan Valley 3

Exact Scales:
1:1250 Area or Circle dig site
1:500 Line dig site

- IMPORTANT NOTICES
- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
 - Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
 - You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
 - When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
 - For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
 - Advice should be sought from the Western Power Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

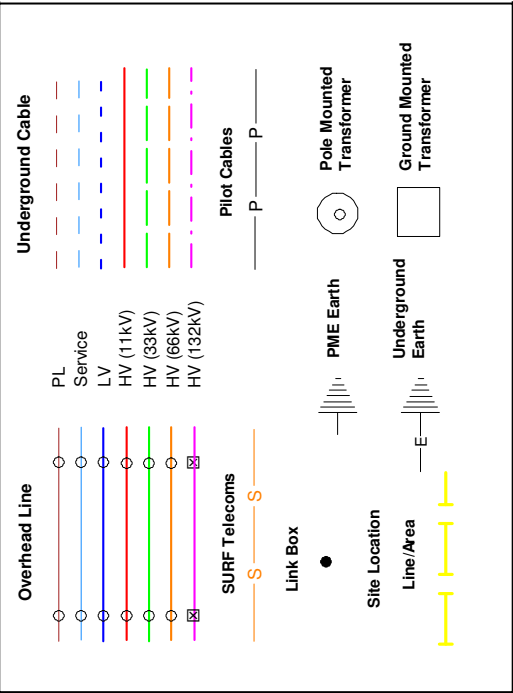

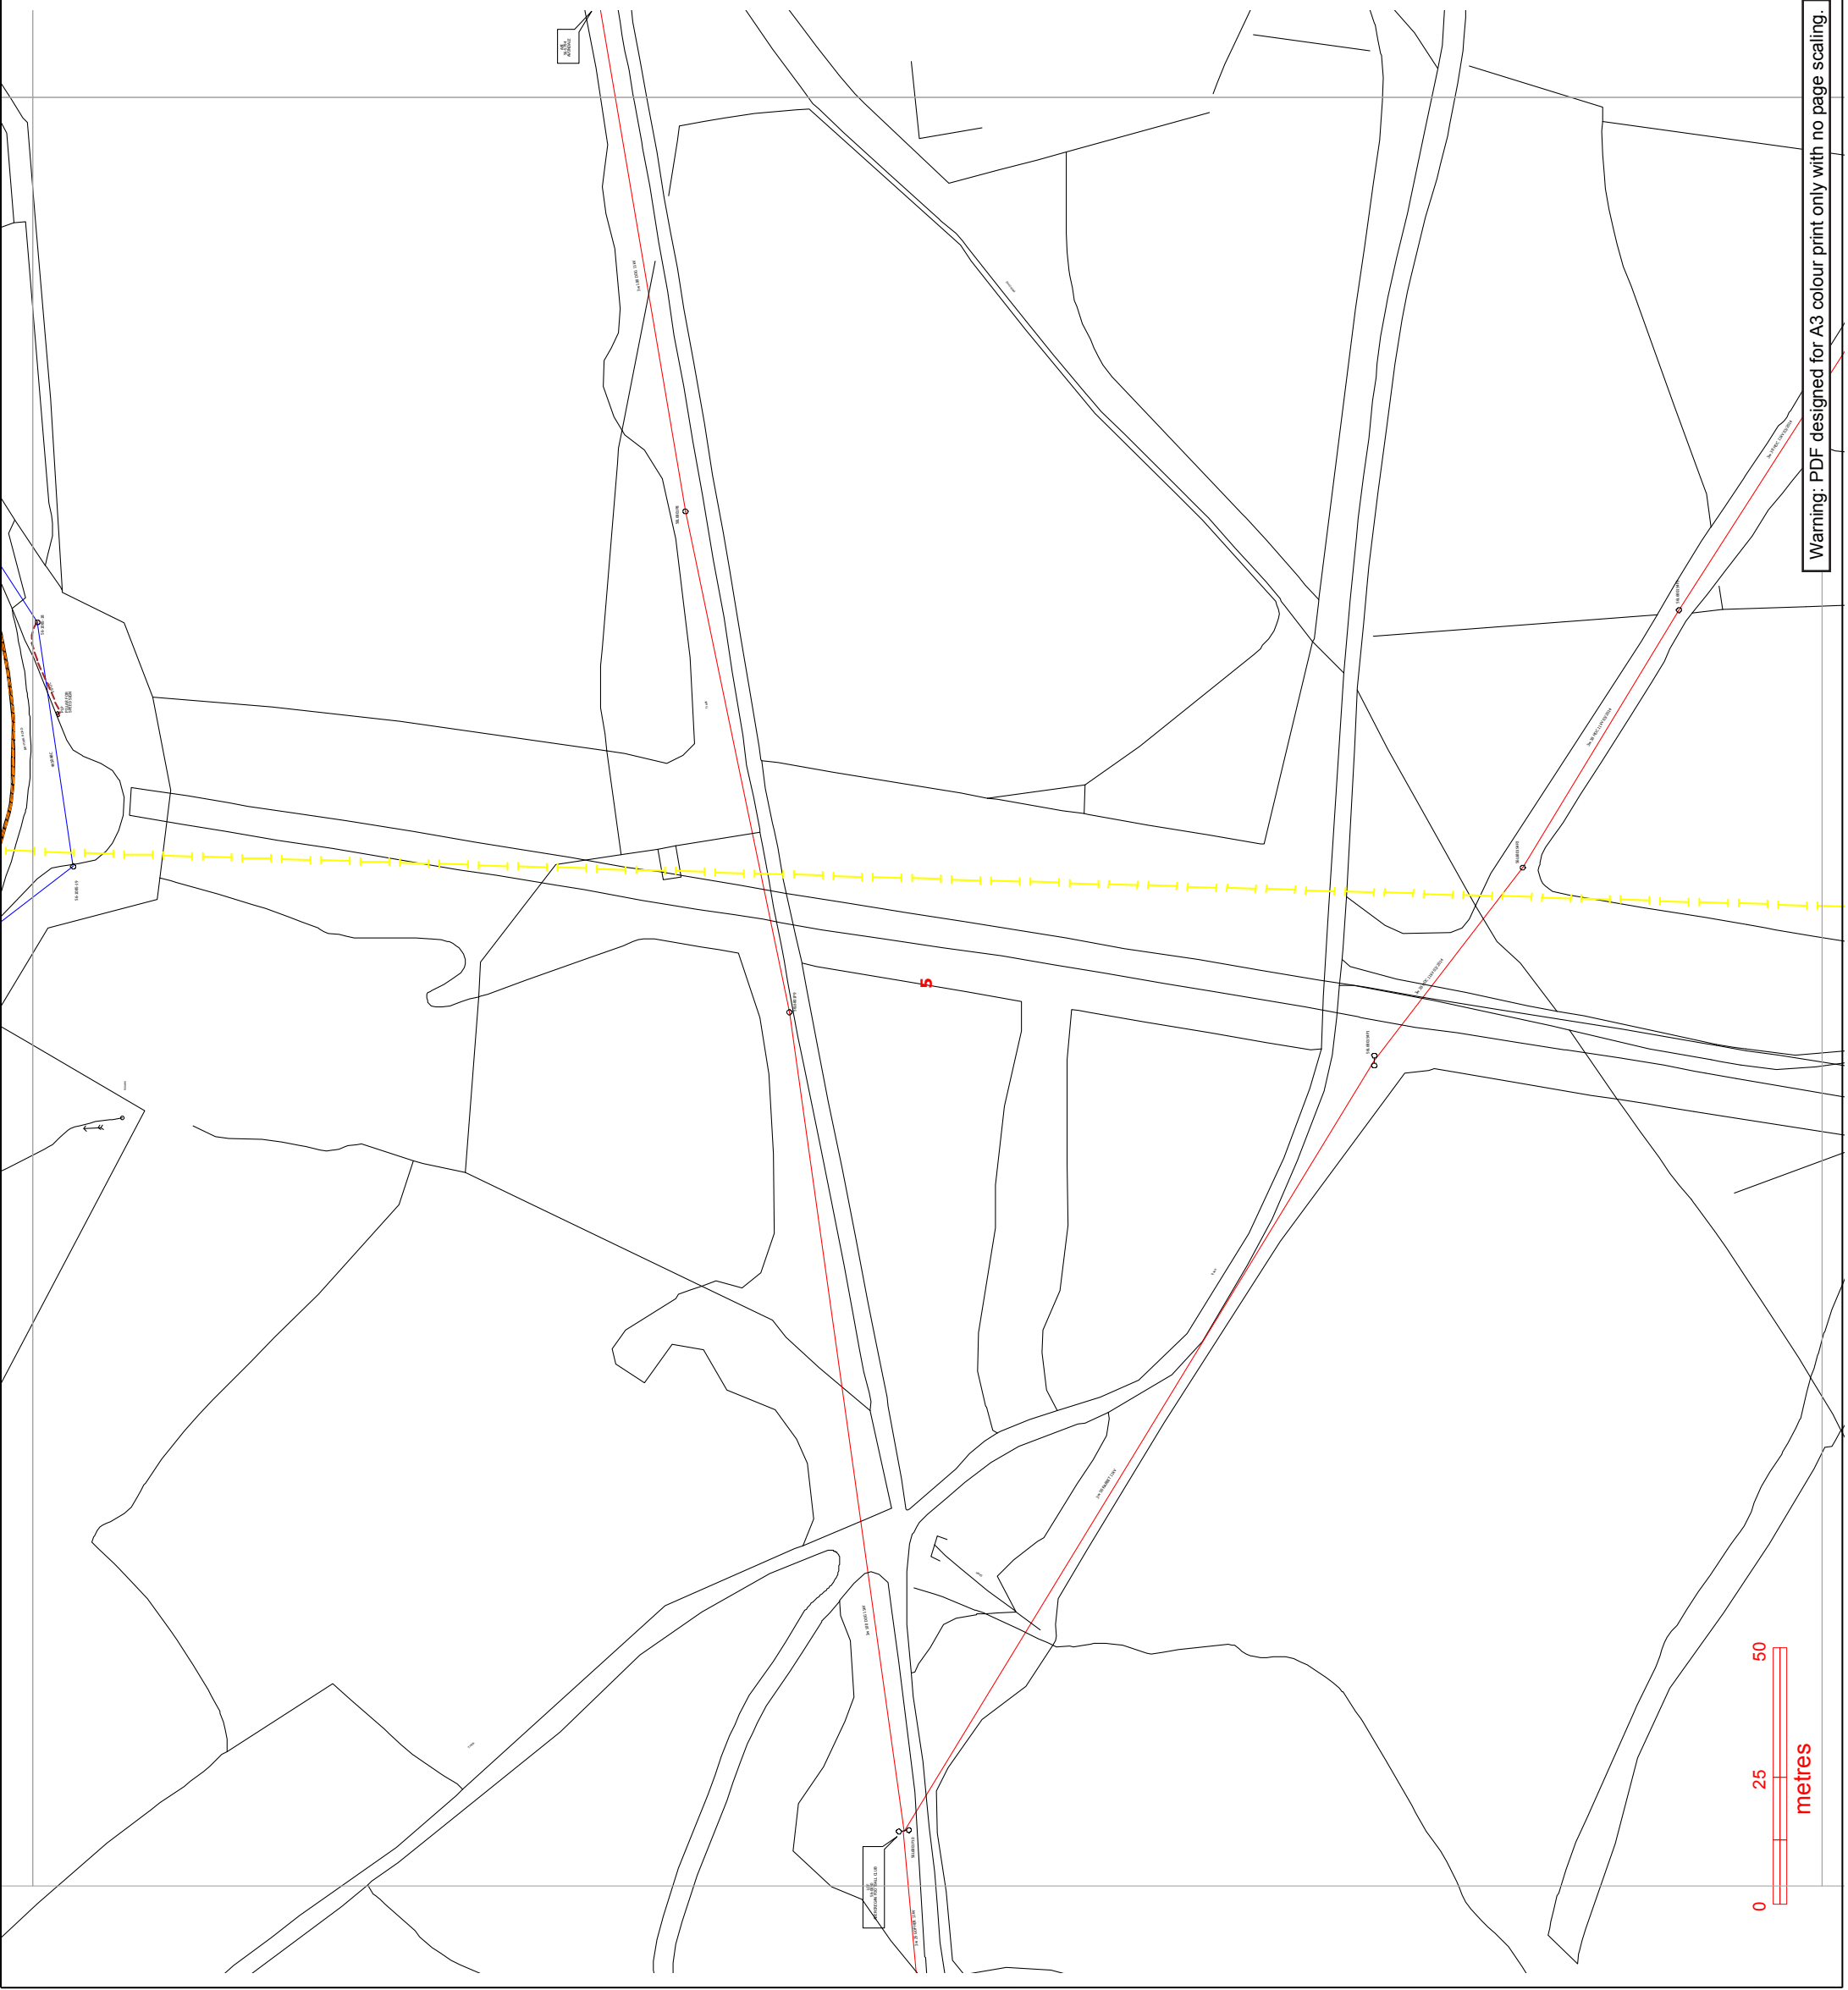



WESTERN POWER DISTRIBUTION

Serving the Midlands, South West and Wales

Contact Us

Mapping Enquiries: 0121 623 9780 All areas

General Enquiries: 0800 096 3080

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105

Date Requested: 22/02/2022

Job Reference: 24811583

Site Location: 286218 195727


Requested by: Miss Emily Wood

Your Scheme/Reference: Afan Valley 3

Exact Scales:
1:1250 Area or Circle dig site
1:500 Line dig site


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the Western Power Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

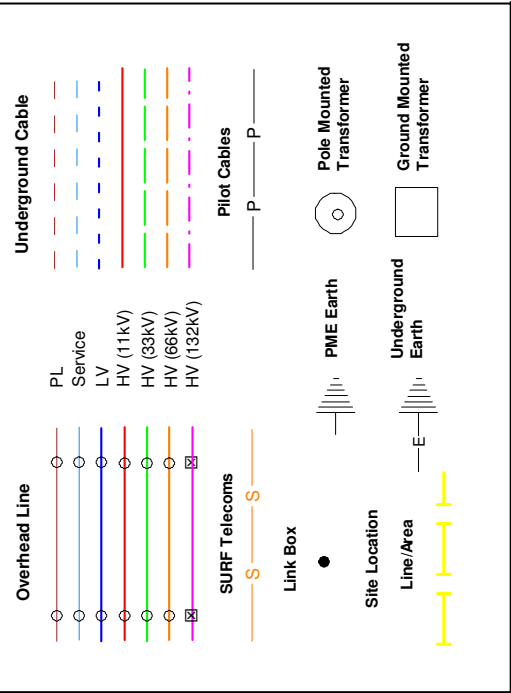

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022488, 100024877 & 100021807.


WPD Copyright: This copy has been made by or with the authority of Western Power Distribution (WPD) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner




Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105

1.150 Area of Circle dig site


- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electricity line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 09603080.
- Advice should be sought from the Western Power Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 09603080

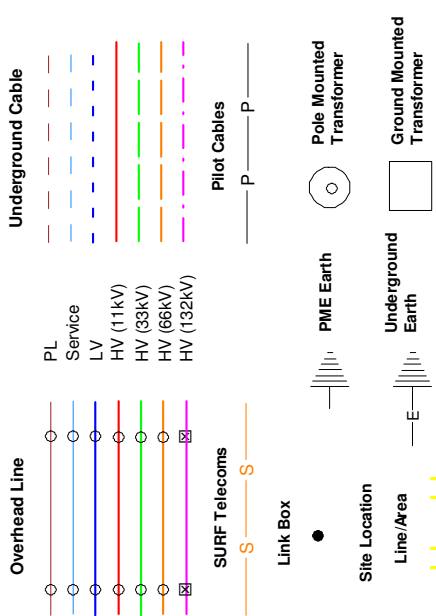

numbers: 100022488, 100024877 & 100021807.
Western Power Distribution (WPD) pursuant to Section 47 of the
Copyright Designs and Patents Act 1988 unless that Act provides a relevant
exception to copyright the copy must not be copied without the prior
permission of the copyright owner

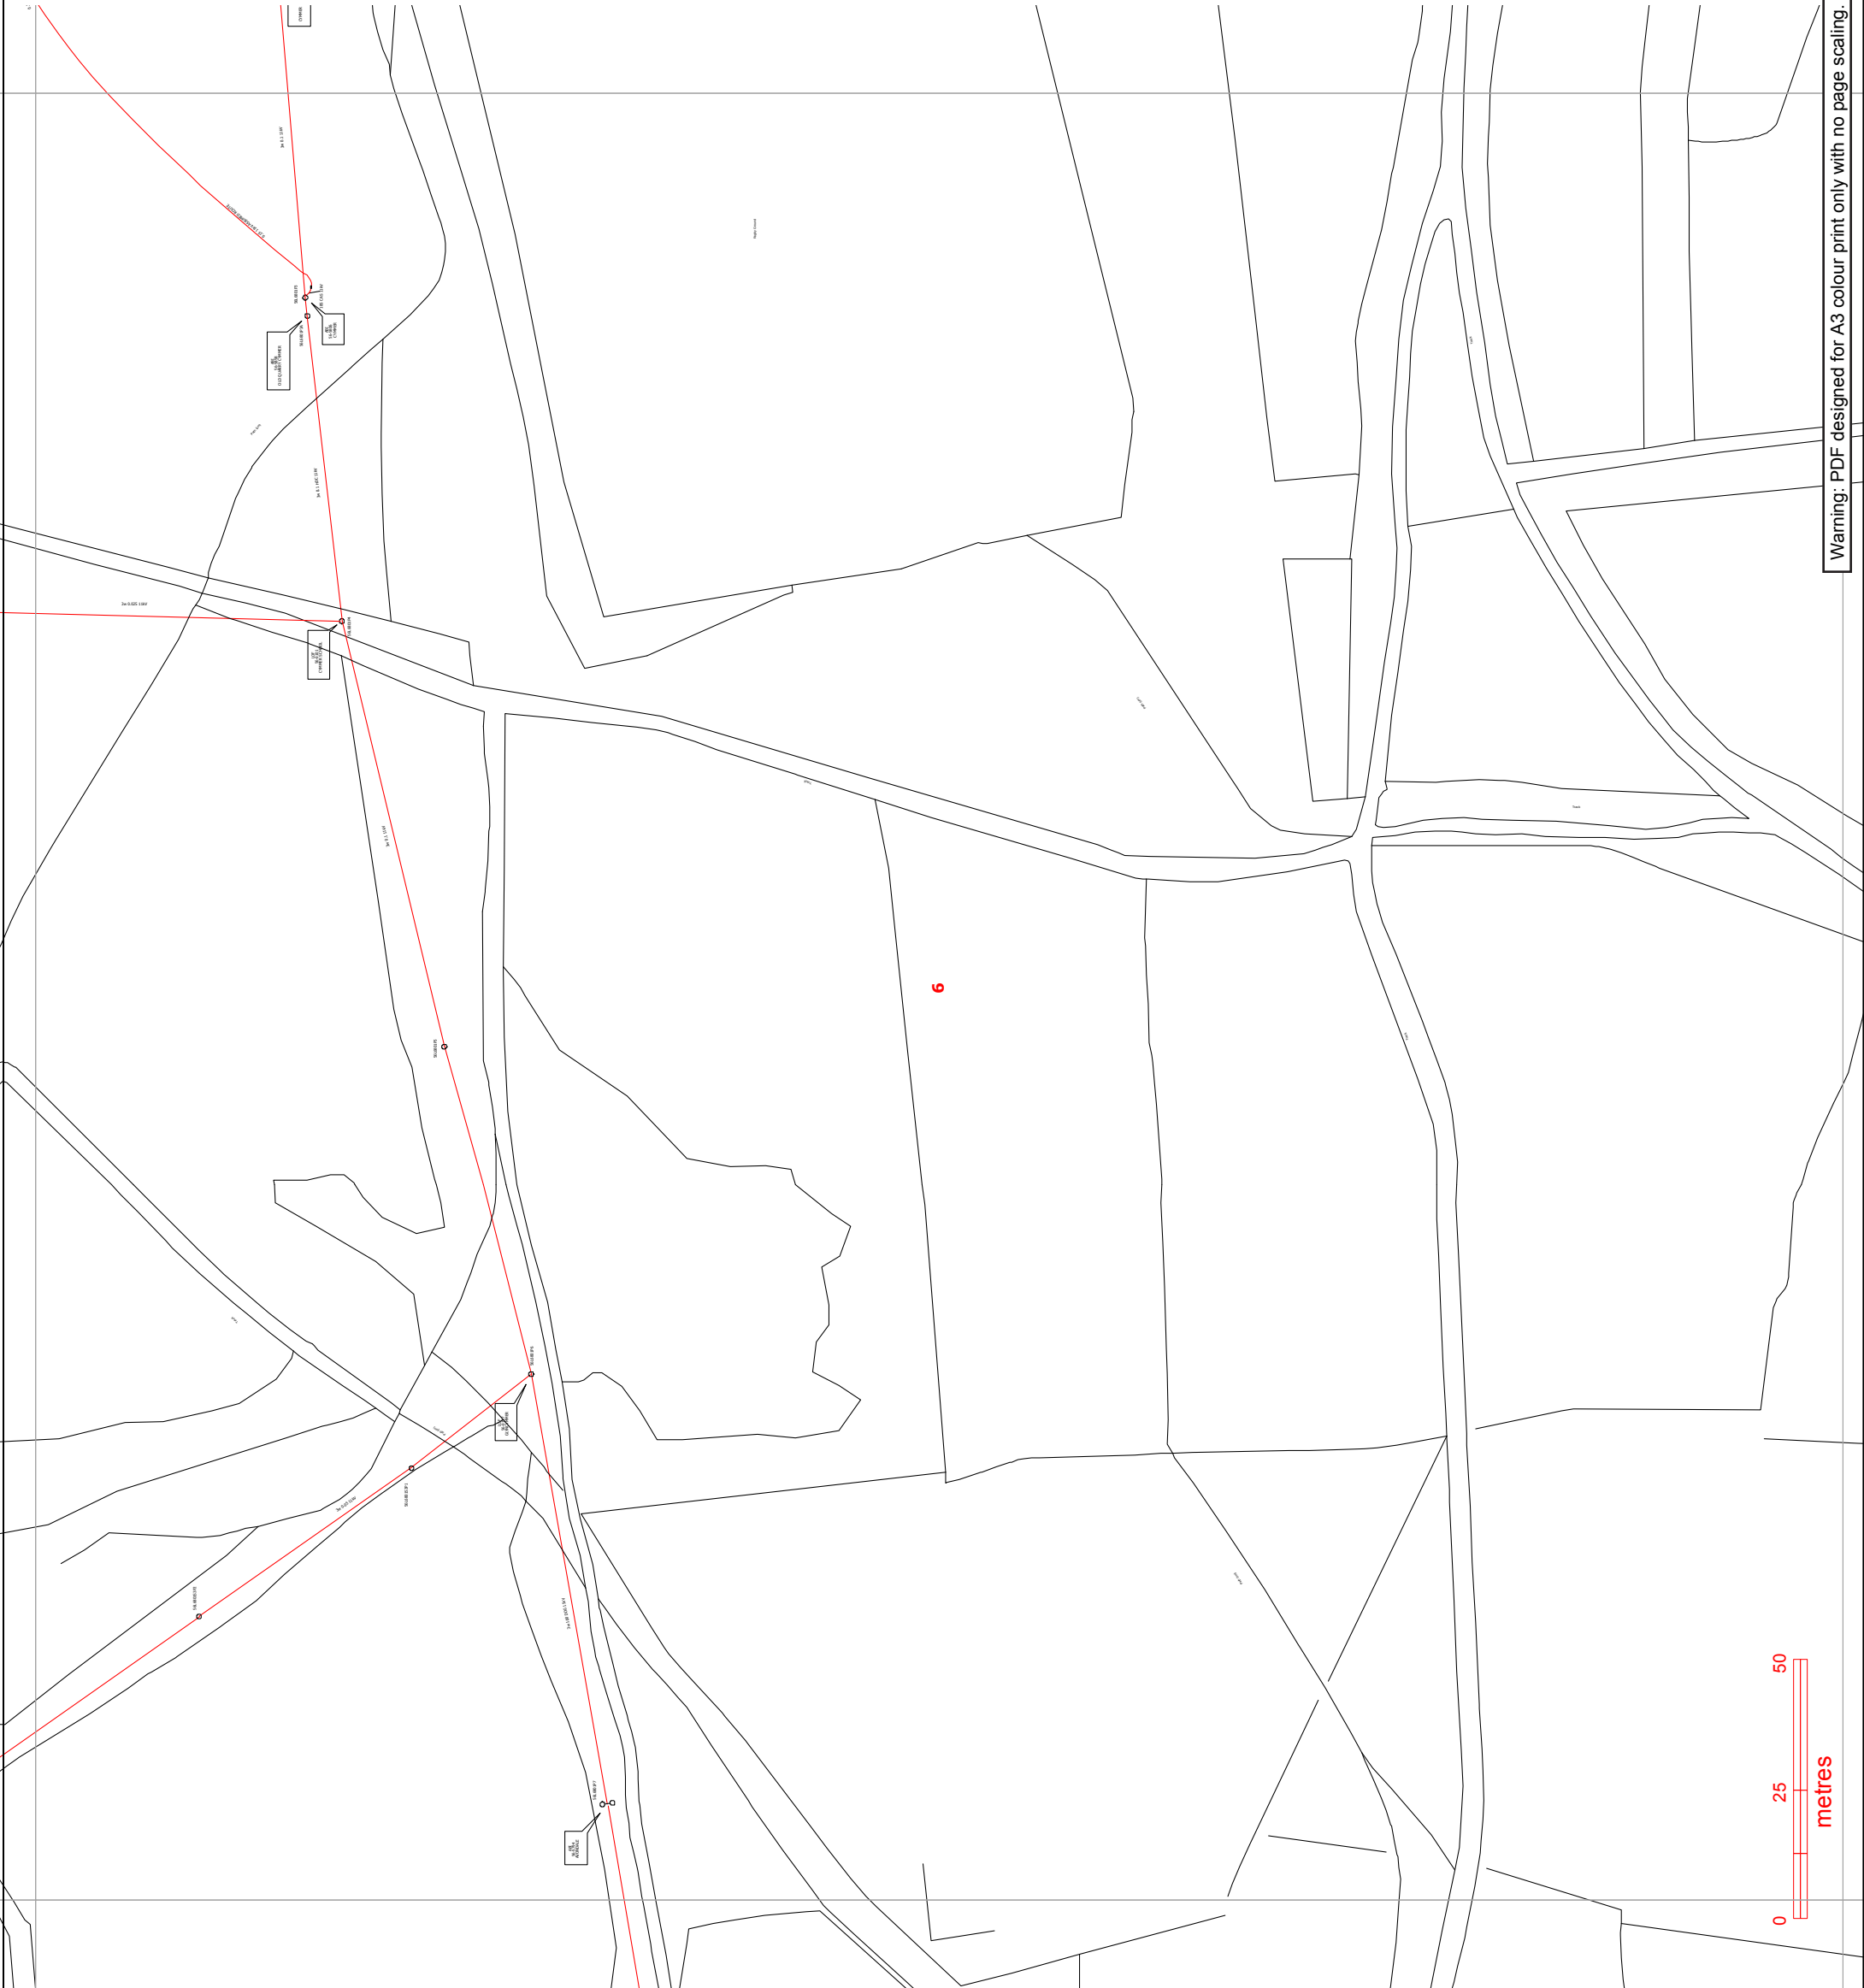


Warning: PDF designed for A3 colour print only with no page scaling.




Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105

1:1250 Area or Circle dig site

- Advice should be sought from the Western Power Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

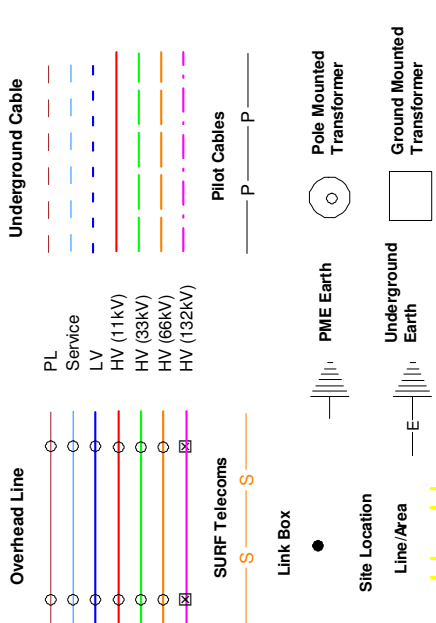

Crown Copyright © All Rights Reserved. Ordnance Survey Licence
 numbers: 100022488, 100024877 & 100021807.
 WPD Copyright: This copy has been made by or with the authority of
 Western Power Distribution (WPD) pursuant to Section 47 of the
 Copyright Designs and Patents Act 1988 unless that Act provides a relevant
 exception to copyright the copy must not be copied without the prior
 permission of the copyright owner

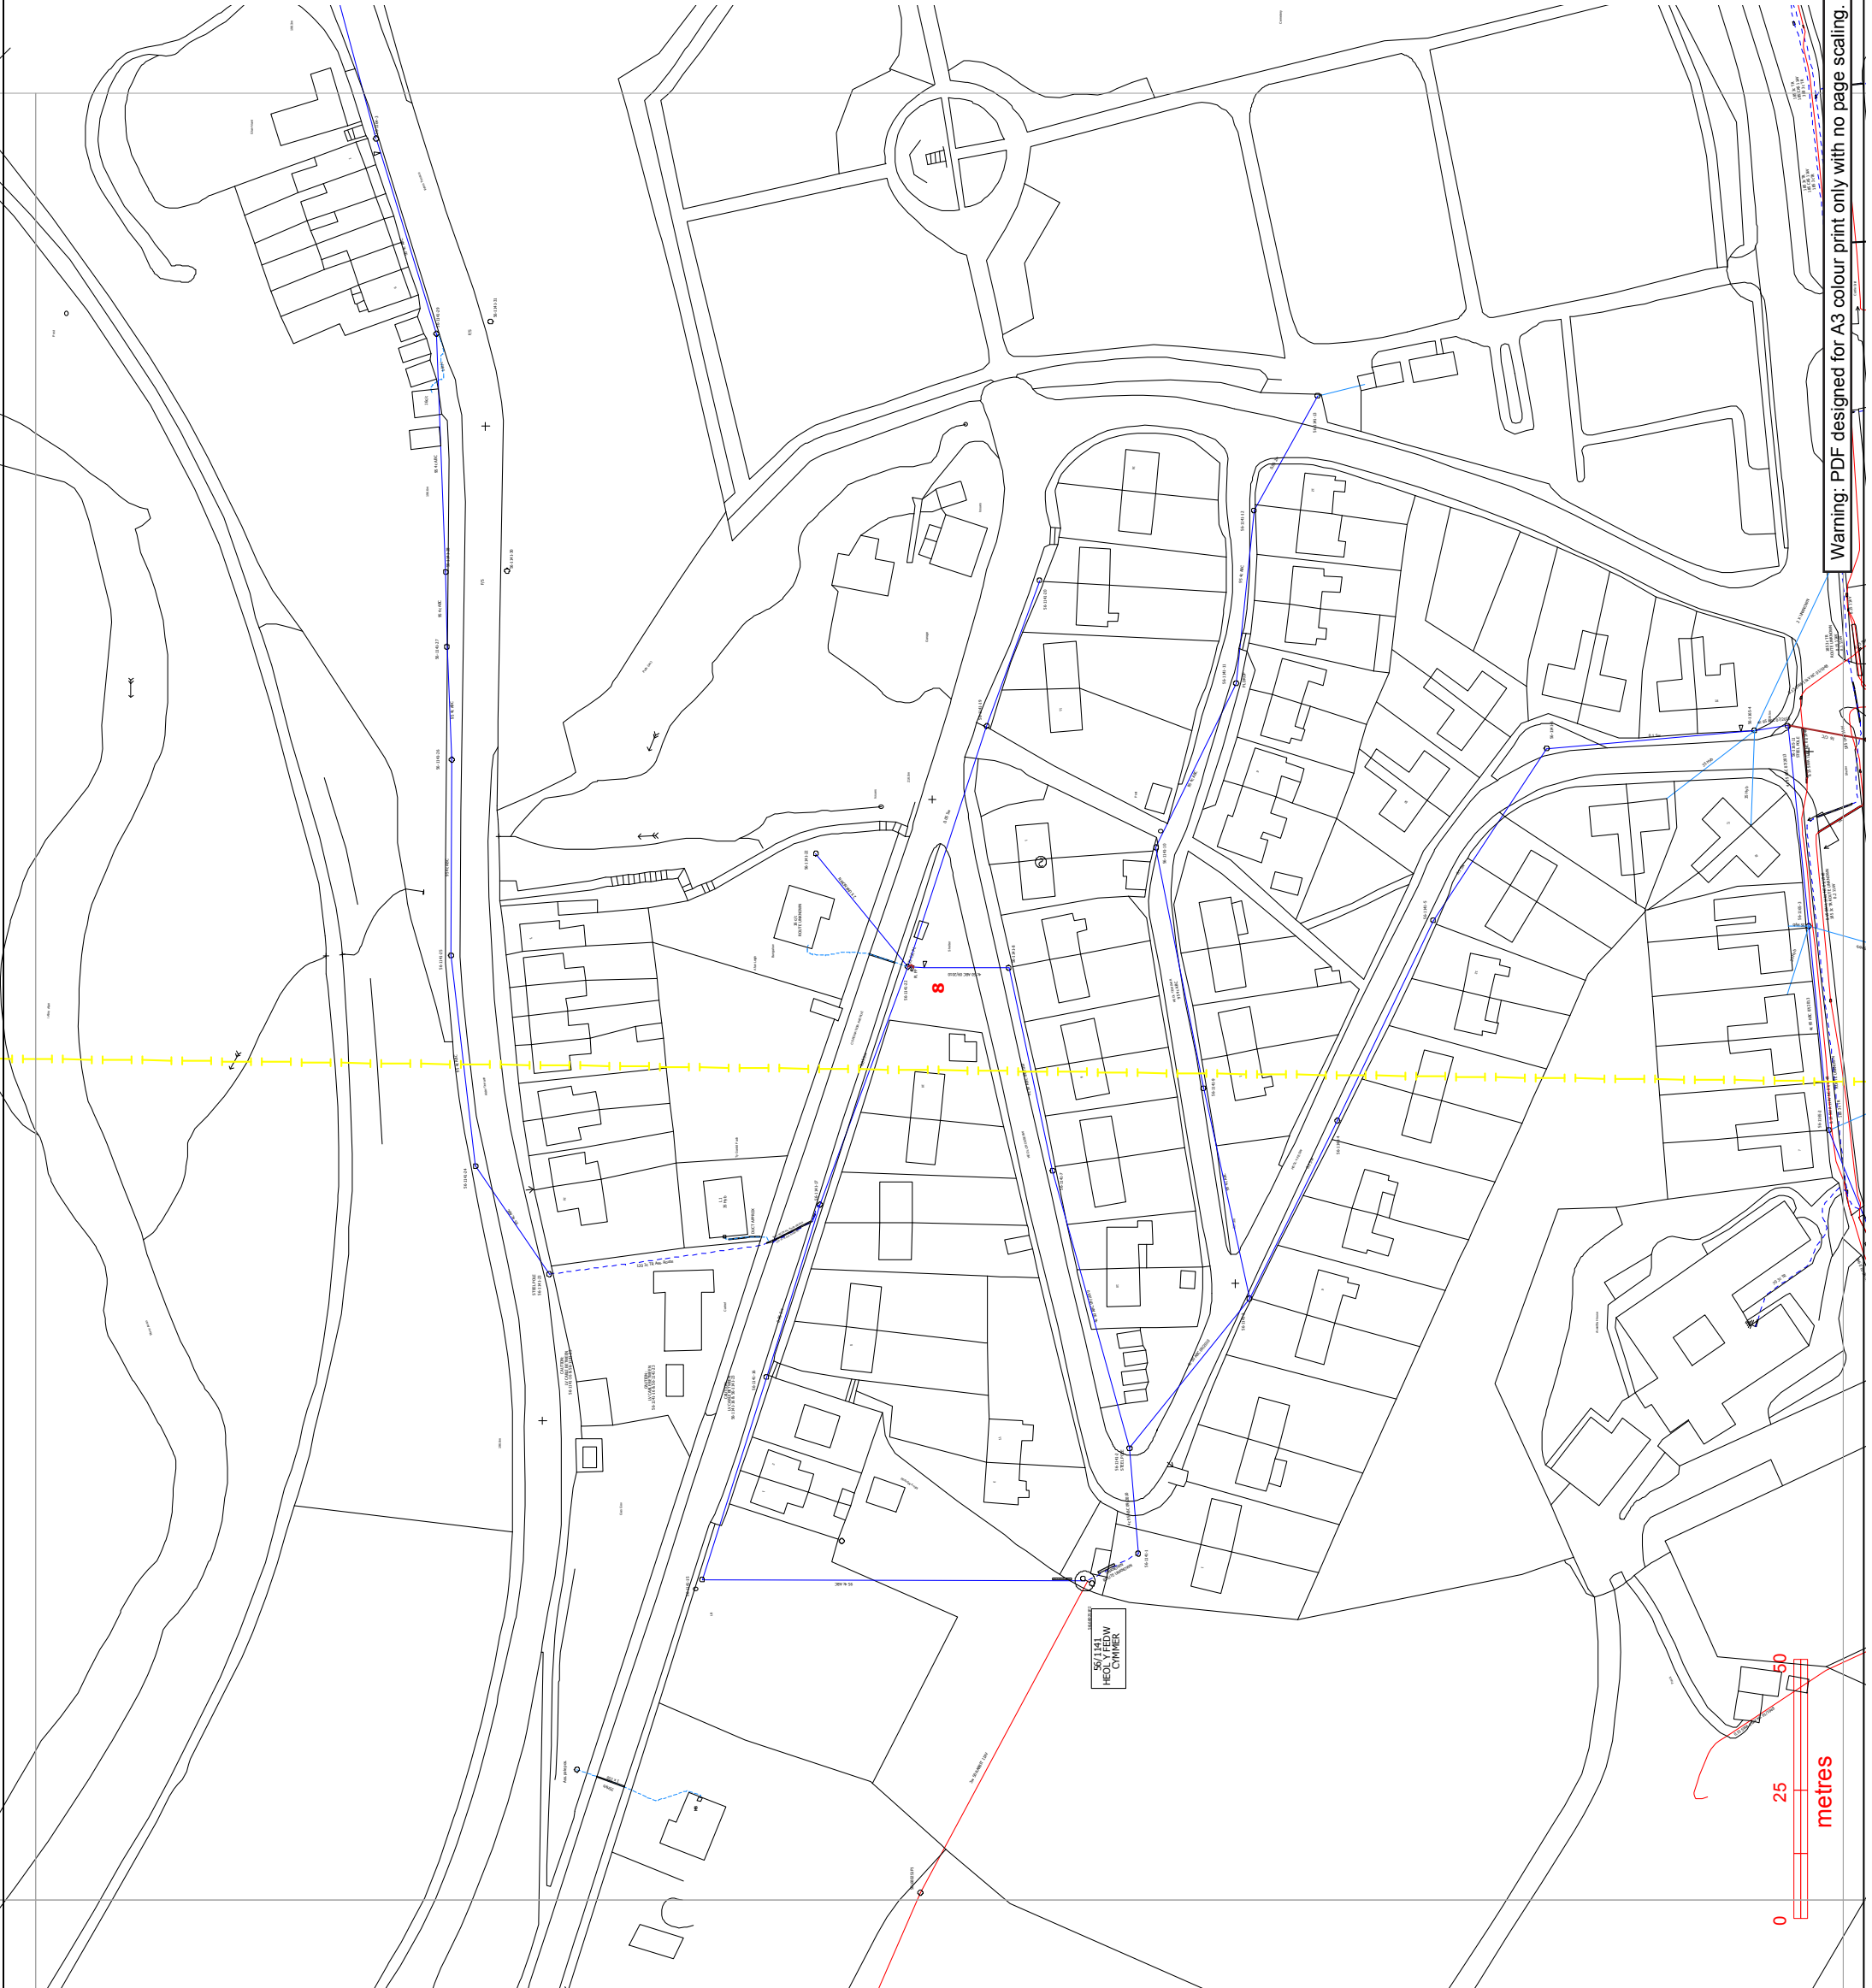


Warning: PDF designed for A3 colour print only with no page scaling.


Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105

U.S. DEPARTMENT OF COMMERCE

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables/using a cable locator and by careful use of hand tools/ in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric/line you should follow the requirements of HSE/ Guidance Note GS6.
- For further advice on working near our electric/ cables or lines, call our Contact Centre on 0800 090/ 3080.
- Advice should be sought from the Western Power/ Distribution Contact Centre for any work that is to/ take place in proximity to 66kV or 132kV underground/ cables and 66kV 132kV overhead lines – 0800 090/ 3080

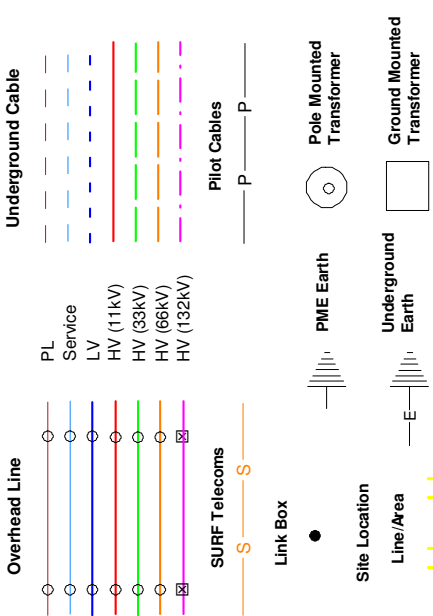


numbers: 100022488, 100024877 & 100021807.
Western Power Distribution (WPD) pursuant to Section 47 of the
Copyright Designs and Patents Act 1988 unless that Act provides a relevant
exception to copyright the copy must not be copied without the prior
permission of the copyright owner

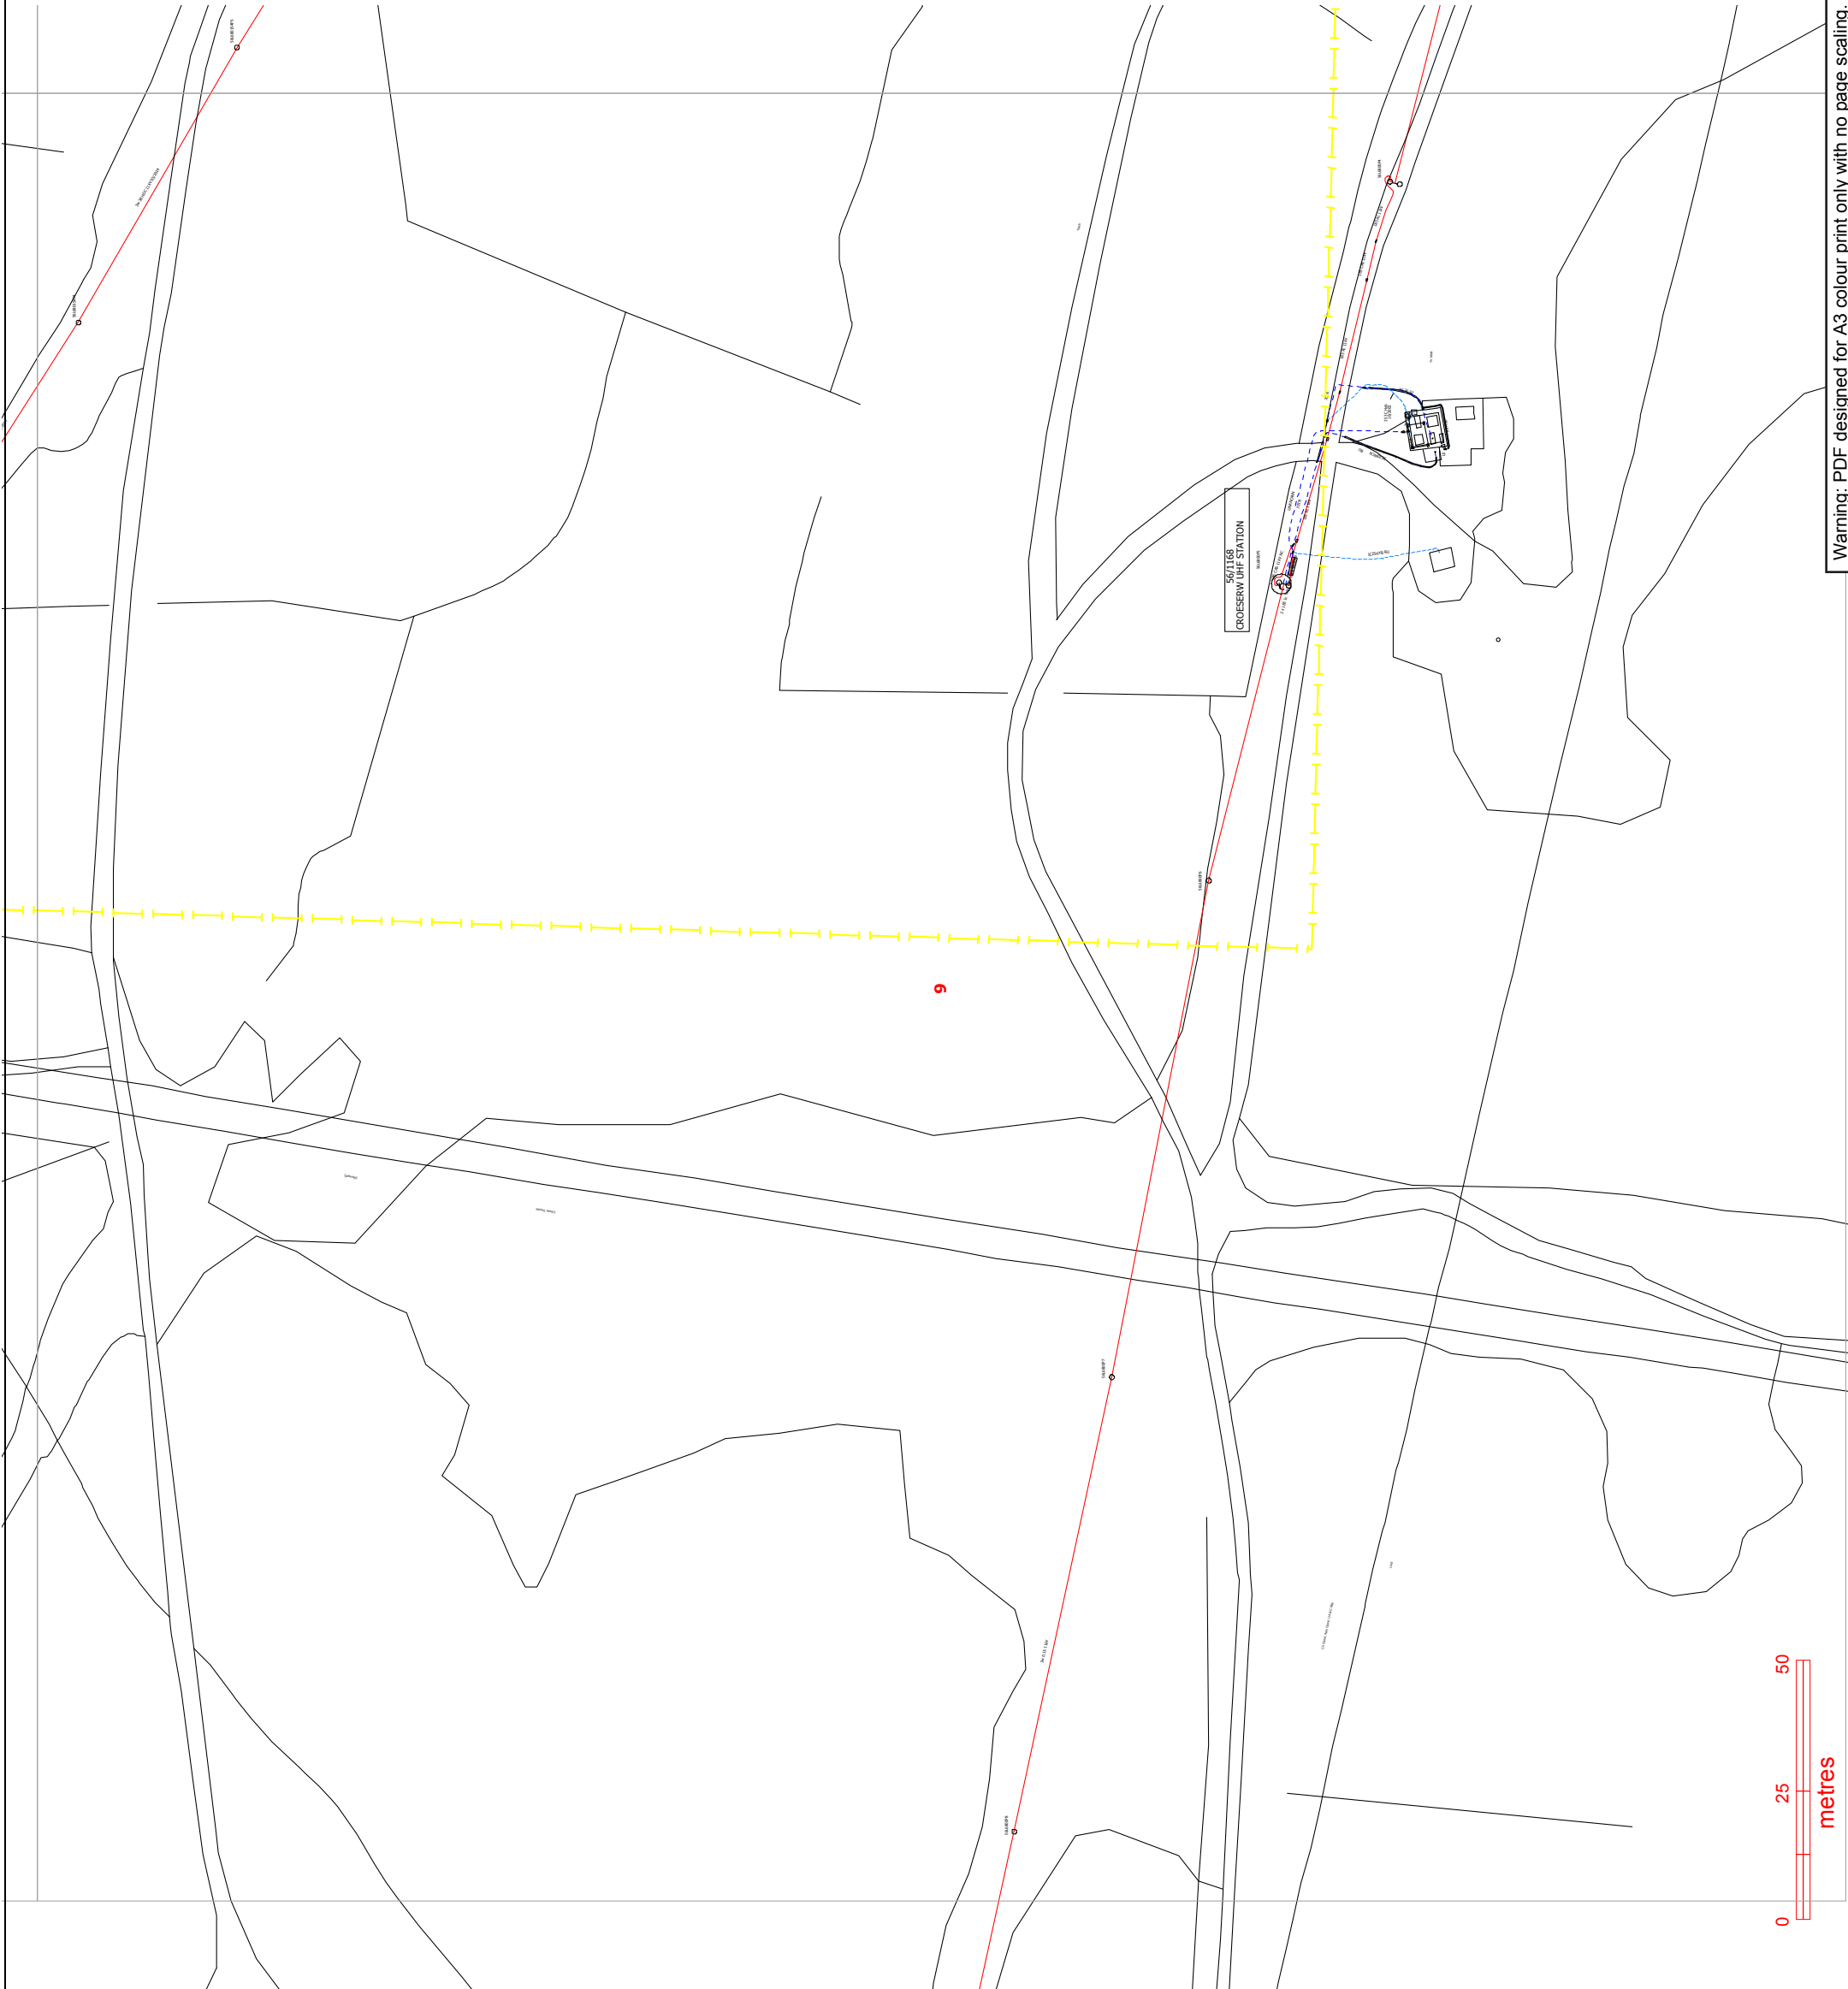


Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105


I. 1230 Aired on Circle Kig site

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.

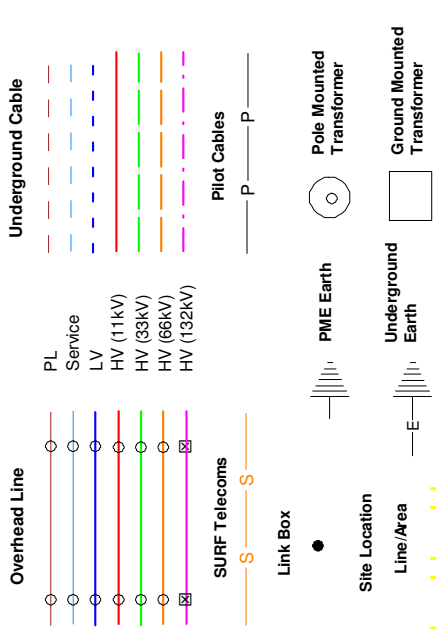

© Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022488, 100024877 & 100021807.

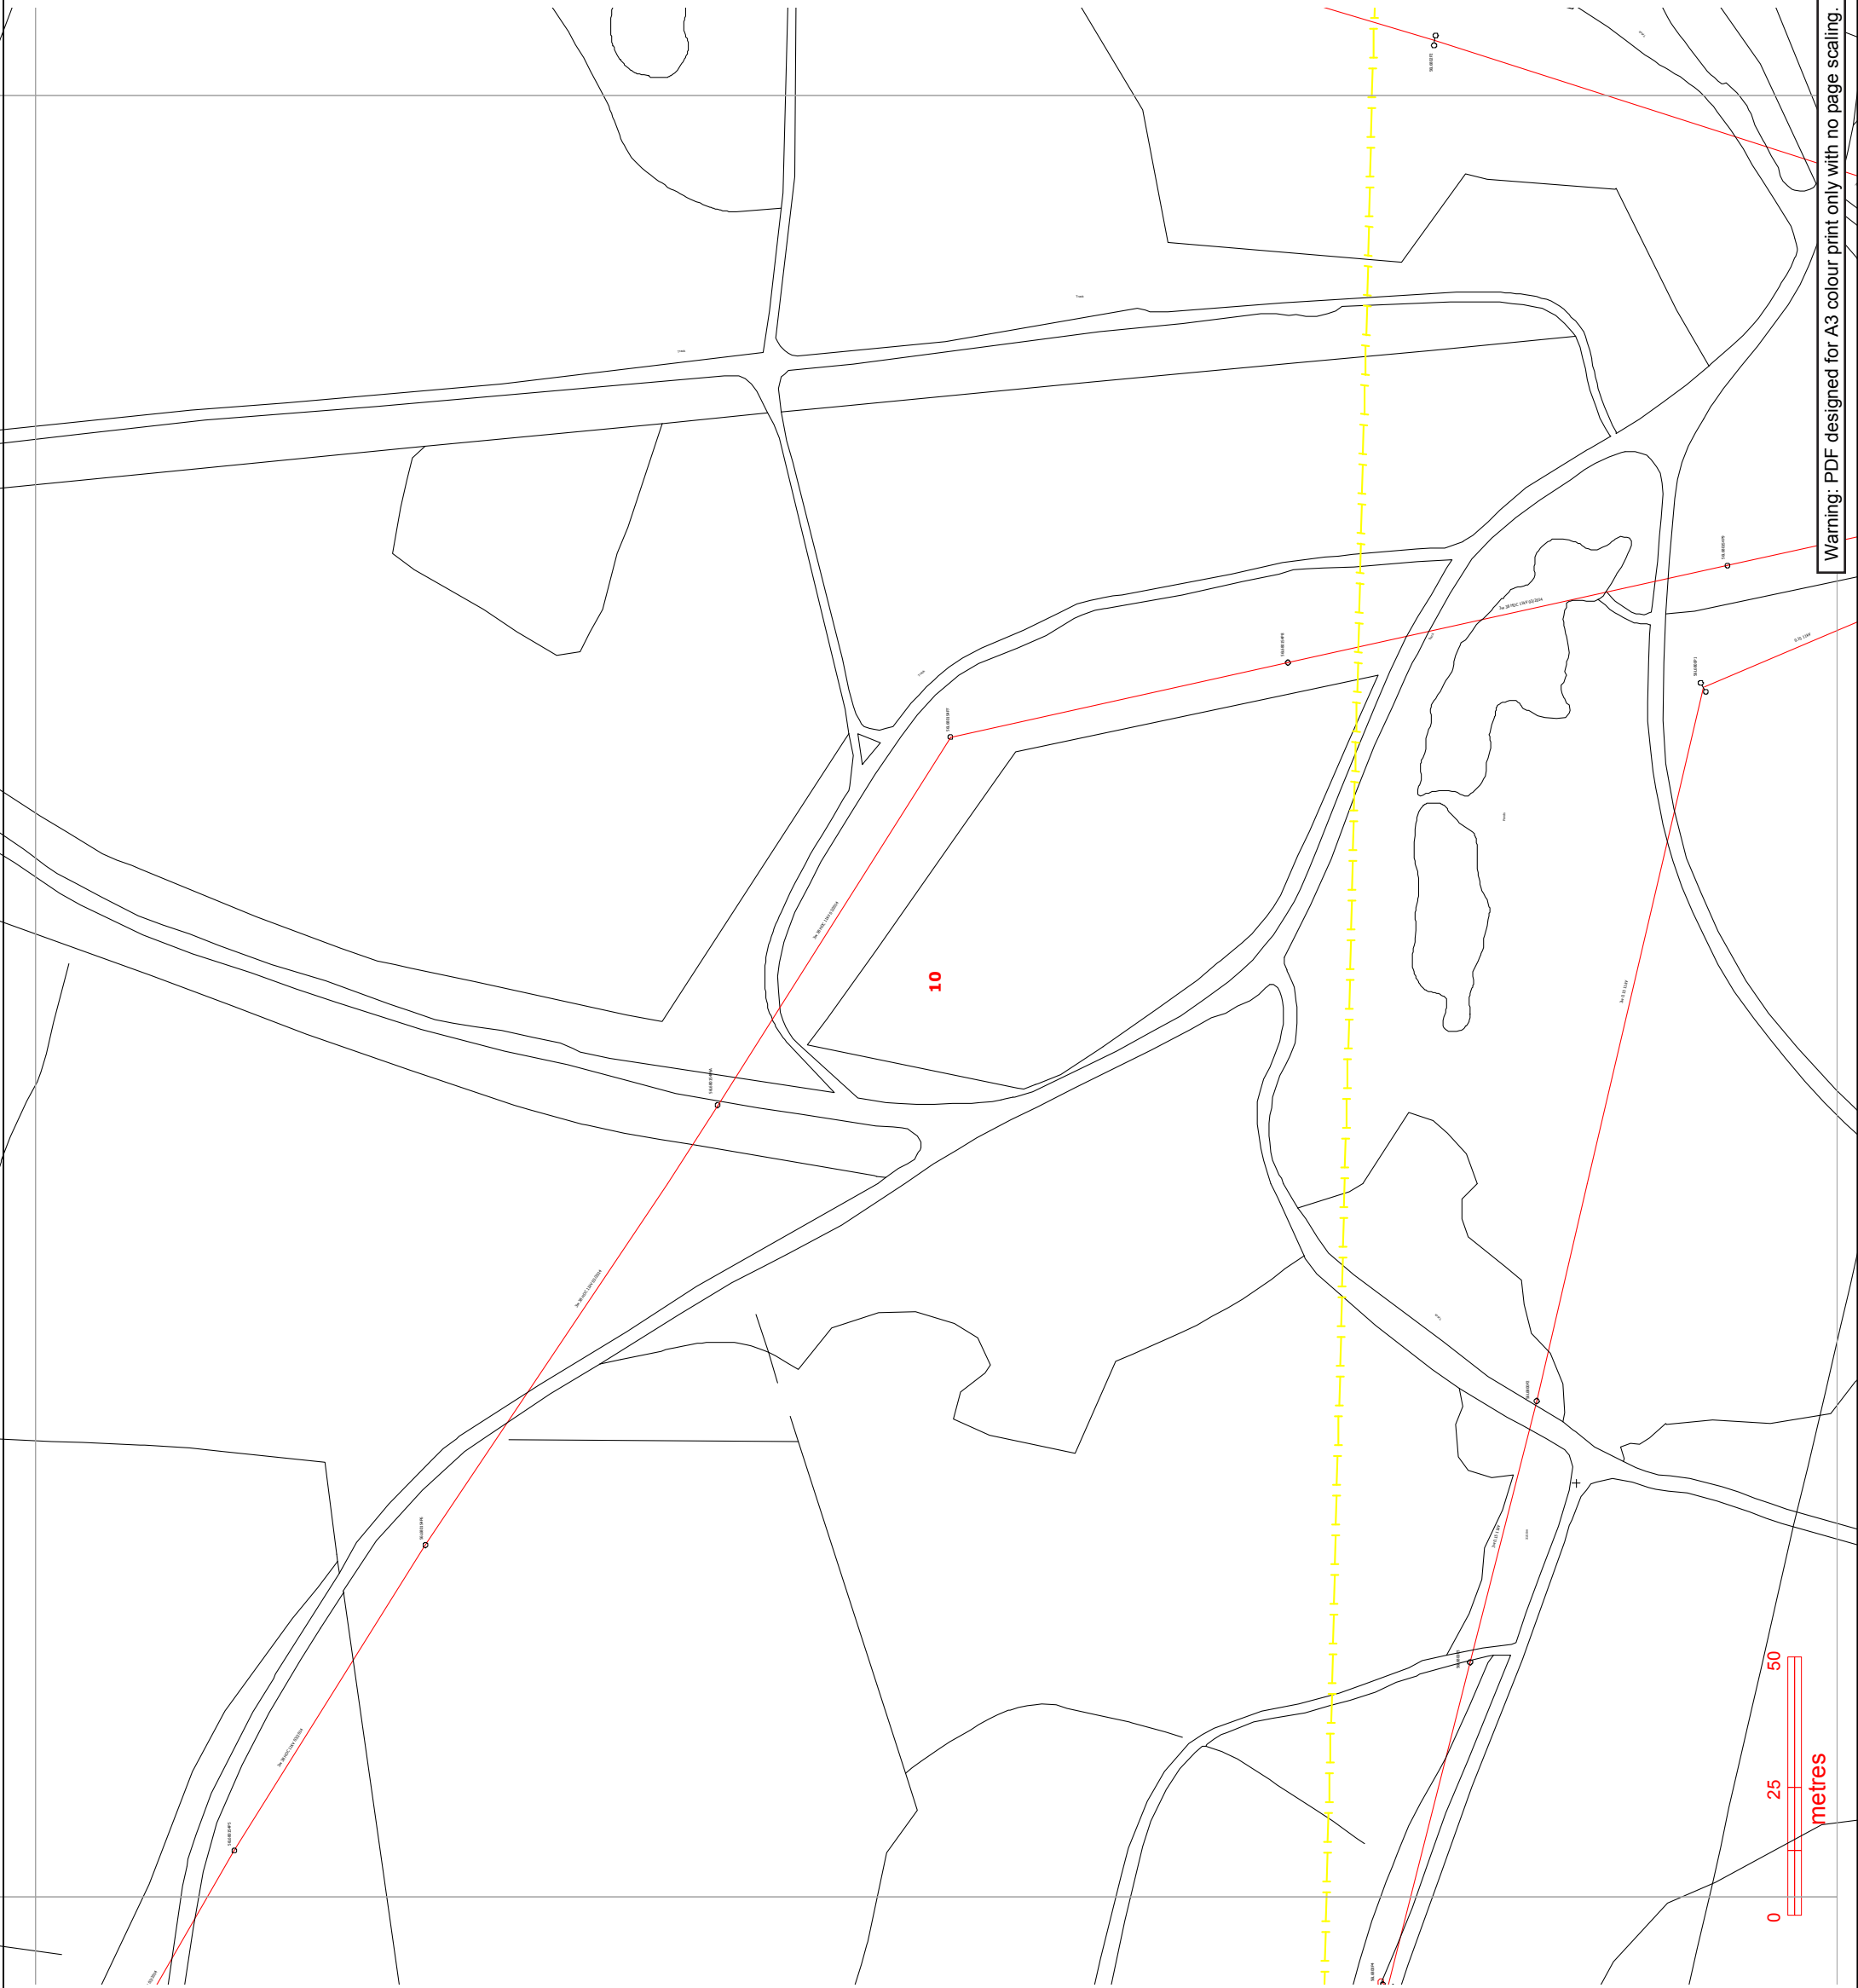





Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105

U.S. DEPARTMENT OF COMMERCE

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools/rods in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electricity line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 09603080.
- Advice should be sought from the Western Power

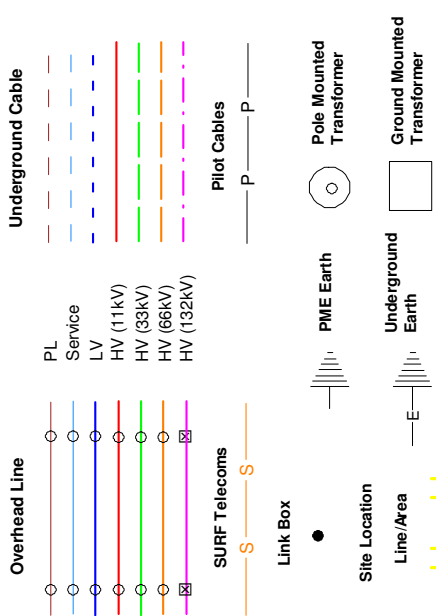

Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022488, 100024877 & 100021807.

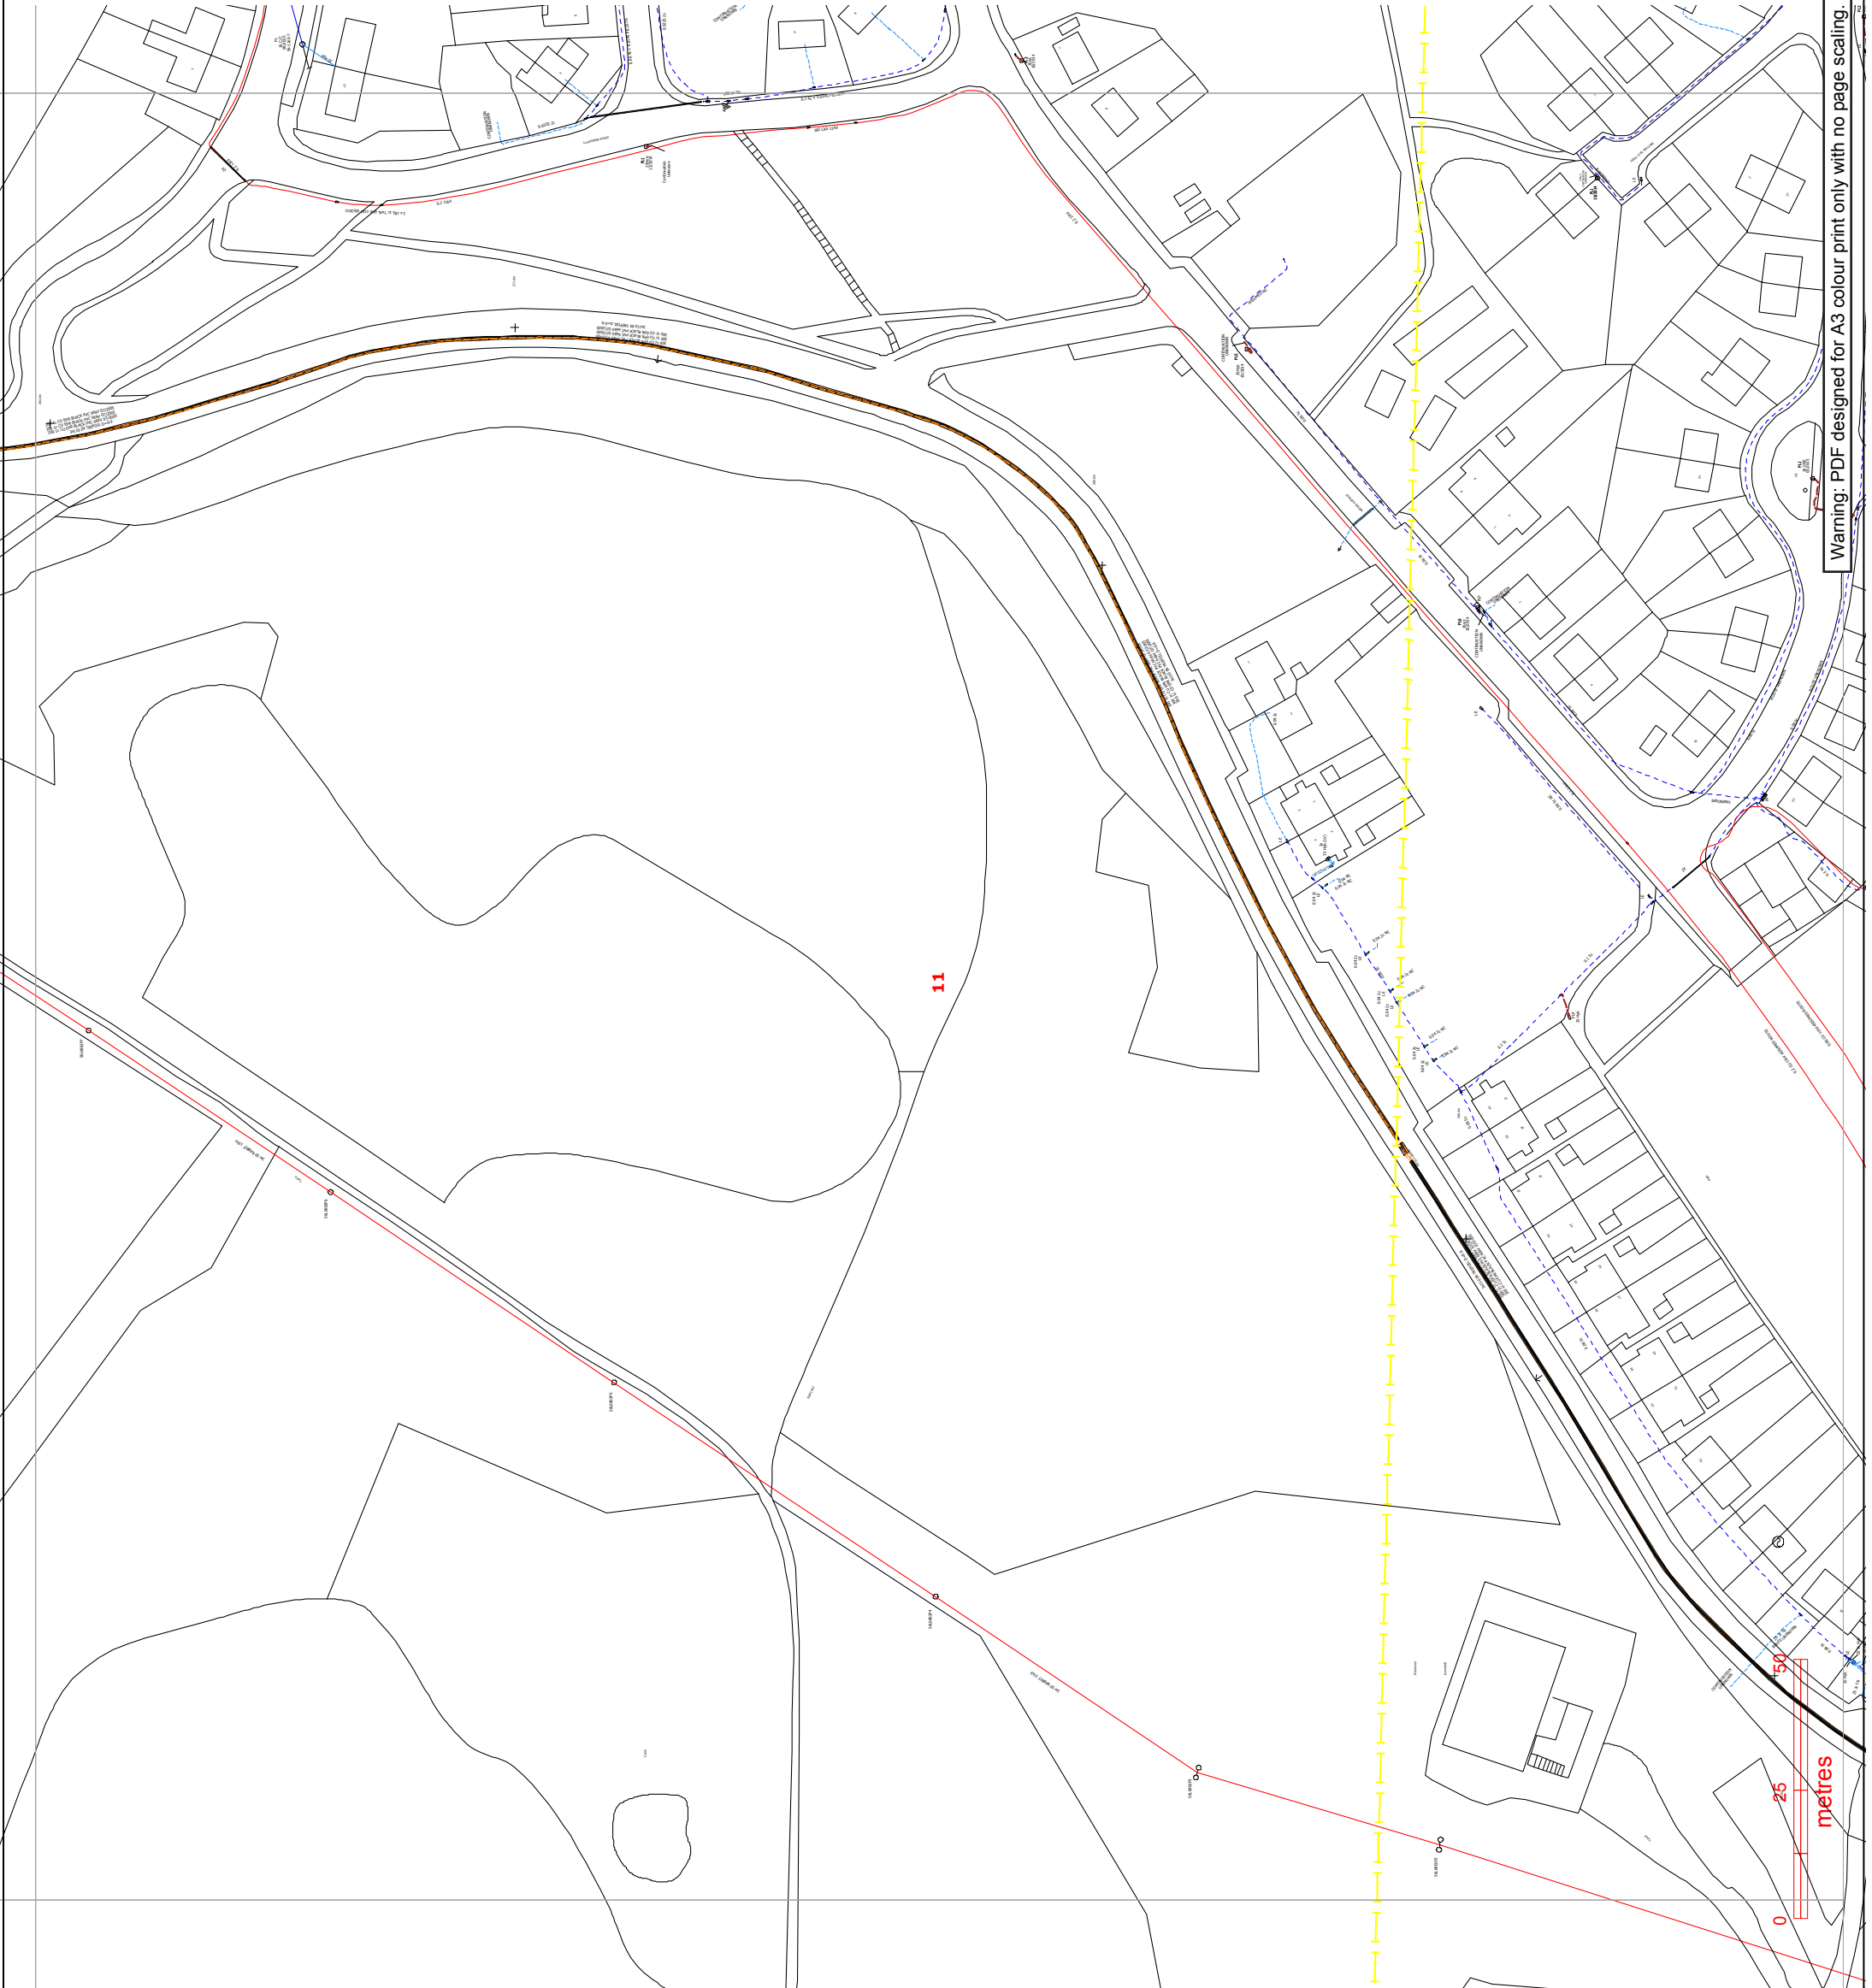


Warning: PDF designed for A3 colour print only with no page scaling.


Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105


Your Scheme/Reference: Afan Valley 2

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the Western Power

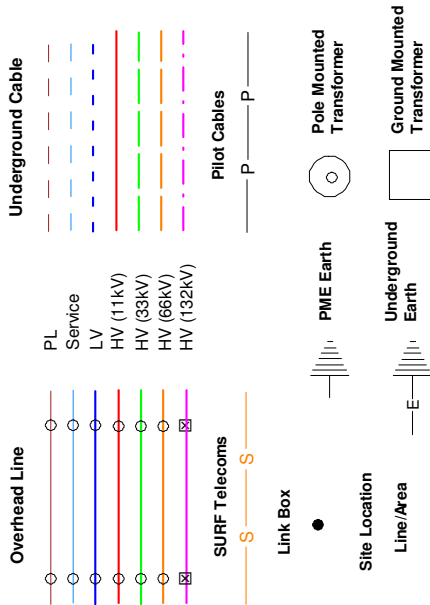

Crown Copyright © All Rights Reserved. Ordnance Survey Licence
 numbers: 100022488, 100024877 & 100021807.
 WPD Copyright: This copy has been made by or with the authority of
 Western Power Distribution (WPD) pursuant to Section 47 of the
 Copyright Designs and Patents Act 1988 unless that Act provides a relevant
 exception to copyright the copy must not be copied without the prior
 permission of the copyright owner

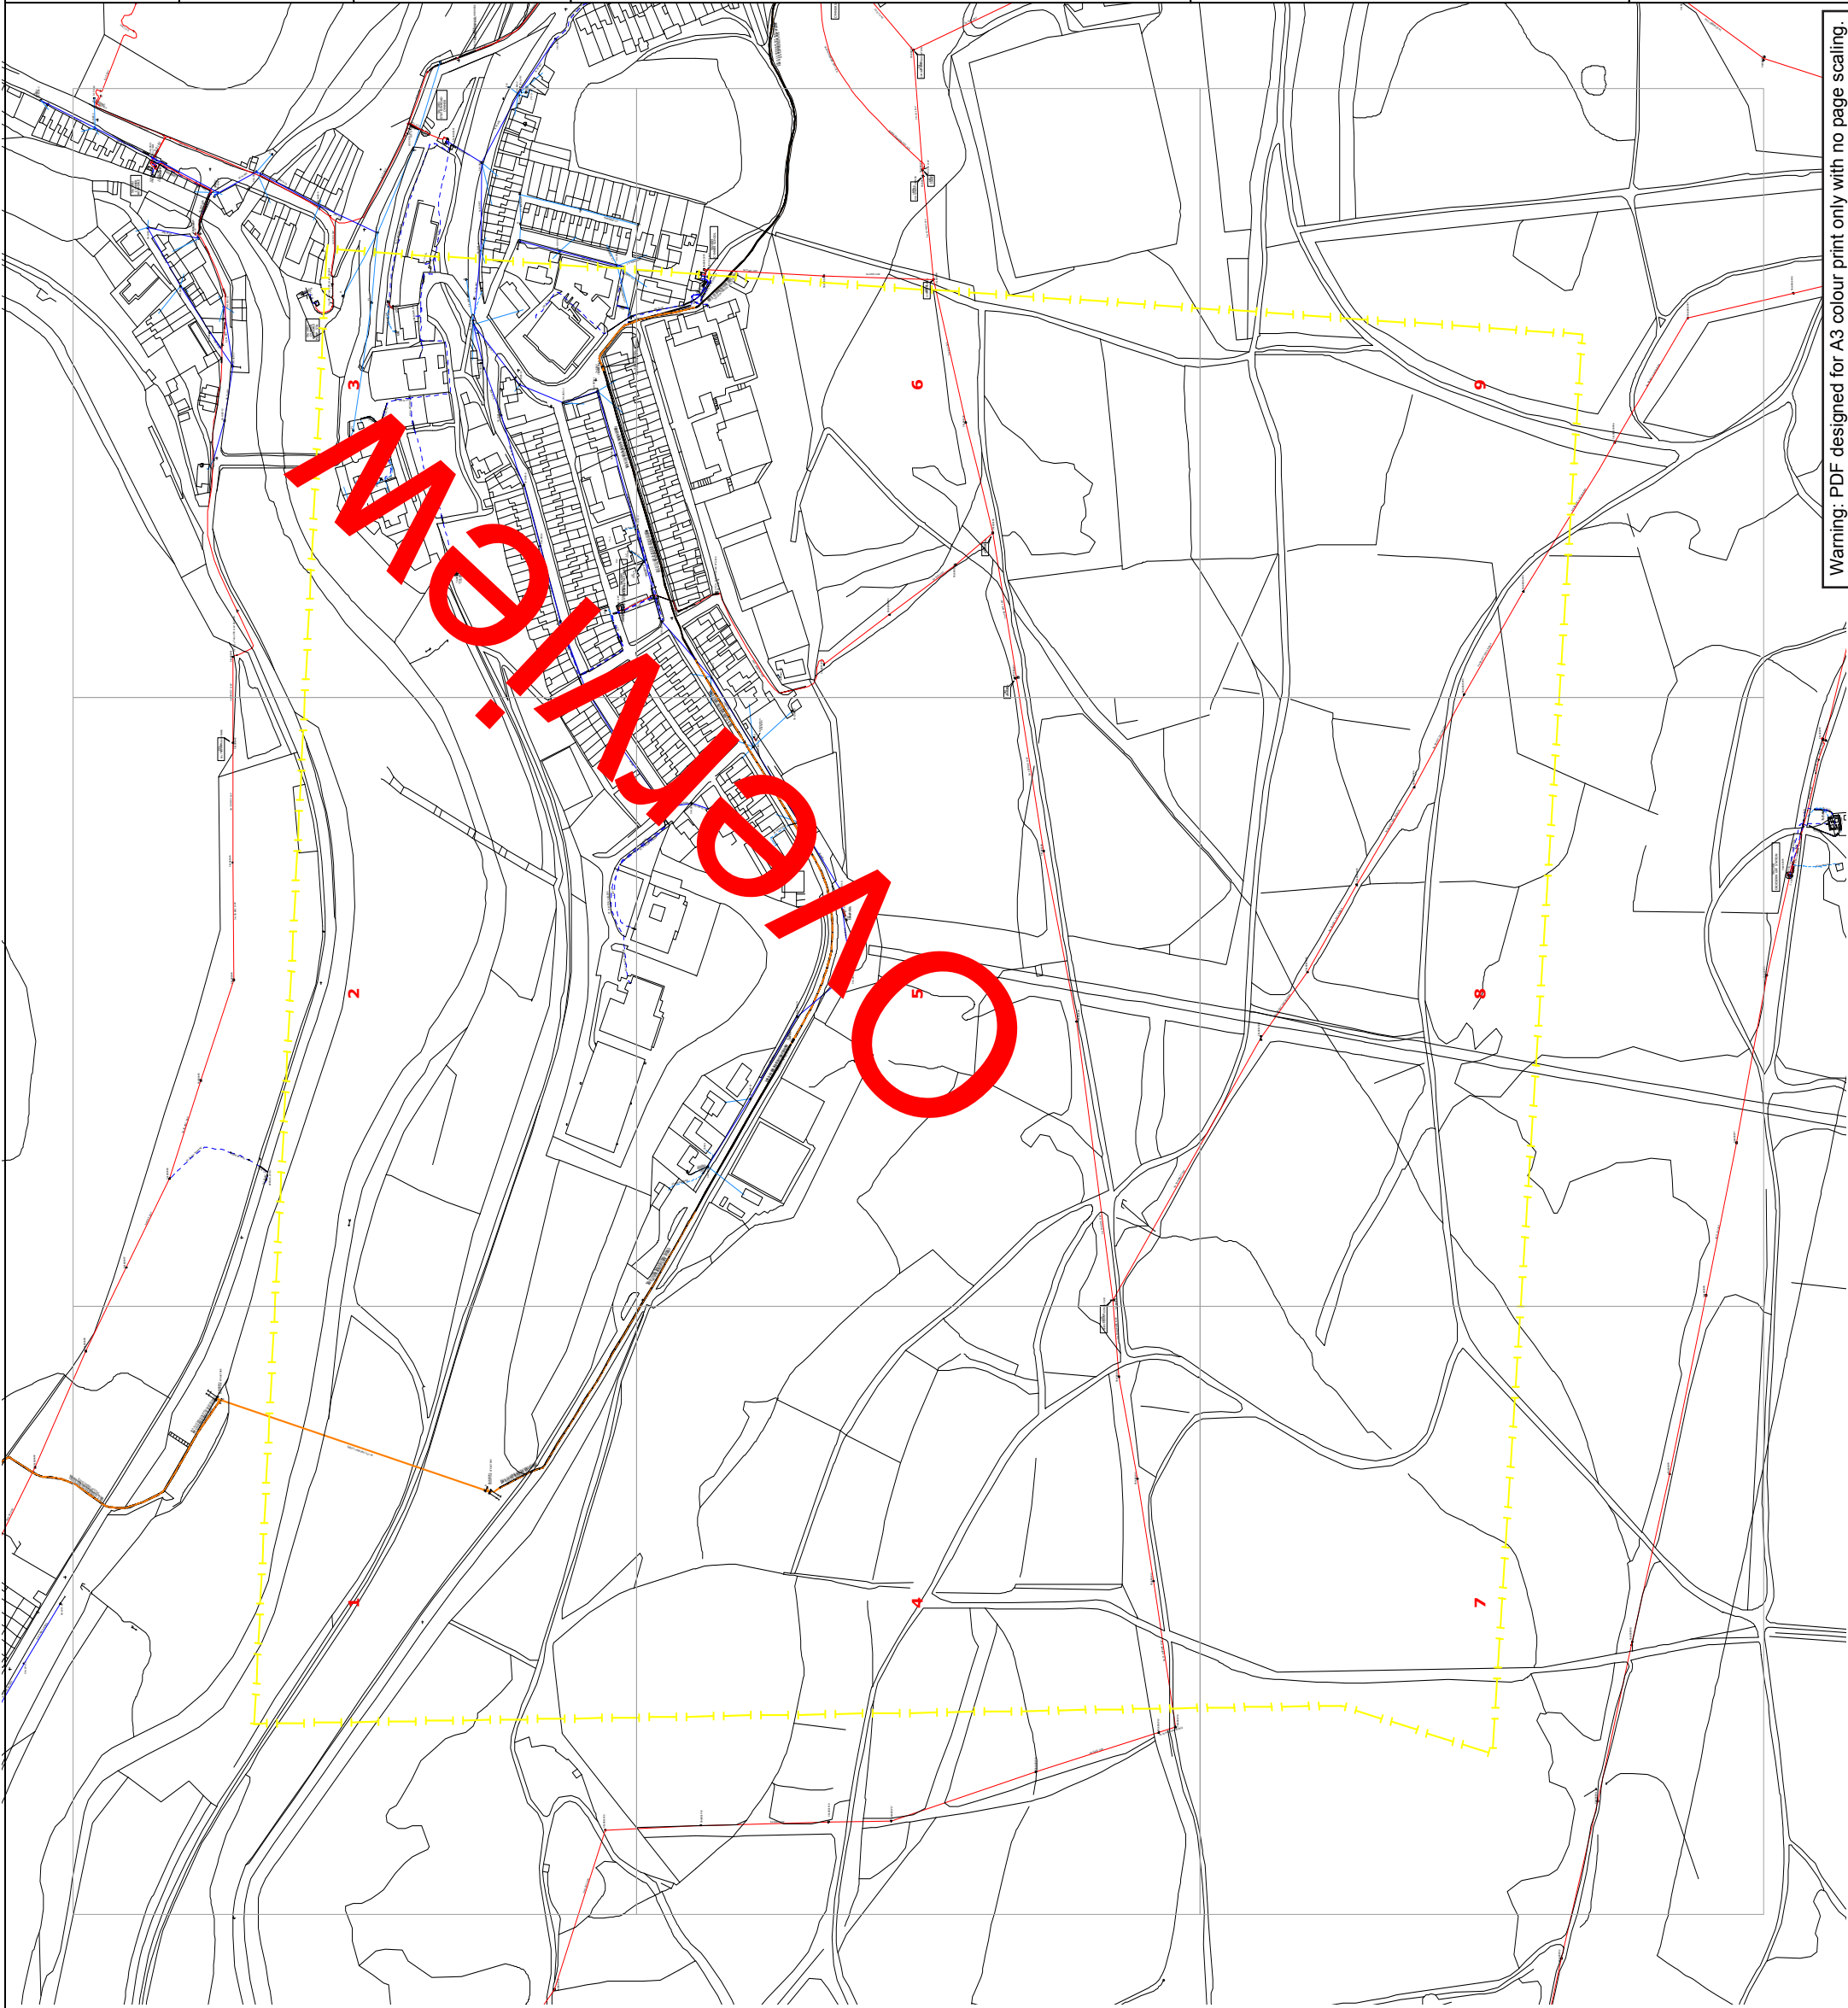

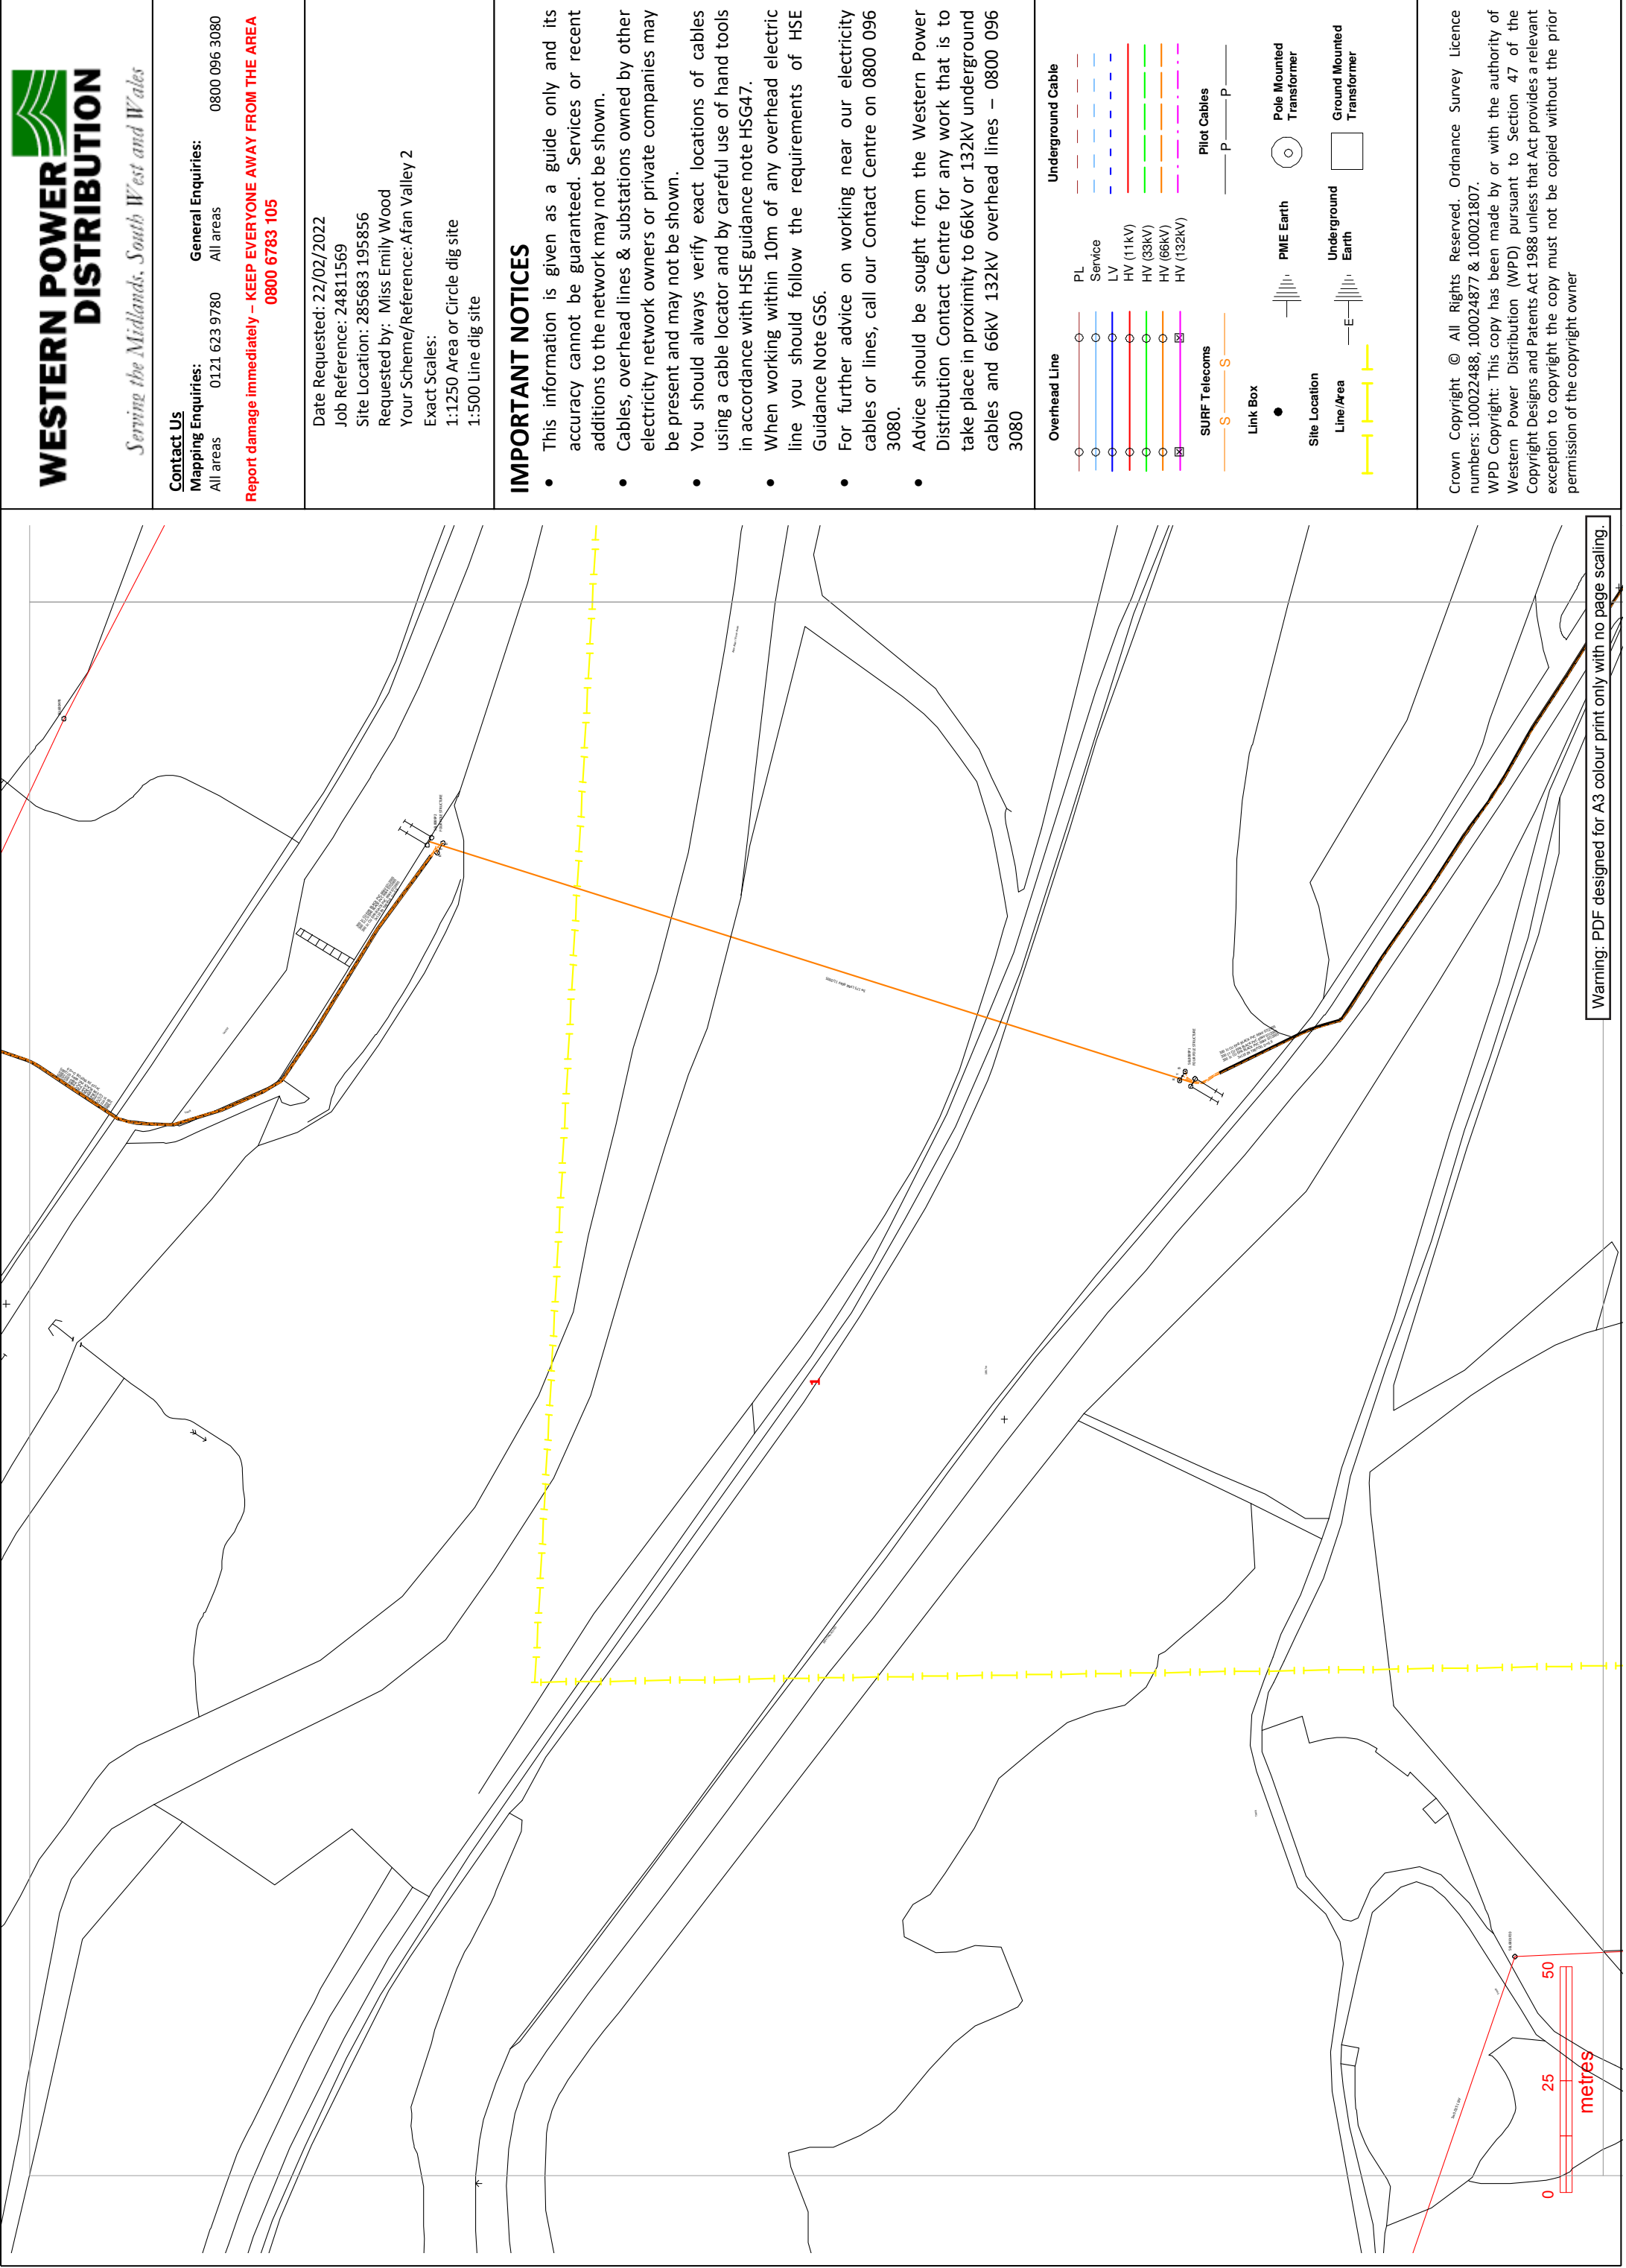

Contact Us

Mapping Enquiries:

All areas

0121 623 9780

0800 096 3080

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105

Date Requested: 22/02/2022

Job Reference: 24811569

Site Location: 285683 195856

Requested by: Miss Emily Wood

Your Scheme/Reference: Afan Valley 2


Exact Scales:

1:1250 Area or Circle dig site

1:500 Line dig site

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the Western Power

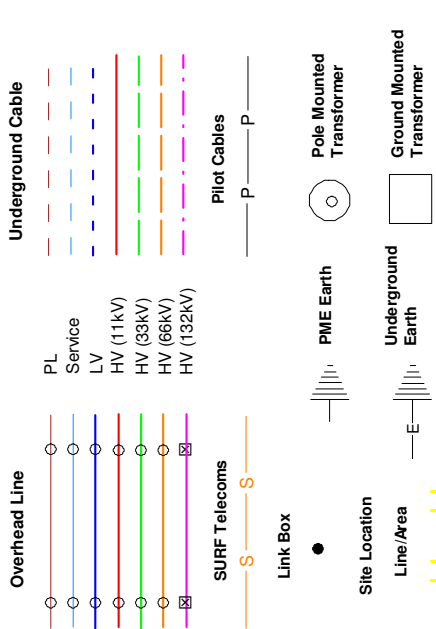

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022488, 100024877 & 100021807.

