
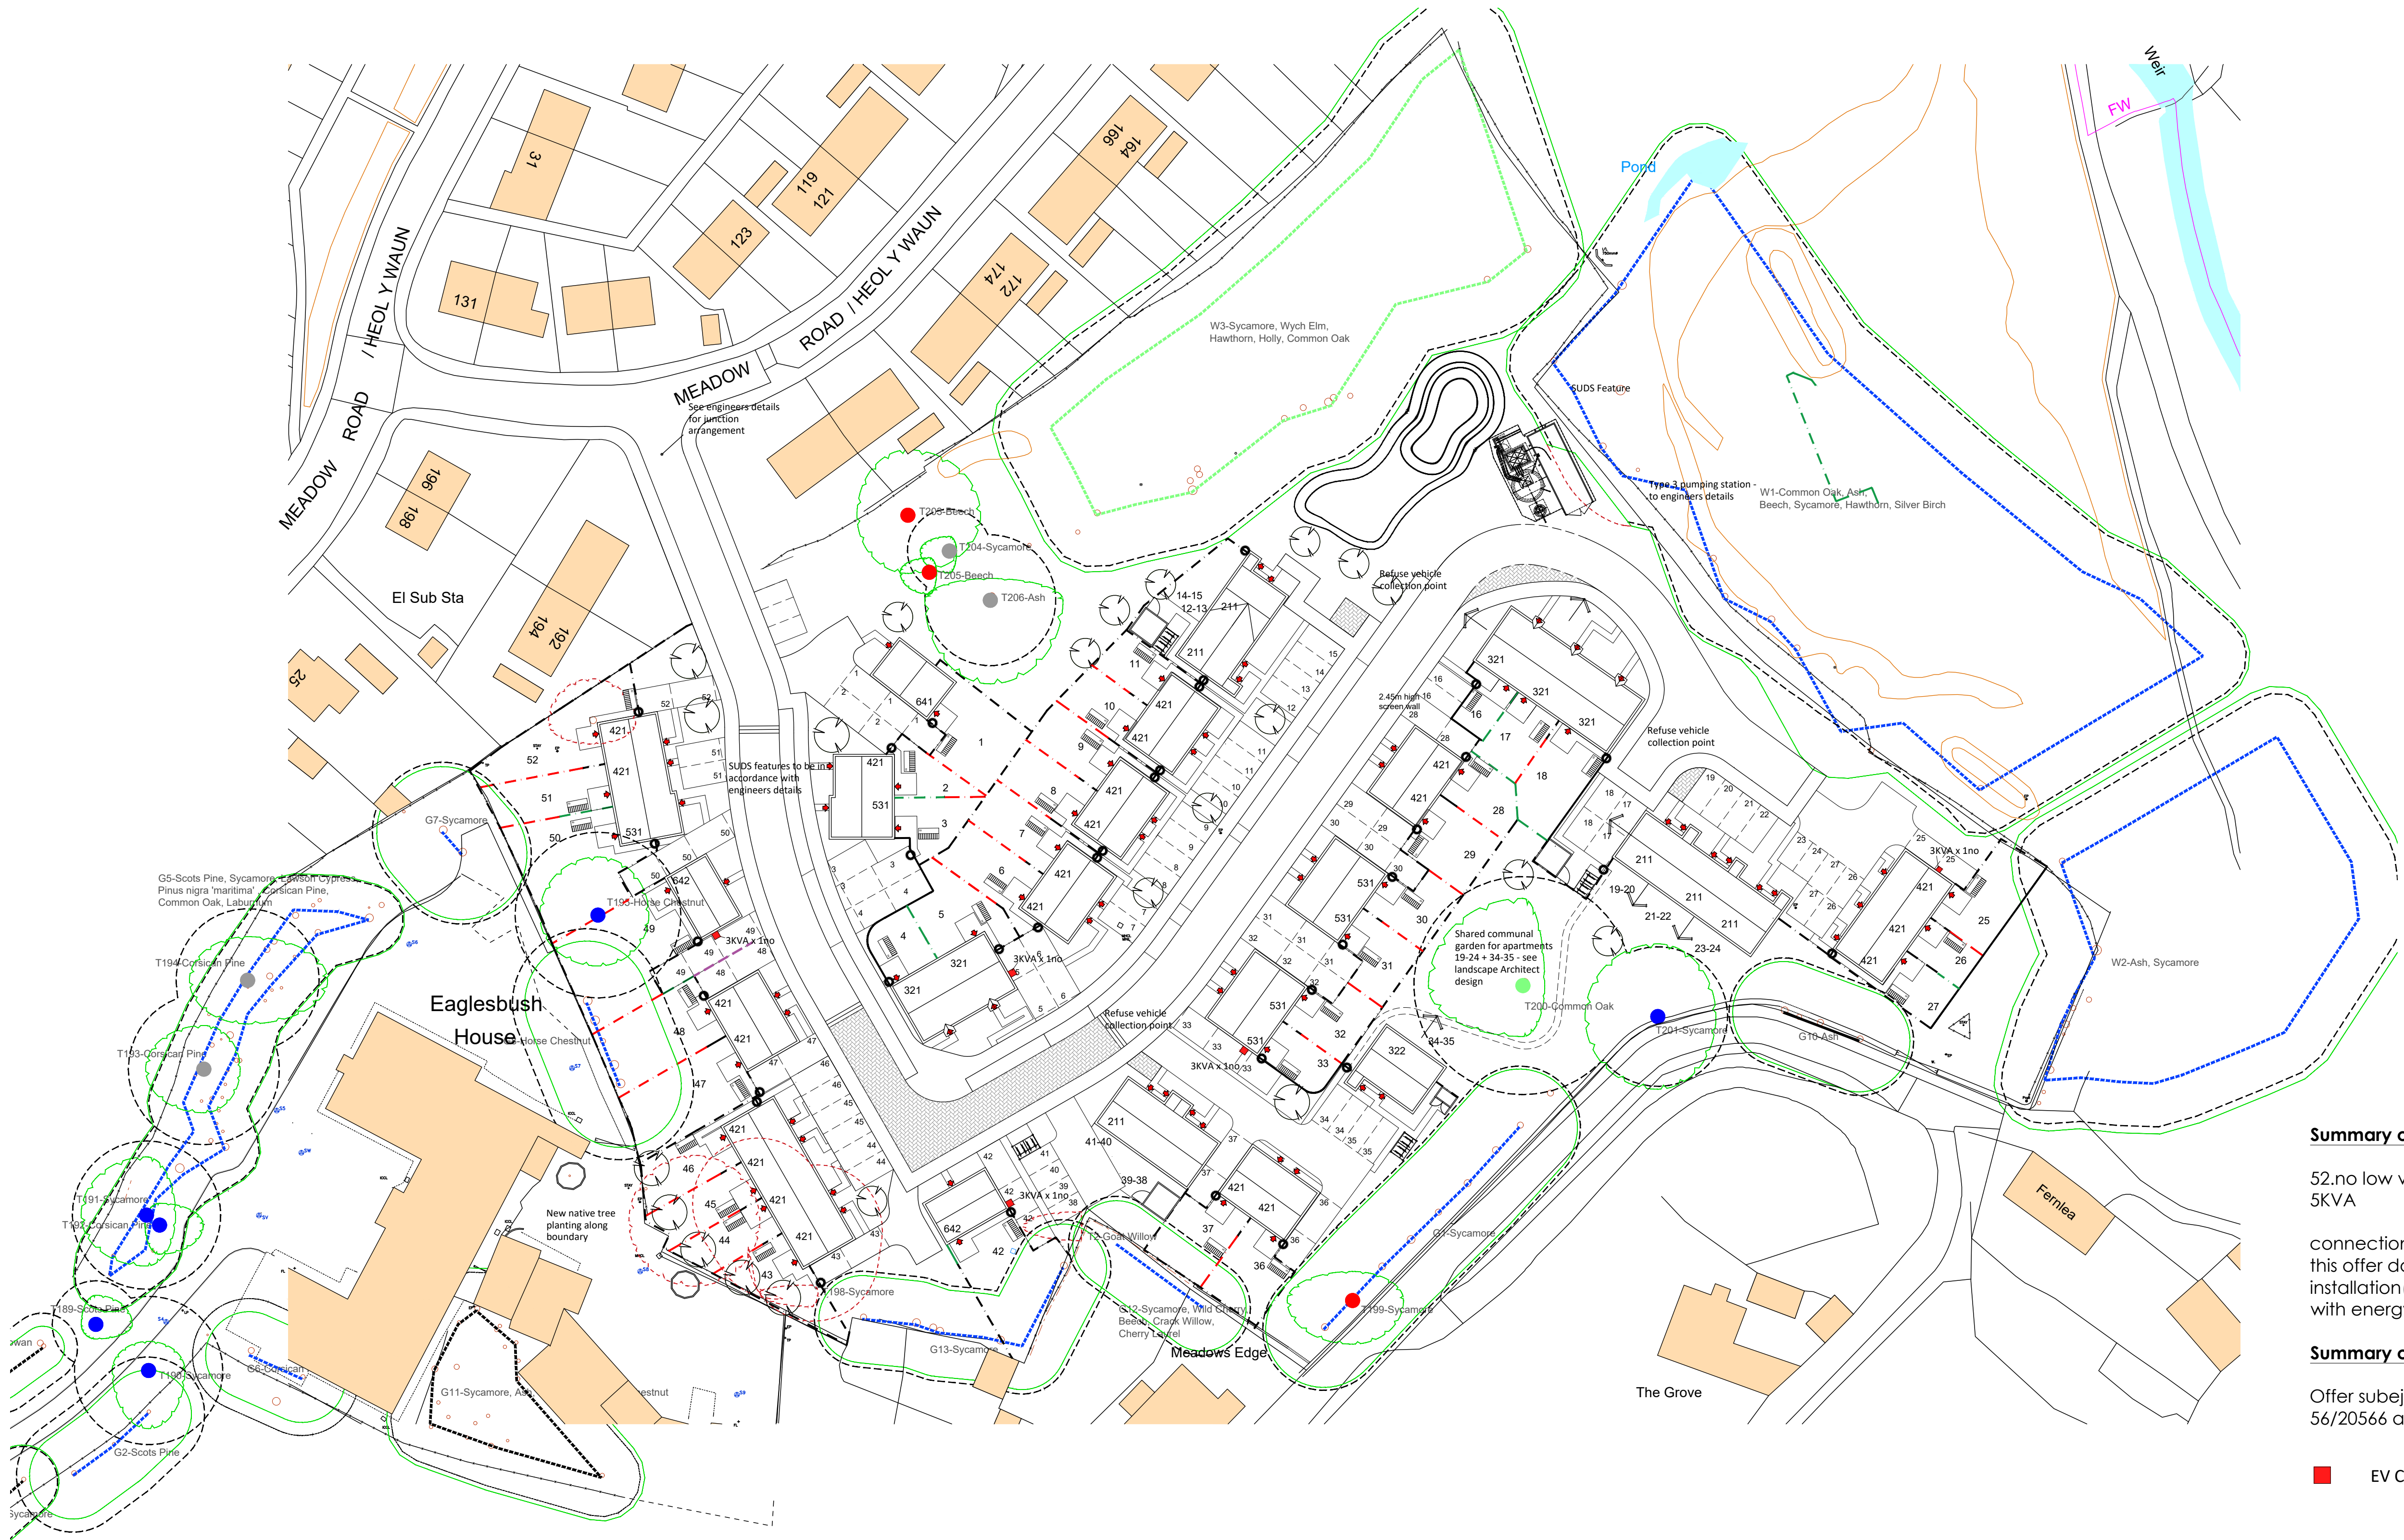


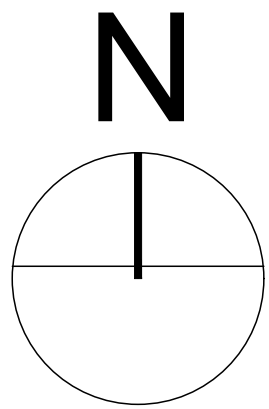

Summary of the electricity connection requirements

52.no low voltage single phase domestic connections with an ADMD of 5KVA

connections have been design to accommodate 3KVA generator this offer does not give formal approval for any specific generation installation(s), which must be applied for separately and in accordable with energy networks associated engineering

Summary of the electricity of the reinforcement required

Offer subeject to reinforcement of WPD network at melincrythan North 56/20566 and diveryed HV cable under customer ref 4155156

■ EV Charging point (3KVA)

Status: **PLANNING**

This drawing is copyright and its use or reproduction without the permission of Spring Design Consultancy Limited is prohibited. All rights are reserved until invoices are paid in full. No responsibility will be taken for any design used for construction prior to receipt of relevant approvals.

rev	date	description	by
D	17.08.22	Layout updated to latest engineering information	CC

Drawn:	CC
Checked:	CW
Date:	August 2020
Scale:	1:250 @ A1 & 1:500 @ A3

Client:	Jones Brothers & Tai Tarian
Project:	Meadow Road
Title:	EV Charging layout
Ref:	2330-01(04)101

Rev:



Unit 2 Chapel Barns | Merthyr Mawr
Bridgend | CF32 0LS | 01656 656267
mail@spring-consultancy.co.uk