



PLAN

Ground floor

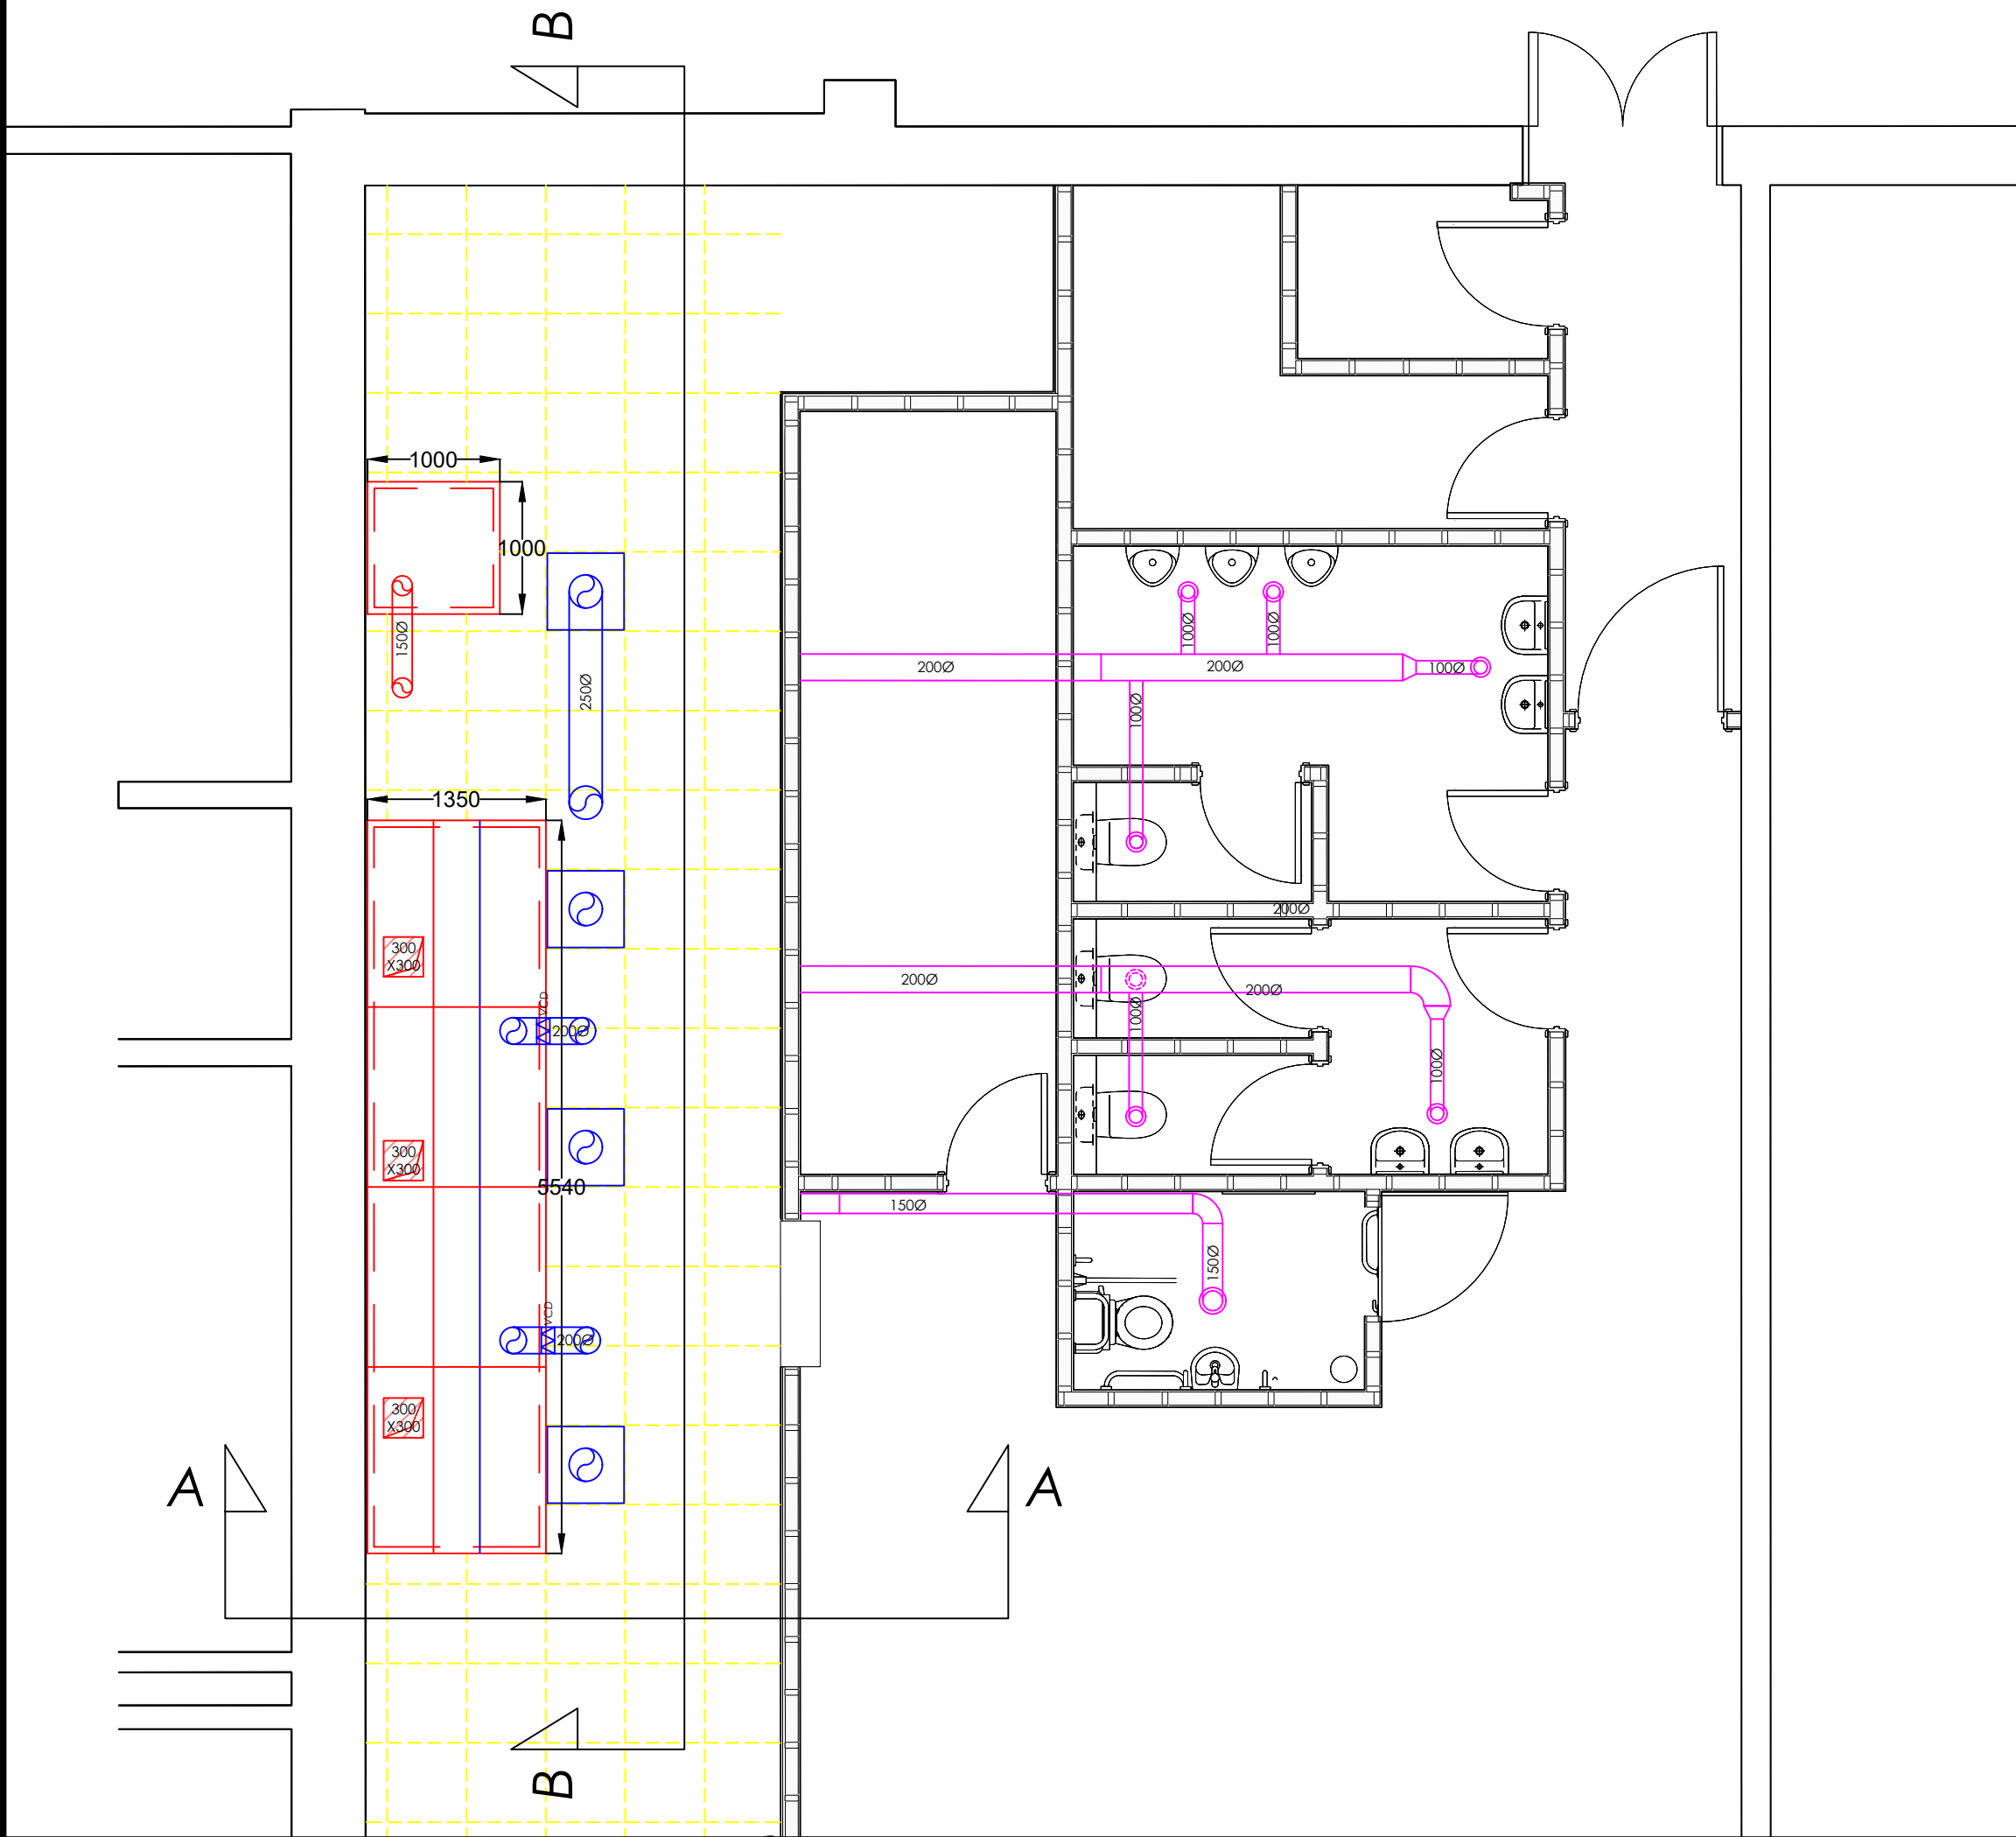


PLAN

Roof

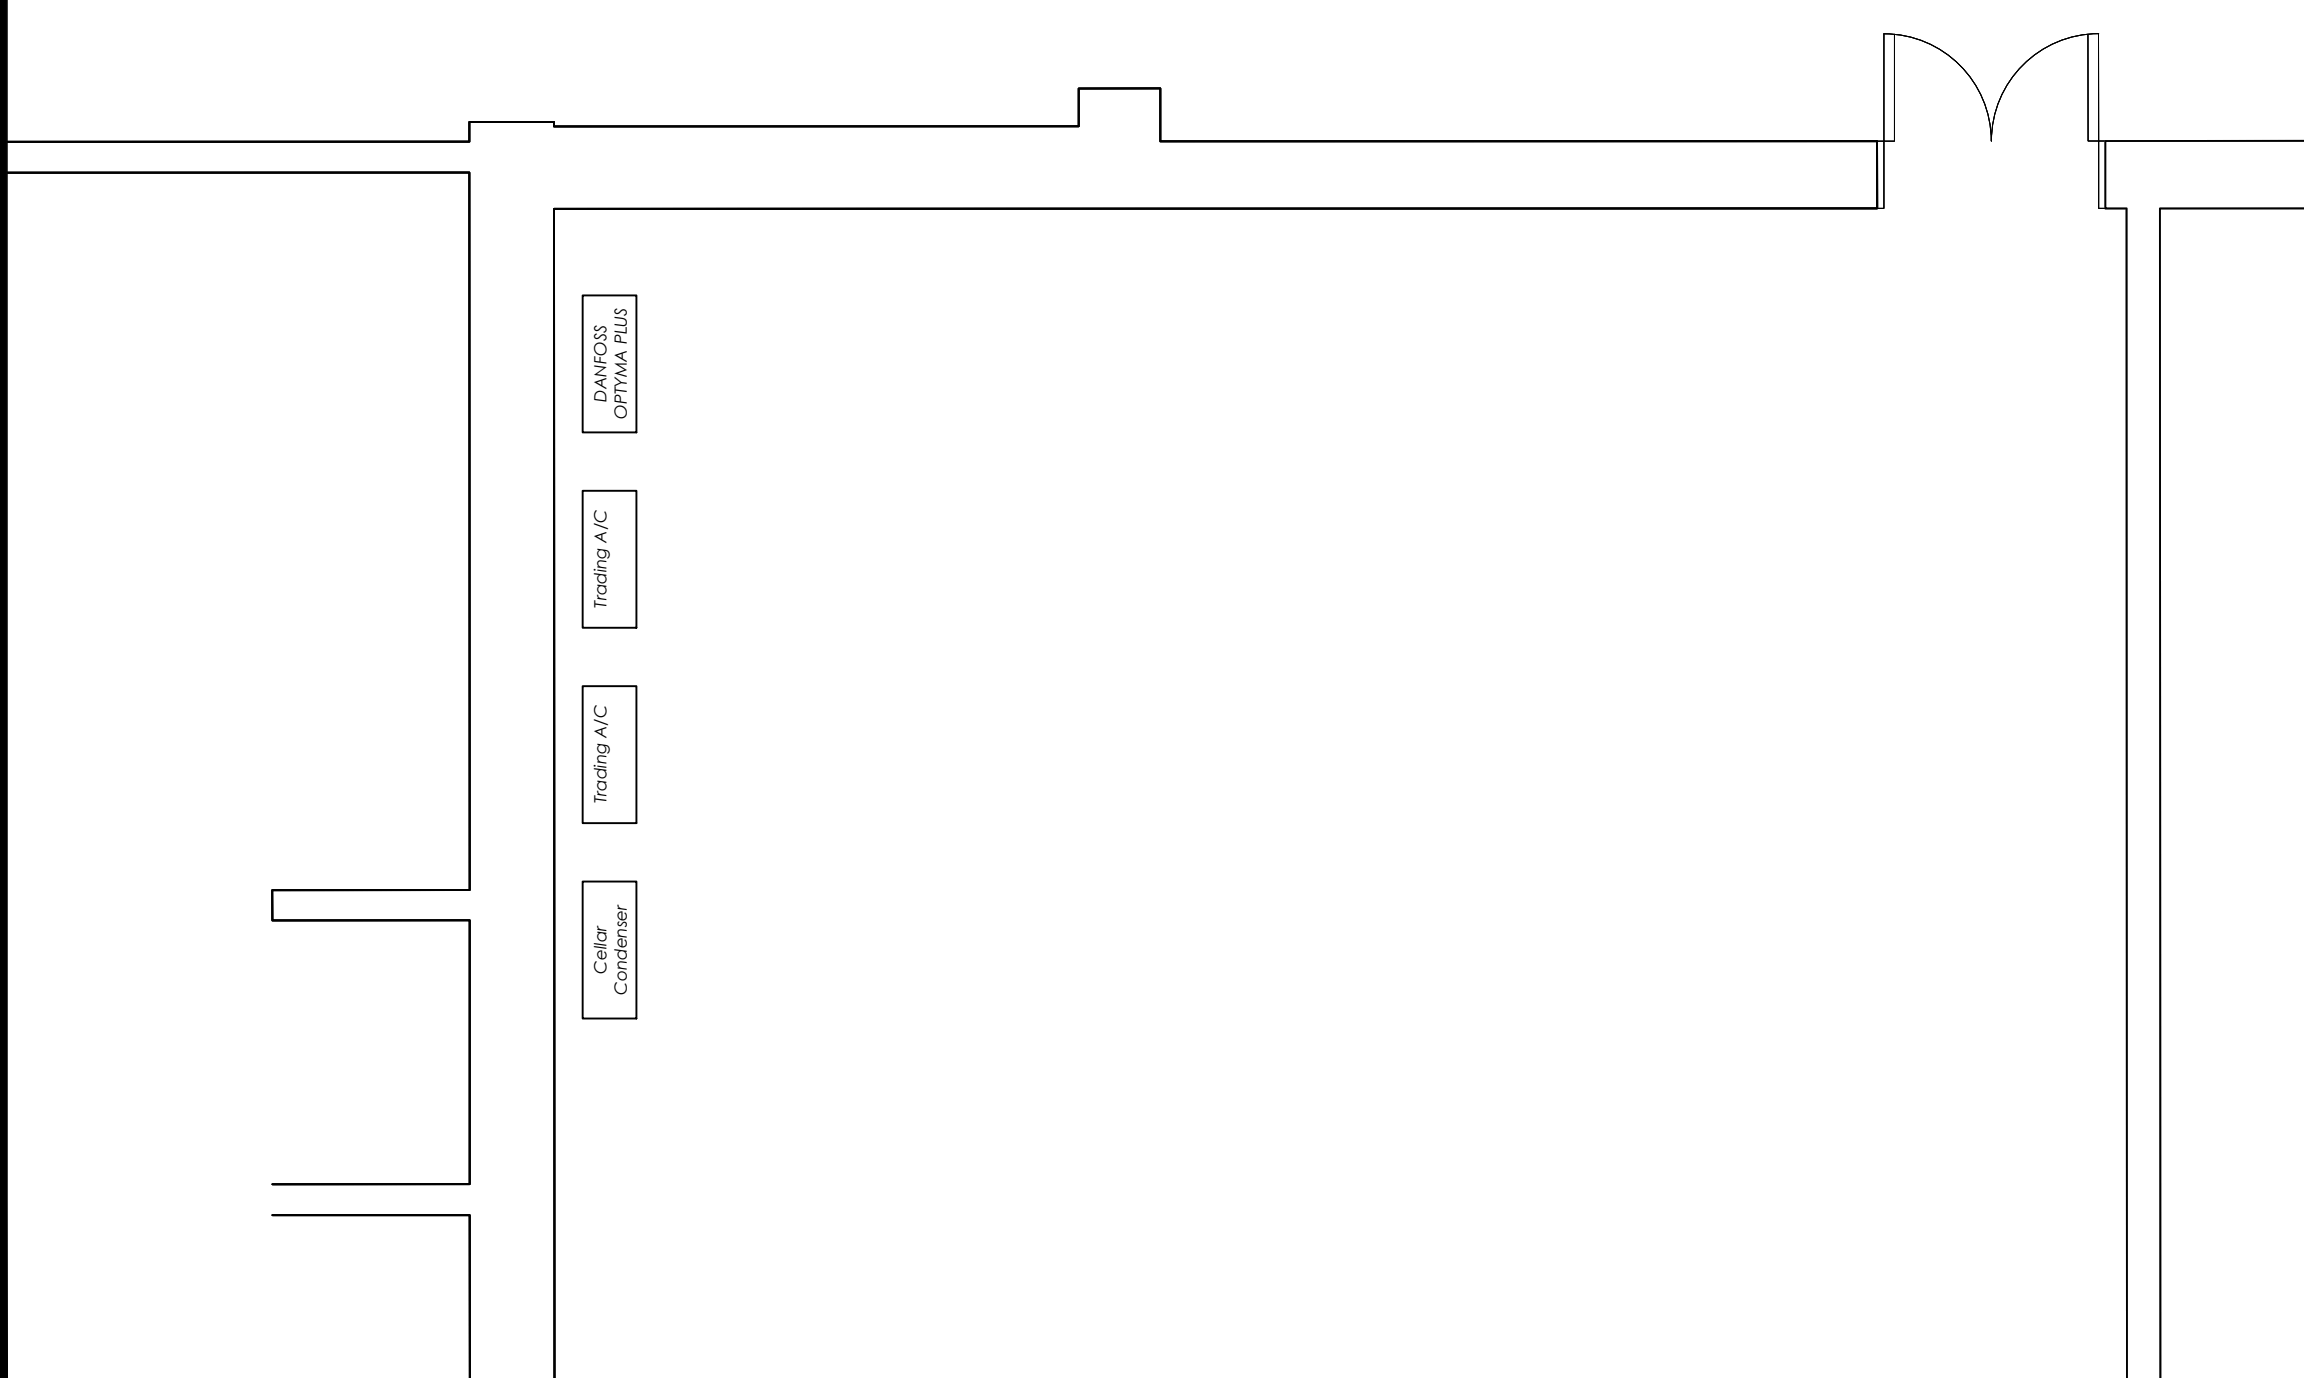


PLAN

Plant Mezzanine

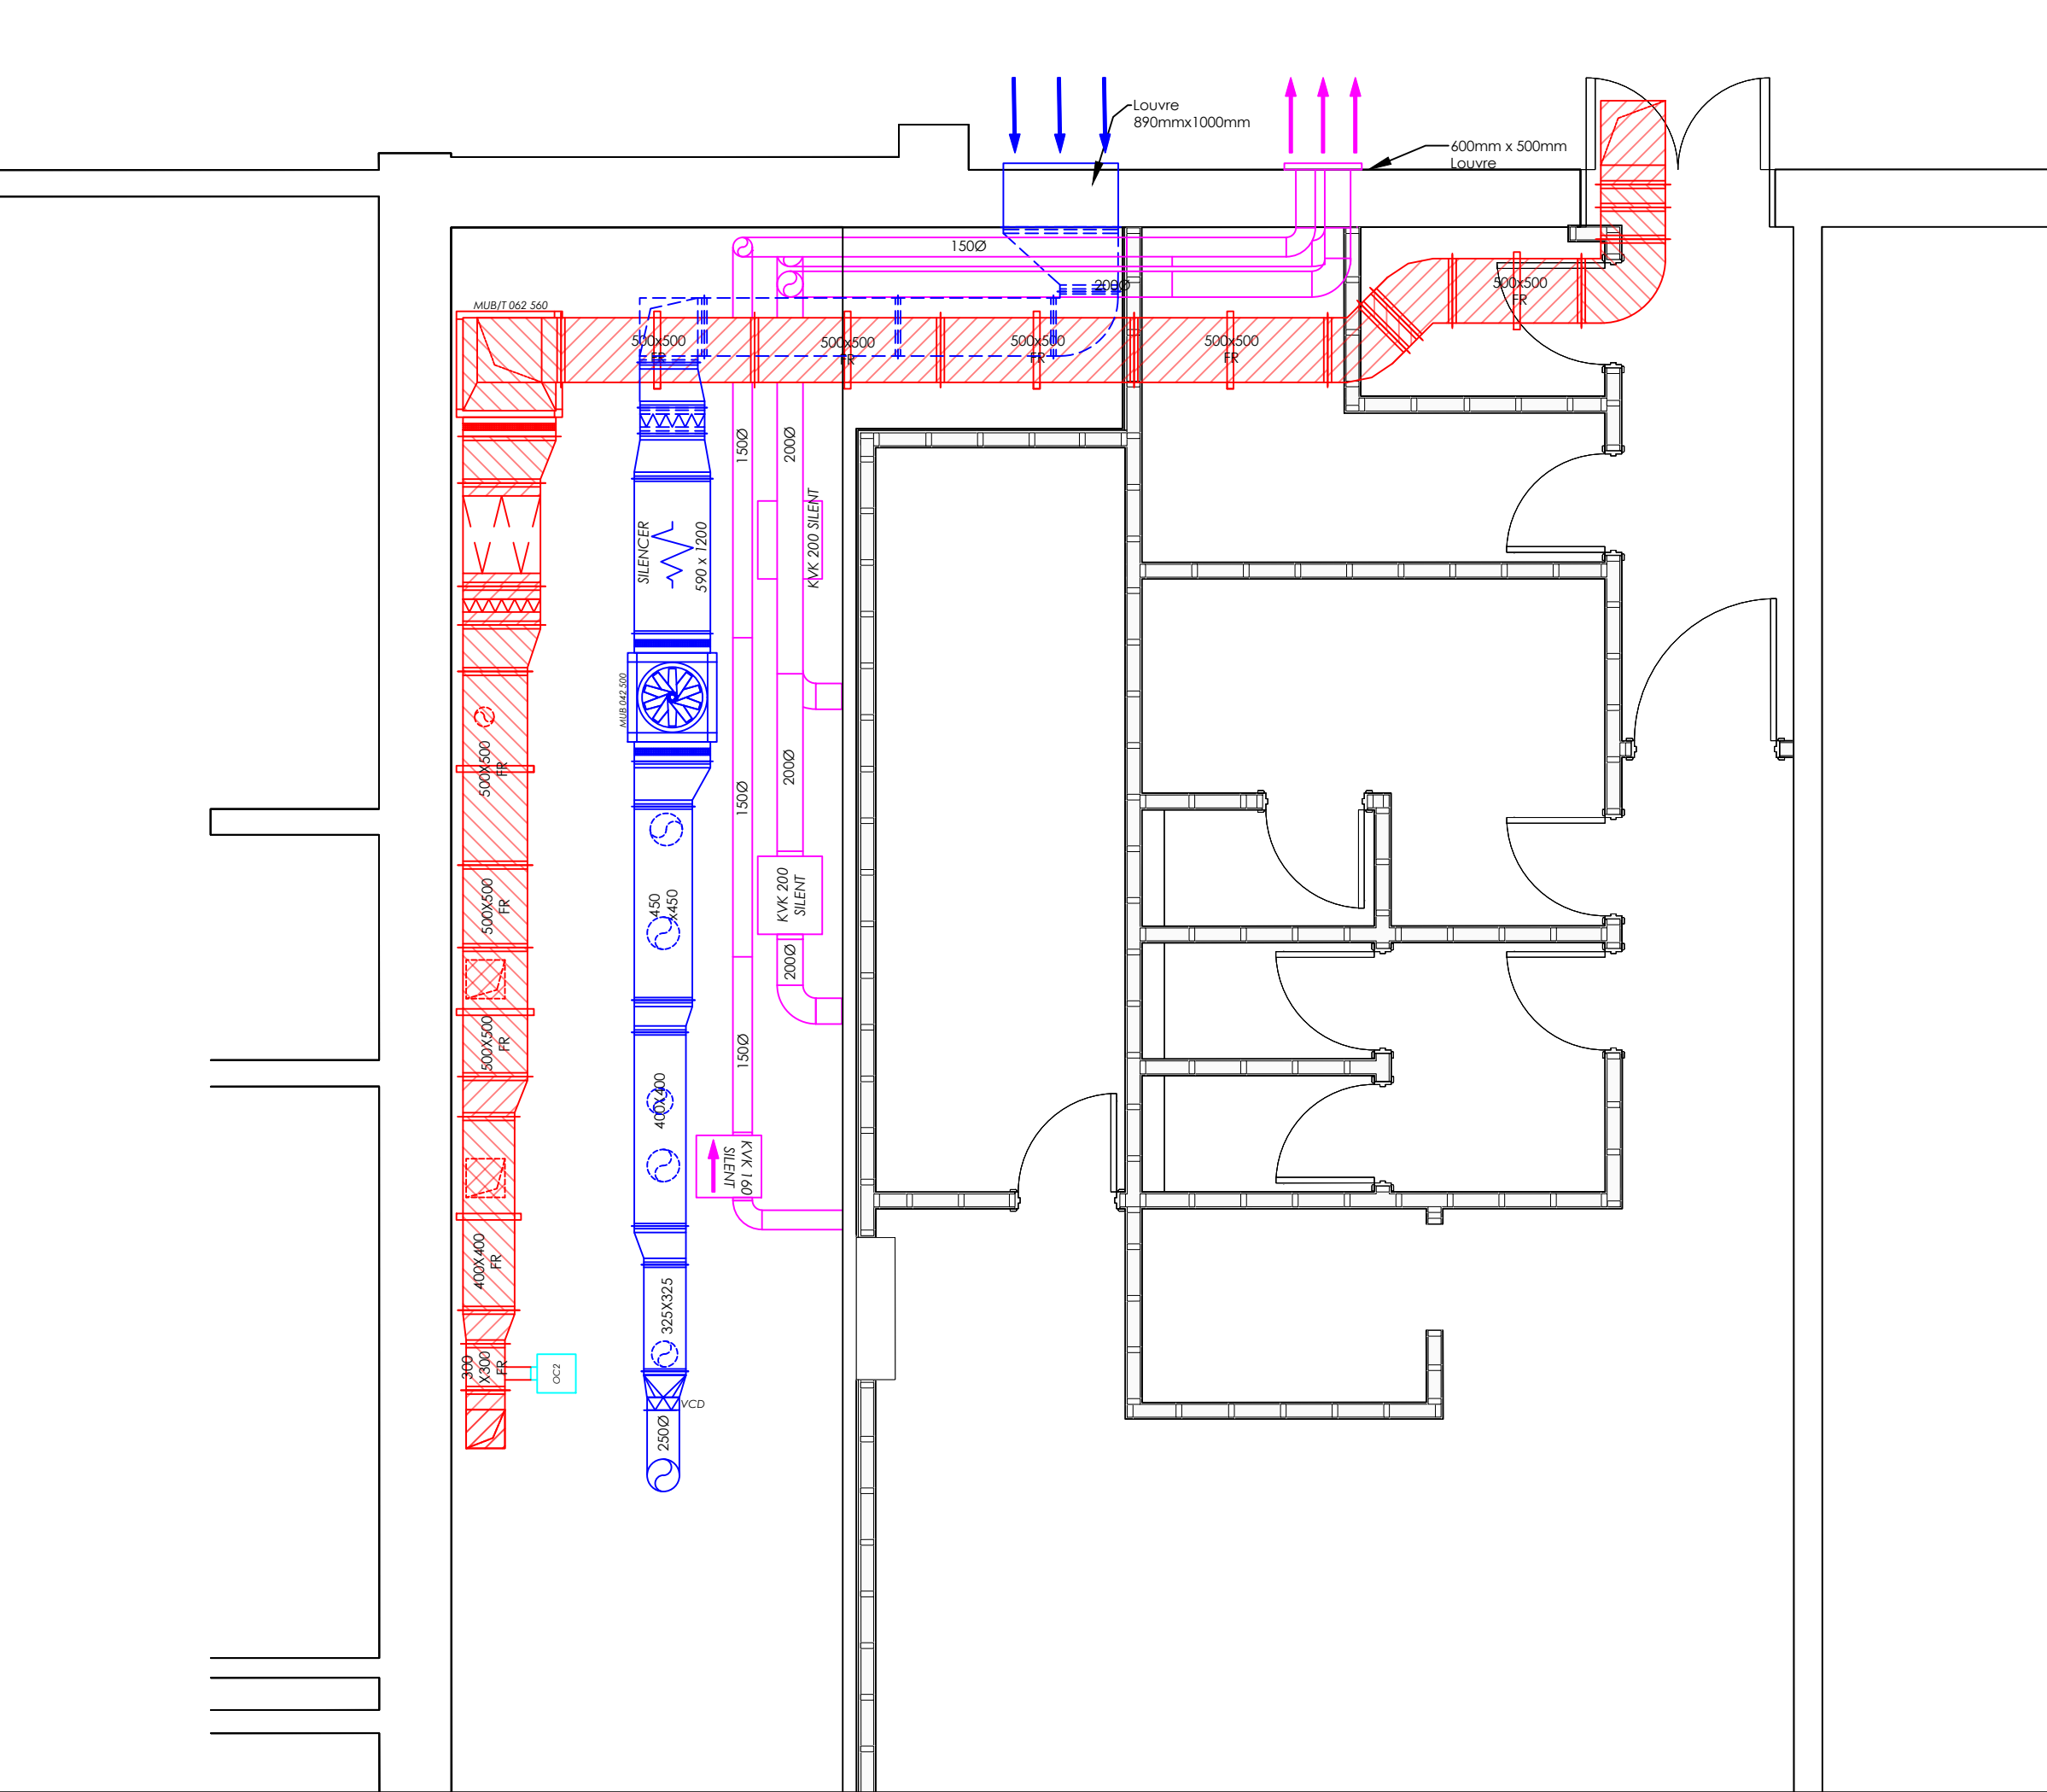

SECTION A-A

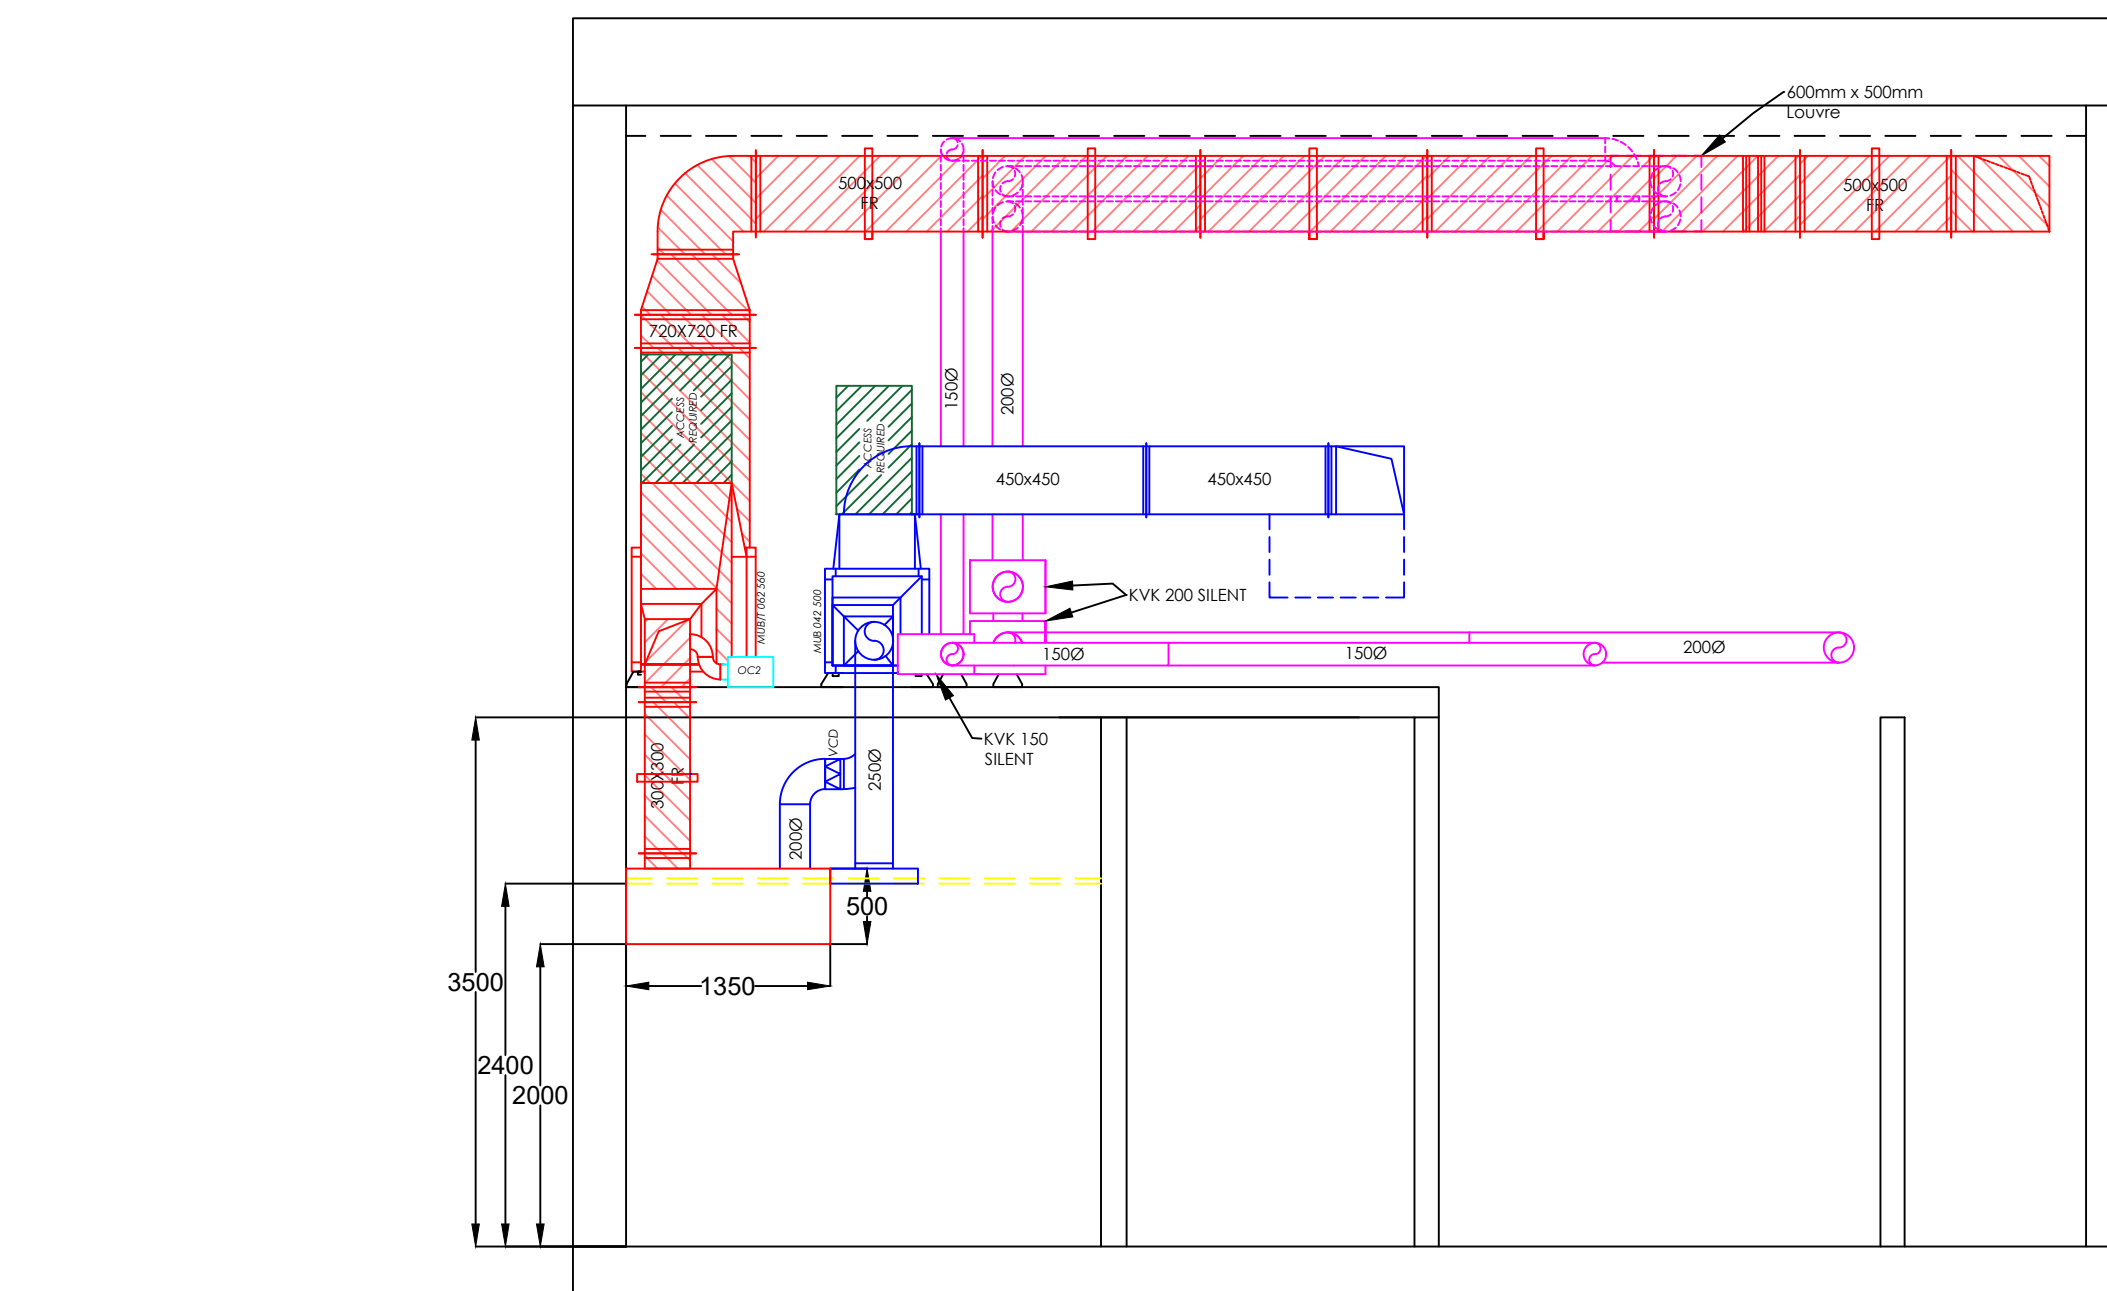

FOR APPROVAL

DO NOT SCALE FROM THIS DRAWING!
ALL MEASUREMENTS IN MILLIMETERS
GENERAL TOLERANCE +/- 1mm.
ALL POWER & SERVICES INSTALLATION BY
CLIENT AND/OR M&E CONTRACTOR.

Kitchen extract	Ceiling grid
Kitchen supply	Kitchen extract Fire Rated
	Toilet extract

FAN INFORMATION
Extract fan: MUB/T 062 560 D4
Start current: 4.48A
Sound level: 38dB at 3M free field

Supply fan: MUB 042 500 D4
Start current: 3.01A
Sound level: 33dB at 3M free field

Approximate canopy weight: 290Kg

Drawing to be used in conjunction with
Architect:
Kitchen:

REV	DATE	NOTES
A	13/10/2022	A/C Condensers added
B	09/11/2022	Extract and toilet termination moved
C	13/12/2022	Supply and toilet louvre termination moved
D	15/12/2022	Supply louvre moved

Client:
Loungers

Project:
Neath Lounge

Scale:	1:50 @ A1
Date:	15/12/2022
Drawn by:	EF
Drawing number:	NL-01
Revision:	D

Partridge Ventilation
"a breath of fresh air"
Cardrew Industrial Estate, Redruth, Cornwall TR15 1SH
01209 204700
enquiries@partridge-ventilation.co.uk

I hereby confirm my acceptance of all information
on this drawing and understand that any subsequent
changes to this plan may be subject to additional charges
Customers Signature: .
Date: .