


Showing Extract Duct



Outside view of terminations

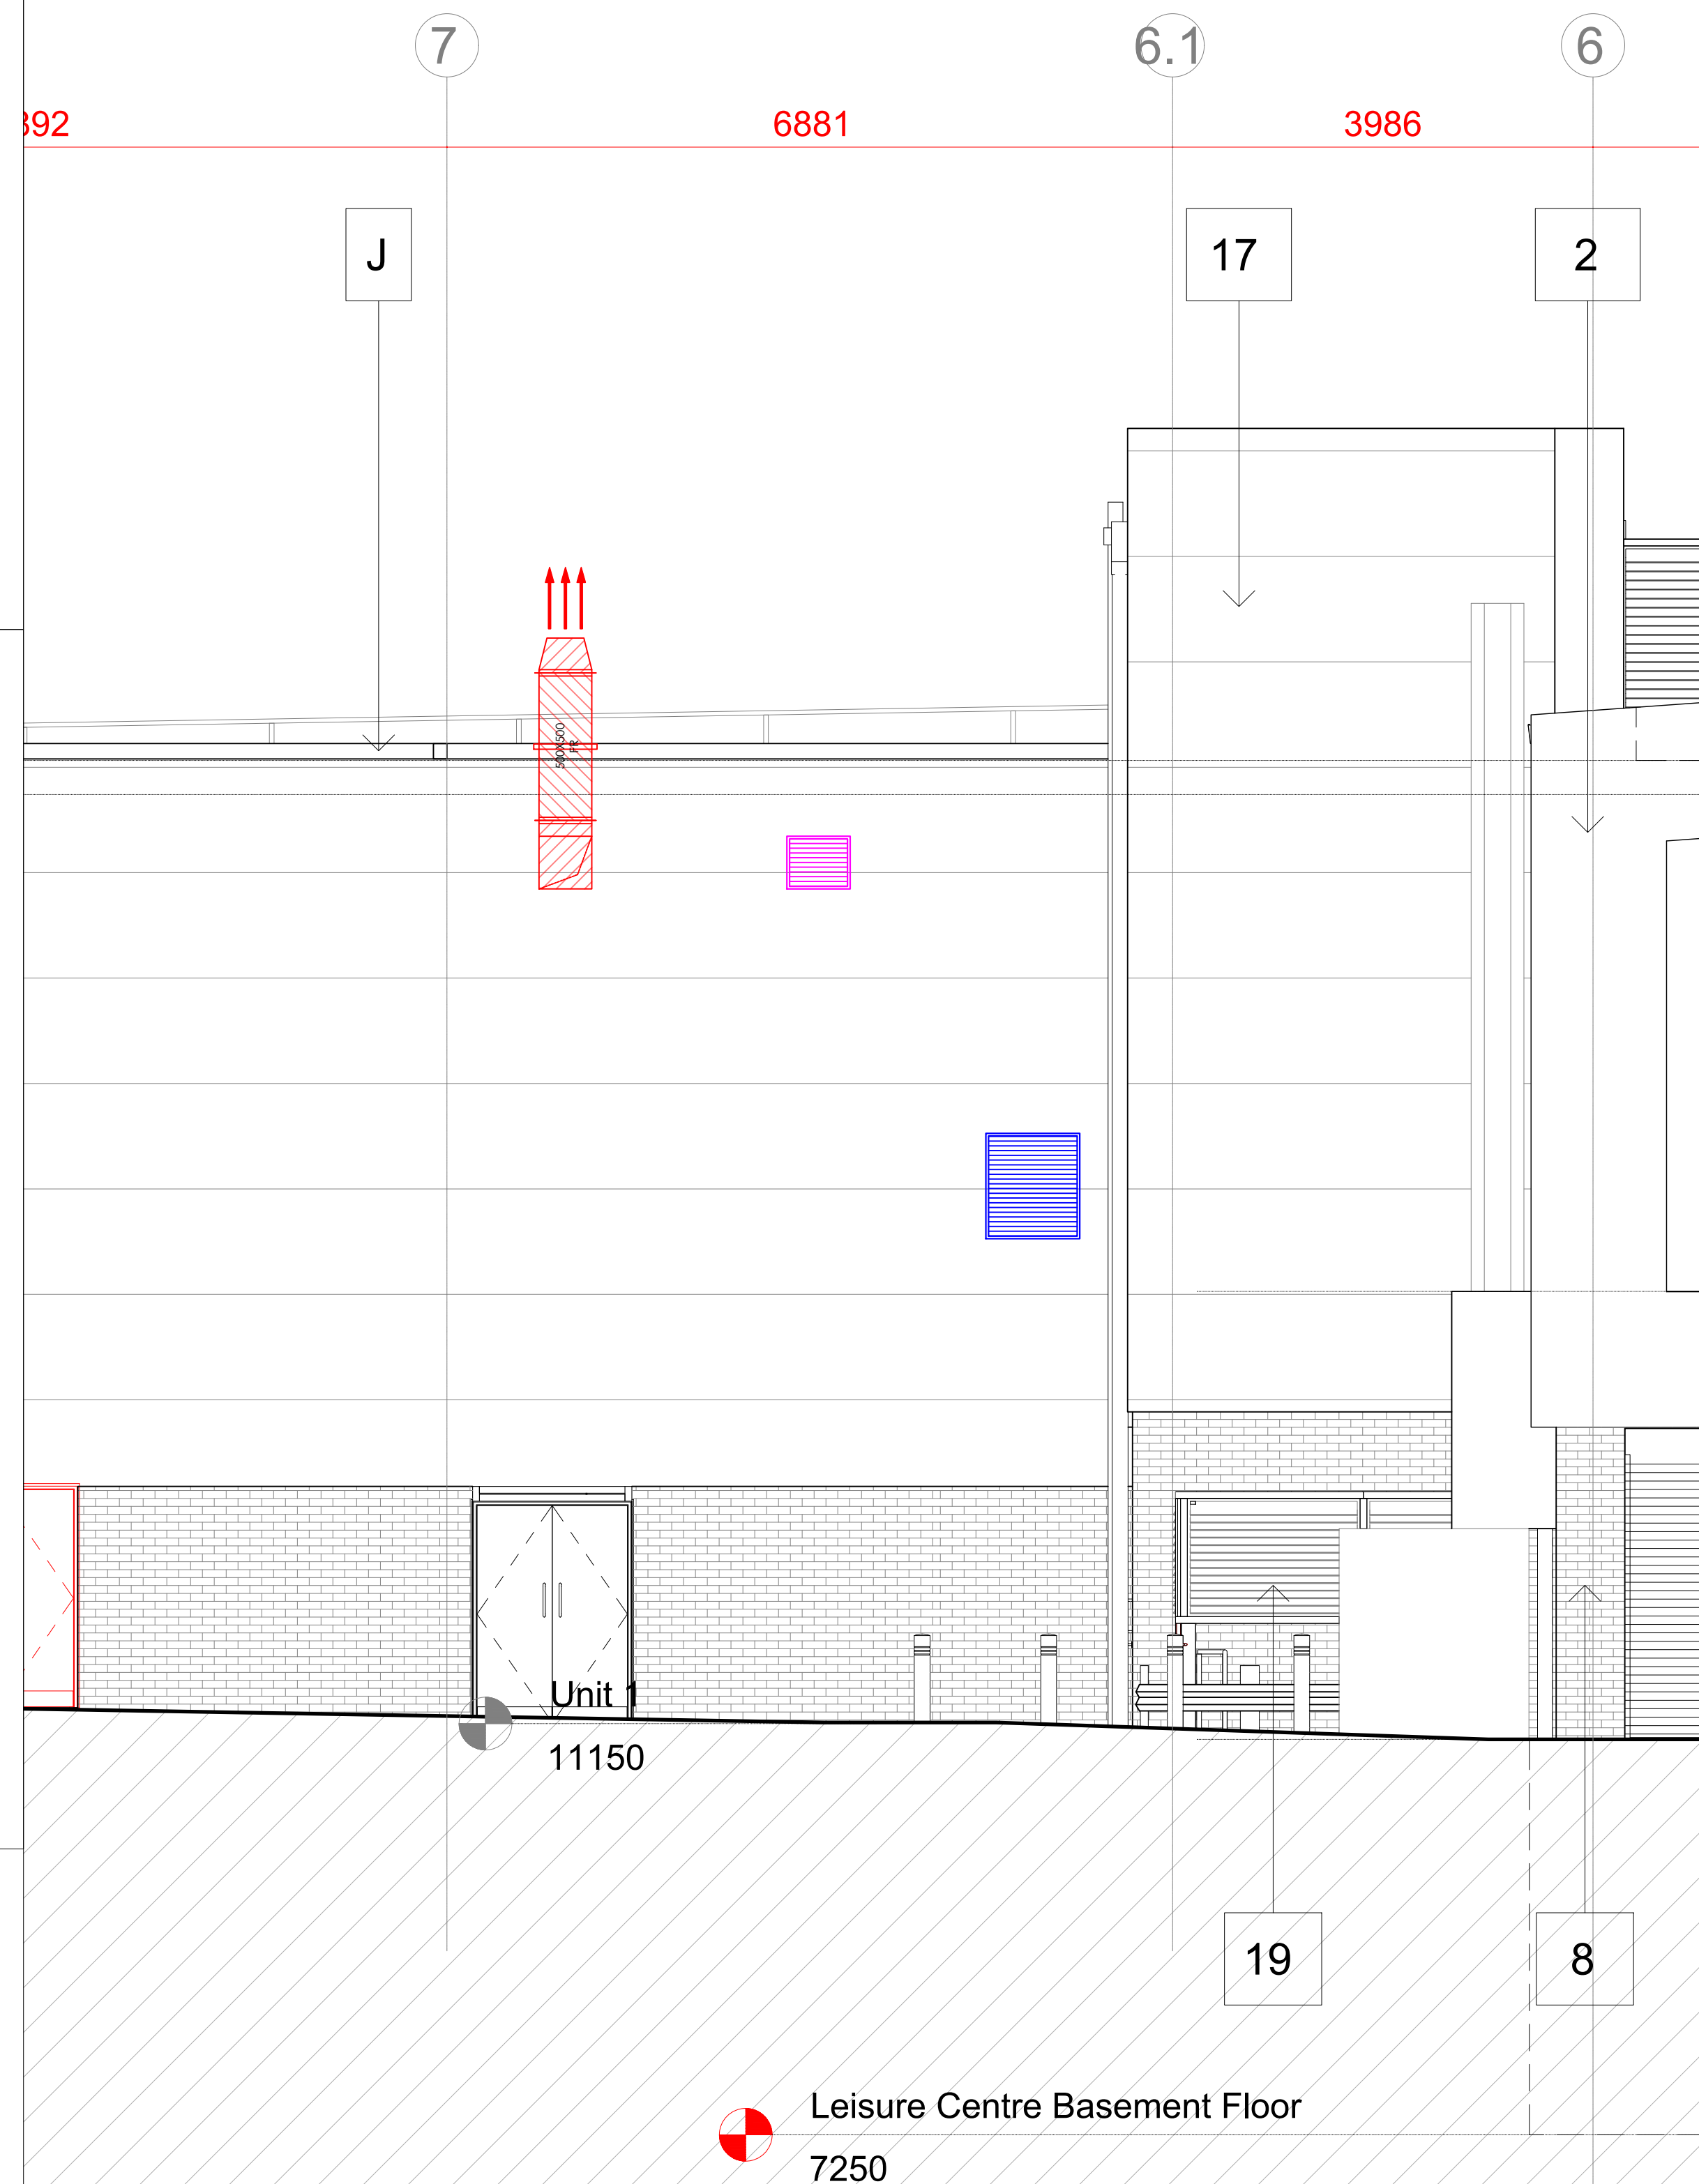

FOR APPROVAL

DO NOT SCALE FROM THIS DRAWING!
ALL MEASUREMENTS IN MILLIMETERS
GENERAL TOLERANCE +/- 1mm.
ALL POWER & SERVICES INSTALLATION BY
CLIENT AND/OR M&E CONTRACTOR.

Kitchen extract
Fire Rated

Sound level: 33dB at 3M free field

Drawing to be used in conjunction with
Architect:
Kitchen:

REV	DATE	NOTES
A	13/10/2022	A/C Condensers added
B	09/11/2022	Extract and toilet termination moved
C	13/12/2022	Supply and toilet louvre termination moved
D	15/12/2022	Supply louvre moved

|| Loungers

Neath Lounge

Revision:	D
-----------	---

"a breath of fresh air"

Cardrew Industrial Estate, Redruth, Cornwall TR15 1SH
01209 204700
enquiries@partridge-ventilation.co.uk

I hereby confirm my acceptance of all information on this drawing and understand that any subsequent changes to this plan may be subject to additional charges

Customers Signature: _____

Date: .