




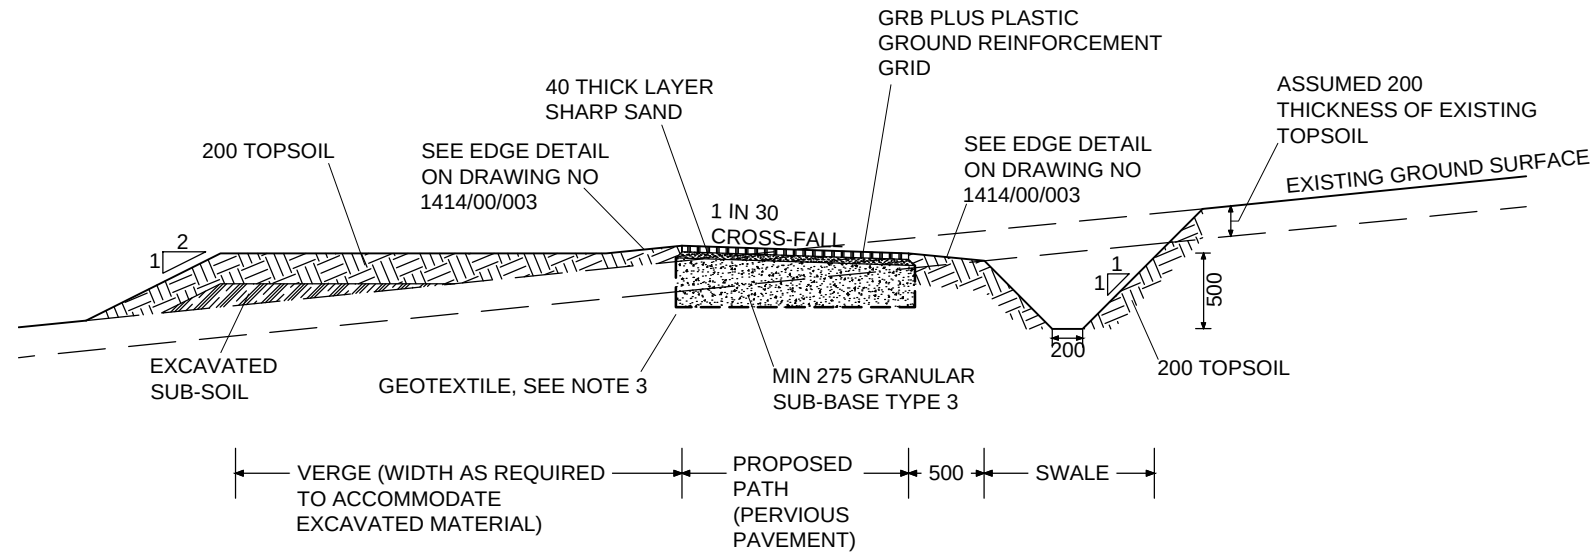


CROSS-SECTION F - F (SCALE 1 : 50)
PROPOSED PERVIOUS PAVEMENT TYPE A

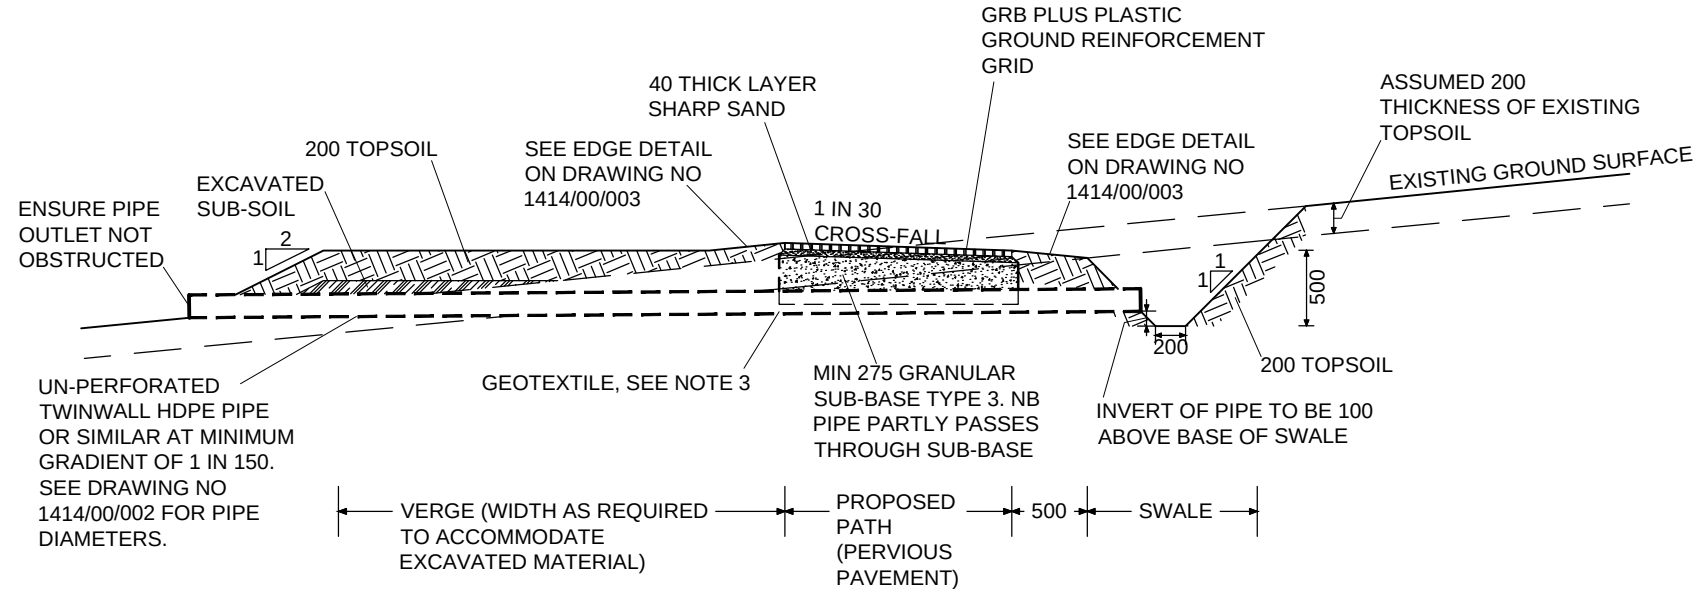


CROSS-SECTION H - H (SCALE 1 : 50)
PROPOSED PERVIOUS PAVEMENT TYPE A
SHOWING SWALE OUTLET PIPE

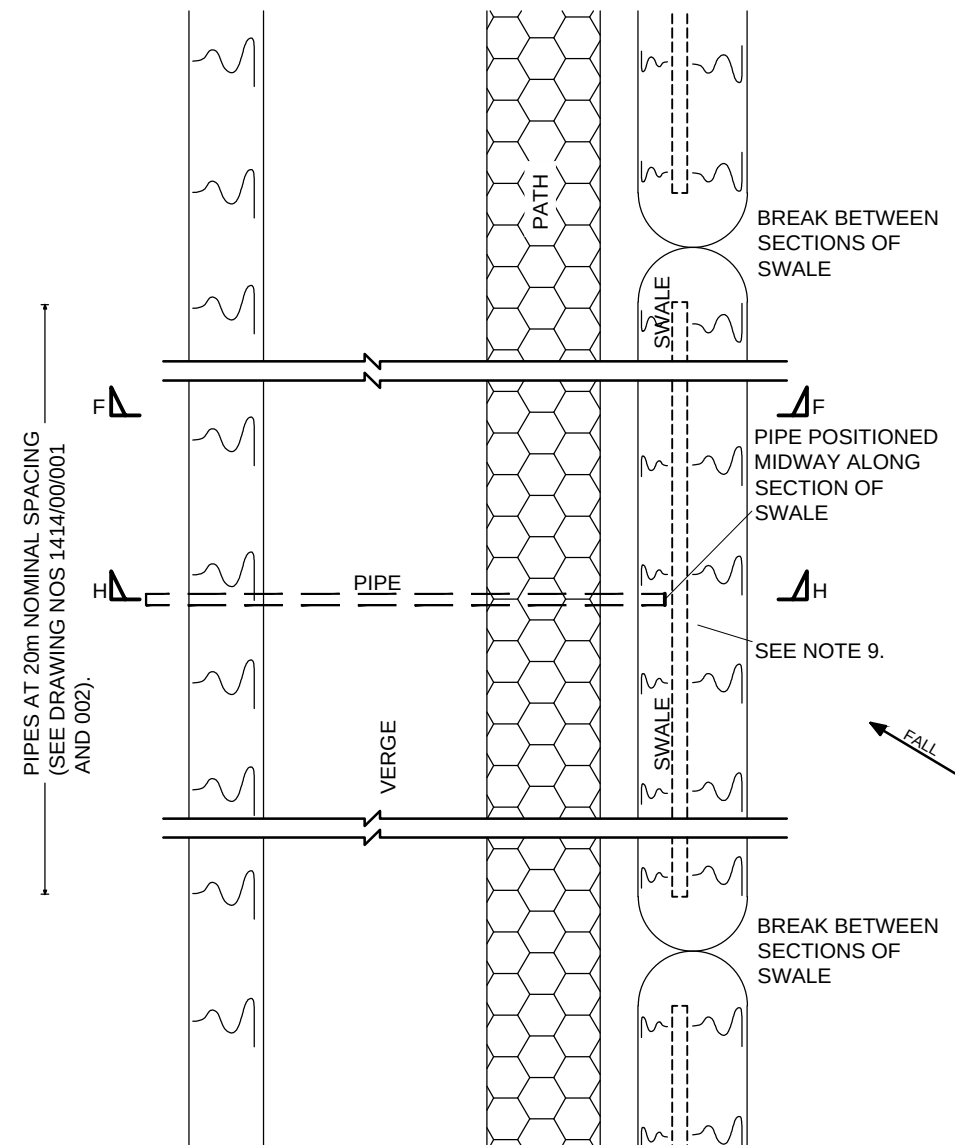


PROPOSED PATH - TYPICAL PLAN WITH TYPES A
AND AS PERVIOUS PAVEMENTS (SCALE 1 : 100)

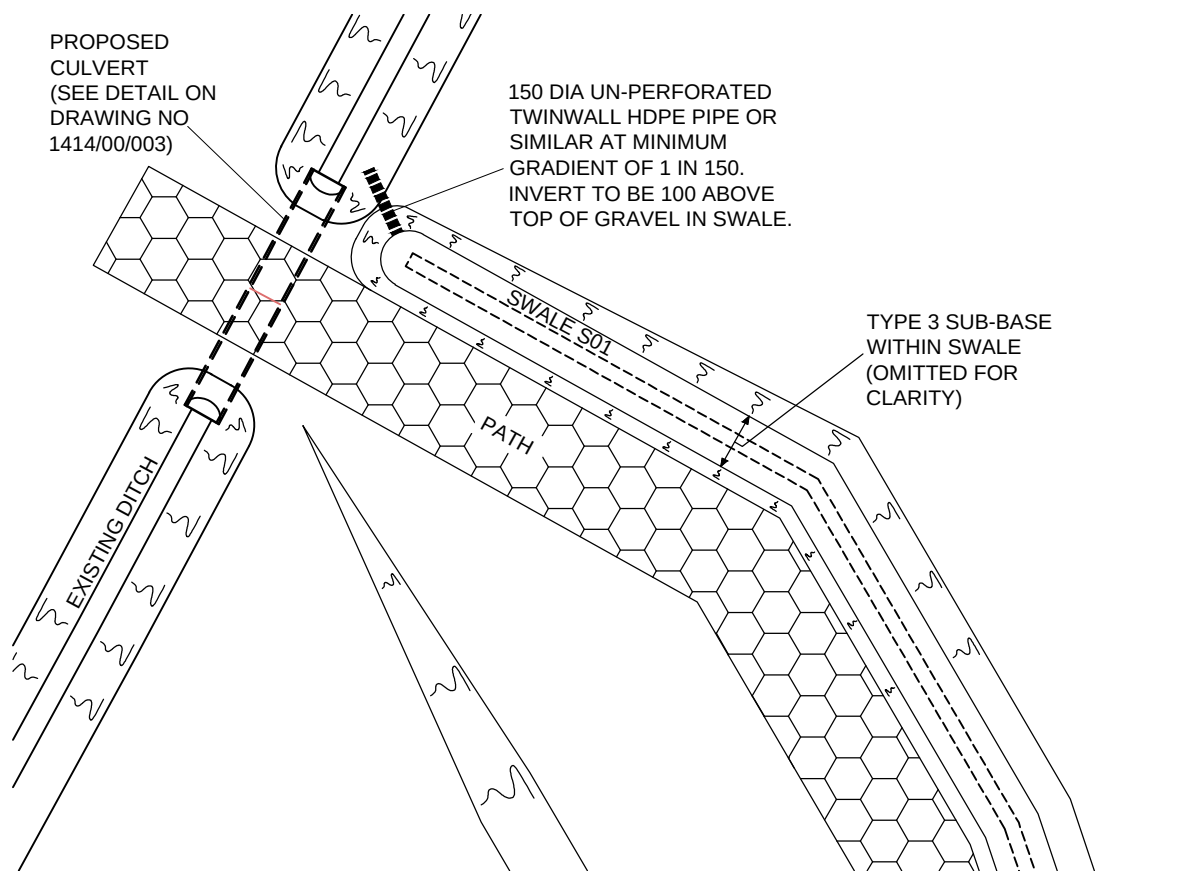


PROPOSED PATH - DRAINAGE ARRANGEMENTS FOR SWALE S01
(SCALE 1 : 100)

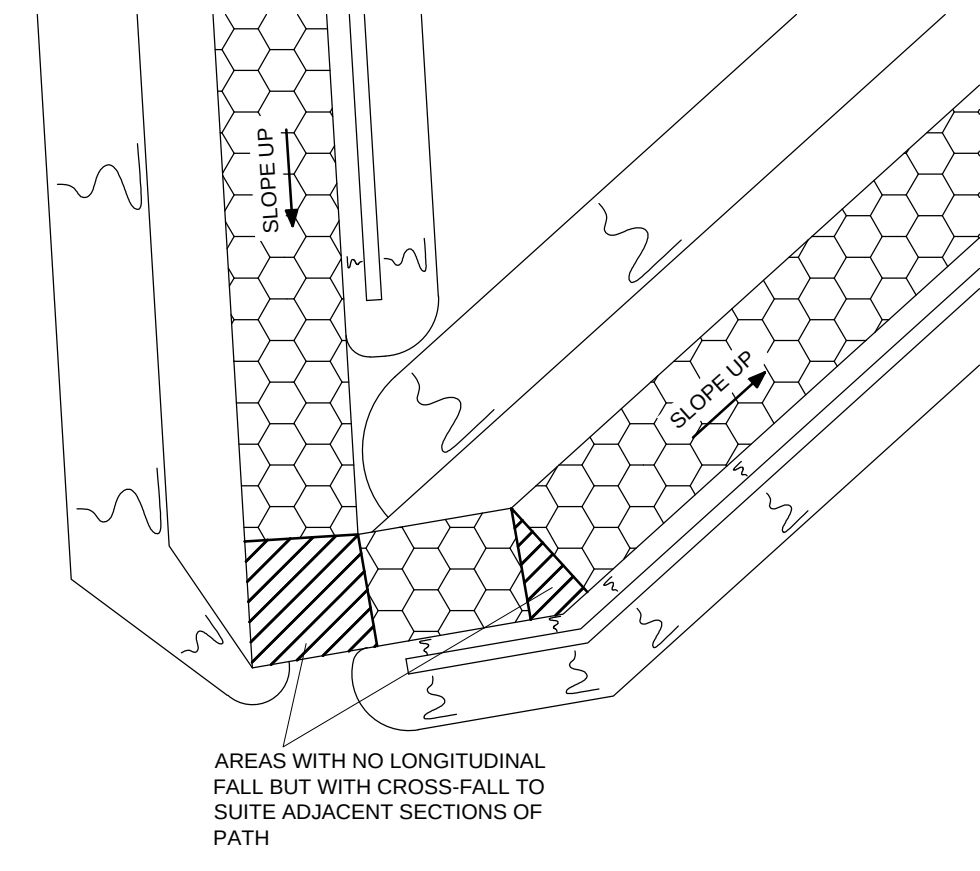


PROPOSED PATH - TYPICAL LAYOUT AT
CHANGES OF DIRECTION (SCALE 1 : 100)

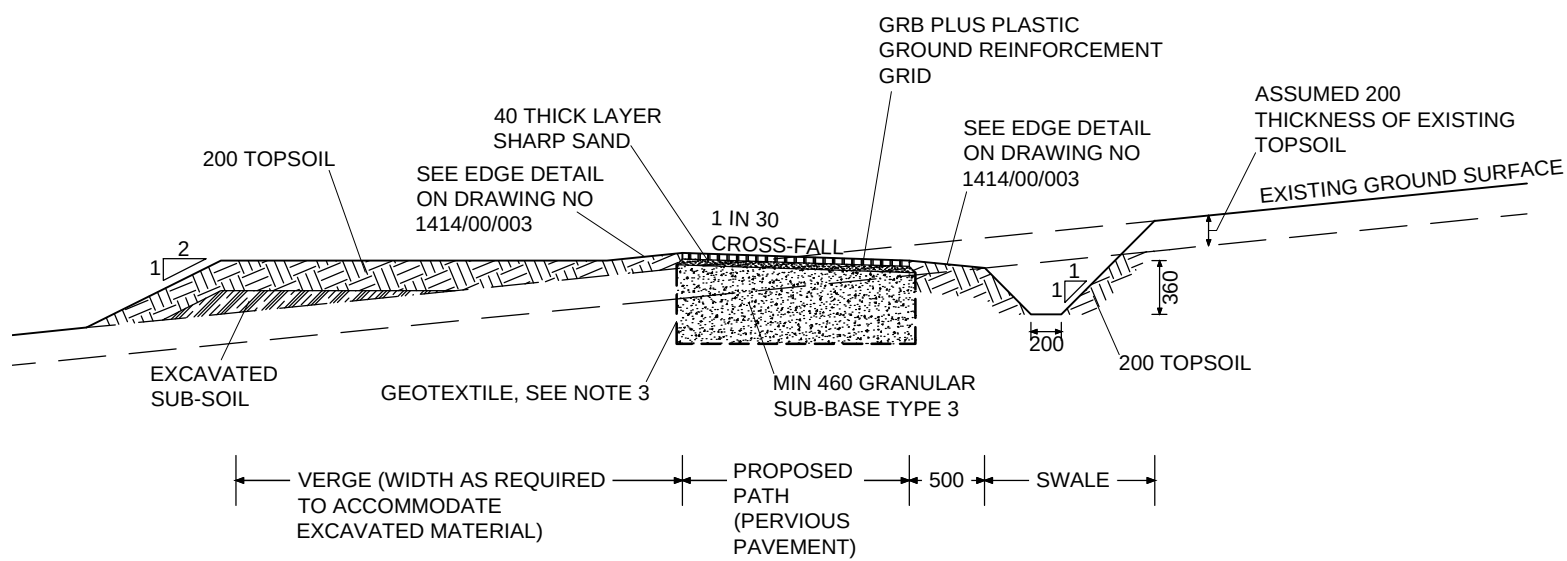


CROSS-SECTION E - E (SCALE 1 : 50)
PROPOSED PERVIOUS PAVEMENT TYPE AS

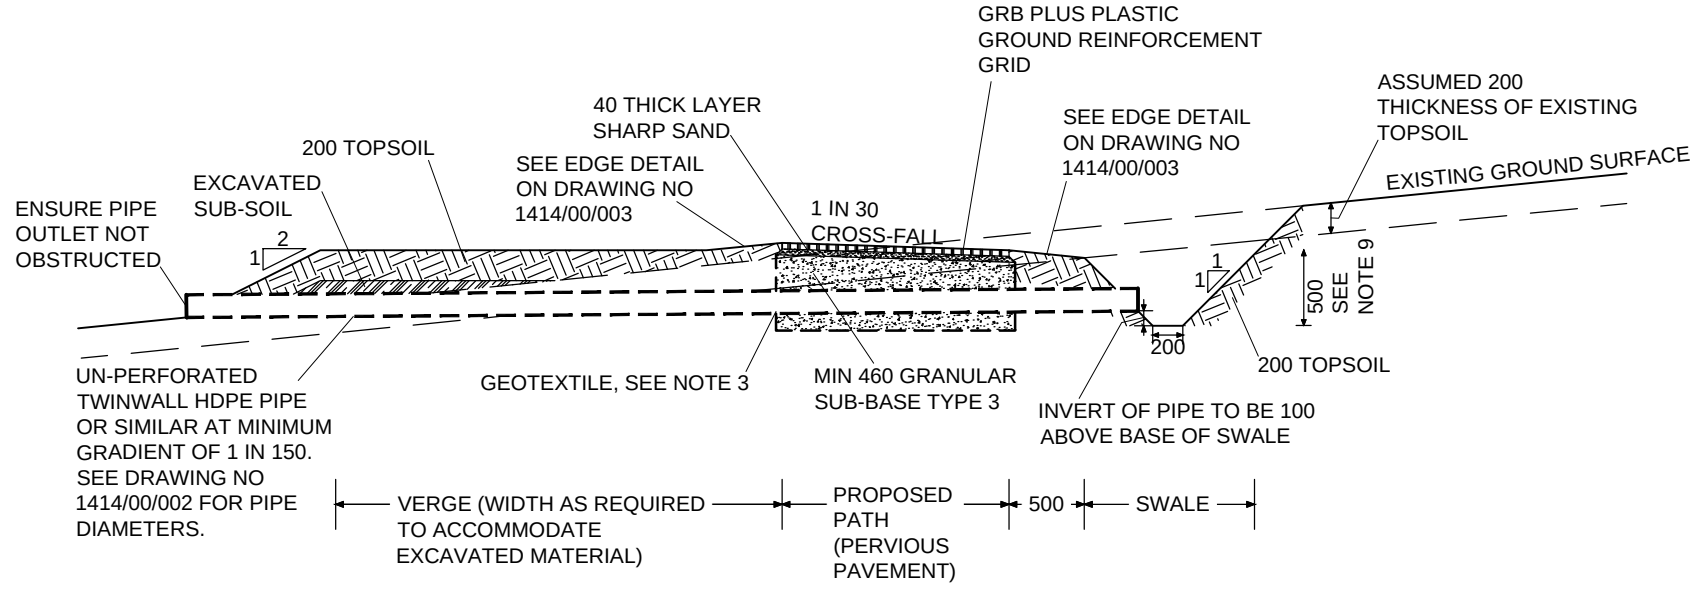


PROPOSED PERVIOUS PAVEMENT TYPE AS (SCALE 1 : 50)
SHOWING SWALE OUTLET PIPE

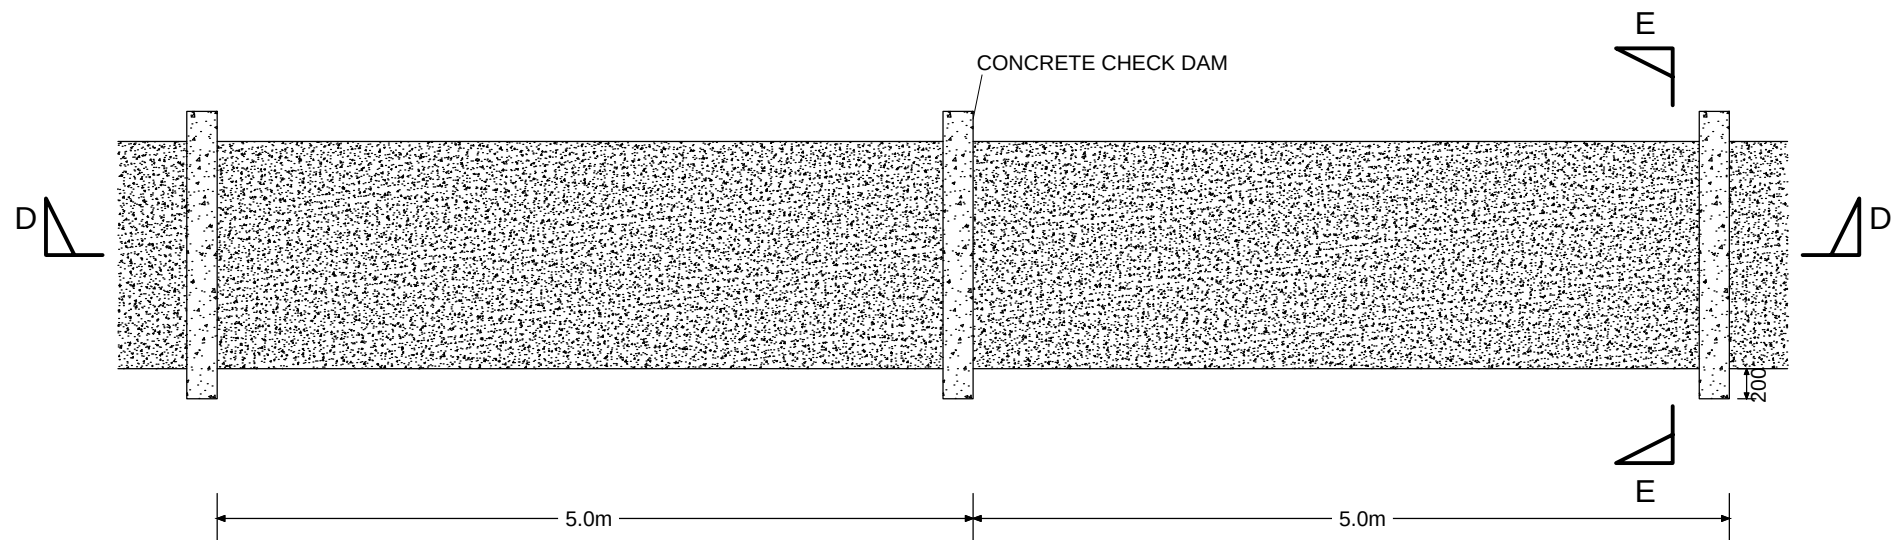


PLAN AT SUB-BASE LEVEL (SCALE 1 : 50)
PROPOSED PERVIOUS PAVEMENT TYPE AS

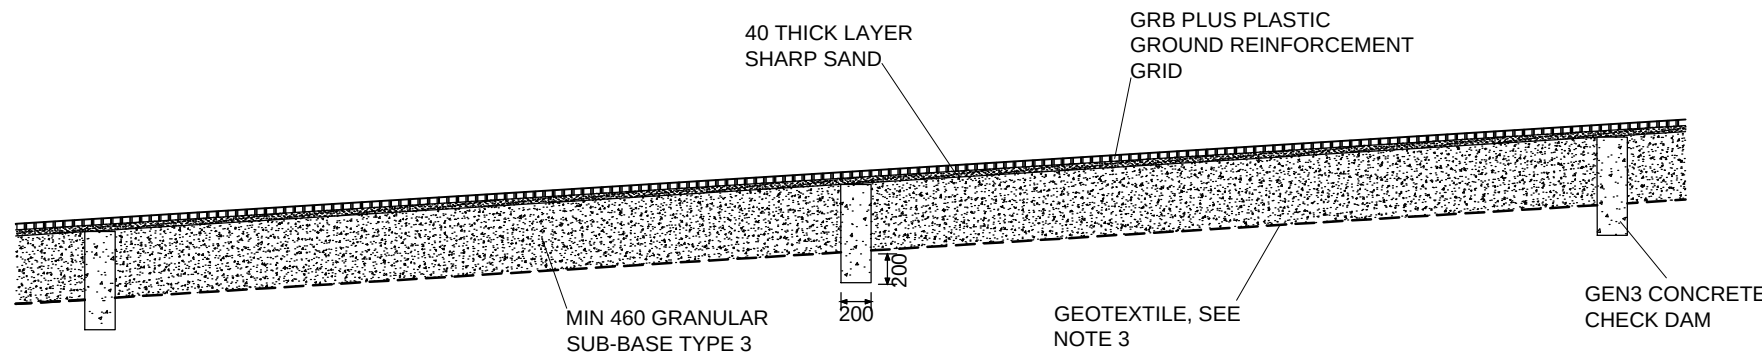

SECTION D - D (SCALE 1 : 50)
PROPOSED PERVIOUS PAVEMENT TYPE AS

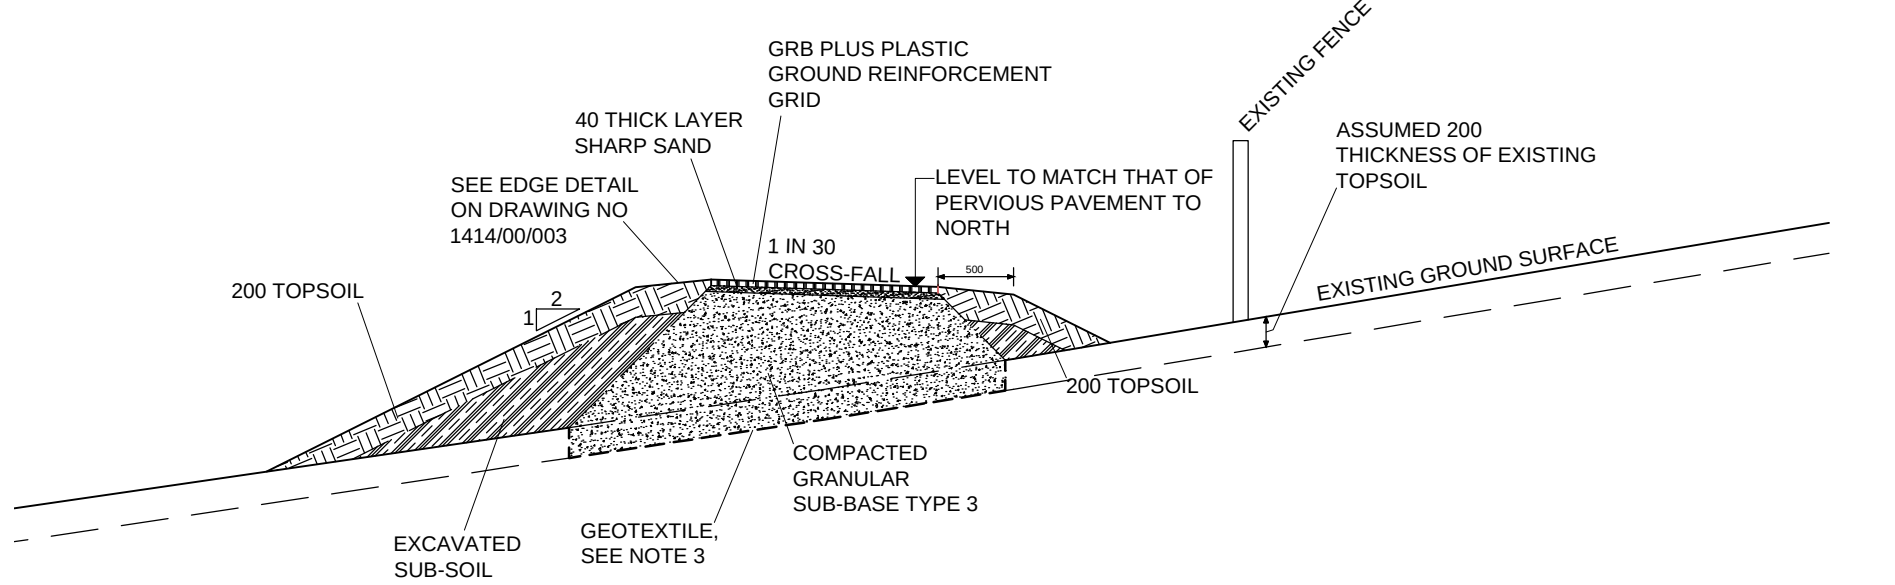

SECTION M - M (SCALE 1 : 50)
PROPOSED PERVIOUS PAVEMENT TYPE A NEAR EASTERN
END OF PATH (SEE DRAWING NO 1414/00/002.

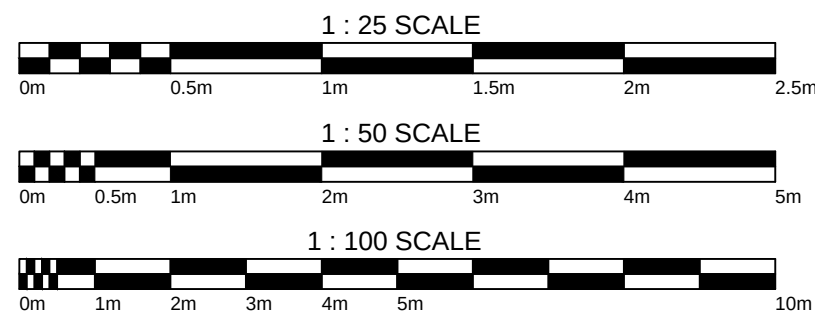

Notes

- ALL DIMENSIONS ARE IN MILLEMETRES.
- TOPSOIL OVER WIDTH OF PERVIOUS PAVEMENT AND SWALE TO BE STRIPPED AND SET ASIDE FOR RE-USE.
- GEOTEXTILE FILTER / SEPARATOR TO BE NONWOVEN GEOTEXTILE AS TERRAM T1000 OR SIMILAR.
- GRANULAR SUB-BASE MATERIAL TO BE TYPE 3 TO CLAUSE 803 OF HIGHWAY AGENCY'S SPECIFICATION.
- GRB PLUS PLASTIC GROUND REINFORCEMENT GRID (GREEN-TECH LTD, RABBIT HILL BUSINESS PARK, GREAT NORTH ROAD, ARKENDALE HG5 0FF) TO BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURERS' INSTRUCTIONS.
- GRAVEL INFILL TO PLASTIC GROUND REINFORCEMENT GRID TO BE CLEAN 10mm SINGLE SIZE GRAVEL. GRAVEL TO COVER GRID BY AT LEAST 25mm TO FACILITATE FUTURE MAINTENANCE (IE RAKING (SEE DRAWING NO 1414/00/021)).
- DEPTH OF SWALES GIVEN ARE MEASURED FROM FINISHED TOP EDGE OF ADJACENT PATH.
- VERGE AND SIDES OF SWALE TO BE GRASS SEEDED ON COMPLETION, TYPE TO SUITE CLIENT.
- FOR PERVIOUS PAVEMENT TYPE AS, BED OF SWALE ADJACENT TO OUTLET SHOWN WITH INCREASED DEPTH. DETAIL FOR THIS SIMILAR TO SECTION J - J ON DRAWING NO 1414/00/003 (BUT EXCLUDES LAYER OF TYPE 3 SUB-BASE). NB THIS DETAIL SHOULD ONLY BE USED FOR TYPE A PAVEMENT IF REQUIRED BY SITE CIRCUMSTANCES.
- THE CONTRACTOR SHOULD AVOID COMPACTING THE SUB-SOIL BENEATH THE PROPOSED PERVIOUS PAVEMENTS BY RUNNING OVER THE EXPOSED SUB-SOIL WITH PLANT. NB THIS IS TO AVOID COMPACTING THE SUB-SOIL WHICH WOULD REDUCE ITS ABILITY ALLOW WATER TO SOAK AWAY.

00	MAR 23	AJB	FIRST ISSUE.		AJB
Rev	Date	Drawn	Description	Chk'd	App'd

Morton-Roberts
Consulting Engineers

Morton-Roberts Consulting Engineers Limited
Sophia House, 28 Cathedral Road
Cardiff CF11 9LJ
Tel: 02920 660283
web site: www.mortonroberts.com
e-mail: enquiries@mortonroberts.com

Client
THE WOODLAND TRUST
COED CADW

Title
BRYNAU FARM, NEATH
PROPOSED PERMISSIVE FOOTPATH
MISCELLANEOUS DETAILS 2 OF 2

Designed	AJB	Interface Chk	N/A	Des Valid'n	N/A
Drawn	AJB	Des Verific'n	N/A	Approved	AJB
Scale	AS SHOWN	Drawing No	1414/00/004	Rev	00