

ALL TIMBER STACKS MUST NOT EXCEED 3 METRES HIGH AND MUST HAVE A MINIMUM OF 6 METRE DISTANCE BETWEEN STACKS AND BOUNDARY

-  Water Hydrants
-  Toilets
-  Fuel Tanks
-  Septic Tank
-  Fire Assembly Point
-  Fire Extinguishers

Site office holds First Aid Kit, Fire Extinguishers and Oil Spill Kits

EMERGENCY CONTACT DETAILS:

Fire: 999


Site Contact: Tim Williams

Contact Number: 07800889009

Grid Ref: SS 74974 90672

What3Word: ///hooks.shower.thigh

Address: Afan Way, Baglan Moors, Port Talbot, SA12 6PZ

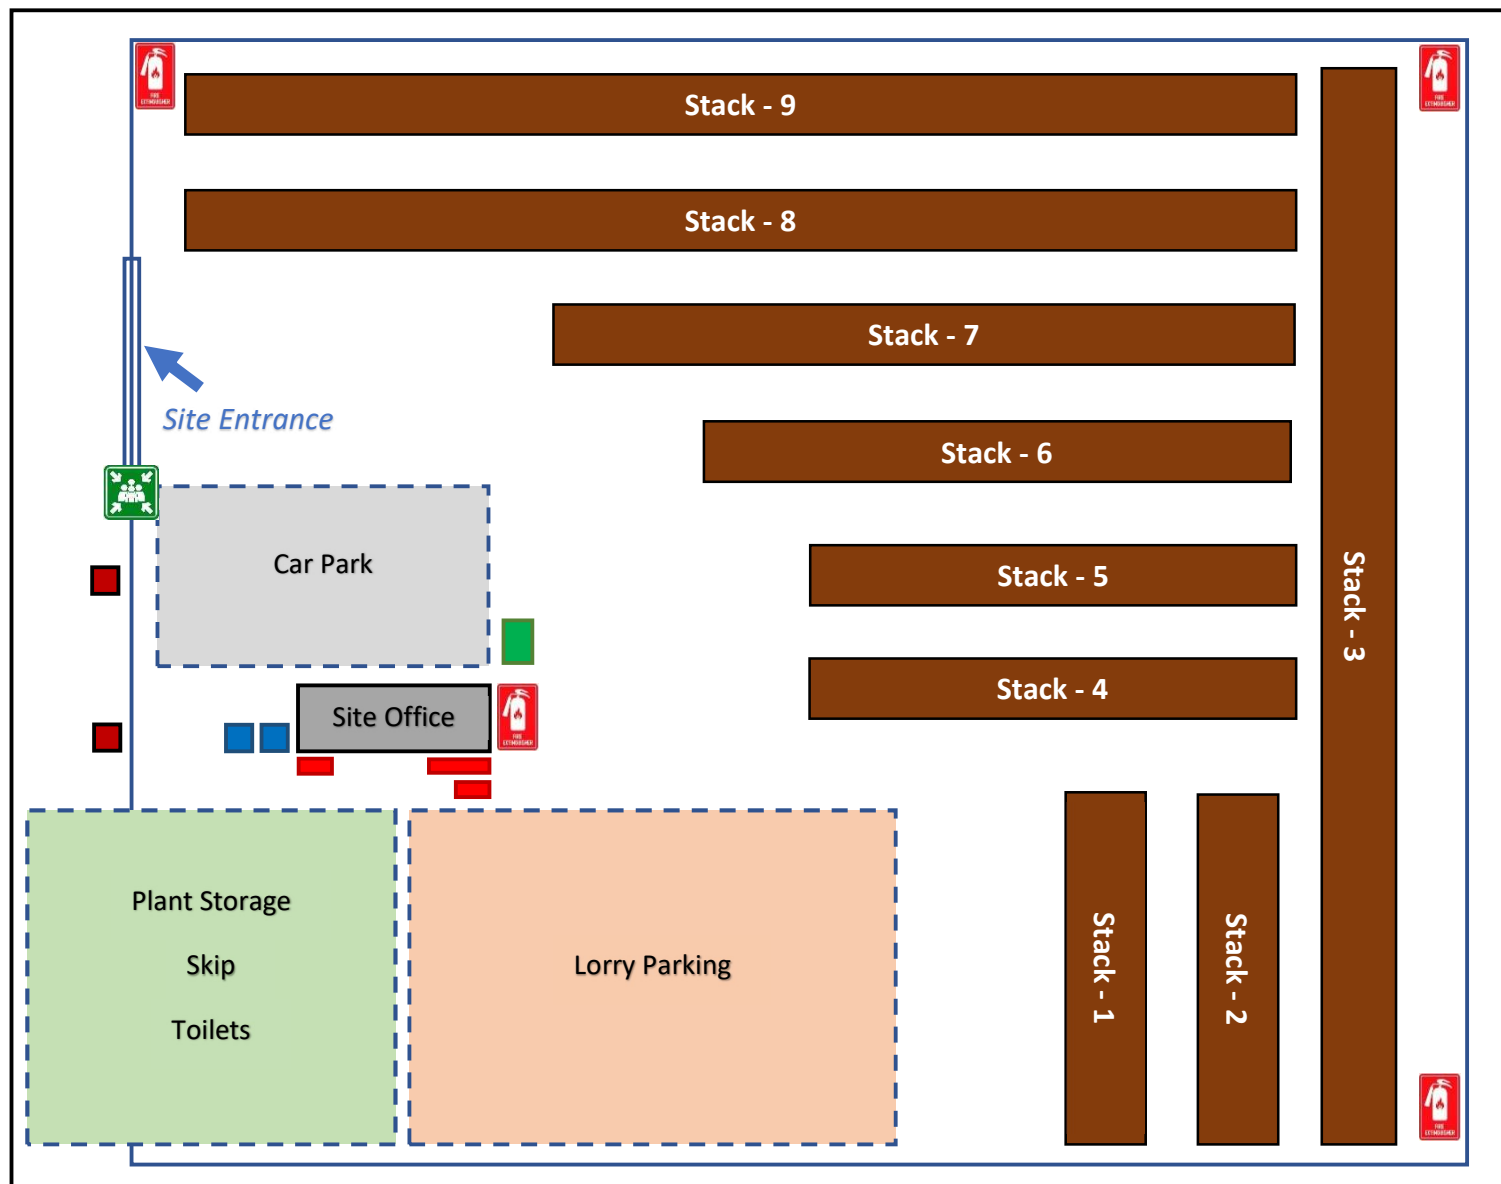

Doc Ref: WBE T&L Mgr	Reason for Rev:	Version: V2
Author: J Borrows		Issue Date: 19/07/2023
Approved: T Williams	Internal Use Only	Page 1 of 1