


Revision	Comments

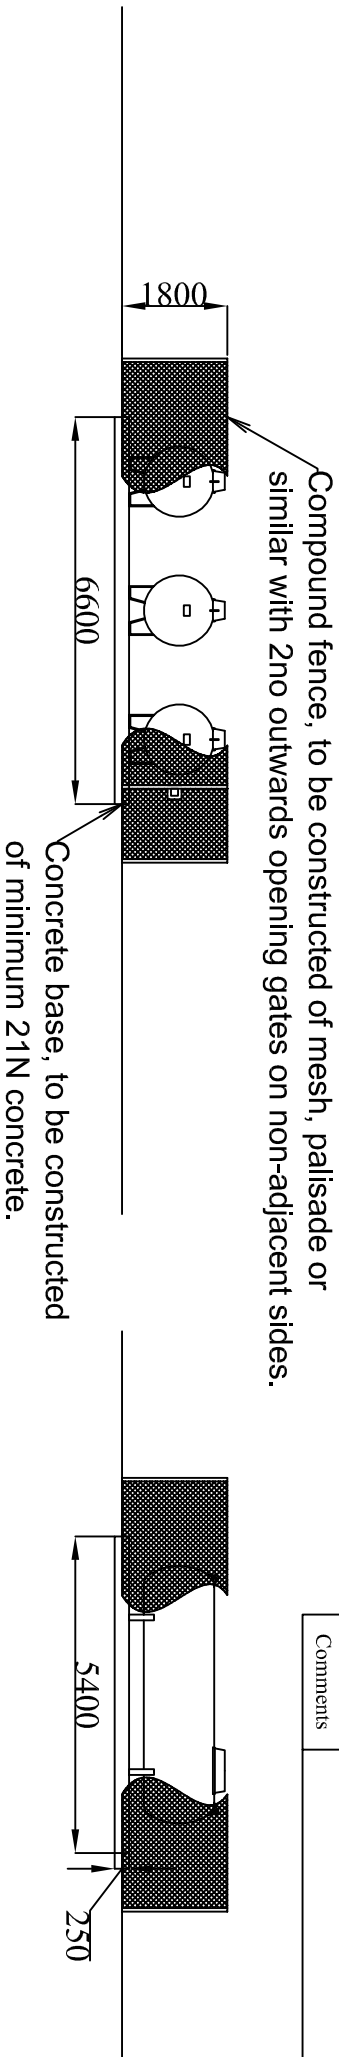

Compound fence, to be constructed of mesh, palisade or similar with 2no outwards opening gates on non-adjacent sides.

Concrete base, to be constructed of minimum 21N concrete.

7.5m separation distance, no buildings, boundaries or fixed sources of ignition to be located in this area.

N.B. All dimensions in mm unless specified otherwise.

Name	Standard Installation with reduced compound
Description	3no 2T bulk LPG vessels
Drawn By:	MIRW
Checked By	
Date	20/03/14
Scale	NTS
Drawing No	771
Project No	N/A
Project Manager	N/A
Revision No	A

