


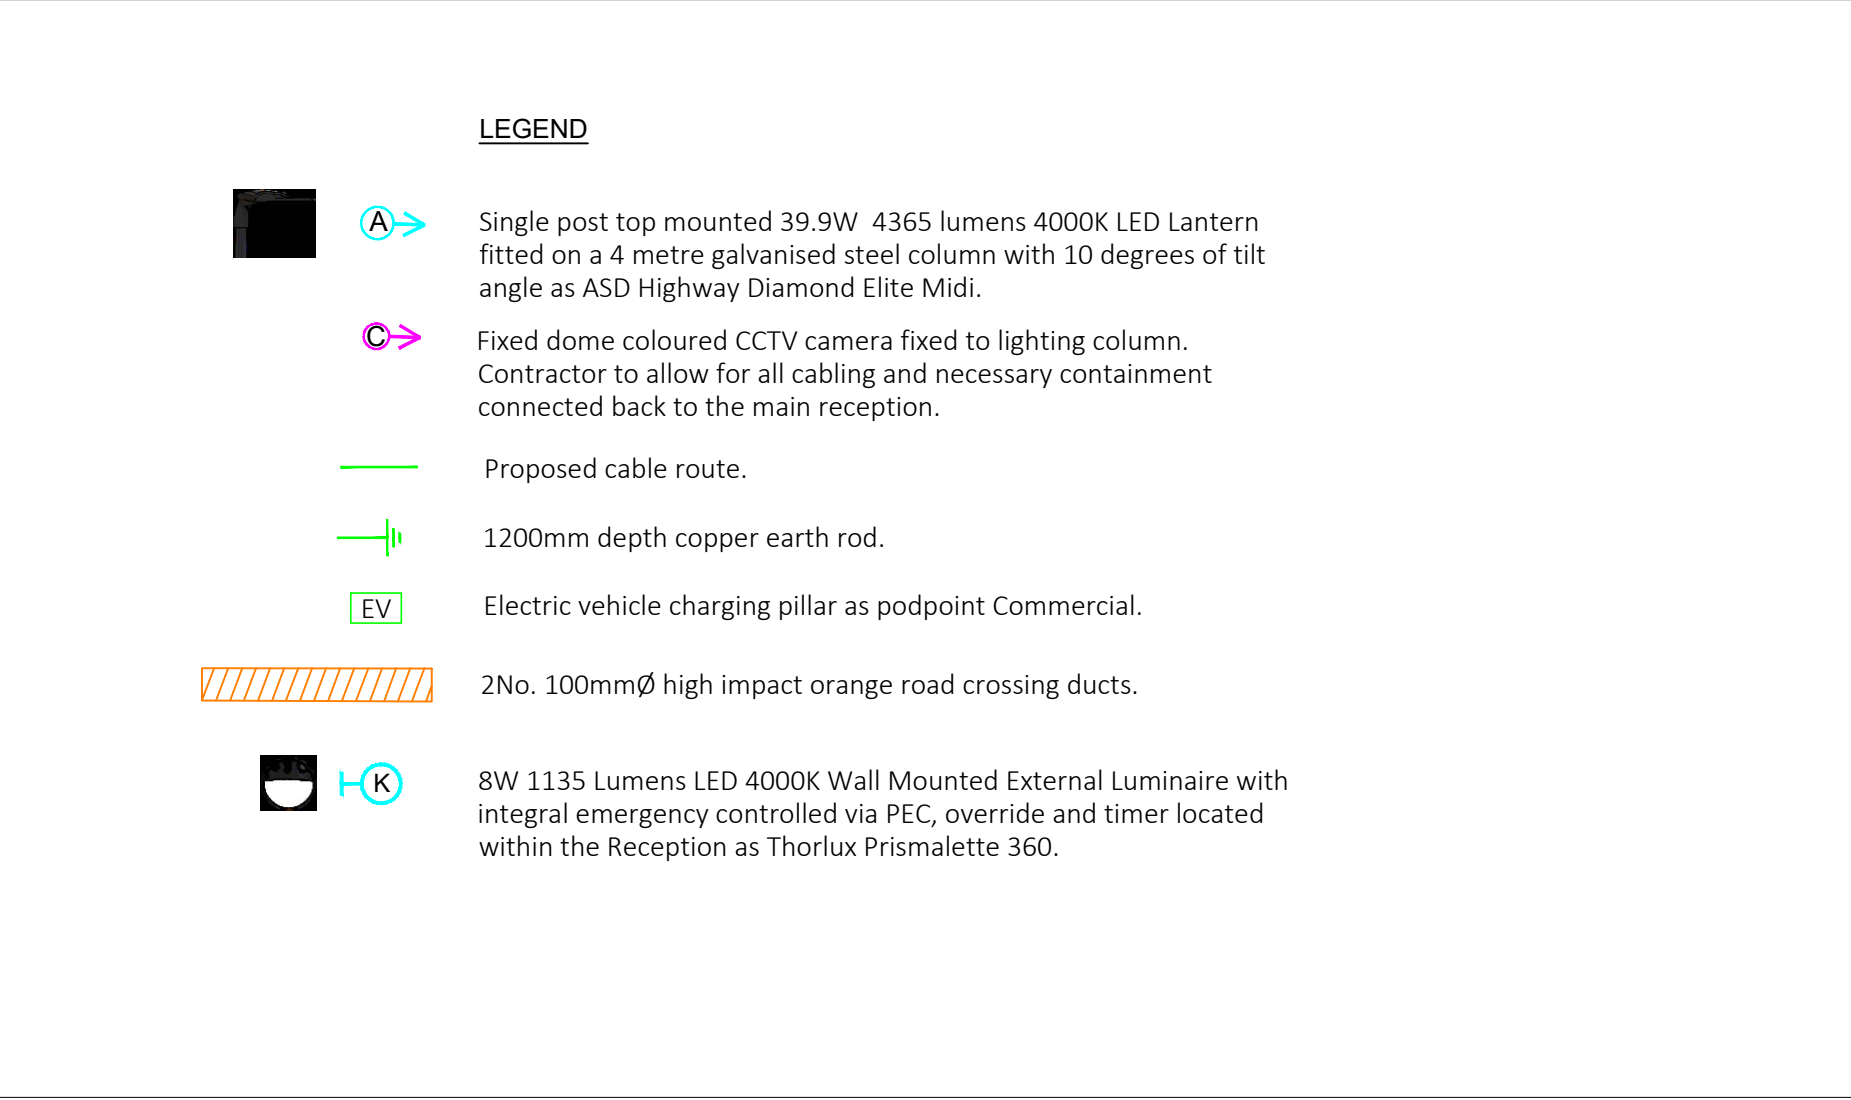

- Exact position of EV charger to be confirmed.
- The contractor shall allow for all coordination of the electrical installation with the complete building and mechanical works.
- All services within new plant room to be suitably coordinated with the new mechanical services.
- Prior to starting on site, the contractor is required to provide their own working installation drawings.
- Contractor to allow for all necessary builders works in relation to chasing cabling and conduits for recessed items.
- This drawing is FOR COMMENT ONLY.

Drawing Number	Rev
2223-009 E07	0