


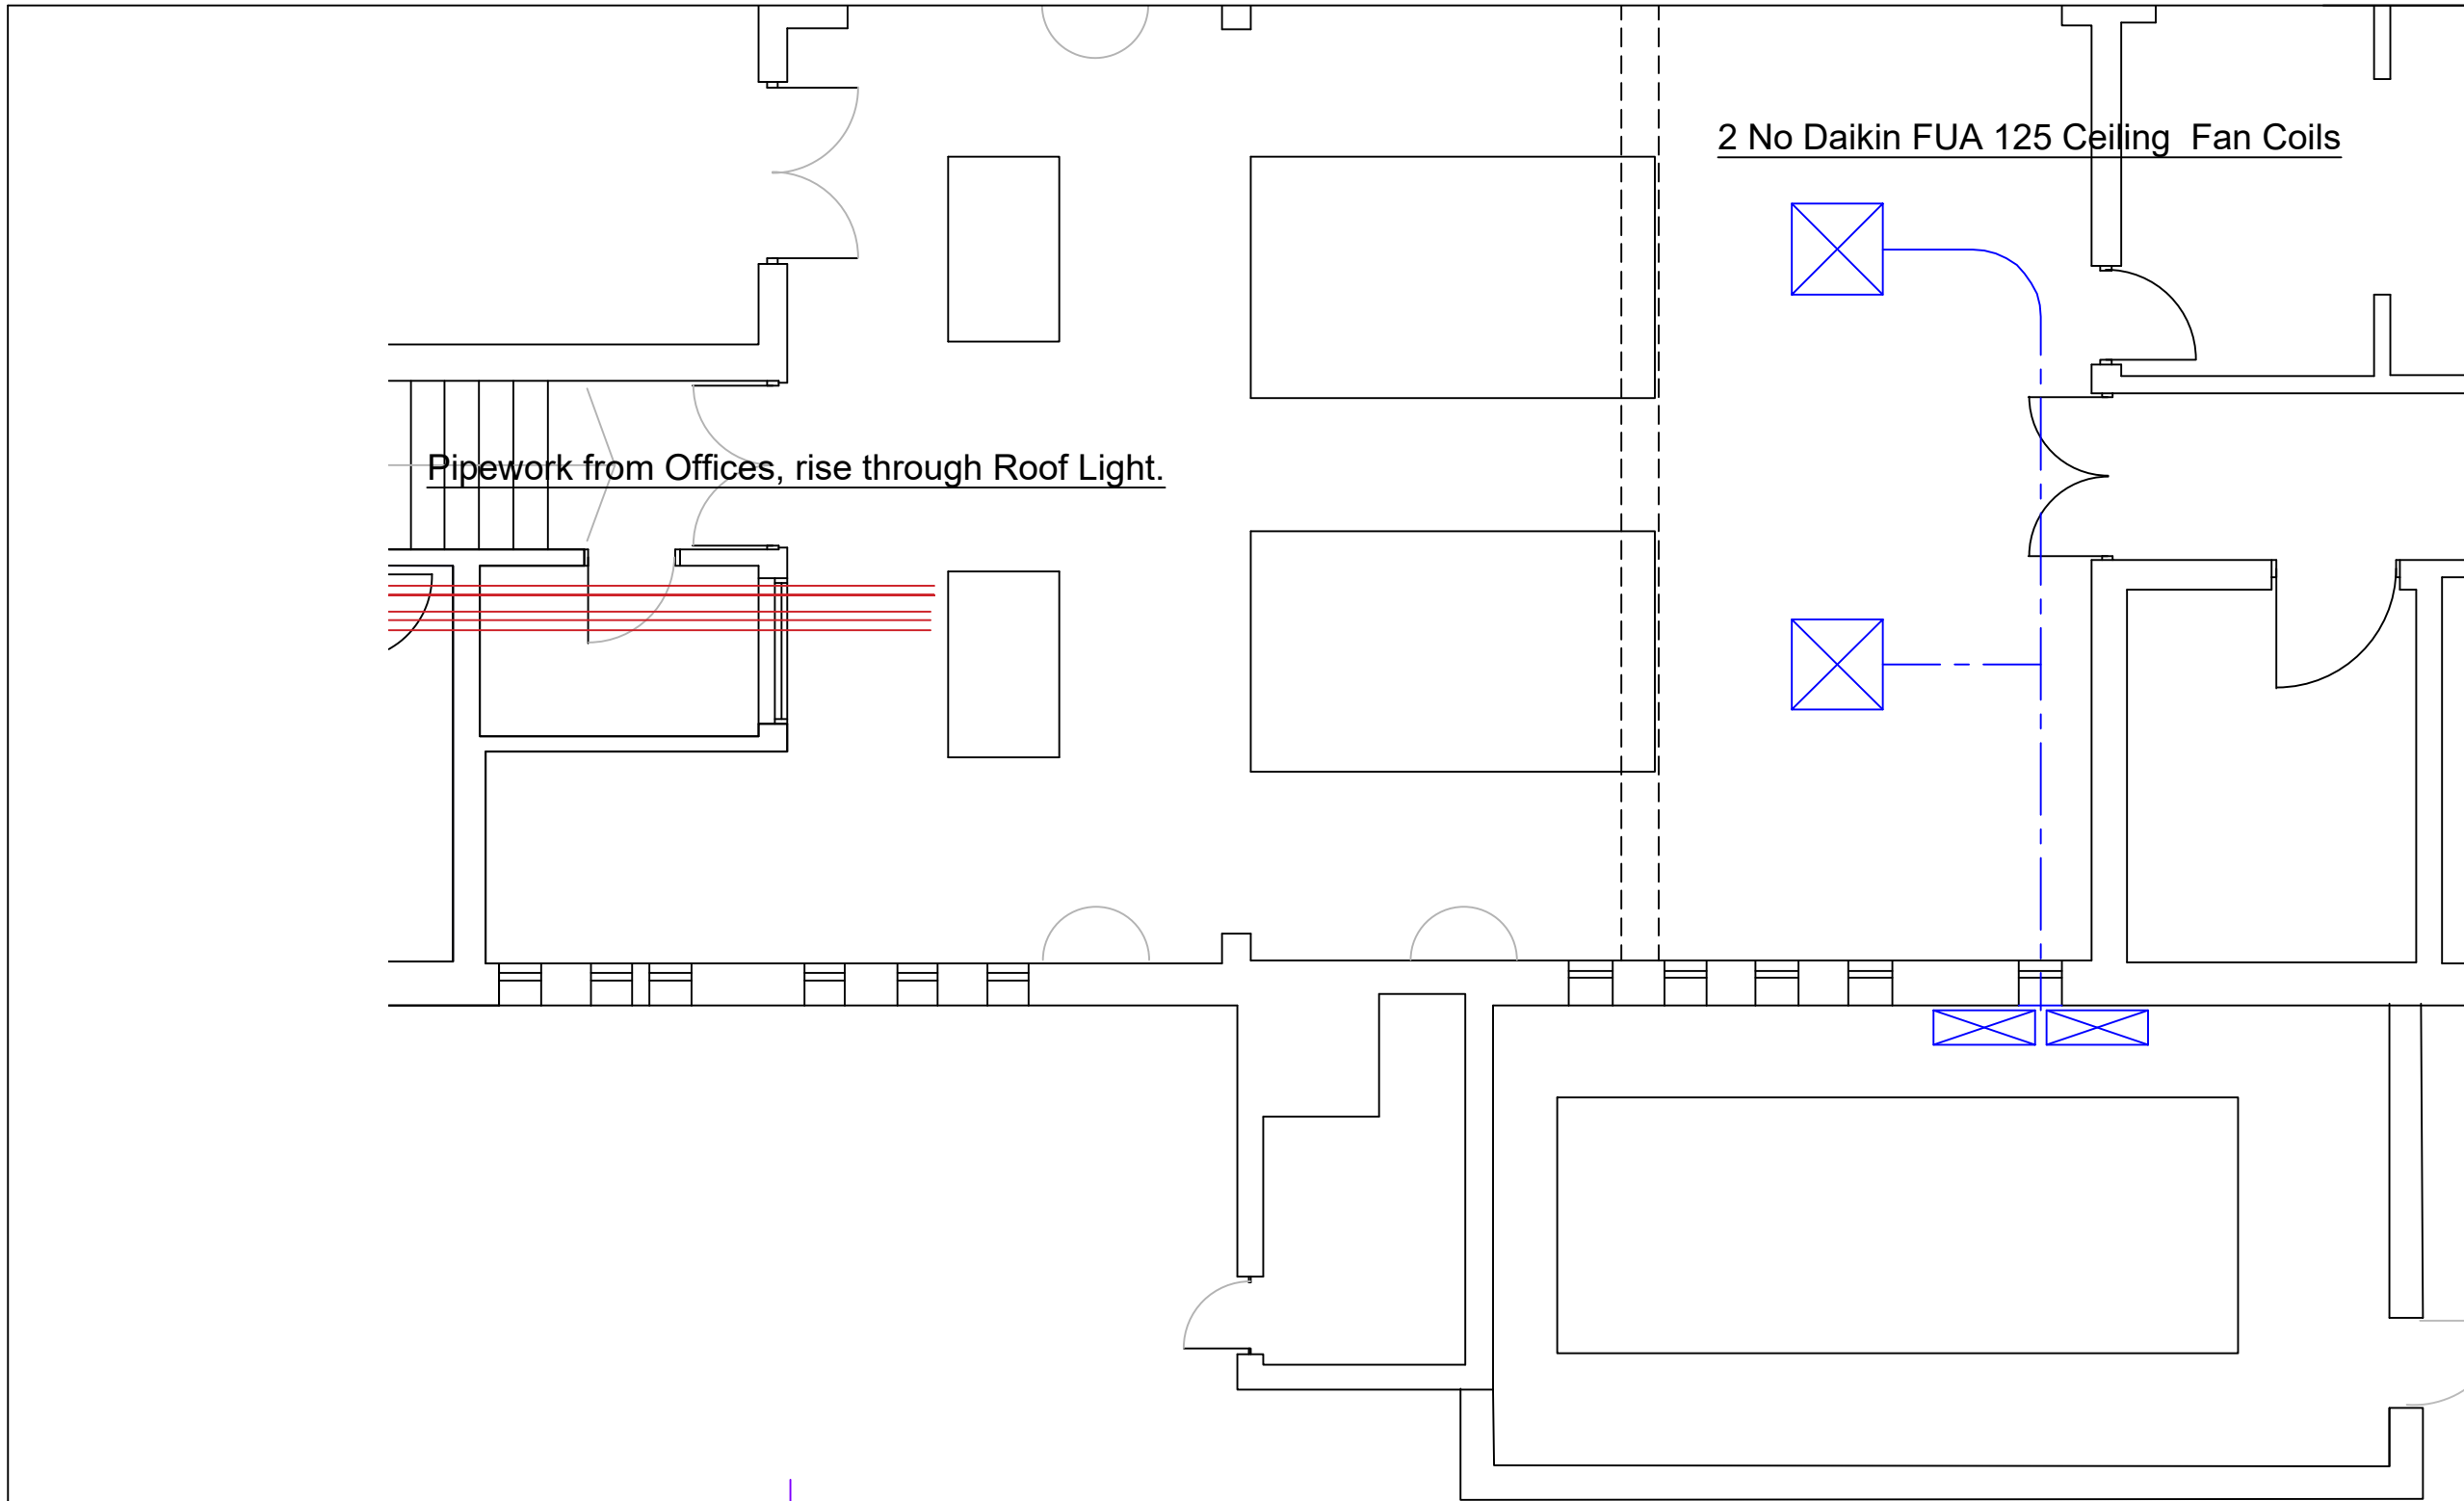

Pipework from Offices, rise through Roof Light.

2 No Daikin FUA 125 Ceiling Fan Coils

2 No Daikin RZAG 125 Outdoor Units@ GFL
Power required 400V TP+N, Power from the
Internal DB

Notes			
Refrigerant			
System Charge			
Safety Information			
MWP	40Bar		
Voltage	400V TP+N		
Revised		Date	
Drawn	KHT	Date	27-2-24
Title: Margam Crem Cooing System Cremarorium Room			
Client: NPTCBC			
F&T Refrigeration Ltd DC Griffiths Way Melyn, Neath SA11 1BT Tel: 01639 634171 Fax: 01639 644422 sales@ftrefrigeration.co.uk www.ftrefrigeration.co.uk			
Drawing No.		Issue.	
1-3-24 M02		B	

Note
Condensing Units for the Office located on the
internal Parapet at Roof Level.

