



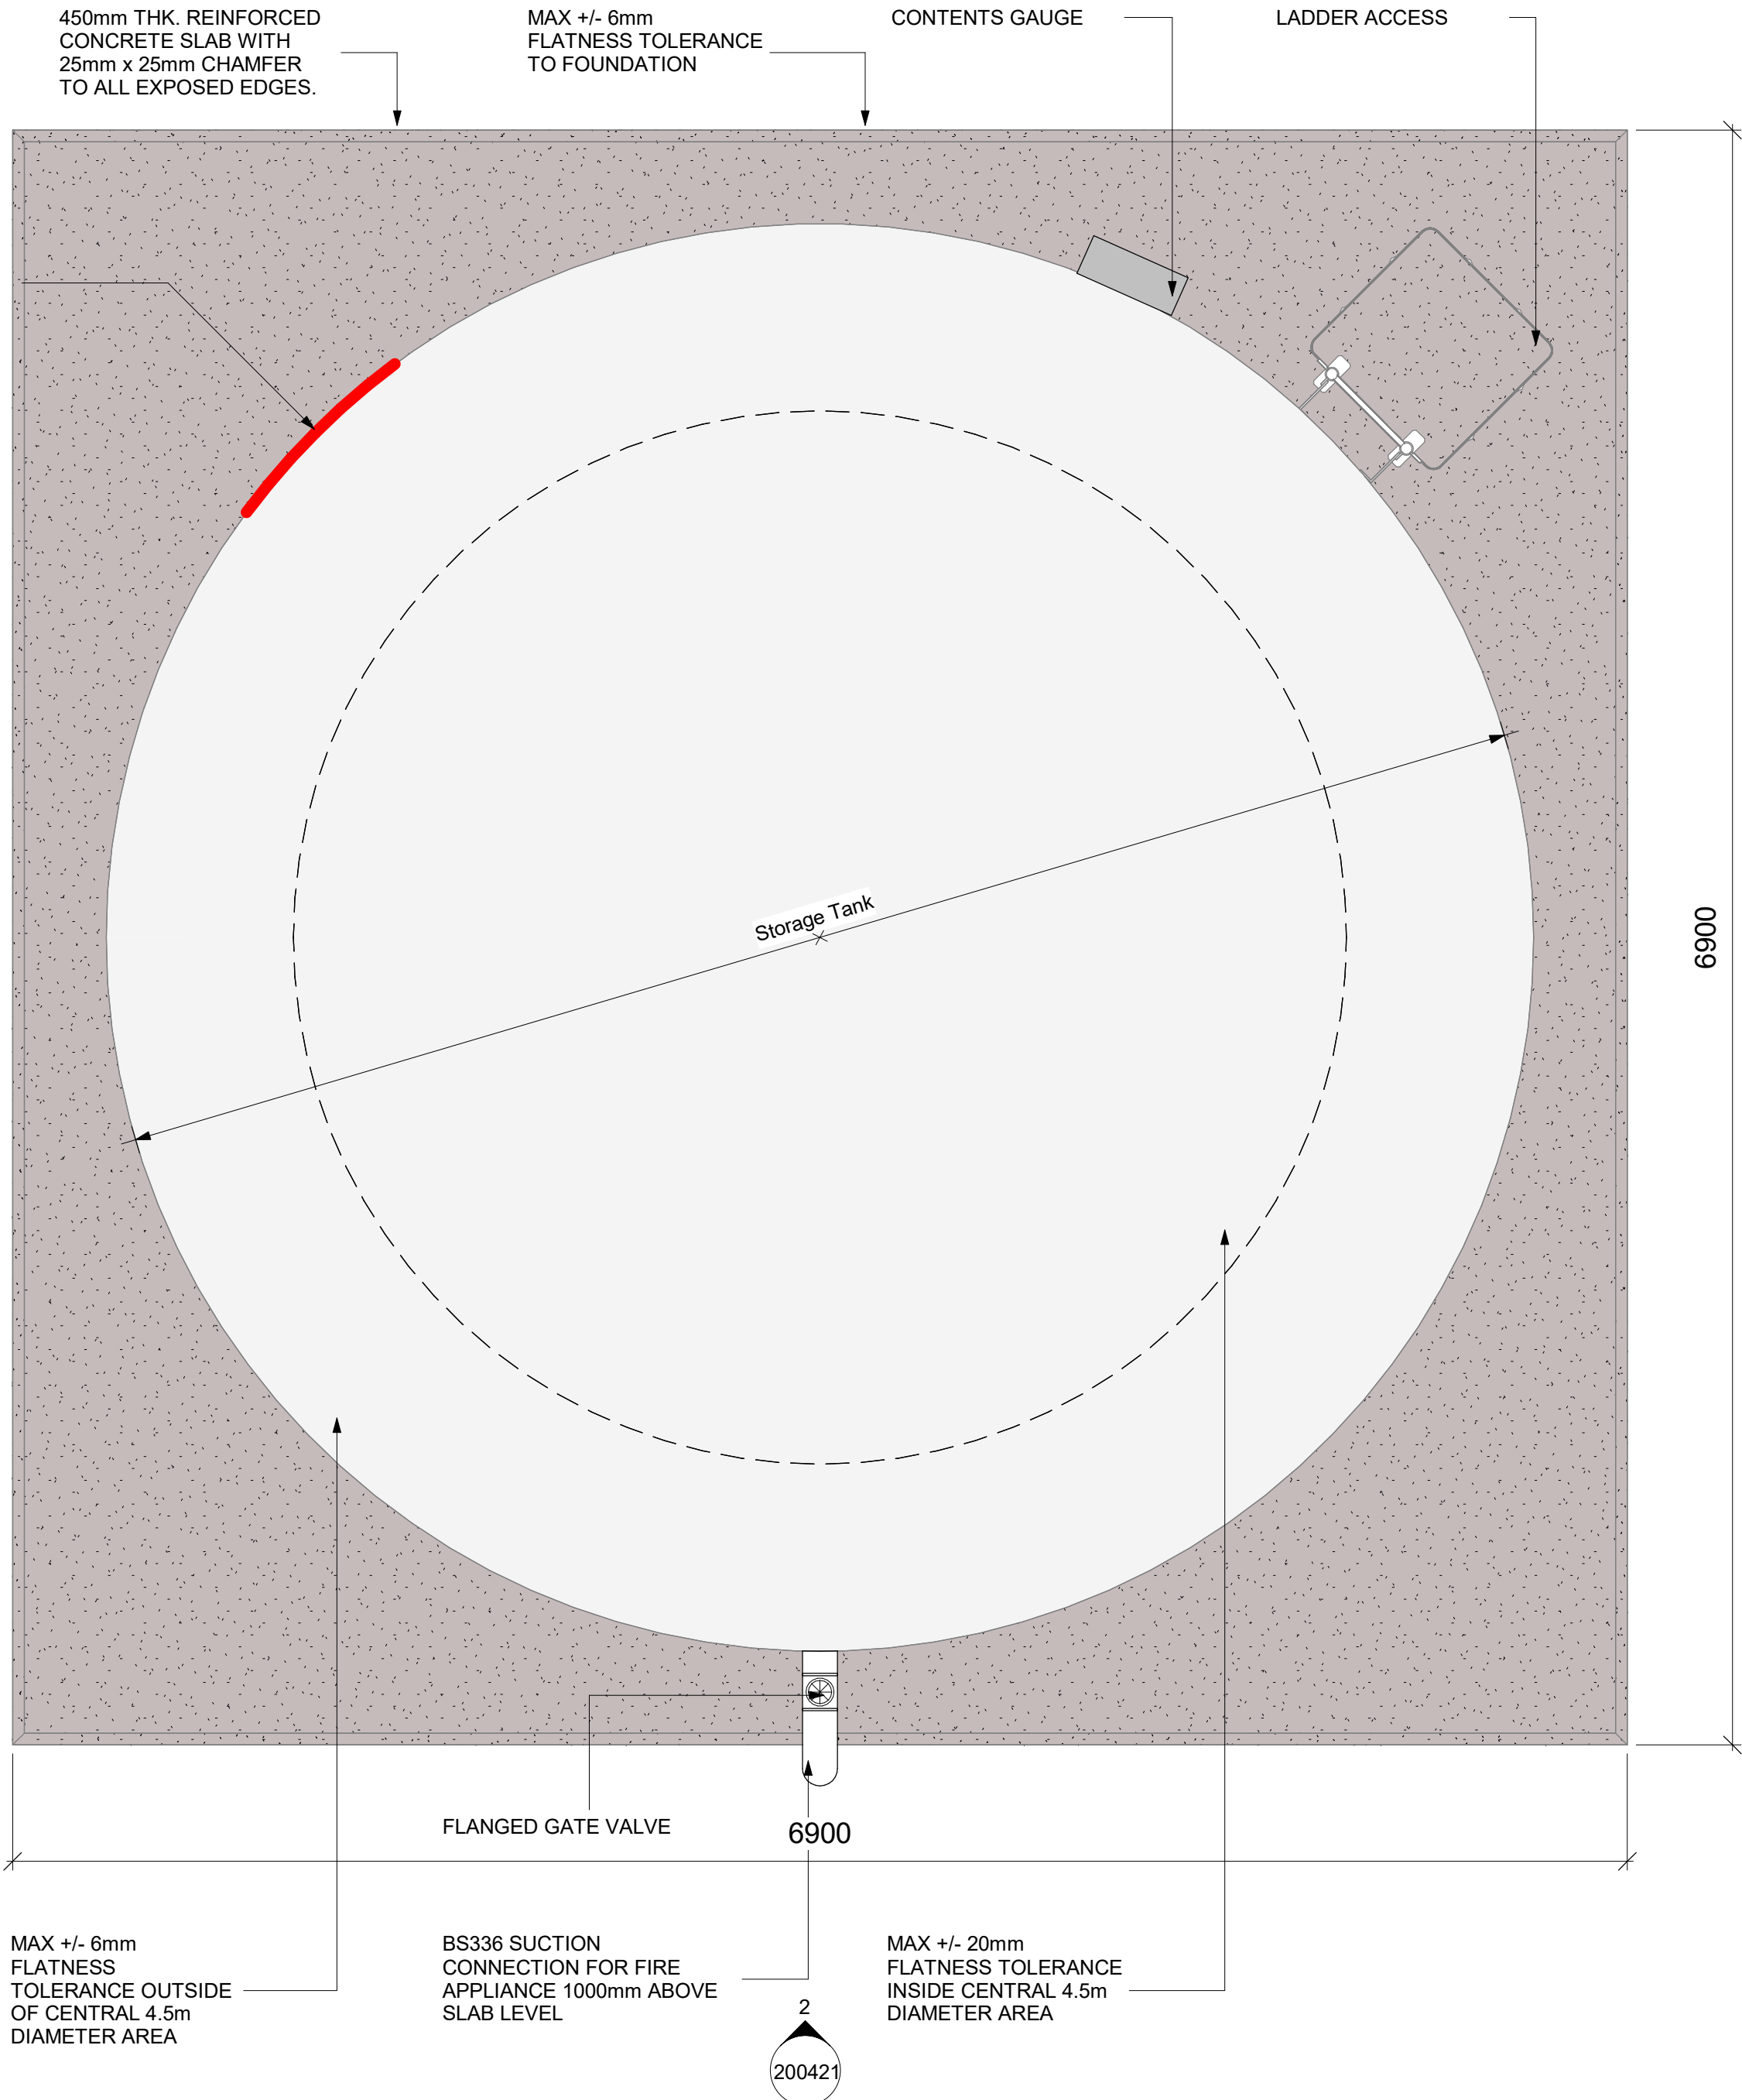

1 Level 00 GA Plan Proposed Water Tank

Scale: 1 : 25

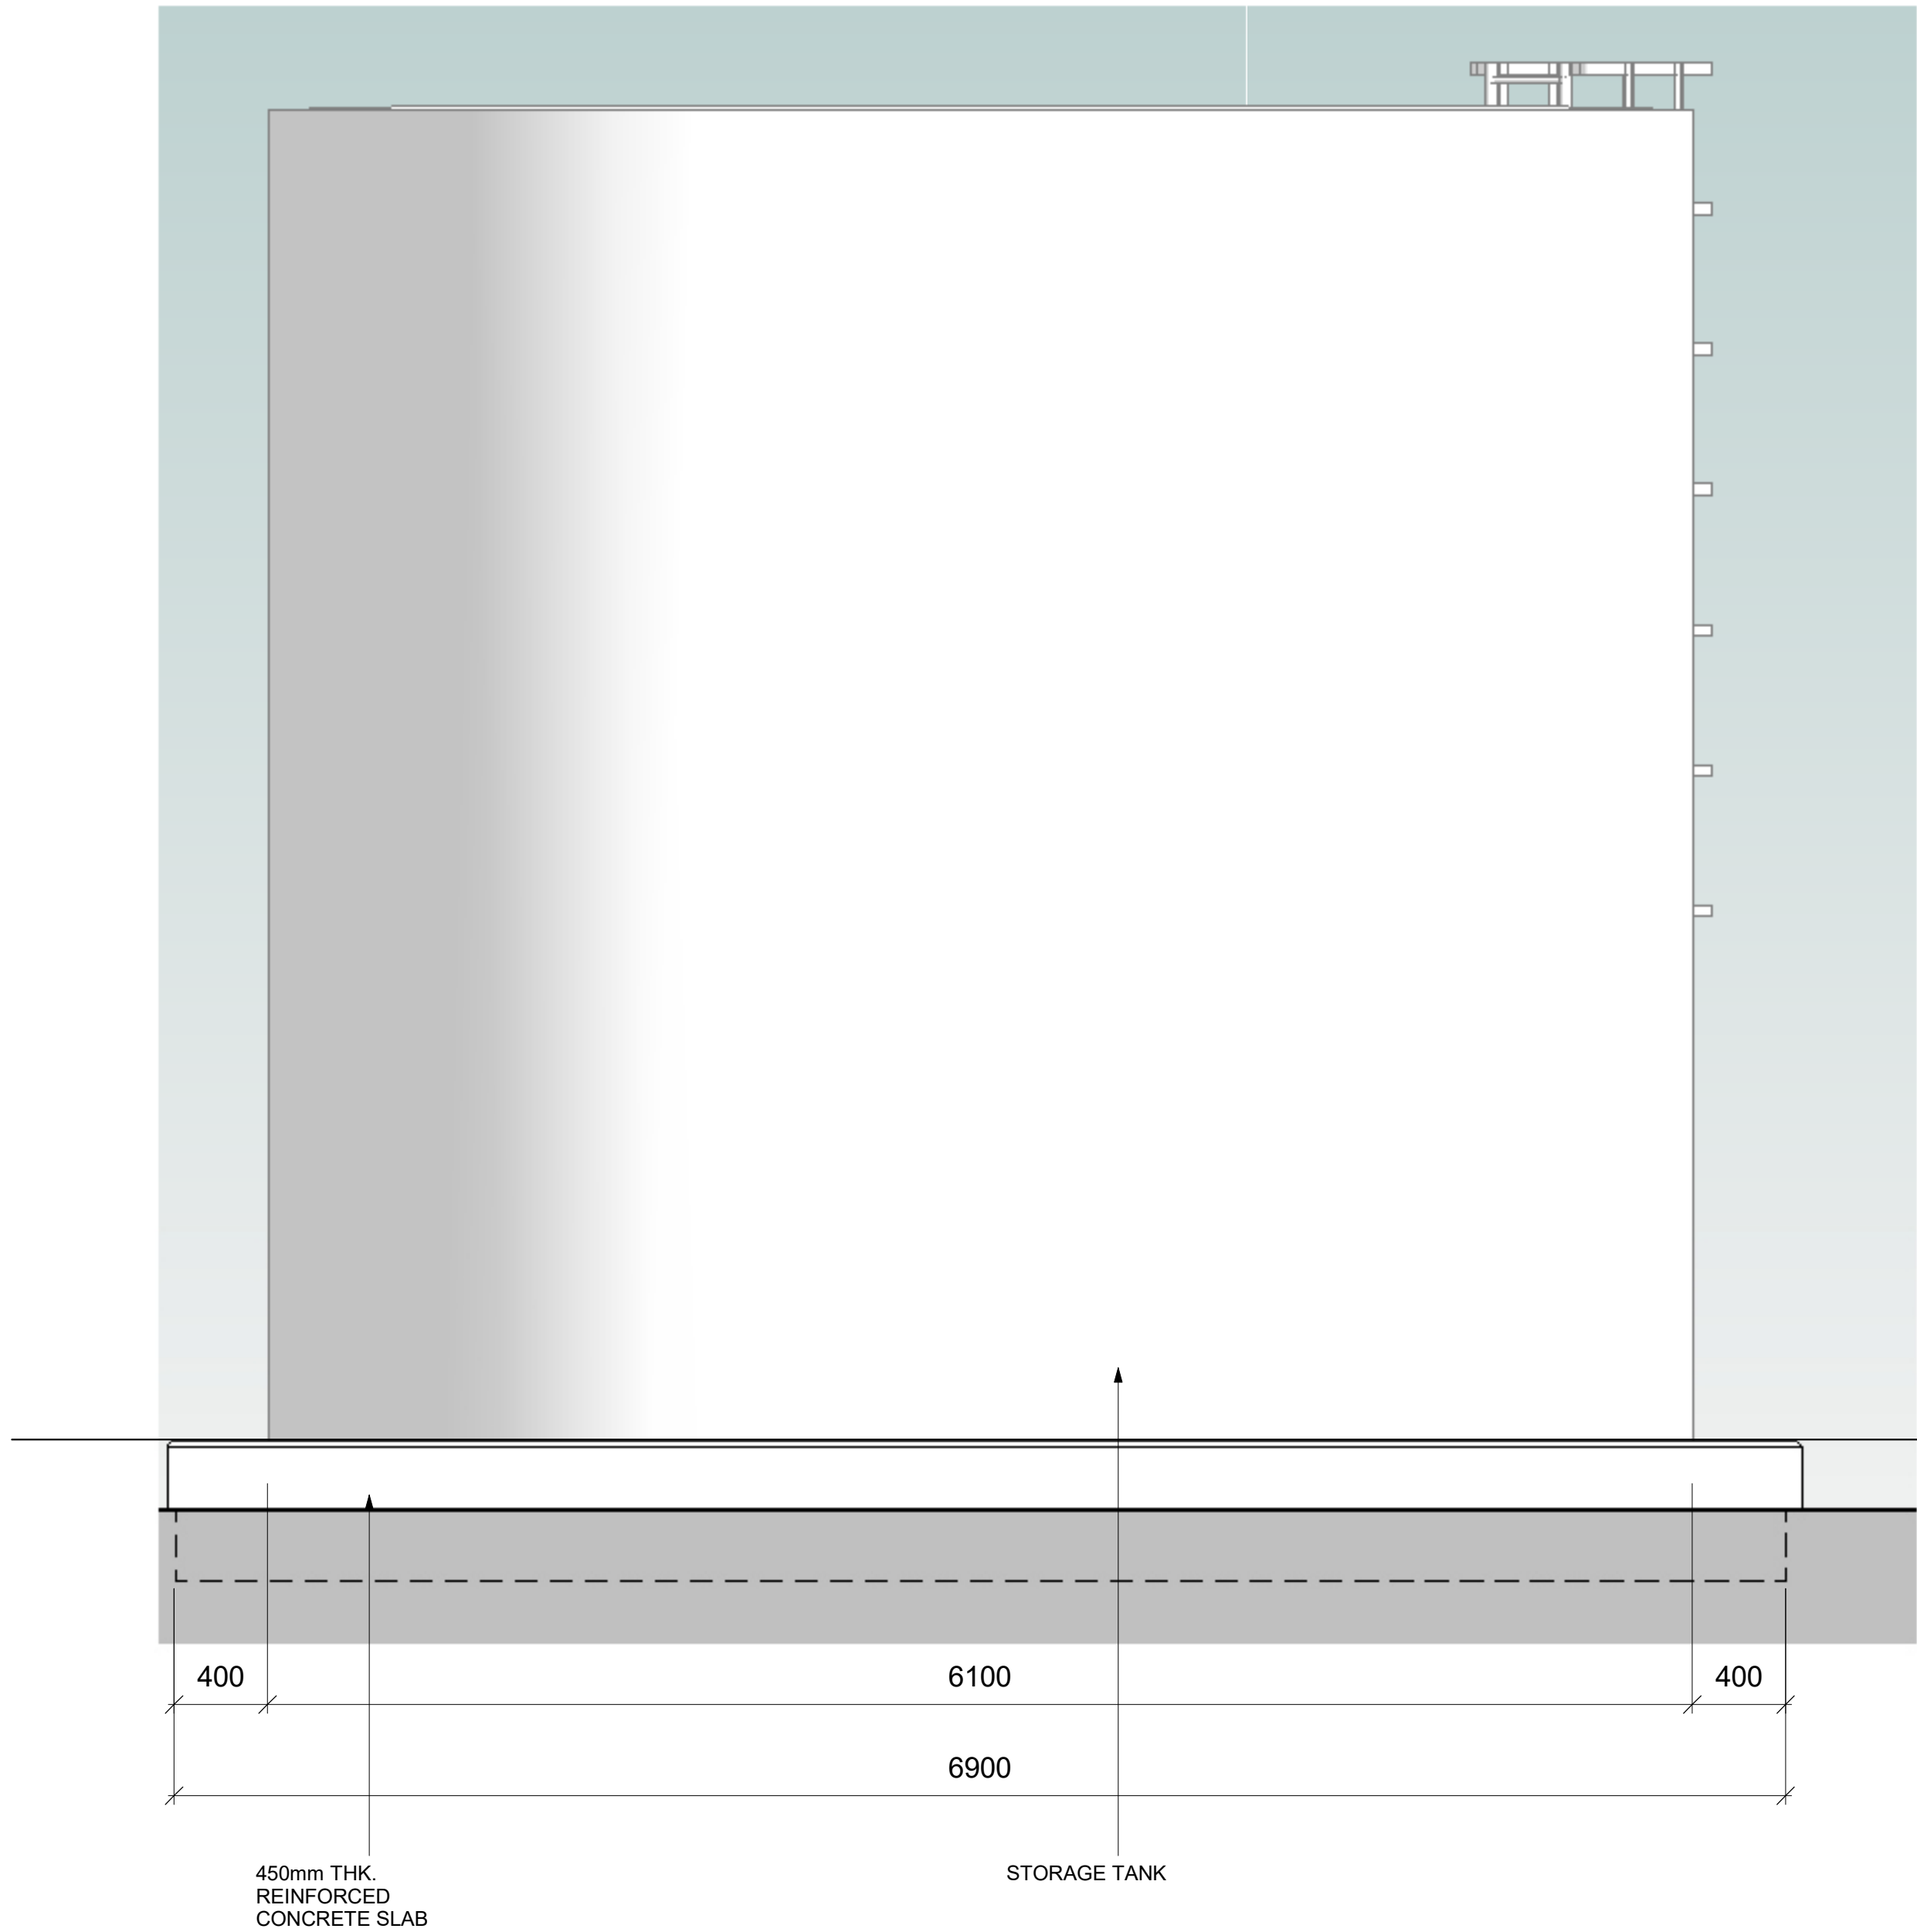


2 Port Talbot Water Tank_South Elevation

Scale: 1 : 25

WATER TANK

GALVANISED STEEL PANELS

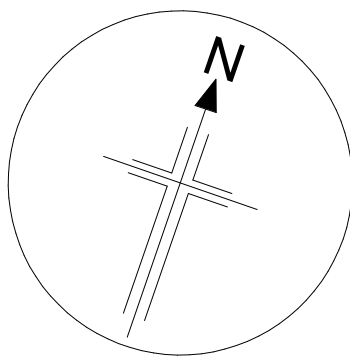

200 0 200 400 600 800 1000
SCALE 1:25 mm

For Planning

GENERAL NOTES

ALL BAKERHICKS DRAWINGS ARE TO BE READ IN CONJUNCTION WITH THE GENERAL NOTES DRAWINGS, THE RELEVANT BAKERHICKS SPECIFICATIONS AND ALL RELEVANT ARCHITECTS AND SERVICE ENGINEERS DRAWINGS AND SPECIFICATION.

ALL LEVELS ARE IN METRES ABOVE ORDINANCE DATUM.

ALL DIMENSIONS ARE IN MILLIMETRES (U.N.O.)

DO NOT SCALE ANY ENGINEERING DRAWINGS OR DIGITAL DATA. IF IN DOUBT ASK, WORK TO FIGURED DIMENSIONS ONLY. ANY DISCREPANCIES IN DIMENSIONS ARE TO BE REFERRED TO ENGINEER BEFORE WORK IS PUT TO HAND.

THE CONTRACTOR MUST ADVISE THE ARCHITECT AND ENGINEER OF ANY DISCREPANCIES BETWEEN THE CONTRACT DRAWINGS AND/OR SITE CONDITIONS / DIMENSIONS AT THE EARLIEST POSSIBLE OPPORTUNITY.


REVISION NOTES ARE FOR GUIDANCE ONLY. FOR SPECIFIC DETAILS, REFER TO CLOUDED AREA ON DRAWINGS FOR MOST RECENT AMENDMENTS.

ALL DIMENSIONS AND LEVELS ARE TO BE CHECKED ON SITE BY THE CONTRACTOR OR HIS SUBCONTRACTOR PRIOR TO PREPARING ANY WORKING DRAWINGS OR COMMENCING ON SITE.

ALL WORK HAS TO BE CARRIED OUT WITH THE REQUIREMENTS OF THE RELEVANT STATUTORY AUTHORITIES AND REGULATIONS.

ALL METHOD STATEMENTS SHOULD BE SUBMITTED TO THE ARCHITECT / CDM PRINCIPAL DESIGNER AND ENGINEER FOR REVIEW AT LEAST TWO WEEKS BEFORE CARRYING OUT THE SAD WORKS.

ALL PROPRIETARY PRODUCTS TO BE AS SPECIFIED OR EQUAL APPROVED.

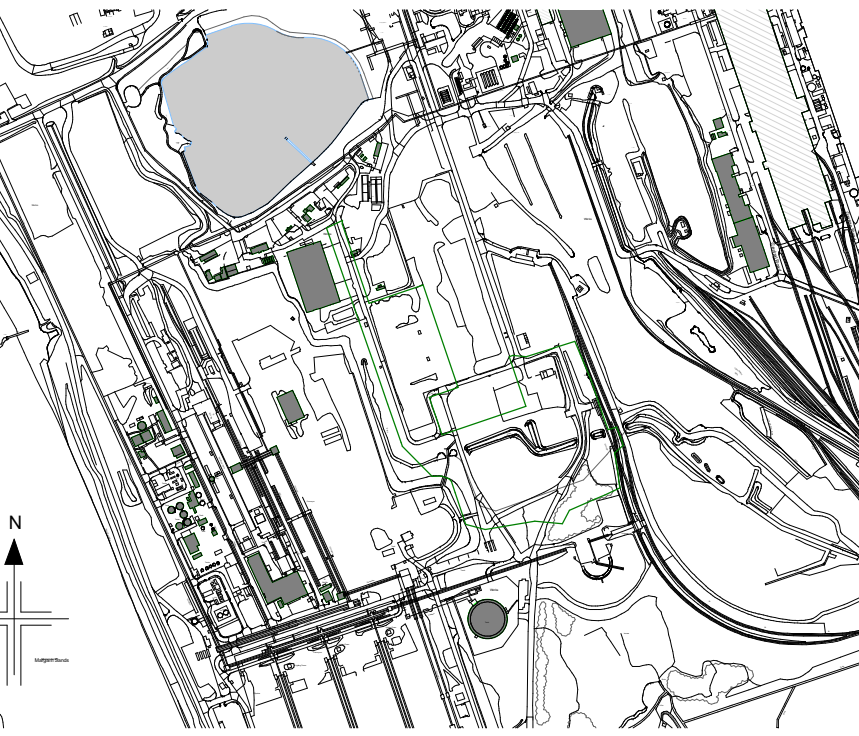

KEYPLAN

TANK BY FRANKLIN HODGE OR SIMILAR APPROVED TO FOLLOWING SPECIFICATION:

- TANK SPECIFICATION:
- MAX HEIGHT: 6m
- MAX DIAMETER: 6m
- MIN CAPACITY: 120m3
- NOTE SLAB SURFACE TOLERANCE AT TANK PERIMETER.
- SUPPLIER TO ADVISE IF REQUIRED TOLERANCE DIFFERS.

EXACT POSITION OF ANCILLARY EQUIPMENT TO SUPPLIER'S DETAILS. SUPPLIER DRAWINGS TO BE SUBMITTED FOR APPROVAL PRIOR TO FABRICATION

P04	S3: Suitable for Review & Comment. Updated Keyplan	DSB	OTR / RW	10/07/25
P03	S3 - For Review & Comment. Updated Boundary Line Colour in Key Plan Following Local Planning Authority Feedback	OTR	PC / RW	25/06/25
P02	S3 - For Review & Comment. Updated following planning feedback provided on 19/05/25	OTR	PC / JK	10/06/25
P01	First Issue - for planning	GP	RW / JK	02/05/25
Rev	Description	Cre'd	Chk'd / App'd	Date

nationalgrid

Master Scheme No:	Sub-Scheme No:	Site:
101677		PORT TALBOT

Margam Connection

Document Title:

Port Talbot GIS Hall - Water Tank

Created by:	Date:	Checked by:	Date:	Approved by:	Date:
GP	15/04/2025	RW	15/04/2025	JK	15/04/2025
Development Eng:	Document Type:	Scale:	Format:	Sheet(s):	Rev:
DWG		1 : 25	A1	1 OF 1	P04

National Grid Document Number: 20_LOR_0065

MARPT-BHK-02-ZZ-DG-A-200421