


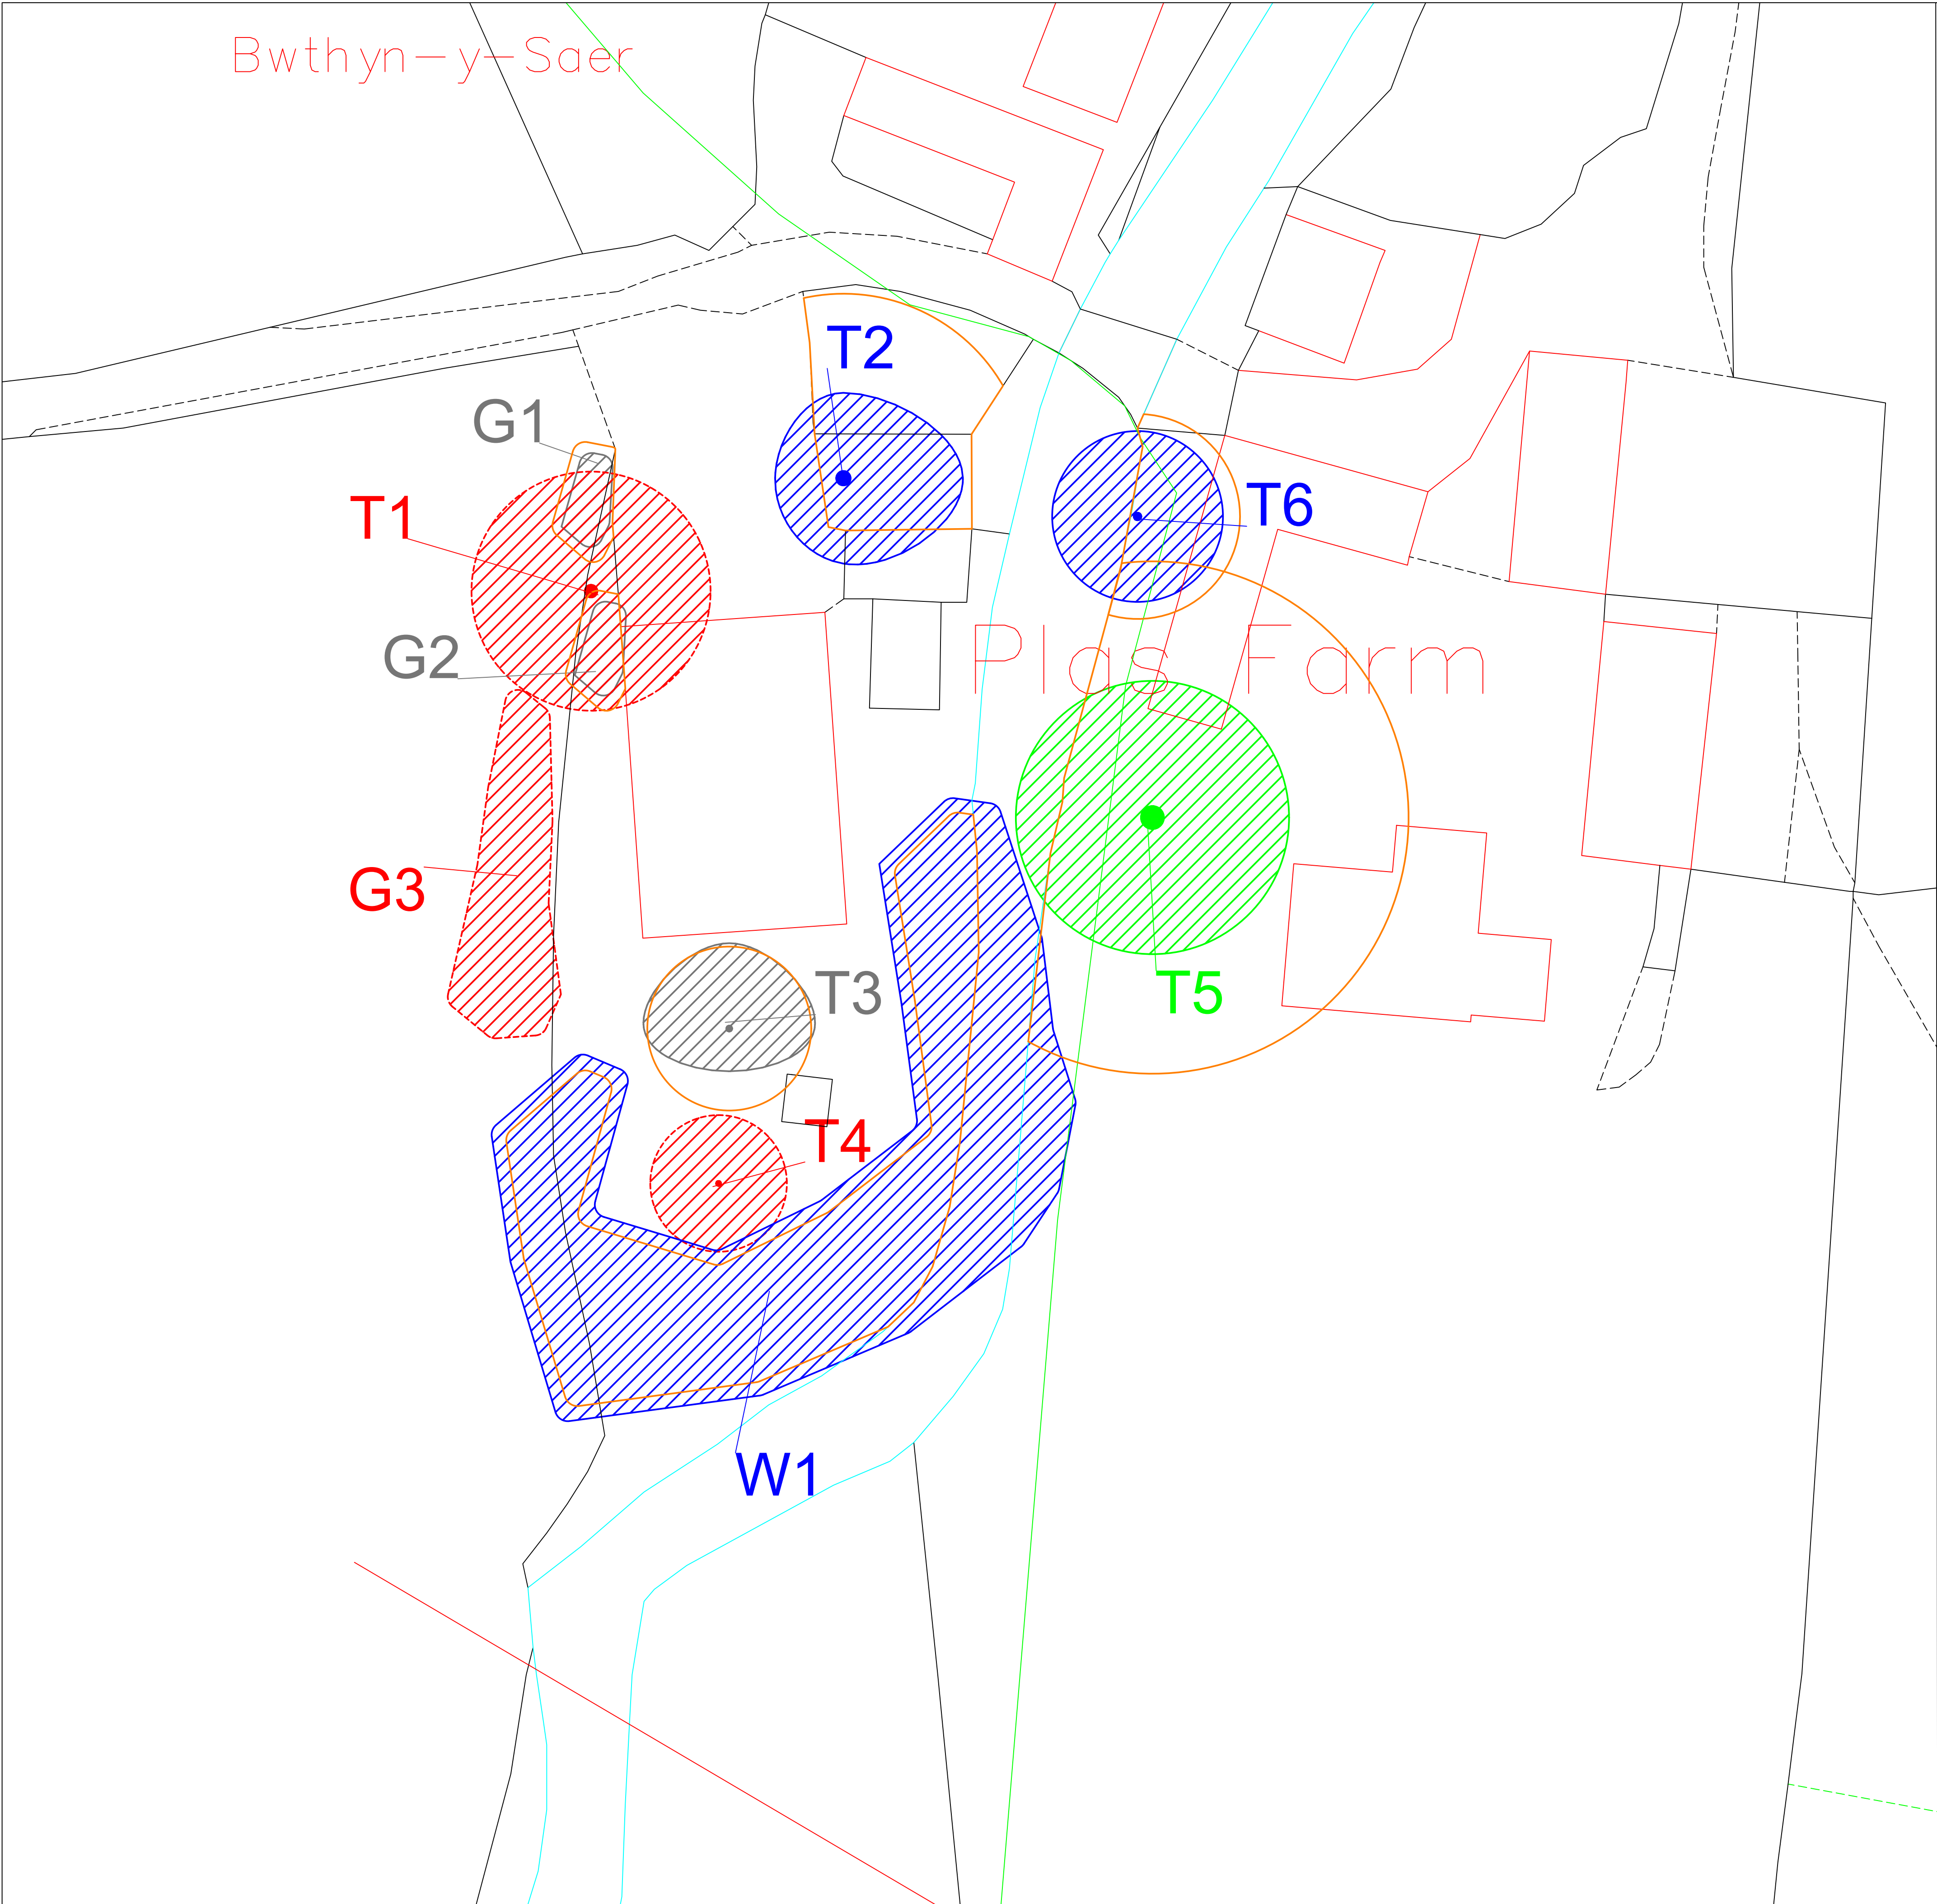

Ref	Tag	Species	Height	Stem Diam (mm)	Life Stage	Life Expectancy	Retention Category	RPA Area (m ²)	RPA Radius (m)
G1	N/A	Sawara cypress (<i>Chamaecyparis pisifera</i>), Leyland cypress (<i>X Cuprocyparis leylandii</i>)	6	130	EM	20-40	C2	7.6	1.6
G2	N/A	Leyland cypress (<i>X Cuprocyparis leylandii</i>), Sawara cypress (<i>Chamaecyparis pisifera</i>)	6	130	EM	20-40	C2	7.6	1.6
G3	N/A	<i>Rhododendron</i> (<i>Rhododendron ponticum</i>)	4	90	EM	<10	U	0	0
W1	N/A	Sycamore (<i>Acer pseudoplatanus</i>), Common hawthorn (<i>Crataegus monogyna</i>), Common ash (<i>Fraxinus excelsior</i>), <i>Rhododendron</i> (<i>Rhododendron ponticum</i>)	18	350	EM	40+	B2	55	4.2
T1	51	Horse chestnut (<i>Aesculus hippocastanum</i>)	17	800	M	<10	U	0	0
T2	52	Horse chestnut (<i>Aesculus hippocastanum</i>)	13	900	M	20-40	B2	366	11
T3	52	Portugal laurel (<i>Prunus lusitanica</i>)	13	400	EM	20-40	C2	72	4.8
T4	54	Common ash (<i>Fraxinus excelsior</i>)	18	350	EM	<10	U	0	0
T5	55	Sessile oak (<i>Quercus petraea</i>)	20	1400	M	40+	A2.3	707	15
T6	N/A	Weeping ash (<i>Fraxinus excelsior</i> 'Pendula')	16	500	EM	20-40	B2	113	6

Key

– Category A.
Trees with high retention value.

– Category B.
Trees with moderate retention value.

– Category C.
Trees with low retention value.

– Category U.
Trees unsuitable for retention due to condition

– Root Protection Area (RPA)

Tree Key

Canopy extents, hatched area represents area within the canopy.

Location of tree base, taken from position on TOPO or GPS.

Reference number
(T for trees, G for groups, W for woodlands, H for hedges).

RPA– an indication of the estimated mininum rooting area required by the tree. Calculated in accordance with BS5837.

Tree Constraints Plan Plas Farm Biomass	
1:300 at A1	
Client	Adam Cropper
Survey Code	25113
Drawn by	LM
Surveyed by	BC
Date	06/08/2025

Tree Check
Arboriculture Ltd.

Ben Clark
TechArborA, Dip Arb L4 (ABC)

Tree Check Arboriculture Ltd.
Tel. 07736236152
Email:ben@treecheck.co.uk
www.Treecheck.co.uk

Drawing designed to be viewed in colour.
Indicative only, check all RPA's on site in accordance with table.