


NOISE IMPACT ASSESSMENT

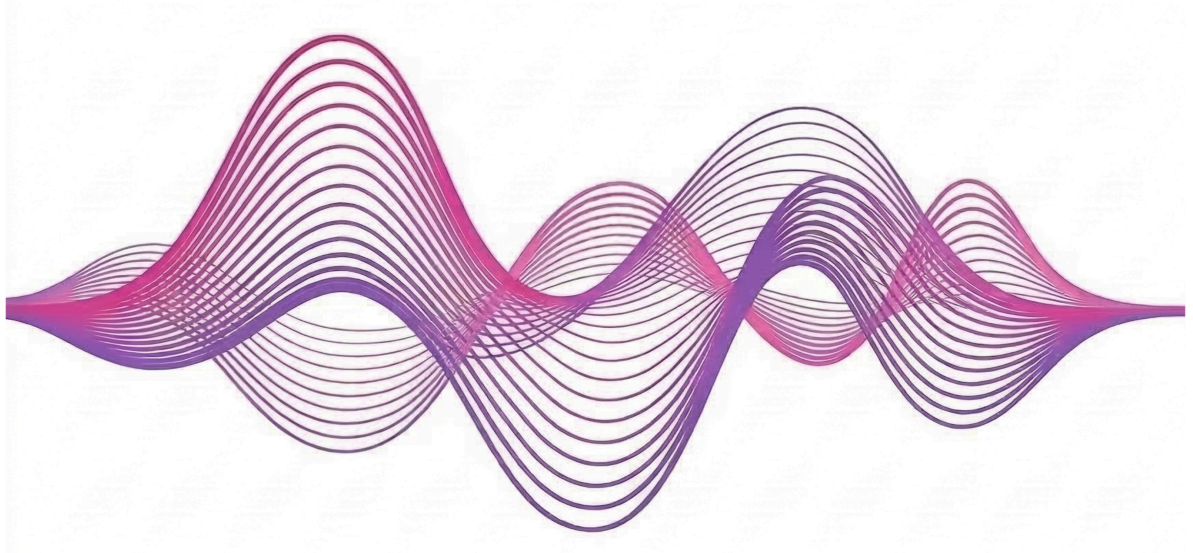

Project: Residential Heat Pump Installation – 51 Ascot Drive

Subject: Technical Methodology and Results Analysis for Planning Application

Date: 13th of May, 2026

Author: Samuel Wall

Contents

NOISE IMPACT ASSESSMENT	0
1. INTRODUCTION AND EXECUTIVE SUMMARY	2
2. LEGISLATIVE AND STANDARDS FRAMEWORK	3
3. SOURCE NOISE DATA SPECIFICATION	4
3.3. Spectral Analysis	4
4. COMPUTATIONAL MODELING METHODOLOGY	6
5. PREDICTED RESULTS AND ANALYSIS	7
5.1. Comparative Results Table	7
5.2. Internal Noise Level Calculation	9
6. CONTEXTUAL ASSESSMENT AND ACOUSTIC MASKING	11
7. CONCLUSION	13
APPENDIX A: TECHNICAL REFERENCES AND MODELING DATA	14
A.1. SOURCE NOISE DATA SPECIFICATION	14
A.2. LEGISLATIVE AND STANDARDS FRAMEWORK	14
A.3. COMPUTATIONAL MODELING ASSUMPTIONS (ISO 9613-2)	14
A.4. GLOSSARY OF ACOUSTIC TERMS	15

1. INTRODUCTION AND EXECUTIVE SUMMARY

1.1. This formal Acoustic Technical Note has been prepared to accompany the planning application regarding the installation of a Daikin EDLA08 Air Source Heat Pump (ASHP) at 51 Ascot Drive. This document serves to quantify, via computational modeling, the potential acoustic impact of the proposed mechanical plant on the residential amenity of the nearest sensitive receptors.

1.2. The primary objective is to demonstrate that the proposed installation will not result in an '**unacceptable degree of disturbance**' and will contribute to an '**appropriate soundscape**' as defined by **Planning Policy Wales (PPW)** and the **Noise and Soundscape Plan for Wales 2023–2028**." To ensure technical robustness, the assessment methodology strictly adheres to the internationally recognized **ISO 9613-2:1996** standard for the attenuation of sound during propagation outdoors.

1.3. Acknowledging the necessity for a definitive prediction, this report employs a conservative methodology incorporating hard ground assumptions ($G=0$) and high facade reflection coefficients. As detailed in **Appendix A.3**, this ensures the predicted levels represent a definitive upper limit of potential impact.

1.4. Computational modeling confirms that the predicted external Rating Noise Level ($L_{A,r}, Tr$) at the closest, worst case neighbouring habitable room assessment point is 39 dB(A).

1.5. This level is 6–16 dB below the prevailing ambient daytime noise climate (45–55 dB) and within the prevailing ambient nighttime noise climate (35–45) as indicated by Data Map Wales. Furthermore, the calculated internal noise level within the nearest habitable room is **29 dB(A)**, which is below the **BS 8233:2014** target of 30 dB for sleeping conditions.

2. LEGISLATIVE AND STANDARDS FRAMEWORK

This assessment has been prepared with reference to the following national standards and planning guidance documents. Detailed definitions are provided in **Appendix A.2**.

2.1. Planning Policy Wales (PPW) Edition 12 (2024):

Paragraph 6.7.21 mandates the **"Agent of Change"** principle, requiring that the proposed installation must mitigate and minimize noise to prevent an **"unacceptable degree of disturbance"** and maintain an **"appropriate soundscape"** for existing residents.

2.2. British Standard BS 8233:2014:

This standard establishes internal ambient noise level targets to safeguard rest and sleep. The relevant criterion is **30 dB LAeq, 8hr** for bedrooms.

2.3. British Standard BS 4142:2014+A1:2019:

This standard provides methods for rating and assessing industrial and commercial sound. It introduces the **Rating Level (L_{Ar},Tr)**, which is the specific sound level of the source corrected for acoustic features.

3. SOURCE NOISE DATA SPECIFICATION

3.1. Unit Specification

- The assessment is based on the Daikin EDLA08 Air Source Heat Pump.
- **Distance to Host Facade:** 300mm.
- **Source Data Reference:** See Table 1 and Table 2.

3.2. Sound Power Verification and Tonality Correction

- The assessment utilizes manufacturer-certified sound pressure data.
- Because the source data is provided as sound pressure at 1 meter, a cumulative correction of **+11 dB** has been applied to each octave band frequency to derive the Sound Power Level (LW). This includes:
 - **+8 dB** for the geometric conversion from pressure to power.
 - **+3 dB** to account for potential operational variance under non-nominal conditions.
- On top of this base conversion, a **+2 dB Tonal Correction** has been pre-applied to the source data levels used in the map. This conservative adjustment accounts for any spectral characteristics inherent to the unit's inverter-driven compressor, ensuring that the modeled results represent a "Rating Level" (L_Ar, Tr) rather than a simple specific sound level.

3.3. Spectral Analysis


Full octave band data (63Hz - 8kHz) has been input into the model to accurately predict the propagation of different frequencies over distance.

Table 1: Sound Pressure Level Data

Daikin EDLA08 Sound Pressure Level Octave Bands								
Frequency (Hz)	63	125	250	500	1000	2000	4000	8000
dB	50	54	49	48	43	37	31	22
Total	57.2							
A-weighted dB	23.8	37.9	40.4	44.8	43	38.2	32	20.9
Total	49							

Table 2: Corrected Sound Power Spectral Data

Daikin EDLA08 Sound Power Level (+8dB geometric conversion and +3dB for operational variance)								
Frequency (Hz)	63	125	250	500	1000	2000	4000	8000
dB	61	65	60	59	54	48	42	33
Total	68.2							
A-weighted dB	34.8	48.9	51.4	55.8	54	49.2	43	31.9
Total	59.8							

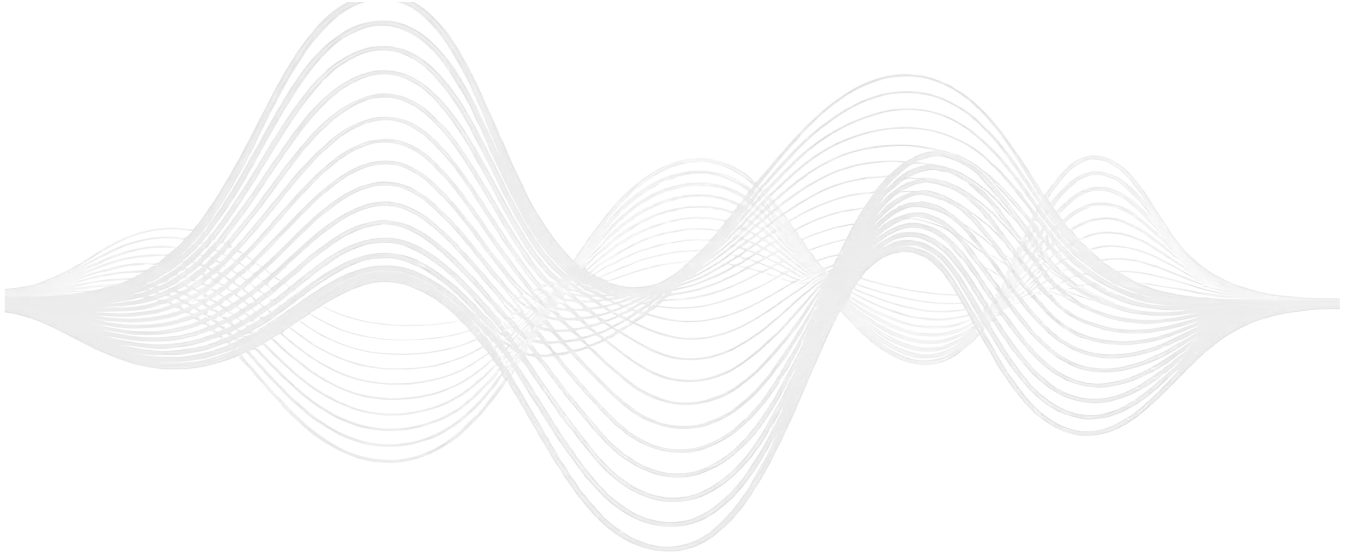

4. COMPUTATIONAL MODELING METHODOLOGY

The noise map and propagation calculations were generated utilizing the ISO 9613-2:1996 standard.

4.1. Facade Reflection (Coefficient 0.982):

A reflection coefficient of 0.982 was strictly applied to all vertical surfaces (brickwork/glazing). This assumes 98.2% of sound energy is reflected back into the environment, effectively modeling the building envelope as a near-perfect acoustic mirror.

4.2. Ground Factor (G=0):

A global Ground Factor of $G=0$ (Hard Ground) was applied to the entire propagation path. This treats the ground as reflective, negating attenuation provided by garden turf.

4.3. Directivity (Q=4):

Hemispherical radiation ($Q=4$) is assumed to account for source directivity resulting from installation in close proximity (300mm) to the reflective host facade as well as the ground.

4.4. Acoustic Feature Correction:

In accordance with BS 4142, a +2 dB tonal correction has been applied to the specific sound level to derive the Rating Level ($L_{Ar,Tr}$).


5. PREDICTED RESULTS AND ANALYSIS

Predictions were calculated at identified receiver locations. The values below represent the Rating Level (L_Ar,Tr), inclusive of the tonal correction.

5.1. Comparative Results Table

Property Address	Assessment Position	Ground Floor	First Floor	Second Floor
53 Ascot Drive	Position 1	31 dB(A)	35 dB(A)	34 dB(A)
	Position 2	-	39 dB(A)	37 dB(A)
	Position 3	22 dB(A)	-	-
	Position 4	-	36 dB(A)	35 dB(A)
	Position 5	-	25 dB(A)	27 dB(A)
	Position 6	-	25 dB(A)	26 dB(A)
49 Ascot Drive	Position 7	-	32 dB(A)	31 dB(A)
	Position 8	-	33 dB(A)	32 dB(A)
	Position 9	-	30 dB(A)	30 dB(A)
	Position 10	-	17 dB(A)	19 dB(A)
	Position 11	-	20 dB(A)	21 dB(A)
	Position 12	26 dB(A)	-	-
	Position 13	21 dB(A)	-	-
	Position 14	18 dB(A)	-	-

ISO 9613-2 Ground-floor assessment points 53 Ascot Drive:

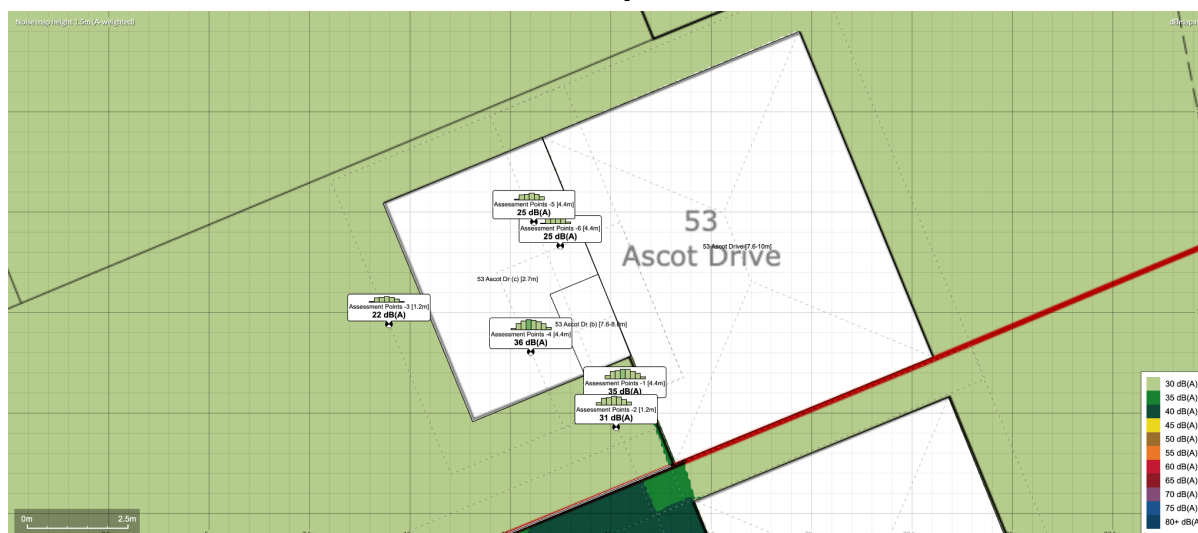

0m 2.5m

30 dB(A)
35 dB(A)
40 dB(A)
45 dB(A)
50 dB(A)
55 dB(A)
60 dB(A)
65 dB(A)
70 dB(A)
75 dB(A)
80+ dB(A)

48 Ascot Drive (7.6-10m)

Ascot Drive (B) (7.6-8.5m)

Assessment Point 7 (4.4m)
32 dB(A)

Assessment Point 8 (4.4m)
33 dB(A)

Assessment Point 9 (4.4m)
38 dB(A)

Assessment Point 10 (4.4m)
37 dB(A)


Assessment Point 11 (4.4m)
20 dB(A)

Assessment Point 12 (1.2m)
26 dB(A)


Assessment Point 13 (1.2m)
21 dB(A)

Assessment Point 14 (1.2m)
18 dB(A)

ISO 9613-2 First-floor assessment points 49 Ascot Drive:

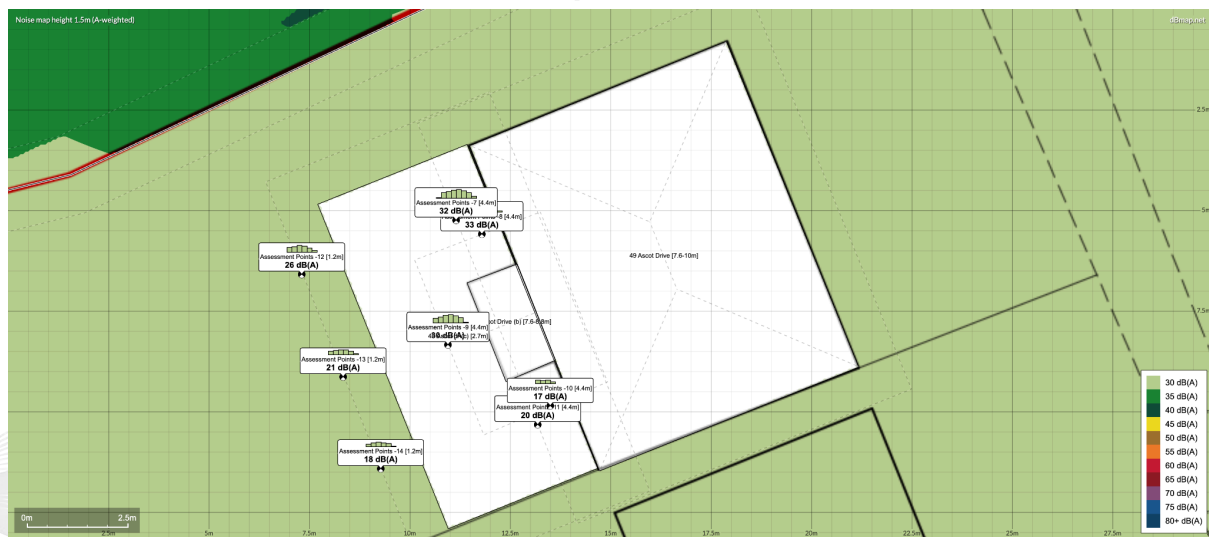

ISO 9613-2 Second-floor assessment points 49 Ascot Drive:

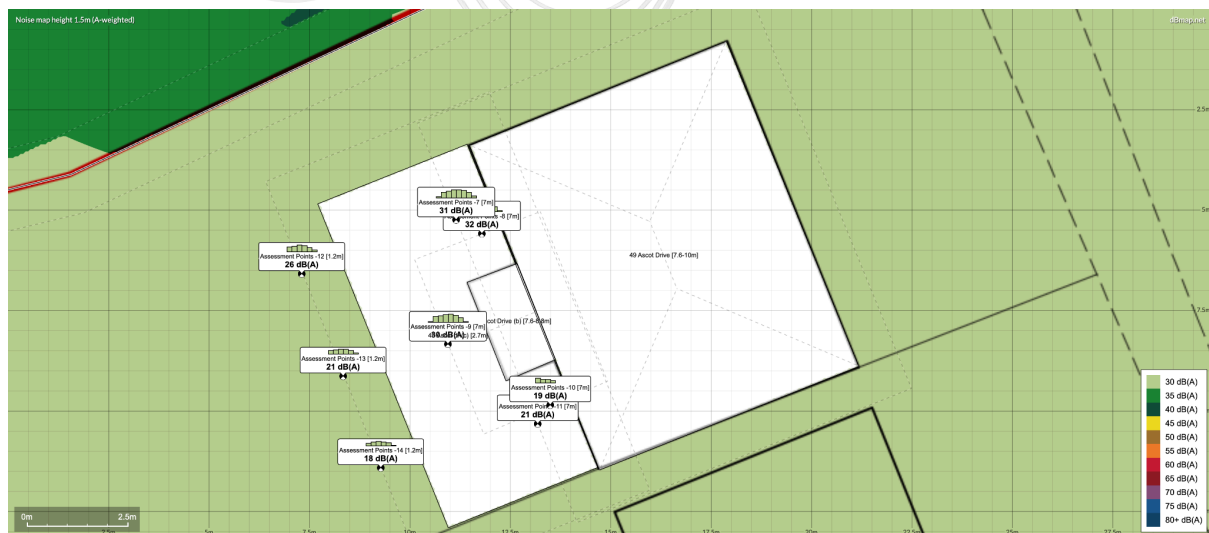

5.2. Internal Noise Level Calculation

The critical receptor is the first floor window at 53 Ascot Drive. It is standard acoustic practice (accepted by the World Health Organization and BS 8233) to assume that a partially open window provides 10-15 dB of attenuation from external noise sources. A conservative attenuation factor of **10 dB** has been adopted.

Internal Level = External Rating Level - Open
Window Attenuation

Internal Level = 39dB(A) - 10dB

Internal Level = 29dB(A)

Compliance: The calculated internal level of **29dB(A)** is **1dB lower** than the BS 8233 target of 30 dB. Confirming that there is no risk of sleep disturbance, even under worst-case assumptions.

6. CONTEXTUAL ASSESSMENT AND ACOUSTIC MASKING

6.1. Ambient Noise Climate:

Strategic noise data from **Data Map Wales** identifies the ambient daytime noise baseline for this location to be within the **45-55 dB(A)** band, and the ambient nighttime noise baseline to be within the **35-45 dB(A) band**.


6.2. Assessment of Impact:

- Prevailing Ambient Noise Climate (Daytime): 45–55 dB(A)
- Plant Rating Level: 39 dB(A).
- Differential: **6 to 16 dB**.
- Prevailing Ambient Noise Climate (Nighttime): 35–45 dB(A)
- Plant Rating Level: 39 dB(A).
- Differential: Within the existing soundscape


6.3. Discussion:

The phenomenon of Acoustic Masking dictates that the broadband noise of the environment will mask the lower-level sound of the new source. When a source's rating level falls below the prevailing ambient noise floor, it is fundamentally rendered acoustically indistinguishable from the background. When the rating level is within the ambient floor, the principle of Acoustic Masking ensures the specific noise remains contained by the existing environmental noise climate. In both scenarios, the source is prevented from introducing a new, significant noise character, thereby preserving the existing soundscape and ensuring no unacceptable disturbance to the health and well-being of residents


Data Map Wales (No Layers):

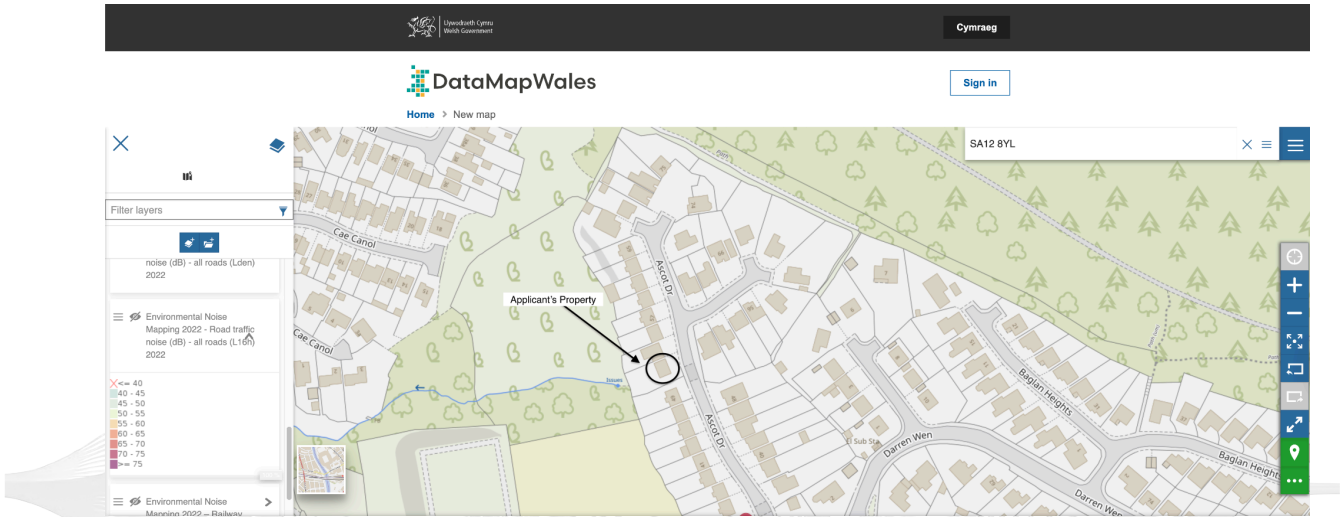

Data Map Wales (Daytime):

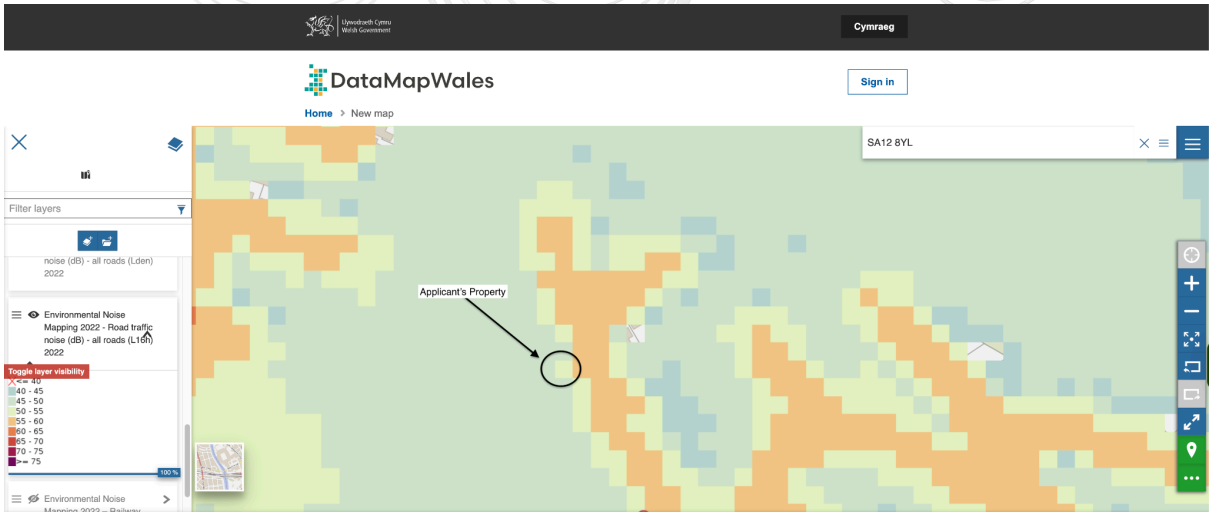

Data Map Wales (No Layers):

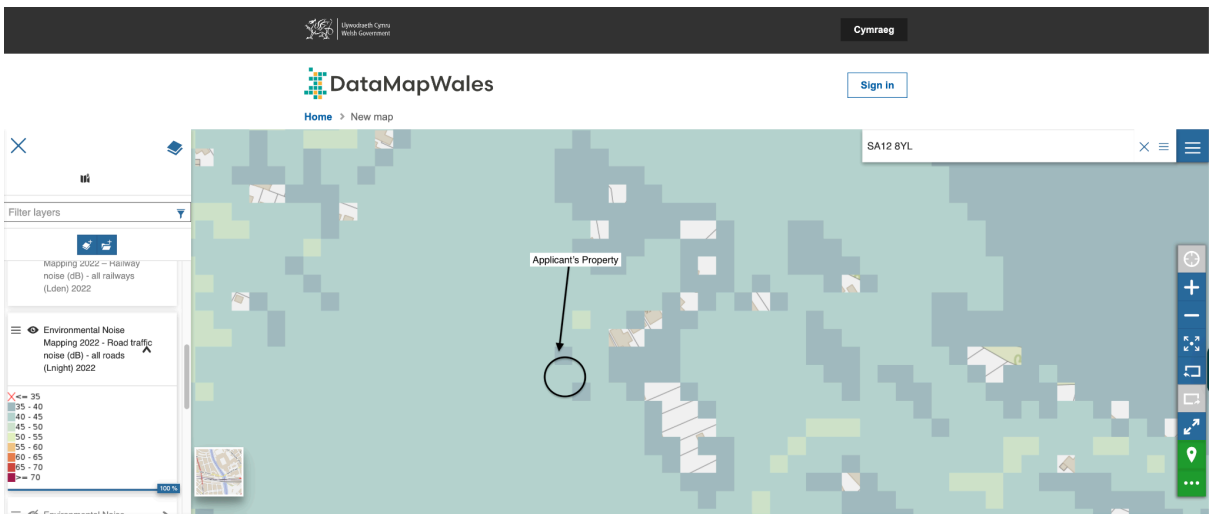

7. CONCLUSION

7.1. This comprehensive computational assessment demonstrates that the proposed installation of the Daikin EDLA08 at 51 Ascot Drive complies with all relevant national planning policies regarding noise.

7.2. External Impact:

The worst-case Rating Level (39 dB) is lower than the prevailing ambient daytime noise levels (45–55 dB), and within the prevailing ambient nighttime levels (35–45 dB.)

7.3. Internal Amenity:

The indoor noise level (29 dB) is below the **BS 8233** sleep protection limit (30 dB).

7.4. The proposal maintains an appropriate soundscape and protects resident well-being; it therefore supports Sustainable Placemaking outcomes and should be considered acceptable for planning approval

APPENDIX A: TECHNICAL REFERENCES AND MODELING DATA

A.1. SOURCE NOISE DATA SPECIFICATION

- **Unit Model:** Daikin EDLA08 Air Source Heat Pump.
- **Spectral Data:** Full octave band data (63Hz - 8kHz) has been utilized for the calculation rather than a single weighted figure to ensure low-frequency content is accurately propagated.
- **Reference Pressure:** 0 dB = 20μPa.

A.2. LEGISLATIVE AND STANDARDS FRAMEWORK


- **Planning Policy Wales (PPW) Edition 12 (2024):** Paragraph 6.7.21 (the "**Agent of Change**" principle) mandates that planning decisions must prevent "**unacceptable noise pollution**" and ensure that the acoustic environment supports the health and well-being of the community.
- **Noise and Soundscape Plan for Wales 2023–2028:** This national policy defines the requirement for an "**appropriate soundscape**" and aligns with the **Environment (Air Quality and Soundscapes) (Wales) Act 2024**. The results of this assessment place the development within a range where the soundscape is preserved, ensuring no "**unacceptable degree of disturbance**" occurs to residential amenity.
- **BS 8233:2014:** Recommends a criterion of 30dB LAeq,8hr for sleeping conditions in bedrooms.
- **BS 4142:2014:** Methodology for rating and assessing industrial and commercial sound.


A.3. COMPUTATIONAL MODELING ASSUMPTIONS (ISO 9613-2)



- **Reflection Coefficient (0.982):** Applied to all vertical surfaces, assuming 98.2% of sound energy is reflected back into the environment.
- **Ground Factor (G=0):** Hard ground applied to the entire propagation path to negate soft ground attenuation, ensuring the predicted levels are conservative.
- **Directivity (Q=4):** Hemispherical radiation assumed due to proximity (300mm) to the reflective host facade and the ground.
- **Atmospheric Absorption:** Standard ISO conditions (10°C, 70%RH) applied.


A.4. GLOSSARY OF ACOUSTIC TERMS


- **dB(A):** A-weighted decibels; a logarithmic scale reflecting the frequency response of the human ear.
- **L_{Aeq,T}:** The "Equivalent Continuous Sound Level" over a specified time period "T".
- **Rating Level (L_{Ar}, Tr):** The specific noise level of the source plus any adjustment for characteristic features.
- **Sound Power Level (L_W):** The total sound energy radiated by a source per unit of time.

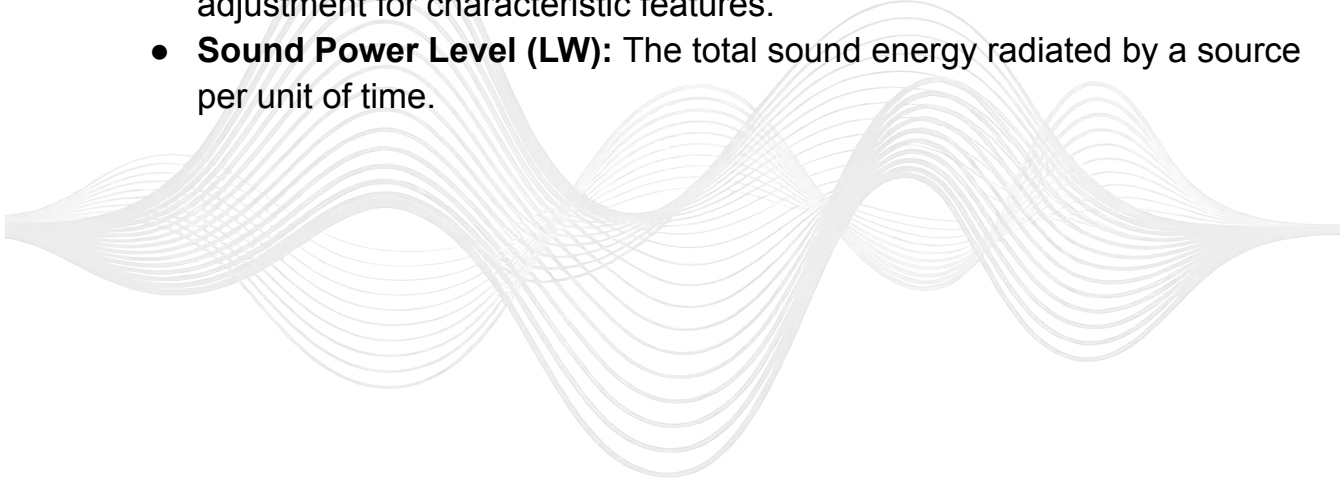





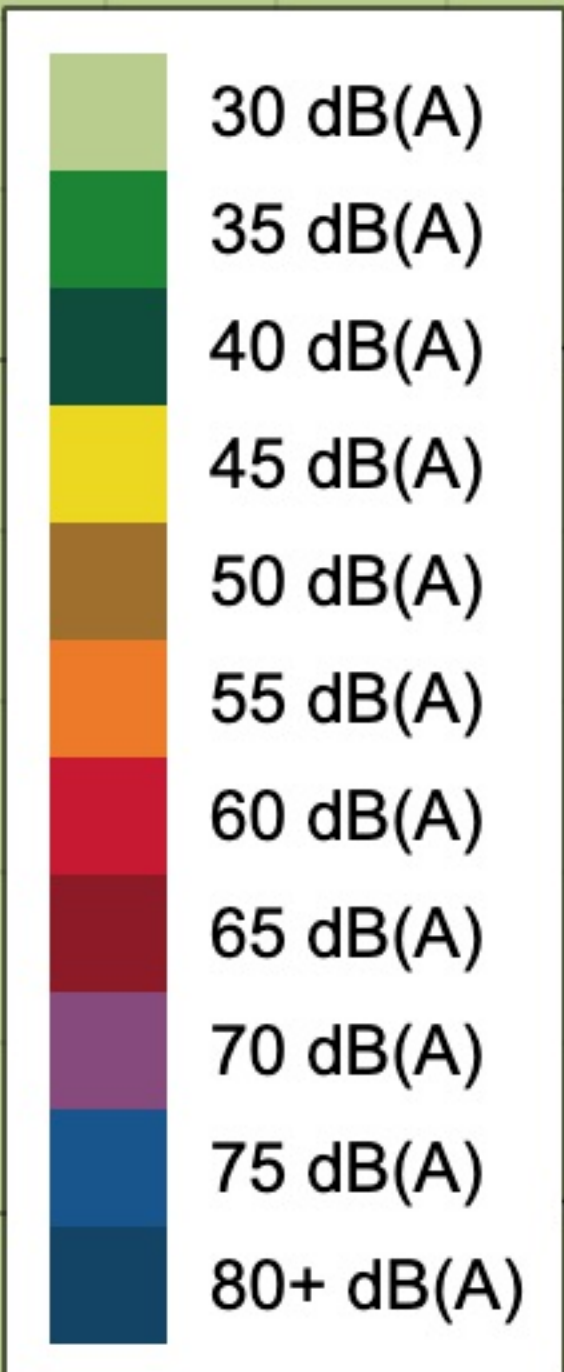












DataMapWales

Sign in

Home > New map

SA12 8YL

Applicant's Property



Filter layers





noise (dB) - all roads (Lden)
2022


Environmental Noise
Mapping 2022 - Road traffic
noise (dB) - all roads (L16h)
2022

<= 40
40 - 45
45 - 50
50 - 55
55 - 60
60 - 65
65 - 70
70 - 75
≥ 75

Environmental Noise
Mapping 2022 - Railway

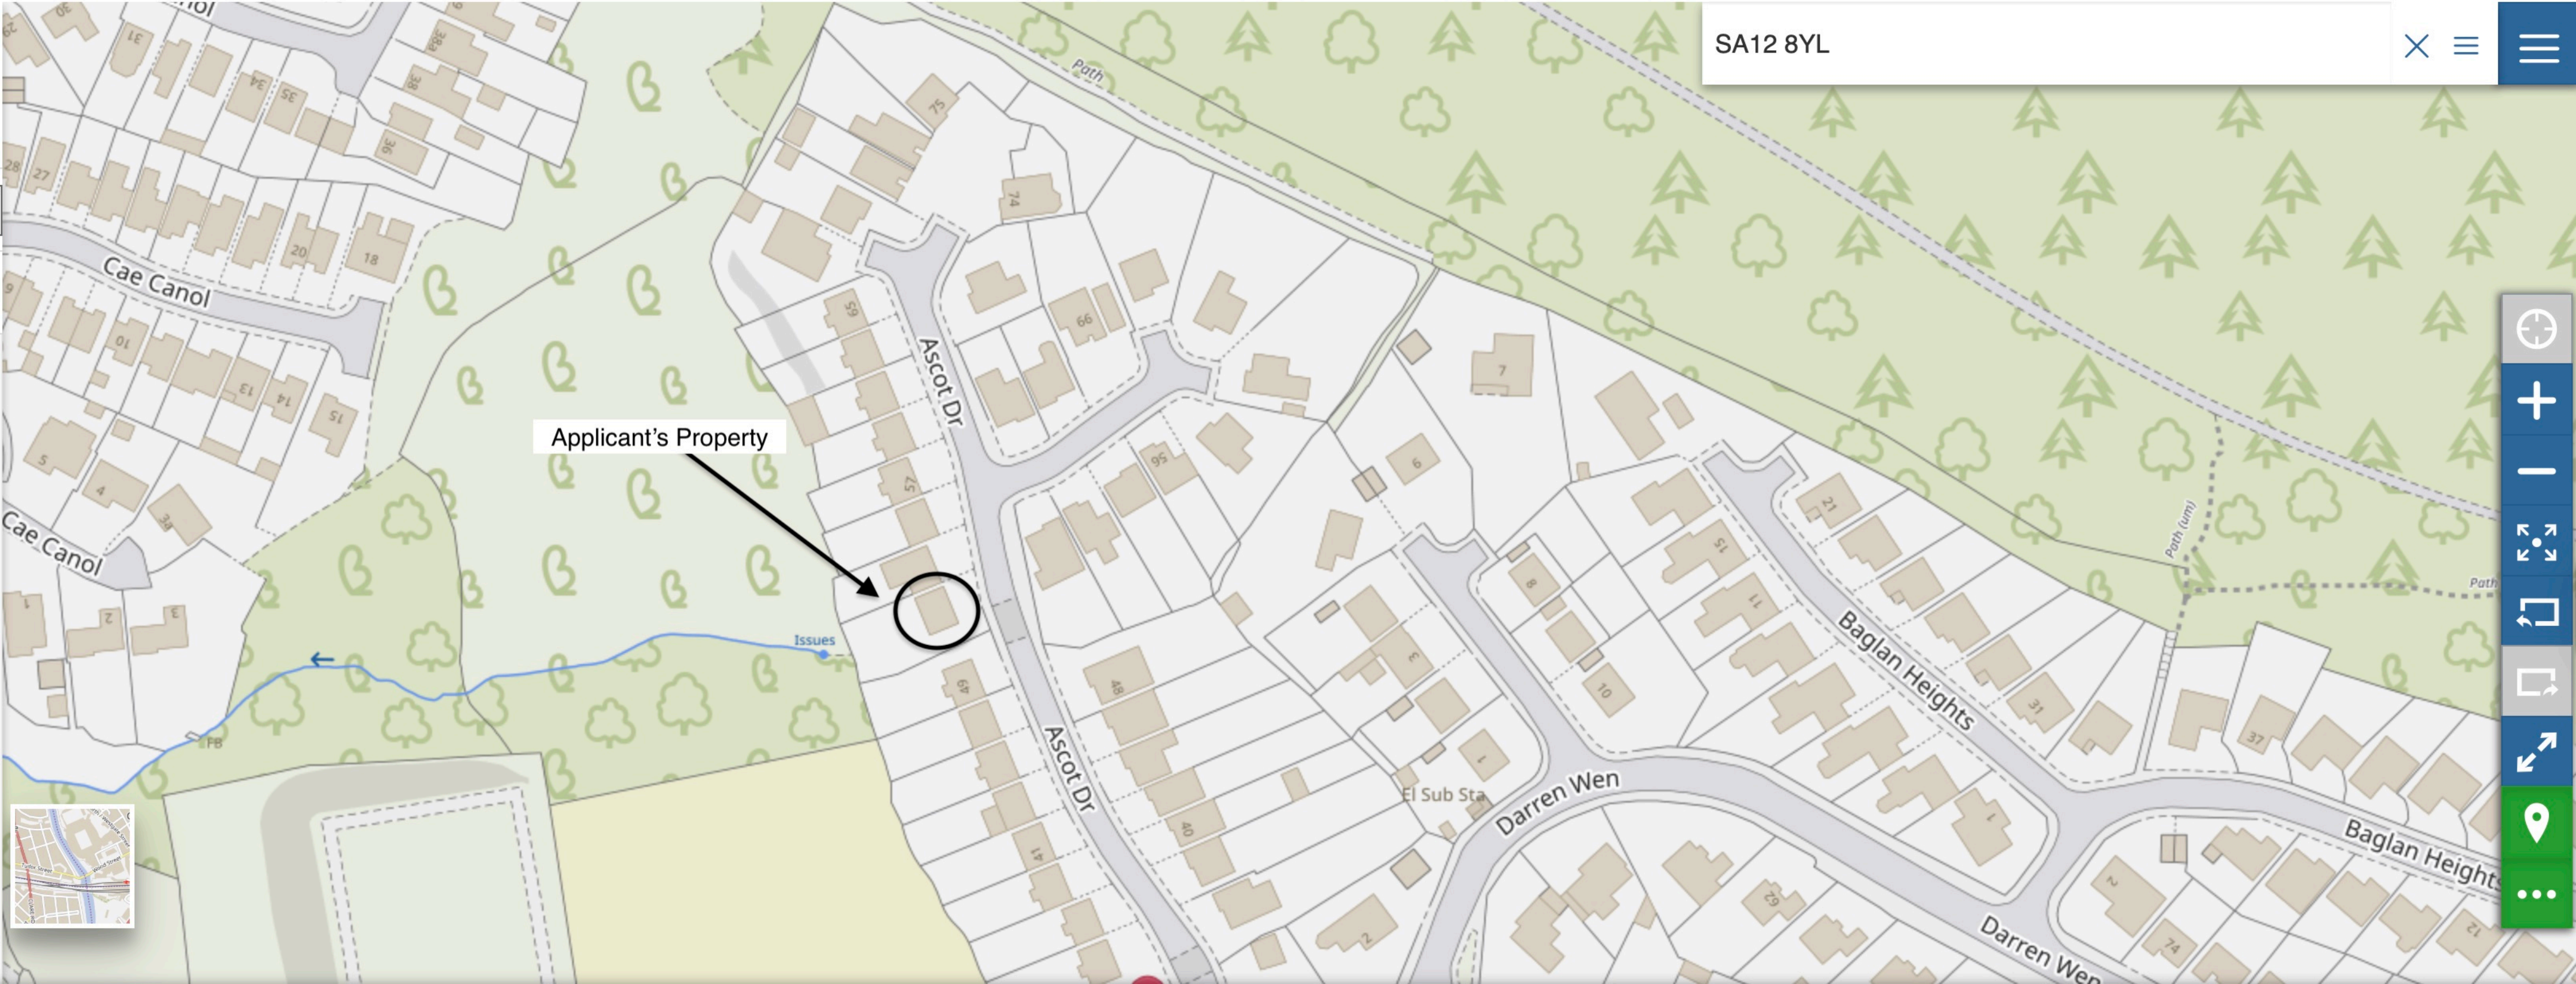

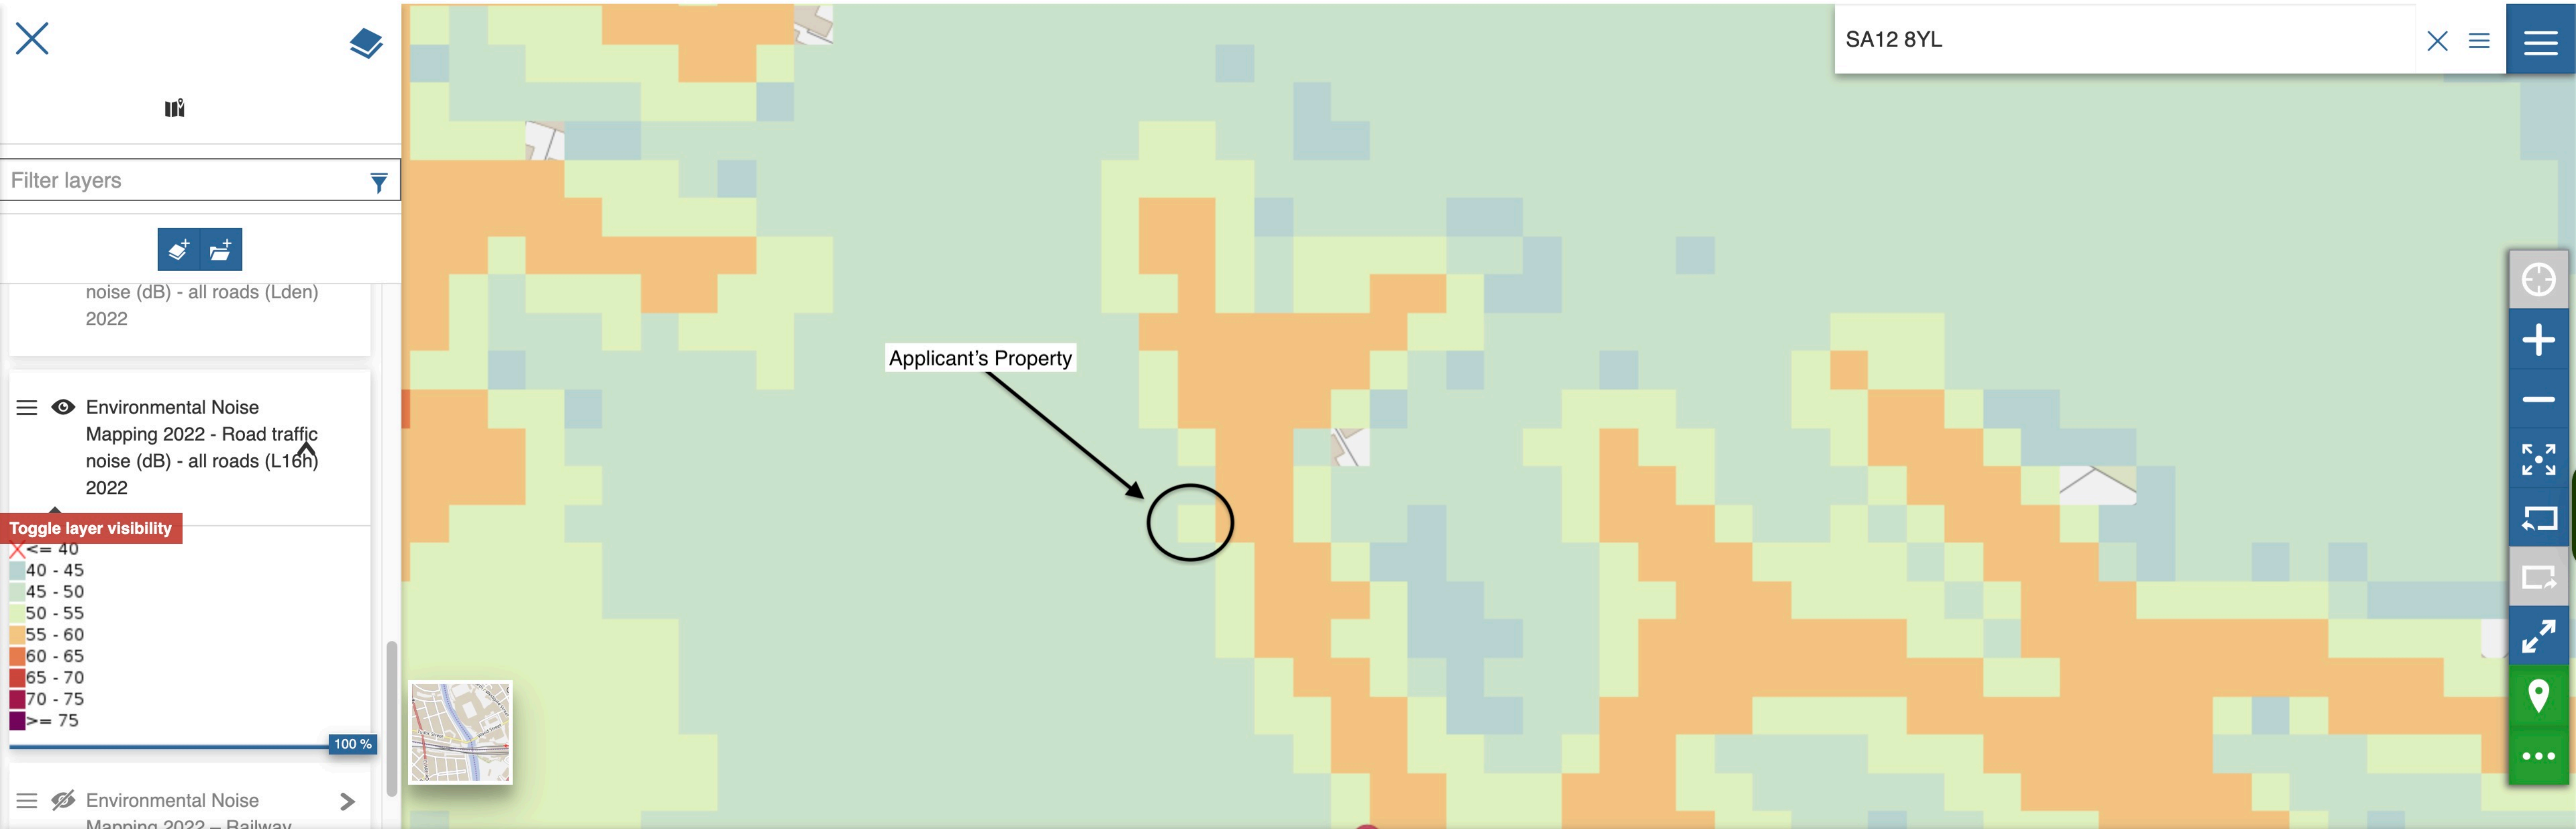

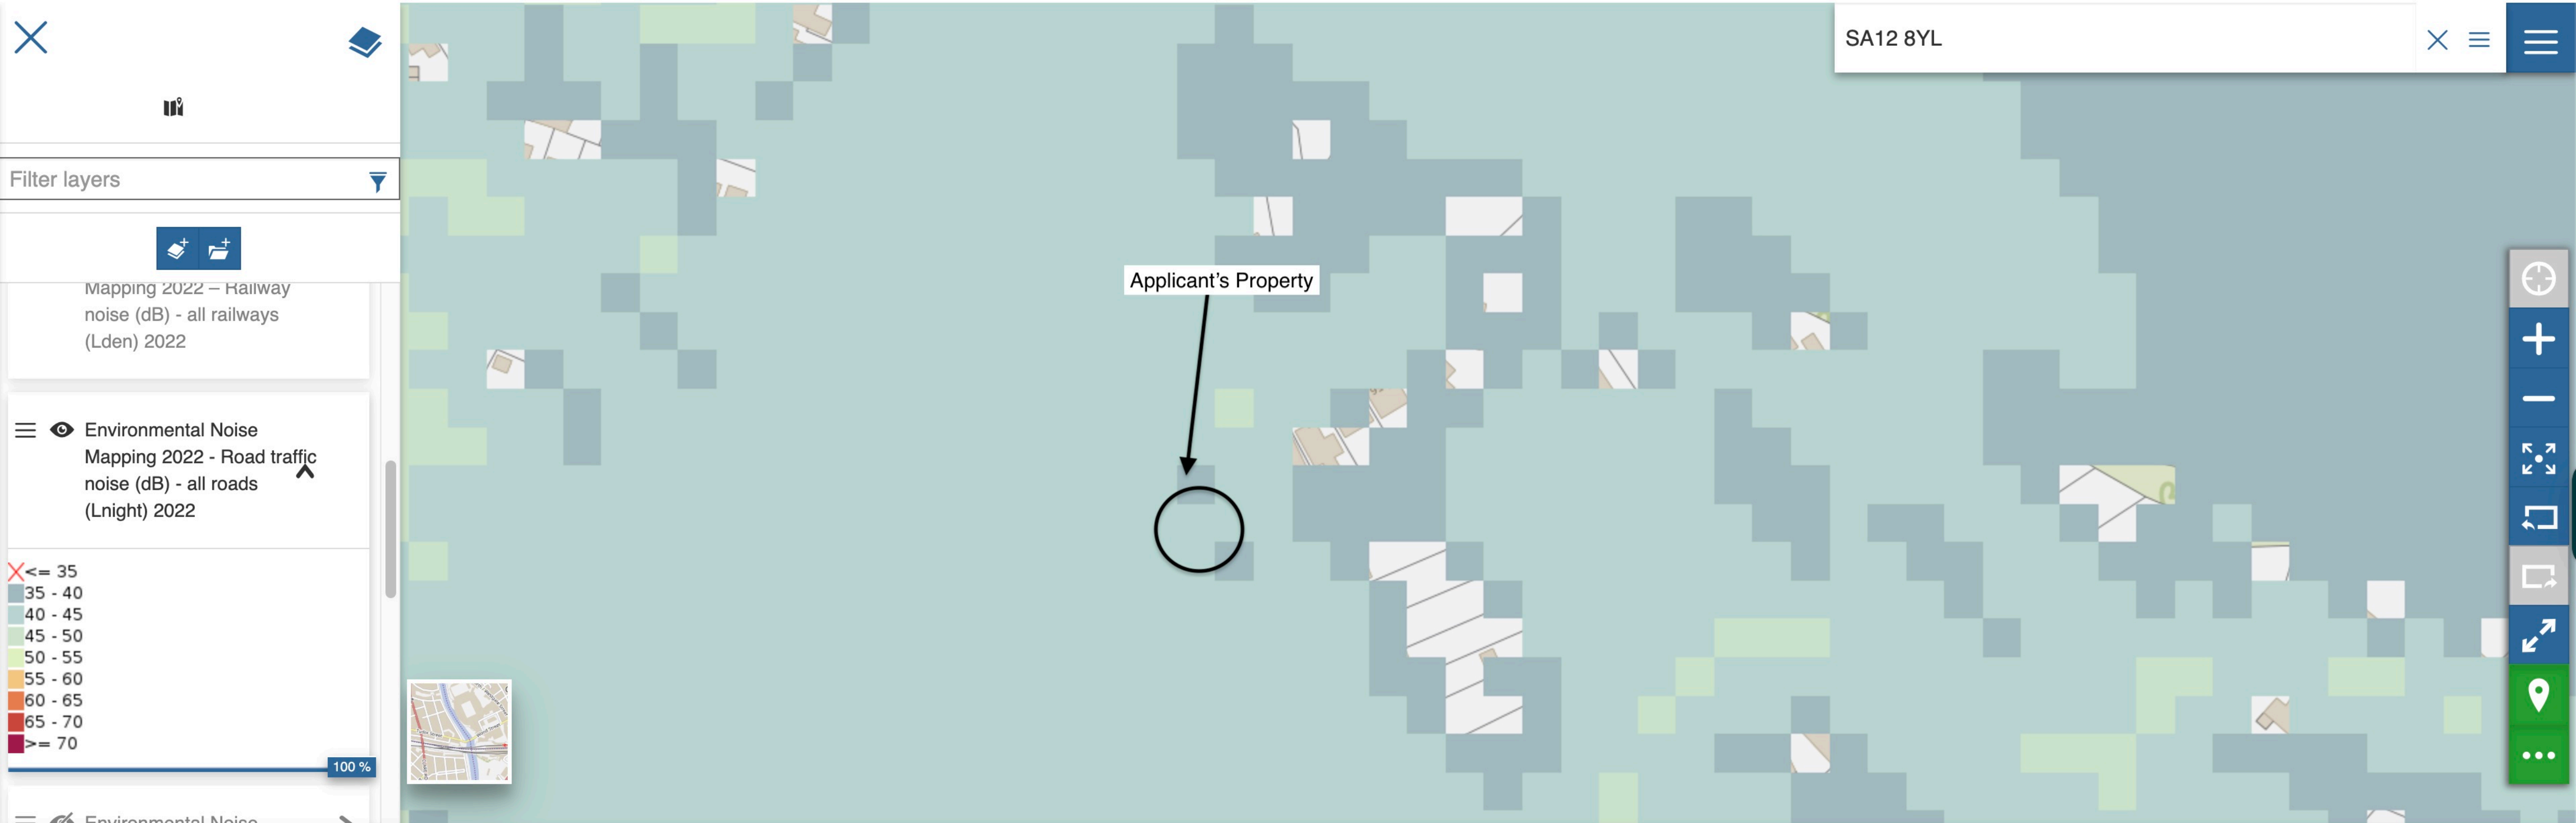

Noise Mapping Results																		
--- Receiver Results - Summary ---																		
Receiver Name	Height (m)	Total dB(A)	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz								
Assessment Points -1	4.4	35.04		9.5	24.1	26.59	30.98	29.3	24.62	18.29	6.58							
Assessment Points -1	7	33.55		8.58	22.67	25.17	29.56	27.74	22.89	16.73	4.97							
Assessment Points -2	1.2	31.32		8.89	22.14	23.3	27.52	25.04	18.81	9.74	-4.81							
Assessment Points -2	4.4	38.78		10.44	24.54	27.03	34.33	34.53	29.85	23.5	11.74							
Assessment Points -2	7	37.3		8.89	22.99	25.48	32.79	33.14	28.29	22.02	10.2							
Assessment Points -3	1.2	22.19		2.59	14.98	15.28	17.03	15.67	9.63	2.8	-12.41							
Assessment Points -4	4.4	35.9		4.46	19.8	27.72	32.11	30.37	25.92	19.52	7.58							
Assessment Points -4	7	34.92		7.24	21.34	26.73	31.12	29.3	24.44	18.16	6.23							
Assessment Points -5	4.4	25.44		1.76	16.04	18.94	22.08	17.64	9.64	0.32	-14.05							
Assessment Points -5	7	26.77		2.94	19.77	22.26	21.65	17.26	9.81	1.1	-12.63							
Assessment Points -6	4.4	24.93		2.37	16.77	19.93	20.86	15.56	6.93	-2.54	-16.85							
Assessment Points -6	7	26.47		4.11	20.21	22.7	20.45	15.23	7.05	-1.7	-15.31							
Assessment Points -7	4.4	32.14		1.75	17.49	21.89	26.27	27.98	24.76	18.29	6.01							
Assessment Points -7	7	31.16		4.76	18.86	21.35	25.73	26.22	23.72	17.56	5.32							
Assessment Points -8	4.4	32.54		1.2	16.5	21.6	28.46	28.1	23.17	16.66	4.31							
Assessment Points -8	7	31.8		4.51	18.6	21.09	28	26.62	22.41	16.4	4.09							
Assessment Points -11	4.4	20.1		-1.9	12.21	13.5	16.45	11.98	3.9	-5.4	-20.31							
Assessment Points -11	7	21.14		-0.66	16.22	13.65	16.53	12.08	4.24	-4.39	-18.69							
Assessment Points -10	4.4	17.2		-1.74	12.38	10.79	12.29	6.72	-1.39	-9.75	-23.68							
Assessment Points -10	7	19.38		-0.4	16.6	11.28	12.85	7.88	0.42	-6.77	-20.11							
Assessment Points -9	4.4	30.09		-0.52	13.98	17.5	24.7	26.63	21.74	15.22	2.81							
Assessment Points -9	7	29.81		2.35	17.52	20.01	24.38	25.49	21.39	14.92	2.43							
Assessment Points -12	1.2	25.99		0.03	16.57	18.3	21.47	20.4	14.7	5.95	-9.38							
Assessment Points -13	1.2	21.3		-2.82	12.73	13.3	15.2	15.98	12.76	4.24	-11.33							
Assessment Points -14	1.2	18.47		-3.83	8.94	12.08	13.24	11.12	9.97	2.76	-13.02							
--- Receiver Results - Sources Analysis ---																		
Receiver Name	Height (m)	Total dB(A)	DAIKIN EDLA08															
Assessment Points -1	4.4	35.04		35.04														
Assessment Points -1	7	33.55		33.55														
Assessment Points -2	1.2	31.32		31.32														
Assessment Points -2	4.4	38.78		38.78														
Assessment Points -2	7	37.3		37.3														
Assessment Points -3	1.2	22.19		22.19														
Assessment Points -4	4.4	35.9		35.9														
Assessment Points -4	7	34.92		34.92														
Assessment Points -5	4.4	25.44		25.44														
Assessment Points -5	7	26.77		26.77														
Assessment Points -6	4.4	24.93		24.93														
Assessment Points -6	7	26.47		26.47														
Assessment Points -7	4.4	32.14		32.14														
Assessment Points -7	7	31.16		31.16														
Assessment Points -8	4.4	32.54		32.54														
Assessment Points -8	7	31.8		31.8														
Assessment Points -11	4.4	20.1		20.1														
Assessment Points -11	7	21.14		21.14														
Assessment Points -10	4.4	17.2		17.2														
Assessment Points -10	7	19.38		19.38														
Assessment Points -9	4.4	30.09		30.09														
Assessment Points -9	7	29.81		29.81														
Assessment Points -12	1.2	25.99		25.99														
Assessment Points -13	1.2	21.3		21.3														
Assessment Points -14	1.2	18.47		18.47														
--- Receiver Results - Full Detail ---																		
Receiver Name	Source Name	Distance to source (m)	Height including ground level (m)	Source height including ground level (m)	Frequency (Hz)	Lw	Ad	Aa	Ag	Ab (total)	Ab (top edge)	Ab (lateral 1)	Ab (lateral 2)	Adjustment	Weighting	Lp		
Assessment Points -1	DAIKIN EDLA08	8.47	4.4	0.5	500	59	-29.55	-0.02	2.76	0 -	-	-	-	2	-3.2	30.98		
Assessment Points -1	DAIKIN EDLA08	8.47	4.4	0.5	1000	54	-29.55	-0.03	2.76	0 -	-	-	-	2	0	29.17		
Assessment Points -1	DAIKIN EDLA08	8.47	4.4	0.5	250	60	-29.55	-0.01	2.76	0 -	-	-	-	2	-8.6	26.59		
Assessment Points -1	DAIKIN EDLA08	8.47	4.4	0.5	2000	48	-29.55	-0.07	2.76	0 -	-	-	-	2	1.2	24.33		
Assessment Points -1	DAIKIN EDLA08	8.47	4.4	0.5	125	65	-29.55	0	2.76	0 -	-	-	-	2	-16.1	24.1		
Assessment Points -1	DAIKIN EDLA08	8.47	4.4	0.5	4000	42	-29.55	-0.22	2.76	0 -	-	-	-	2	1	17.98		
Assessment Points -1	DAIKIN EDLA08 (	32.96	4.4	0.5	1000	53.91	-41.36	-0.13	2.98	-3.52	-3.52	-	-	2	0	13.89		
Assessment Points -1	DAIKIN EDLA08 (	32.96	4.4	0.5	2000	47.91	-41.36	-0.28	2.98	-2.67	-2.67	-	-	2	1.2	9.78		
Assessment Points -1	DAIKIN EDLA08 (	44.06	4.4	0.5	2000	47.82	-43.88	-0.38	2.99	0 -	-	-	-	2	1.2	9.75		
Assessment Points -1	DAIKIN EDLA08	8.47	4.4	0.5	63	61	-29.55	0	2.76	-0.5	-0.5	-	-	2	-26.2	9.5		
Assessment Points -1	DAIKIN EDLA08	8.47	4.4	0.5	8000	33	-29.55	-0.79	2.76	0 -	-	-	-	2	-1.1	6.31		
Assessment Points -1	DAIKIN EDLA08 (	32.96	4.4	0.5	4000	41.91	-41.36	-0.87	2.98	-1.67	-1.67	-	-	2	1	3.99		
Assessment Points -1	DAIKIN EDLA08 (	44.06	4.4	0.5	4000	41.82	-43.88	-1.16	2.99	0 -	-	-	-	2	1	2.78		
Assessment Points -1	DAIKIN EDLA08 (	39.36	4.4	0.5	4000	41.91	-42.9	-1.03	2.99	-9.83	-9.83	-	-	2	1	-5.87		
Assessment Points -1	DAIKIN EDLA08 (	32.96	4.4	0.5	8000	32.91	-41.36	-3.09	2.98	-0.88	-0.88	-	-	2	-1.1	-8.53		
Assessment Points -1	DAIKIN EDLA08 (	44.06	4.4	0.5	8000	32.82	-43.88	-4.12	2.99	0 -	-	-	-	2	-1.1	-11.29		
Assessment Points -1	DAIKIN EDLA08 (	50.47	4.4	0.5	8000	32.82	-45.06	-4.72	2.99	-0.15	-0.15	-	-	2	-1.1	-13.22		
Assessment Points -1	DAIKIN EDLA08 (	39.36	4.4	0.5	8000	32.91	-42.9	-3.68	2.99	-12.16	-12.16	-	-	2	-1.1	-21.94		
Assessment Points -1	DAIKIN EDLA08 (	56.24	4.4	0.5	8000	32.82	-46	-5.26	2.99	-14.54	-14.54	-	-	2	-1.1	-29.09		
Assessment Points -1	DAIKIN EDLA08	9.94	7	0.5	500	59	-30.94	-0.02	2.72	0 -	-	-	-	2	-3.2	29.56		
Assessment Points -1	DAIKIN EDLA08	9.94	7	0.5	1000	54	-30.94	-0.04	2.72	0 -	-	-	-	2	0	27.74		
Assessment Points -1	DAIKIN EDLA08	9.94	7	0.5	250	60	-30.94	-0.01	2.72	0 -	-	-	-	2	-8.6	25.17		
Assessment Points -1	DAIKIN EDLA08	9.94	7	0.5	2000	48	-30.94	-0.09	2.72	0 -	-	-	-	2	1.2	22.89		
Assessment Points -1	DAIKIN EDLA08	9.94	7	0.5	125	65	-30.94	0	2.72	0 -	-	-	-	2	-16.1	22.67		
Assessment Points -1	DAIKIN EDLA08	9.94	7	0.5	4000	42	-30.94	-0.26	2.72	0 -	-	-	-	2	1	16.52		
Assessment Points -1	DAIKIN EDLA08	9.94	7	0.5	63	61	-30.94	0	2.72	0 -	-	-	-	2	-26.2	8.58		
Assessment Points -1	DAIKIN EDLA08	9.94	7	0.5	8000	33	-30.94	-0.93	2.72	0 -	-	-	-	2	-1.1	4.75		
Assessment Points -1	DAIKIN EDLA08 (	39.7	7	0.5	4000	41.91	-42.98	-1.04	2.98	-0.37	-0.37	-	-	2	1	3.51		
Assessment Points -1	DAIKIN EDLA08 (	50.73	7	0.5	8000	32.91	-42.98	-3.72	2.98	-0.03	-0.03	-	-	2	-1.1	-9.92		
Assessment Points -1	DAIKIN EDLA08 (	56.48	7	0.5	8000	32.82	-45.11	-4.75	2.99	0 -	-	-	-	2	-1.1	-13.14		
Assessment Points -1	DAIKIN EDLA08 (			0.5	8000	32.82	-46.04	-5.29	2.99	-10.58	-10.58	-	-	2	-1.1	-25.19		
Assessment Points -2	DAIKIN EDLA08	7.05	1.2	0.5	500	59	-27.96	-0.02	2.9	-6.87	-9.95	-9.82	-	2	-3.2	25.85		
Assessment Points -2	DAIKIN EDLA08	7.05	1.2	0.5	250	60	-27.96	-0.01	2.9	-5.03	-8.09	-7.99	-	2	-8.6	23.3		
Assessment Points -2	DAIKIN EDLA08 (	7.2	1.2	0.5	500	58.91	-28.15	-0.02	2.9	-9.89	-9.89	-	-	2	-3.2	22.56		
Assessment Points -2	DAIKIN EDLA08	7.05	1.2	0.5	125	65	-27.96	0	2.9	-3.7	-6.74	-6.67	-	2	-16.1	22.14		
Assessment Points -2	DAIKIN EDLA08	7.05	1															

Assessment Points -2	DAIKIN EDLA08 (	7.2	1.2	0.5	2000	47.91	-28.15	-0.06	2.9	-14.77	-14.77	-	-	2	1.2	11.04
Assessment Points -2	DAIKIN EDLA08 (	10	1.2	0.5	2000	47.91	-31	-0.09	2.95	-13.43	-13.43	-	-	2	1.2	9.55
Assessment Points -2	DAIKIN EDLA08 (	10.11	1.2	0.5	2000	47.82	-31.1	-0.09	2.95	-13.38	-13.38	-	-	2	1.2	9.41
Assessment Points -2	DAIKIN EDLA08 (	7.05	1.2	0.5	63	61	-27.96	0	2.9	-2.84	-5.87	-5.83	-	2	-26.2	8.89
Assessment Points -2	DAIKIN EDLA08 (	12.81	1.2	0.5	2000	47.82	-33.15	-0.11	2.97	-13.13	-13.13	-	-	2	1.2	7.6
Assessment Points -2	DAIKIN EDLA08 (	7.05	1.2	0.5	4000	42	-27.96	-0.19	2.9	-14.54	-17.64	-17.46	-	2	1	5.21
Assessment Points -2	DAIKIN EDLA08 (	28.17	1.2	0.5	2000	47.82	-40	-0.24	2.99	-9.77	-9.77	-	-	2	1.2	4.01
Assessment Points -2	DAIKIN EDLA08 (	34.11	1.2	0.5	2000	47.91	-41.66	-0.29	3	-8.3	-8.3	-	-	2	1.2	3.85
Assessment Points -2	DAIKIN EDLA08 (	35.05	1.2	0.5	2000	47.82	-41.89	-0.3	3	-8.16	-8.16	-	-	2	1.2	3.67
Assessment Points -2	DAIKIN EDLA08 (	36.13	1.2	0.5	2000	47.82	-42.16	-0.31	3	-8.01	-8.01	-	-	2	1.2	3.55
Assessment Points -2	DAIKIN EDLA08 (	35.18	1.2	0.5	1000	53.82	-41.92	-0.14	3	-13.46	-13.46	-	-	2	0	3.3
Assessment Points -2	DAIKIN EDLA08 (	25.21	1.2	0.5	2000	47.91	-39.03	-0.22	2.99	-12.91	-12.91	-	-	2	1.2	1.95
Assessment Points -2	DAIKIN EDLA08 (	7.2	1.2	0.5	4000	41.91	-28.15	-0.19	2.9	-17.56	-17.56	-	-	2	1	1.92
Assessment Points -2	DAIKIN EDLA08 (	32.21	1.2	0.5	1000	53.91	-41.16	-0.13	2.99	-15.73	-15.73	-	-	2	0	1.89
Assessment Points -2	DAIKIN EDLA08 (	10	1.2	0.5	4000	41.91	-31	-0.26	2.95	-16.13	-16.13	-	-	2	1	0.47
Assessment Points -2	DAIKIN EDLA08 (	10.11	1.2	0.5	4000	41.82	-31.1	-0.27	2.95	-16.08	-16.08	-	-	2	1	0.33
Assessment Points -2	DAIKIN EDLA08 (	36.36	1.2	0.5	2000	47.82	-42.21	-0.31	3	-12.59	-12.59	-	-	2	1.2	-1.1
Assessment Points -2	DAIKIN EDLA08 (	12.81	1.2	0.5	4000	41.82	-33.15	-0.34	2.97	-15.81	-15.81	-	-	2	1	-1.51
Assessment Points -2	DAIKIN EDLA08 (	35.18	1.2	0.5	2000	47.82	-41.92	-0.3	3	-16.2	-16.2	-	-	2	1.2	-4.41
Assessment Points -2	DAIKIN EDLA08 (	34.11	1.2	0.5	4000	41.91	-41.66	-0.9	3	-10.26	-10.26	-	-	2	1	-4.91
Assessment Points -2	DAIKIN EDLA08 (	28.17	1.2	0.5	4000	41.82	-40	-0.74	2.99	-12.04	-12.04	-	-	2	1	-4.96
Assessment Points -2	DAIKIN EDLA08 (	35.05	1.2	0.5	4000	41.82	-41.89	-0.92	3	-10.08	-10.08	-	-	2	1	-5.07
Assessment Points -2	DAIKIN EDLA08 (	36.13	1.2	0.5	4000	41.82	-42.16	-0.95	3	-9.89	-9.89	-	-	2	1	-5.17
Assessment Points -2	DAIKIN EDLA08 (	32.21	1.2	0.5	2000	47.91	-41.16	-0.28	2.99	-18.6	-18.6	-	-	2	1.2	-5.93
Assessment Points -2	DAIKIN EDLA08 (	25.21	1.2	0.5	4000	41.91	-39.03	-0.66	2.99	-15.57	-15.57	-	-	2	1	-7.36
Assessment Points -2	DAIKIN EDLA08 (	43.36	1.2	0.5	2000	47.82	-43.74	-0.37	3	-17.34	-17.34	-	-	2	1.2	-7.44
Assessment Points -2	DAIKIN EDLA08 (	7.05	1.2	0.5	8000	33	-27.96	-0.66	2.9	-17.16	-20	-20.35	-	2	-1.1	-8.98
Assessment Points -2	DAIKIN EDLA08 (	36.36	1.2	0.5	4000	41.82	-42.21	-0.96	3	-15.23	-15.23	-	-	2	1	-10.58
Assessment Points -2	DAIKIN EDLA08 (	7.2	1.2	0.5	8000	32.91	-28.15	-0.67	2.9	-20	-20	-	-	2	-1.1	-12.1
Assessment Points -2	DAIKIN EDLA08 (	35.18	1.2	0.5	4000	41.82	-41.92	-0.92	3	-19.06	-19.06	-	-	2	1	-14.09
Assessment Points -2	DAIKIN EDLA08 (	10	1.2	0.5	8000	32.91	-31	-0.94	2.95	-18.98	-18.98	-	-	2	-1.1	-14.15
Assessment Points -2	DAIKIN EDLA08 (	10.11	1.2	0.5	8000	32.82	-31.1	-0.95	2.95	-18.93	-18.93	-	-	2	-1.1	-14.3
Assessment Points -2	DAIKIN EDLA08 (	32.21	1.2	0.5	4000	41.91	-41.16	-0.85	2.99	-21.53	-21.53	-	-	2	1	-15.63
Assessment Points -2	DAIKIN EDLA08 (	12.81	1.2	0.5	8000	32.82	-33.15	-1.2	2.97	-18.65	-18.65	-	-	2	-1.1	-16.31
Assessment Points -2	DAIKIN EDLA08 (	43.36	1.2	0.5	4000	41.82	-43.74	-1.14	3	-20.24	-20.24	-	-	2	1	-17.3
Assessment Points -2	DAIKIN EDLA08 (	41.6	1.2	0.5	4000	41.82	-43.38	-1.09	3	-22.14	-22.14	-	-	2	1	-18.79
Assessment Points -2	DAIKIN EDLA08 (	38.64	1.2	0.5	4000	41.91	-42.74	-1.01	3	-23.55	-23.55	-	-	2	1	-19.4
Assessment Points -2	DAIKIN EDLA08 (	28.17	1.2	0.5	8000	32.82	-40	-2.64	2.99	-14.63	-14.63	-	-	2	-1.1	-20.54
Assessment Points -2	DAIKIN EDLA08 (	34.11	1.2	0.5	8000	32.91	-41.66	-3.19	3	-12.63	-12.63	-	-	2	-1.1	-20.68
Assessment Points -2	DAIKIN EDLA08 (	49.16	1.2	0.5	4000	41.82	-44.83	-1.29	3	-22.57	-22.57	-	-	2	1	-20.87
Assessment Points -2	DAIKIN EDLA08 (	35.05	1.2	0.5	8000	32.82	-41.89	-3.28	3	-12.42	-12.42	-	-	2	-1.1	-20.88
Assessment Points -2	DAIKIN EDLA08 (	36.13	1.2	0.5	8000	32.82	-42.16	-3.38	3	-12.21	-12.21	-	-	2	-1.1	-21.02
Assessment Points -2	DAIKIN EDLA08 (	25.21	1.2	0.5	8000	32.91	-39.03	-2.36	2.99	-18.4	-18.4	-	-	2	-1.1	-22.98
Assessment Points -2	DAIKIN EDLA08 (	36.36	1.2	0.5	8000	32.82	-42.21	-3.4	3	-18.04	-18.04	-	-	2	-1.1	-26.93
Assessment Points -2	DAIKIN EDLA08 (	35.18	1.2	0.5	8000	32.82	-41.92	-3.29	3	-21.99	-21.99	-	-	2	-1.1	-30.49
Assessment Points -2	DAIKIN EDLA08 (	32.21	1.2	0.5	8000	32.91	-41.16	-3.01	2.99	-24.5	-24.5	-	-	2	-1.1	-31.86
Assessment Points -2	DAIKIN EDLA08 (	43.36	1.2	0.5	8000	32.82	-43.74	-4.06	3	-23.19	-23.19	-	-	2	-1.1	-34.27
Assessment Points -2	DAIKIN EDLA08 (	38.64	1.2	0.5	8000	32.91	-42.74	-3.62	3	-25	-25	-	-	2	-1.1	-34.55
Assessment Points -2	DAIKIN EDLA08 (	41.6	1.2	0.5	8000	32.82	-43.38	-3.89	3	-25	-25	-	-	2	-1.1	-35.55
Assessment Points -2	DAIKIN EDLA08 (	49.16	1.2	0.5	8000	32.82	-44.83	-4.6	3	-25	-25	-	-	2	-1.1	-37.71
Assessment Points -2	DAIKIN EDLA08 (	49.79	1.2	0.5	8000	32.82	-44.94	-4.66	3	-25	-25	-	-	2	-1.1	-37.88
Assessment Points -2	DAIKIN EDLA08 (	55.57	1.2	0.5	8000	32.82	-45.9	-5.2	3.24	-25	-25	-	-	2	-1.1	-39.13
Assessment Points -2	DAIKIN EDLA08 (	8.02	4.4	0.5	500	59	-29.09	-0.02	2.73	0	-	-	-	2	-3.2	31.42
Assessment Points -2	DAIKIN EDLA08 (	8.16	4.4	0.5	500	58.91	-29.23	-0.02	2.74	0	-	-	-	2	-3.2	31.2
Assessment Points -2	DAIKIN EDLA08 (	8.02	4.4	0.5	1000	54	-29.09	-0.03	2.73	0	-	-	-	2	0	29.61
Assessment Points -2	DAIKIN EDLA08 (	8.16	4.4	0.5	1000	53.91	-29.23	-0.03	2.74	0	-	-	-	2	0	29.39
Assessment Points -2	DAIKIN EDLA08 (	10.71	4.4	0.5	1000	53.91	-31.59	-0.04	2.84	0	-	-	-	2	0	27.12
Assessment Points -2	DAIKIN EDLA08 (	8.02	4.4	0.5	250	60	-29.09	-0.01	2.73	0	-	-	-	2	-8.6	27.03
Assessment Points -2	DAIKIN EDLA08 (	10.81	4.4	0.5	1000	53.82	-31.68	-0.04	2.85	0	-	-	-	2	0	26.95
Assessment Points -2	DAIKIN EDLA08 (	8.02	4.4	0.5	2000	48	-29.09	-0.07	2.73	0	-	-	-	2	1.2	24.77
Assessment Points -2	DAIKIN EDLA08 (	8.16	4.4	0.5	2000	47.91	-29.23	-0.07	2.74	0	-	-	-	2	1.2	24.55
Assessment Points -2	DAIKIN EDLA08 (	8.02	4.4	0.5	125	65	-29.09	0	2.73	0	-	-	-	2	-16.1	24.54
Assessment Points -2	DAIKIN EDLA08 (	10.71	4.4	0.5	2000	47.91	-31.59	-0.09	2.84	0	-	-	-	2	1.2	22.27
Assessment Points -2	DAIKIN EDLA08 (	10.81	4.4	0.5	2000	47.82	-31.68	-0.09	2.85	0	-	-	-	2	1.2	22.1
Assessment Points -2	DAIKIN EDLA08 (	8.02	4.4	0.5	4000	42	-29.09	-0.21	2.73	0	-	-	-	2	1	18.43
Assessment Points -2	DAIKIN EDLA08 (	8.16	4.4	0.5	4000	41.91	-29.23	-0.21	2.74	0	-	-	-	2	1	18.21
Assessment Points -2	DAIKIN EDLA08 (	10.71	4.4	0.5	4000	41.91	-31.59	-0.28	2.84	0	-	-	-	2	1	15.88
Assessment Points -2	DAIKIN EDLA08 (	10.81	4.4	0.5	4000	41.82	-31.68	-0.28	2.85	0	-	-	-	2	1	15.71
Assessment Points -2	DAIKIN EDLA08 (	32.44	4.4	0.5	1000	53.91	-41.22	-0.13	2.98	-3.49	-3.49	-	-	2	0	14.06
Assessment Points -2	DAIKIN EDLA08 (	28.43	4.4	0.5	2000	47.82	-40.08	-0.25	2.98	0	-	-	-	2	1.2	13.68
Assessment Points -2	DAIKIN EDLA08 (	35.38	4.4	0.5	1000	53.82	-41.98	-0.14	2.98	-3.66	-3.66	-	-	2	0	13.03
Assessment Points -2	DAIKIN EDLA08 (	8.02	4.4	0.5	63	61	-29.09	0	2.73	0	-	-	-	2	-26.2	10.44
Assessment Points -2	DAIKIN EDLA08 (	32.44	4.4	0.5	2000	47.91	-41.22	-0.28	2.98	-2.59	-2.59	-	-	2	1.2	10
Assessment Points -2	DAIKIN EDLA08 (	43.53	4.4	0.5	2000	47.82	-43.78	-0.38	2.99	0	-	-	-	2	1.2	9.86
Assessment Points -2	DAIKIN EDLA08 (	35.38	4.4	0.5	2000	47.82	-41.98	-0.31	2.98	-2.99	-2.99	-	-	2	1.2	8.73
Assessment Points -2	DAIKIN EDLA08 (	28.43	4.4	0.5	4000	41.82	-40.08	-0.75	2.98	0	-	-	-	2	1	6.98
Assessment Points -2	DAIKIN EDLA08 (	8.02	4.4	0.5	8000	33	-29.09	-0.75	2.73	0	-	-	-	2	-1.1	6.79
Assessment Points -2	DAIKIN EDLA08 (	8.16	4.4	0.5	8000	32.91	-29.23	-0.76	2.74	0	-	-	-	2	-1.1	6.56
Assessment Points -2	DAIKIN EDLA08 (	32.44	4.4	0.5	4000	41.91	-41.22	-0.85	2.98	-1.54	-1.54	-	-	2	1	4.28
Assessment Points -2	DAIKIN EDLA08 (	10.71	4.4	0.5	8000	32.91	-31.59	-1	2.84	0	-	-	-	2	-1.1	4.06
Assessment Points -2	DAIKIN EDLA08 (	10.81	4.4	0.5	8000	32.82	-31.68	-1.01	2.85	0	-	-	-	2	-1.1	3.88
Assessment Points -2	DAIKIN EDLA08 (	43.53	4.4	0.5	4000	41.82	-43.78	-1.14	2.99	0	-	-	-	2	1	2.89
Assessment Points -2	DAIKIN EDLA08 (	35.38	4.4	0.5	4000	41.82	-41.98	-0.93	2.98	-2.29	-2.29	-	-	2	1	2.61
Assessment Points -2	DAIKIN EDLA08 (	38.83	4.4	0.5	4000	41.91	-42.78	-1.02	2.99	-9.71	-9.71	-	-	2	1	-5.61
Assessment Points -2	DAIKIN EDLA0															

Assessment Points -2	DAIKIN EDLA08 (	9.56	7	0.5	4000	42	-30.61	-0.25	2.7	0	-	-	-	2	1	16.84
Assessment Points -2	DAIKIN EDLA08 (	9.67	7	0.5	4000	41.91	-30.71	-0.25	2.71	0	-	-	-	2	1	16.65
Assessment Points -2	DAIKIN EDLA08 (	11.9	7	0.5	4000	41.91	-32.51	-0.31	2.8	0	-	-	-	2	1	14.89
Assessment Points -2	DAIKIN EDLA08 (	12	7	0.5	4000	41.82	-32.58	-0.32	2.8	0	-	-	-	2	1	14.73
Assessment Points -2	DAIKIN EDLA08	9.56	7	0.5	63	61	-30.61	0	2.7	0	-	-	-	2	-26.2	8.89
Assessment Points -2	DAIKIN EDLA08	9.56	7	0.5	8000	33	-30.61	-0.89	2.7	0	-	-	-	2	-1.1	5.1
Assessment Points -2	DAIKIN EDLA08 (	9.67	7	0.5	8000	32.91	-30.71	-0.91	2.71	0	-	-	-	2	-1.1	4.9
Assessment Points -2	DAIKIN EDLA08 (	39.18	7	0.5	4000	41.91	-42.86	-1.03	2.98	-0.34	-0.34	-	-	2	1	3.67
Assessment Points -2	DAIKIN EDLA08 (	11.9	7	0.5	8000	32.91	-32.51	-1.11	2.8	0	-	-	-	2	-1.1	2.99
Assessment Points -2	DAIKIN EDLA08 (	12	7	0.5	8000	32.82	-32.58	-1.12	2.8	0	-	-	-	2	-1.1	2.82
Assessment Points -2	DAIKIN EDLA08 (	42.1	7	0.5	4000	41.82	-43.49	-1.11	2.98	-0.67	-0.67	-	-	2	1	2.54
Assessment Points -2	DAIKIN EDLA08 (	39.18	7	0.5	8000	32.91	-42.86	-3.67	2.98	-0.02	-0.02	-	-	2	-1.1	-9.75
Assessment Points -2	DAIKIN EDLA08 (	42.1	7	0.5	8000	32.82	-43.49	-3.94	2.98	-0.17	-0.17	-	-	2	-1.1	-10.89
Assessment Points -2	DAIKIN EDLA08 (	50.2	7	0.5	8000	32.82	-45.01	-4.7	2.99	0	-	-	-	2	-1.1	-13
Assessment Points -2	DAIKIN EDLA08 (	55.94	7	0.5	8000	32.82	-45.96	-5.24	2.99	-10.48	-10.48	-	-	2	-1.1	-24.96
Assessment Points -3	DAIKIN EDLA08	12.51	1.2	0.5	500	59	-32.95	-0.03	2.97	-13.33	-13.47	-28.3	-	2	-3.2	14.46
Assessment Points -3	DAIKIN EDLA08 (	12.92	1.2	0.5	500	58.91	-33.23	-0.03	2.97	-13.91	-13.91	-	-	2	-3.2	13.52
Assessment Points -3	DAIKIN EDLA08	12.51	1.2	0.5	250	60	-32.95	-0.01	2.97	-10.73	-10.94	-24.03	-	2	-8.6	12.67
Assessment Points -3	DAIKIN EDLA08	12.51	1.2	0.5	125	65	-32.95	0	2.97	-8.51	-8.86	-19.62	-	2	-16.1	12.41
Assessment Points -3	DAIKIN EDLA08 (	18.01	1.2	0.5	1000	53.82	-36.11	-0.07	2.98	-10.43	-10.43	-	-	2	0	12.2
Assessment Points -3	DAIKIN EDLA08 (	12.92	1.2	0.5	250	59.91	-33.23	-0.01	2.97	-11.22	-11.22	-	-	2	-8.6	11.82
Assessment Points -3	DAIKIN EDLA08 (	12.92	1.2	0.5	125	64.91	-33.23	0	2.97	-9.06	-9.06	-	-	2	-16.1	11.49
Assessment Points -3	DAIKIN EDLA08	12.51	1.2	0.5	1000	54	-32.95	-0.05	2.97	-16.35	-16.47	-31.87	-	2	0	9.62
Assessment Points -3	DAIKIN EDLA08 (	12.92	1.2	0.5	1000	53.91	-33.23	-0.05	2.97	-17.32	-17.32	-	-	2	0	8.29
Assessment Points -3	DAIKIN EDLA08 (	18.01	1.2	0.5	2000	47.82	-36.11	-0.16	2.98	-12.8	-12.8	-	-	2	1.2	4.94
Assessment Points -3	DAIKIN EDLA08 (	30.24	1.2	0.5	2000	47.91	-40.61	-0.26	2.99	-8.97	-8.97	-	-	2	1.2	4.26
Assessment Points -3	DAIKIN EDLA08 (	37.02	1.2	0.5	1000	53.91	-42.37	-0.15	3	-12.91	-12.91	-	-	2	0	3.48
Assessment Points -3	DAIKIN EDLA08 (	37.17	1.2	0.5	1000	53.82	-42.4	-0.15	3	-12.91	-12.91	-	-	2	0	3.36
Assessment Points -3	DAIKIN EDLA08	12.51	1.2	0.5	2000	48	-32.95	-0.11	2.97	-20.07	-20.21	-35.04	-	2	1.2	1.04
Assessment Points -3	DAIKIN EDLA08	12.51	1.2	0.5	63	61	-32.95	0	2.97	-6.75	-7.29	-16.02	-	2	-26.2	0.07
Assessment Points -3	DAIKIN EDLA08 (	12.92	1.2	0.5	2000	47.91	-33.23	-0.11	2.97	-21.6	-21.6	-	-	2	1.2	-0.86
Assessment Points -3	DAIKIN EDLA08 (	12.92	1.2	0.5	63	60.91	-33.23	0	2.97	-7.43	-7.43	-	-	2	-26.2	-0.98
Assessment Points -3	DAIKIN EDLA08 (	48.09	1.2	0.5	2000	47.82	-44.64	-0.42	3	-12.61	-12.61	-	-	2	1.2	-3.64
Assessment Points -3	DAIKIN EDLA08 (	37.02	1.2	0.5	2000	47.91	-42.37	-0.32	3	-15.61	-15.61	-	-	2	1.2	-4.2
Assessment Points -3	DAIKIN EDLA08 (	18.01	1.2	0.5	4000	41.82	-36.11	-0.47	2.98	-15.46	-15.46	-	-	2	1	-4.23
Assessment Points -3	DAIKIN EDLA08 (	37.17	1.2	0.5	2000	47.82	-42.4	-0.32	3	-15.61	-15.61	-	-	2	1.2	-4.31
Assessment Points -3	DAIKIN EDLA08 (	30.24	1.2	0.5	4000	41.91	-40.61	-0.79	2.99	-11.08	-11.08	-	-	2	1	-4.58
Assessment Points -3	DAIKIN EDLA08 (	30.34	1.2	0.5	4000	41.82	-40.64	-0.8	2.99	-11.06	-11.06	-	-	2	1	-4.67
Assessment Points -3	DAIKIN EDLA08 (	42.21	1.2	0.5	4000	41.82	-43.51	-1.11	3	-8.78	-8.78	-	-	2	1	-5.57
Assessment Points -3	DAIKIN EDLA08 (	41.35	1.2	0.5	4000	41.82	-43.33	-1.09	3	-9.88	-9.88	-	-	2	1	-6.47
Assessment Points -3	DAIKIN EDLA08 (	53.86	1.2	0.5	2000	47.82	-45.63	-0.46	3.16	-17.37	-17.37	-	-	2	1.2	-9.28
Assessment Points -3	DAIKIN EDLA08	12.51	1.2	0.5	4000	42	-32.95	-0.33	2.97	-24.48	-24.68	-38.1	-	2	1	-9.79
Assessment Points -3	DAIKIN EDLA08 (	12.92	1.2	0.5	4000	41.91	-33.23	-0.34	2.97	-25	-25	-	-	2	1	-10.69
Assessment Points -3	DAIKIN EDLA08 (	48.09	1.2	0.5	4000	41.82	-44.64	-1.26	3	-15.27	-15.27	-	-	2	1	-13.35
Assessment Points -3	DAIKIN EDLA08 (	37.02	1.2	0.5	4000	41.91	-42.37	-0.97	3	-18.45	-18.45	-	-	2	1	-13.89
Assessment Points -3	DAIKIN EDLA08 (	37.17	1.2	0.5	4000	41.82	-42.4	-0.98	3	-18.45	-18.45	-	-	2	1	-14.01
Assessment Points -3	DAIKIN EDLA08 (	53.86	1.2	0.5	4000	41.82	-45.63	-1.41	3.16	-20.26	-20.26	-	-	2	1	-19.32
Assessment Points -3	DAIKIN EDLA08 (	18.01	1.2	0.5	8000	32.82	-36.11	-1.69	2.98	-18.28	-18.28	-	-	2	-1.1	-19.37
Assessment Points -3	DAIKIN EDLA08 (	30.24	1.2	0.5	8000	32.91	-40.61	-2.83	2.99	-13.56	-13.56	-	-	2	-1.1	-20.2
Assessment Points -3	DAIKIN EDLA08 (	30.34	1.2	0.5	8000	32.82	-40.64	-2.84	2.99	-13.53	-13.53	-	-	2	-1.1	-20.3
Assessment Points -3	DAIKIN EDLA08 (	38.86	1.2	0.5	4000	41.82	-42.79	-1.02	3	-25	-25	-	-	2	1	-20.99
Assessment Points -3	DAIKIN EDLA08 (	42.21	1.2	0.5	8000	32.82	-43.51	-3.95	3	-10.91	-10.91	-	-	2	-1.1	-21.65
Assessment Points -3	DAIKIN EDLA08	12.51	1.2	0.5	8000	33	-32.95	-1.17	2.97	-24.9	-25	-41.12	-	2	-1.1	-22.15
Assessment Points -3	DAIKIN EDLA08 (	12.92	1.2	0.5	8000	32.91	-33.23	-1.21	2.97	-25	-25	-	-	2	-1.1	-22.66
Assessment Points -3	DAIKIN EDLA08 (	41.35	1.2	0.5	8000	32.82	-43.33	-3.87	3	-12.2	-12.2	-	-	2	-1.1	-22.68
Assessment Points -3	DAIKIN EDLA08 (	37.02	1.2	0.5	8000	32.91	-42.37	-3.47	3	-21.37	-21.37	-	-	2	-1.1	-30.4
Assessment Points -3	DAIKIN EDLA08 (	48.09	1.2	0.5	8000	32.82	-44.64	-4.5	3	-18.09	-18.09	-	-	2	-1.1	-30.51
Assessment Points -3	DAIKIN EDLA08 (	37.17	1.2	0.5	8000	32.82	-42.4	-3.48	3	-21.37	-21.37	-	-	2	-1.1	-30.53
Assessment Points -3	DAIKIN EDLA08 (	38.86	1.2	0.5	8000	32.82	-42.79	-3.64	3	-25	-25	-	-	2	-1.1	-34.71
Assessment Points -3	DAIKIN EDLA08 (	53.86	1.2	0.5	8000	32.82	-45.63	-5.04	3.16	-23.21	-23.21	-	-	2	-1.1	-37
Assessment Points -4	DAIKIN EDLA08	10.46	4.4	0.5	500	59	-31.39	-0.02	2.84	0	-	-	-	2	-3.2	29.22
Assessment Points -4	DAIKIN EDLA08 (	10.67	4.4	0.5	500	58.91	-31.57	-0.02	2.84	0	-	-	-	2	-3.2	28.96
Assessment Points -4	DAIKIN EDLA08	10.46	4.4	0.5	1000	54	-31.39	-0.04	2.84	0	-	-	-	2	0	27.41
Assessment Points -4	DAIKIN EDLA08 (	10.67	4.4	0.5	1000	53.91	-31.57	-0.04	2.84	0	-	-	-	2	0	27.15
Assessment Points -4	DAIKIN EDLA08	10.46	4.4	0.5	250	60	-31.39	-0.01	2.84	0	-	-	-	2	-8.6	24.84
Assessment Points -4	DAIKIN EDLA08 (	10.67	4.4	0.5	250	59.91	-31.57	-0.01	2.84	0	-	-	-	2	-8.6	24.58
Assessment Points -4	DAIKIN EDLA08	10.46	4.4	0.5	2000	48	-31.39	-0.09	2.84	0	-	-	-	2	1.2	22.56
Assessment Points -4	DAIKIN EDLA08 (	10.67	4.4	0.5	2000	47.91	-31.57	-0.09	2.84	0	-	-	-	2	1.2	22.3
Assessment Points -4	DAIKIN EDLA08	10.46	4.4	0.5	125	65	-31.39	0	2.84	-2.54	-2.54	-	-	2	-16.1	19.8
Assessment Points -4	DAIKIN EDLA08	10.46	4.4	0.5	4000	42	-31.39	-0.27	2.84	0	-	-	-	2	1	16.17
Assessment Points -4	DAIKIN EDLA08 (	10.67	4.4	0.5	4000	41.91	-31.57	-0.28	2.84	0	-	-	-	2	1	15.91
Assessment Points -4	DAIKIN EDLA08 (	28.1	4.4	0.5	2000	47.91	-39.97	-0.24	2.98	0	-	-	-	2	1.2	13.87
Assessment Points -4	DAIKIN EDLA08 (	35	4.4	0.5	1000	53.91	-41.88	-0.14	2.98	-3.62	-3.62	-	-	2	0	13.26
Assessment Points -4	DAIKIN EDLA08 (	46.08	4.4	0.5	2000	47.82	-44.27	-0.4	2.99	0	-	-	-	2	1.2	9.35
Assessment Points -4	DAIKIN EDLA08 (	35	4.4	0.5	2000	47.91	-41.88	-0.3	2.98	-2.91	-2.91	-	-	2	1.2	9.01
Assessment Points -4	DAIKIN EDLA08 (	28.1	4.4	0.5	4000	41.91	-39.97	-0.74	2.98	0	-	-	-	2	1	7.18
Assessment Points -4	DAIKIN EDLA08	10.46	4.4	0.5	63	61	-31.39	0	2.84	-3.79	-3.79	-	-	2	-26.2	4.46
Assessment Points -4	DAIKIN EDLA08	10.46	4.4	0.5	8000	33	-31.39	-0.98	2.84	0	-	-	-	2	-1.1	4.37
Assessment Points -4	DAIKIN EDLA08 (	10.67	4.4	0.5	8000	32.91	-31.57	-1	2.84	0	-	-	-	2	-1.1	4.09
Assessment Points -4	DAIKIN EDLA08 (	35	4.4	0.5	4000	41.91	-41.88	-0.92	2.98	-2.14	-2.14	-	-	2	1	2.96
Assessment Points -4	DAIKIN EDLA08 (	46.08	4.4	0.5	4000	41.82	-44.27	-1.21	2.99	0	-	-	-	2	1	2.33
Assessment Points -4	DAIKIN EDLA08 (	28.1	4.4	0.5	8000	32.91	-39.97	-2.63	2.98	0	-	-	-	2	-1.1	-5.82
Assessment Points -4	DAIKIN EDLA08 (	41.37	4.4	0.5	4000	41.91	-43.33	-1.09	2.99	-10.21	-10.21	-	-	2	1	-6.73
Assessment Points -4	DAIKIN EDLA08 (	35	4.4	0.5	8000	32.91	-41.88	-3.28	2.98	-1.56	-1.56					

Assessment Points -5	DAIKIN EDLA08	13.1	4.4	0.5	500	59	-33.34	-0.03	2.89	-5.24	-22.23	-6.84	-10.63	2	-3.2	22.08
Assessment Points -5	DAIKIN EDLA08	13.1	4.4	0.5	250	60	-33.34	-0.01	2.89	-4	-4	-	-	2	-8.6	18.94
Assessment Points -5	DAIKIN EDLA08	13.1	4.4	0.5	1000	54	-33.34	-0.05	2.89	-7.86	-25	-9.09	-14.27	2	0	17.64
Assessment Points -5	DAIKIN EDLA08	13.1	4.4	0.5	125	65	-33.34	0	2.89	-4.4	-4.4	-	-	2	-16.1	16.04
Assessment Points -5	DAIKIN EDLA08	13.1	4.4	0.5	2000	48	-33.34	-0.11	2.89	-11.17	-25	-12.32	-18.35	2	1.2	9.47
Assessment Points -5	DAIKIN EDLA08	13.1	4.4	0.5	63	61	-33.34	0	2.89	-4.59	-4.59	-	-	2	-26.2	1.76
Assessment Points -5	DAIKIN EDLA08	13.1	4.4	0.5	4000	42	-33.34	-0.34	2.89	-14.24	-25	-15.52	-21.92	2	1	-0.04
Assessment Points -5	DAIKIN EDLA08 (	13.18	4.4	0.5	2000	47.91	-33.4	-0.11	2.89	-25	-25	-	-	2	1.2	-4.5
Assessment Points -5	DAIKIN EDLA08 (	13.18	4.4	0.5	4000	41.91	-33.4	-0.35	2.89	-25	-25	-	-	2	1	-10.94
Assessment Points -5	DAIKIN EDLA08	13.1	4.4	0.5	8000	33	-33.34	-1.23	2.89	-16.93	-25	-18.54	-25.09	2	-1.1	-14.71
Assessment Points -5	DAIKIN EDLA08 (	44.31	4.4	0.5	4000	41.91	-43.93	-1.16	2.99	-25	-25	-	-	2	1	-22.19
Assessment Points -5	DAIKIN EDLA08 (	13.18	4.4	0.5	8000	32.91	-33.4	-1.23	2.89	-25	-25	-	-	2	-1.1	-22.92
Assessment Points -5	DAIKIN EDLA08 (	44.31	4.4	0.5	8000	32.91	-43.93	-4.15	2.99	-25	-25	-	-	2	-1.1	-36.28
Assessment Points -5	DAIKIN EDLA08 (	55.42	4.4	0.5	8000	32.82	-45.87	-5.19	2.99	-25	-25	-	-	2	-1.1	-39.34
Assessment Points -5	DAIKIN EDLA08 (	61.2	4.4	0.5	8000	32.82	-46.73	-5.73	2.99	-25	-25	-	-	2	-1.1	-40.74
Assessment Points -5	DAIKIN EDLA08	14.09	7	0.5	250	60	-33.98	-0.02	2.85	0	-	-	-	2	-8.6	22.26
Assessment Points -5	DAIKIN EDLA08	14.09	7	0.5	500	59	-33.98	-0.03	2.85	-4.99	-17.93	-6.75	-10.49	2	-3.2	21.65
Assessment Points -5	DAIKIN EDLA08	14.09	7	0.5	125	65	-33.98	-0.01	2.85	0	-	-	-	2	-16.1	19.77
Assessment Points -5	DAIKIN EDLA08	14.09	7	0.5	1000	54	-33.98	-0.06	2.85	-7.56	-20	-8.96	-14.15	2	0	17.26
Assessment Points -5	DAIKIN EDLA08	14.09	7	0.5	2000	48	-33.98	-0.12	2.85	-10.6	-20	-12.09	-18.16	2	1.2	9.35
Assessment Points -5	DAIKIN EDLA08	14.09	7	0.5	63	61	-33.98	0	2.85	-2.73	-2.73	-	-	2	-26.2	2.94
Assessment Points -5	DAIKIN EDLA08	14.09	7	0.5	4000	42	-33.98	-0.37	2.85	-13.28	-20	-15.21	-21.65	2	1	0.22
Assessment Points -5	DAIKIN EDLA08 (	14.17	7	0.5	2000	47.91	-34.03	-0.12	2.86	-20	-20	-	-	2	1.2	-0.18
Assessment Points -5	DAIKIN EDLA08 (	14.17	7	0.5	4000	41.91	-34.03	-0.37	2.86	-20	-20	-	-	2	1	-6.63
Assessment Points -5	DAIKIN EDLA08	14.09	7	0.5	8000	33	-33.98	-1.32	2.85	-15.45	-20	-18.18	-24.79	2	-1.1	-14
Assessment Points -5	DAIKIN EDLA08 (	44.62	7	0.5	4000	41.91	-43.99	-1.17	2.98	-20	-20	-	-	2	1	-17.26
Assessment Points -5	DAIKIN EDLA08 (	14.17	7	0.5	8000	32.91	-34.03	-1.33	2.86	-20	-20	-	-	2	-1.1	-18.68
Assessment Points -5	DAIKIN EDLA08 (	44.62	7	0.5	8000	32.91	-43.99	-4.18	2.98	-20	-20	-	-	2	-1.1	-31.37
Assessment Points -5	DAIKIN EDLA08 (	55.67	7	0.5	8000	32.82	-45.91	-5.21	2.99	-20	-20	-	-	2	-1.1	-34.41
Assessment Points -5	DAIKIN EDLA08 (	61.42	7	0.5	8000	32.82	-46.77	-5.75	2.99	-25	-25	-	-	2	-1.1	-40.8
Assessment Points -6	DAIKIN EDLA08	12.33	4.4	0.5	500	59	-32.82	-0.03	2.88	-6.97	-22.59	-10.82	-9.49	2	-3.2	20.86
Assessment Points -6	DAIKIN EDLA08	12.33	4.4	0.5	250	60	-32.82	-0.01	2.88	-3.52	-3.52	-	-	2	-8.6	19.93
Assessment Points -6	DAIKIN EDLA08	12.33	4.4	0.5	125	65	-32.82	0	2.88	-4.19	-4.19	-	-	2	-16.1	16.77
Assessment Points -6	DAIKIN EDLA08	12.33	4.4	0.5	1000	54	-32.82	-0.05	2.88	-10.45	-25	-14.52	-12.87	2	0	15.56
Assessment Points -6	DAIKIN EDLA08	12.33	4.4	0.5	2000	48	-32.82	-0.11	2.88	-14.23	-25	-18.6	-16.82	2	1.2	6.93
Assessment Points -6	DAIKIN EDLA08	12.33	4.4	0.5	63	61	-32.82	0	2.88	-4.49	-4.49	-	-	2	-26.2	2.37
Assessment Points -6	DAIKIN EDLA08	12.33	4.4	0.5	4000	42	-32.82	-0.32	2.88	-17.32	-25	-22.15	-20.33	2	1	-2.58
Assessment Points -6	DAIKIN EDLA08	12.33	4.4	0.5	8000	33	-32.82	-1.15	2.88	-19.75	-25	-25.32	-23.48	2	-1.1	-16.95
Assessment Points -6	DAIKIN EDLA08 (	43.52	4.4	0.5	4000	41.91	-43.77	-1.14	2.99	-25	-25	-	-	2	1	-22.02
Assessment Points -6	DAIKIN EDLA08 (	43.52	4.4	0.5	8000	32.91	-43.77	-4.07	2.99	-25	-25	-	-	2	-1.1	-36.05
Assessment Points -6	DAIKIN EDLA08 (	54.64	4.4	0.5	8000	32.82	-45.75	-5.11	2.99	-25	-25	-	-	2	-1.1	-39.15
Assessment Points -6	DAIKIN EDLA08 (	60.41	4.4	0.5	8000	32.82	-46.62	-5.65	2.99	-25	-25	-	-	2	-1.1	-40.56
Assessment Points -6	DAIKIN EDLA08	13.38	7	0.5	250	60	-33.53	-0.01	2.84	0	-	-	-	2	-8.6	22.7
Assessment Points -6	DAIKIN EDLA08	13.38	7	0.5	500	59	-33.53	-0.03	2.84	-6.63	-18.05	-10.69	-9.35	2	-3.2	20.45
Assessment Points -6	DAIKIN EDLA08	13.38	7	0.5	125	65	-33.53	0	2.84	0	-	-	-	2	-16.1	20.21
Assessment Points -6	DAIKIN EDLA08	13.38	7	0.5	1000	54	-33.53	-0.05	2.84	-10.03	-20	-14.41	-12.74	2	0	15.23
Assessment Points -6	DAIKIN EDLA08	13.38	7	0.5	2000	48	-33.53	-0.12	2.84	-13.35	-20	-18.41	-16.61	2	1.2	7.05
Assessment Points -6	DAIKIN EDLA08	13.38	7	0.5	63	61	-33.53	0	2.84	-2	-2	-	-	2	-26.2	4.11
Assessment Points -6	DAIKIN EDLA08	13.38	7	0.5	4000	42	-33.53	-0.35	2.84	-15.78	-20	-21.88	-20.04	2	1	-1.83
Assessment Points -6	DAIKIN EDLA08	13.38	7	0.5	8000	33	-33.53	-1.25	2.84	-17.45	-20	-25.02	-23.16	2	-1.1	-15.49
Assessment Points -6	DAIKIN EDLA08 (	43.83	7	0.5	4000	41.91	-43.84	-1.15	2.98	-20	-20	-	-	2	1	-17.09
Assessment Points -6	DAIKIN EDLA08 (	43.83	7	0.5	8000	32.91	-43.84	-4.1	2.98	-20	-20	-	-	2	-1.1	-31.14
Assessment Points -6	DAIKIN EDLA08 (	54.88	7	0.5	8000	32.82	-45.79	-5.14	2.99	-20	-20	-	-	2	-1.1	-34.21
Assessment Points -6	DAIKIN EDLA08 (	60.63	7	0.5	8000	32.82	-46.65	-5.68	2.99	-25	-25	-	-	2	-1.1	-40.61
Assessment Points -7	DAIKIN EDLA08	14.81	4.4	0.5	500	59	-34.41	-0.03	2.92	0	-	-	-	2	-3.2	26.27
Assessment Points -7	DAIKIN EDLA08	14.81	4.4	0.5	1000	54	-34.41	-0.06	2.92	0	-	-	-	2	0	24.45
Assessment Points -7	DAIKIN EDLA08 (	17.82	4.4	0.5	1000	53.91	-36.02	-0.07	2.94	0	-	-	-	2	0	22.76
Assessment Points -7	DAIKIN EDLA08	14.81	4.4	0.5	250	60	-34.41	-0.02	2.92	0	-	-	-	2	-8.6	21.89
Assessment Points -7	DAIKIN EDLA08	14.81	4.4	0.5	2000	48	-34.41	-0.13	2.92	0	-	-	-	2	1.2	19.58
Assessment Points -7	DAIKIN EDLA08 (	25.73	4.4	0.5	1000	53.91	-39.21	-0.1	2.97	0	-	-	-	2	0	19.57
Assessment Points -7	DAIKIN EDLA08 (	14.9	4.4	0.5	2000	47.91	-34.46	-0.13	2.92	0	-	-	-	2	1.2	19.44
Assessment Points -7	DAIKIN EDLA08 (	28.8	4.4	0.5	1000	53.82	-40.19	-0.11	2.98	0	-	-	-	2	0	18.5
Assessment Points -7	DAIKIN EDLA08 (	17.82	4.4	0.5	2000	47.91	-36.02	-0.15	2.94	0	-	-	-	2	1.2	17.88
Assessment Points -7	DAIKIN EDLA08	14.81	4.4	0.5	125	65	-34.41	-0.01	2.92	-1.9	-1.9	-	-	2	-16.1	17.49
Assessment Points -7	DAIKIN EDLA08 (	25.73	4.4	0.5	2000	47.91	-39.21	-0.22	2.97	0	-	-	-	2	1.2	14.65
Assessment Points -7	DAIKIN EDLA08 (	28.8	4.4	0.5	2000	47.82	-40.19	-0.25	2.98	0	-	-	-	2	1.2	13.56
Assessment Points -7	DAIKIN EDLA08	14.81	4.4	0.5	4000	42	-34.41	-0.39	2.92	0	-	-	-	2	1	13.12
Assessment Points -7	DAIKIN EDLA08 (	14.9	4.4	0.5	4000	41.91	-34.46	-0.39	2.92	0	-	-	-	2	1	12.97
Assessment Points -7	DAIKIN EDLA08 (	17.82	4.4	0.5	4000	41.91	-36.02	-0.47	2.94	0	-	-	-	2	1	11.36
Assessment Points -7	DAIKIN EDLA08 (	49.57	4.4	0.5	2000	47.82	-44.9	-0.43	2.99	0	-	-	-	2	1.2	8.68
Assessment Points -7	DAIKIN EDLA08 (	25.73	4.4	0.5	4000	41.91	-39.21	-0.68	2.97	0	-	-	-	2	1	8
Assessment Points -7	DAIKIN EDLA08 (	28.8	4.4	0.5	4000	41.82	-40.19	-0.76	2.98	0	-	-	-	2	1	6.86
Assessment Points -7	DAIKIN EDLA08	14.81	4.4	0.5	63	61	-34.41	0	2.92	-3.56	-3.56	-	-	2	-26.2	1.75
Assessment Points -7	DAIKIN EDLA08 (	49.57	4.4	0.5	4000	41.82	-44.9	-1.3	2.99	0	-	-	-	2	1	1.61
Assessment Points -7	DAIKIN EDLA08	14.81	4.4	0.5	8000	33	-34.41	-1.39	2.92	0	-	-	-	2	-1.1	1.02
Assessment Points -7	DAIKIN EDLA08 (	14.9	4.4	0.5	8000	32.91	-34.46	-1.39	2.92	0	-	-	-	2	-1.1	0.87
Assessment Points -7	DAIKIN EDLA08 (	17.82	4.4	0.5	8000	32.91	-36.02	-1.67	2.94	0	-	-	-	2	-1.1	-0.94
Assessment Points -7	DAIKIN EDLA08 (	31.46	4.4	0.5	4000	41.91	-40.95	-0.83	2.98	-9.34	-9.34	-	-	2	1	-3.23
Assessment Points -7	DAIKIN EDLA08 (	25.73	4.4	0.5	8000	32.91	-39.21	-2.41	2.97	0	-	-	-	2	-1.1	-4.83
Assessment Points -7	DAIKIN EDLA08 (	34.54	4.4	0.5	4000	41.82	-41.77	-0.91	2.98	-10	-10	-	-	2	1	-4.87
Assessment Points -7	DAIKIN EDLA08 (	28.8	4.4	0.5	8000	32.82	-40.19	-2.7	2.98	0	-	-	-	2	-1.1	-6.18
Assessment Points -7	DAIKIN EDLA08 (	49.56	4.4	0.5	8000	32.82	-44.9	-4.64	2.99	0	-	-	-	2	-1.1	-12.82
Assessment Points -7	DAIKIN EDLA08 (	49.57	4.4	0.5	8000	32.82	-44.9	-4.64	2.99	0	-	-	-	2	-1.1	-12.83
Assessment Points -7	DAIKIN EDLA08 (	31.46	4.4	0.5	8000	32.91	-40.95	-2.94	2.98							

Assessment Points -7	DAIKIN EDLA08 (	18.57	7	0.5	8000	32.91	-36.38	-1.74	2.91	0	-	-	-	2	-1.1	-1.39
Assessment Points -7	DAIKIN EDLA08 (	29.27	7	0.5	8000	32.82	-40.33	-2.74	2.97	0	-	-	-	2	-1.1	-6.38
Assessment Points -7	DAIKIN EDLA08 (	31.89	7	0.5	8000	32.91	-41.07	-2.98	2.97	-0.69	-0.69	-	-	2	-1.1	-7.97
Assessment Points -7	DAIKIN EDLA08 (	34.93	7	0.5	8000	32.82	-41.86	-3.27	2.98	-2.36	-2.36	-	-	2	-1.1	-10.79
Assessment Points -7	DAIKIN EDLA08 (	49.83	7	0.5	8000	32.82	-44.95	-4.66	2.99	0	-	-	-	2	-1.1	-12.9
Assessment Points -8	DAIKIN EDLA08 (	15.33	4.4	0.5	500	59	-34.71	-0.03	2.92	0	-	-	-	2	-3.2	25.98
Assessment Points -8	DAIKIN EDLA08 (	17.28	4.4	0.5	500	58.91	-35.75	-0.04	2.94	0	-	-	-	2	-3.2	24.86
Assessment Points -8	DAIKIN EDLA08 (	15.33	4.4	0.5	1000	54	-34.71	-0.06	2.92	0	-	-	-	2	0	24.15
Assessment Points -8	DAIKIN EDLA08 (	17.28	4.4	0.5	1000	53.91	-35.75	-0.07	2.94	0	-	-	-	2	0	23.03
Assessment Points -8	DAIKIN EDLA08 (	15.33	4.4	0.5	250	60	-34.71	-0.02	2.92	0	-	-	-	2	-8.6	21.6
Assessment Points -8	DAIKIN EDLA08 (	26.27	4.4	0.5	1000	53.91	-39.39	-0.1	2.97	0	-	-	-	2	0	19.39
Assessment Points -8	DAIKIN EDLA08 (	15.33	4.4	0.5	2000	48	-34.71	-0.13	2.92	0	-	-	-	2	1.2	19.28
Assessment Points -8	DAIKIN EDLA08 (	28.26	4.4	0.5	1000	53.82	-40.02	-0.11	2.98	0	-	-	-	2	0	18.66
Assessment Points -8	DAIKIN EDLA08 (	17.28	4.4	0.5	2000	47.91	-35.75	-0.15	2.94	0	-	-	-	2	1.2	18.15
Assessment Points -8	DAIKIN EDLA08 (	15.33	4.4	0.5	125	65	-34.71	-0.01	2.92	-2.6	-2.6	-	-	2	-16.1	16.5
Assessment Points -8	DAIKIN EDLA08 (	26.27	4.4	0.5	2000	47.91	-39.39	-0.23	2.97	0	-	-	-	2	1.2	14.47
Assessment Points -8	DAIKIN EDLA08 (	28.26	4.4	0.5	2000	47.82	-40.02	-0.24	2.98	0	-	-	-	2	1.2	13.73
Assessment Points -8	DAIKIN EDLA08 (	15.33	4.4	0.5	4000	42	-34.71	-0.4	2.92	0	-	-	-	2	1	12.81
Assessment Points -8	DAIKIN EDLA08 (	17.28	4.4	0.5	4000	41.91	-35.75	-0.45	2.94	0	-	-	-	2	1	11.64
Assessment Points -8	DAIKIN EDLA08 (	32.01	4.4	0.5	1000	53.91	-41.11	-0.13	2.98	-6.46	-6.46	-	-	2	0	11.2
Assessment Points -8	DAIKIN EDLA08 (	34.01	4.4	0.5	1000	53.82	-41.63	-0.14	2.98	-6.68	-6.68	-	-	2	0	10.36
Assessment Points -8	DAIKIN EDLA08 (	26.27	4.4	0.5	4000	41.91	-39.39	-0.69	2.97	0	-	-	-	2	1	7.81
Assessment Points -8	DAIKIN EDLA08 (	28.26	4.4	0.5	4000	41.82	-40.02	-0.74	2.98	0	-	-	-	2	1	7.03
Assessment Points -8	DAIKIN EDLA08 (	32.01	4.4	0.5	2000	47.91	-41.11	-0.28	2.98	-7.72	-7.72	-	-	2	1.2	4.99
Assessment Points -8	DAIKIN EDLA08 (	34.01	4.4	0.5	2000	47.82	-41.63	-0.29	2.98	-8.04	-8.04	-	-	2	1.2	4.04
Assessment Points -8	DAIKIN EDLA08 (	15.33	4.4	0.5	63	61	-34.71	0	2.92	-3.81	-3.81	-	-	2	-26.2	1.2
Assessment Points -8	DAIKIN EDLA08 (	15.33	4.4	0.5	8000	33	-34.71	-1.43	2.92	0	-	-	-	2	-1.1	0.68
Assessment Points -8	DAIKIN EDLA08 (	17.28	4.4	0.5	8000	32.91	-35.75	-1.62	2.94	0	-	-	-	2	-1.1	-0.62
Assessment Points -8	DAIKIN EDLA08 (	32.01	4.4	0.5	4000	41.91	-41.1	-0.84	2.98	-9.49	-9.49	-	-	2	1	-3.54
Assessment Points -8	DAIKIN EDLA08 (	32.01	4.4	0.5	4000	41.91	-41.11	-0.84	2.98	-9.5	-9.5	-	-	2	1	-3.55
Assessment Points -8	DAIKIN EDLA08 (	34.01	4.4	0.5	4000	41.82	-41.63	-0.89	2.98	-9.91	-9.91	-	-	2	1	-4.63
Assessment Points -8	DAIKIN EDLA08 (	34.01	4.4	0.5	4000	41.82	-41.63	-0.89	2.98	-9.92	-9.92	-	-	2	1	-4.64
Assessment Points -8	DAIKIN EDLA08 (	26.27	4.4	0.5	8000	32.91	-39.39	-2.46	2.97	0	-	-	-	2	-1.1	-5.06
Assessment Points -8	DAIKIN EDLA08 (	28.26	4.4	0.5	8000	32.82	-40.02	-2.65	2.98	0	-	-	-	2	-1.1	-5.97
Assessment Points -8	DAIKIN EDLA08 (	50.11	4.4	0.5	8000	32.82	-45	-4.69	2.99	0	-	-	-	2	-1.1	-12.97
Assessment Points -8	DAIKIN EDLA08 (	32.01	4.4	0.5	8000	32.91	-41.1	-3	2.98	-11.73	-11.73	-	-	2	-1.1	-19.03
Assessment Points -8	DAIKIN EDLA08 (	32.01	4.4	0.5	8000	32.91	-41.11	-3	2.98	-11.74	-11.74	-	-	2	-1.1	-19.05
Assessment Points -8	DAIKIN EDLA08 (	34.01	4.4	0.5	8000	32.82	-41.63	-3.18	2.98	-12.23	-12.23	-	-	2	-1.1	-20.33
Assessment Points -8	DAIKIN EDLA08 (	34.01	4.4	0.5	8000	32.82	-41.63	-3.18	2.98	-12.24	-12.24	-	-	2	-1.1	-20.35
Assessment Points -8	DAIKIN EDLA08 (	16.18	7	0.5	500	59	-35.18	-0.04	2.89	0	-	-	-	2	-3.2	25.47
Assessment Points -8	DAIKIN EDLA08 (	18.05	7	0.5	500	58.91	-36.13	-0.04	2.91	0	-	-	-	2	-3.2	24.45
Assessment Points -8	DAIKIN EDLA08 (	16.18	7	0.5	1000	54	-35.18	-0.06	2.89	0	-	-	-	2	0	23.64
Assessment Points -8	DAIKIN EDLA08 (	18.05	7	0.5	1000	53.91	-36.13	-0.07	2.91	0	-	-	-	2	0	22.62
Assessment Points -8	DAIKIN EDLA08 (	16.18	7	0.5	250	60	-35.18	-0.02	2.89	0	-	-	-	2	-8.6	21.09
Assessment Points -8	DAIKIN EDLA08 (	16.18	7	0.5	2000	48	-35.18	-0.14	2.89	0	-	-	-	2	1.2	18.77
Assessment Points -8	DAIKIN EDLA08 (	16.18	7	0.5	125	65	-35.18	-0.01	2.89	0	-	-	-	2	-16.1	18.6
Assessment Points -8	DAIKIN EDLA08 (	18.05	7	0.5	2000	47.91	-36.13	-0.16	2.91	0	-	-	-	2	1.2	17.74
Assessment Points -8	DAIKIN EDLA08 (	32.43	7	0.5	1000	53.91	-41.22	-0.13	2.97	-3.67	-3.67	-	-	2	0	13.86
Assessment Points -8	DAIKIN EDLA08 (	28.74	7	0.5	2000	47.82	-40.17	-0.25	2.96	0	-	-	-	2	1.2	13.57
Assessment Points -8	DAIKIN EDLA08 (	34.41	7	0.5	1000	53.82	-41.73	-0.14	2.97	-3.85	-3.85	-	-	2	0	13.08
Assessment Points -8	DAIKIN EDLA08 (	16.18	7	0.5	4000	42	-35.18	-0.43	2.89	0	-	-	-	2	1	12.28
Assessment Points -8	DAIKIN EDLA08 (	18.05	7	0.5	4000	41.91	-36.13	-0.47	2.91	0	-	-	-	2	1	11.22
Assessment Points -8	DAIKIN EDLA08 (	32.43	7	0.5	2000	47.91	-41.22	-0.28	2.97	-2.87	-2.87	-	-	2	1.2	9.72
Assessment Points -8	DAIKIN EDLA08 (	34.41	7	0.5	2000	47.82	-41.73	-0.3	2.97	-3.26	-3.26	-	-	2	1.2	8.71
Assessment Points -8	DAIKIN EDLA08 (	28.74	7	0.5	4000	41.82	-40.17	-0.75	2.96	0	-	-	-	2	1	6.87
Assessment Points -8	DAIKIN EDLA08 (	16.18	7	0.5	63	61	-35.18	0	2.89	0	-	-	-	2	-26.2	4.51
Assessment Points -8	DAIKIN EDLA08 (	32.43	7	0.5	4000	41.91	-41.22	-0.85	2.97	-1.83	-1.83	-	-	2	1	3.98
Assessment Points -8	DAIKIN EDLA08 (	32.43	7	0.5	4000	41.91	-41.22	-0.85	2.97	-1.85	-1.85	-	-	2	1	3.97
Assessment Points -8	DAIKIN EDLA08 (	34.4	7	0.5	4000	41.82	-41.73	-0.9	2.97	-2.57	-2.57	-	-	2	1	2.59
Assessment Points -8	DAIKIN EDLA08 (	34.41	7	0.5	4000	41.82	-41.73	-0.9	2.97	-2.59	-2.59	-	-	2	1	2.57
Assessment Points -8	DAIKIN EDLA08 (	16.18	7	0.5	8000	33	-35.18	-1.51	2.89	0	-	-	-	2	-1.1	0.09
Assessment Points -8	DAIKIN EDLA08 (	18.05	7	0.5	8000	32.91	-36.13	-1.69	2.91	0	-	-	-	2	-1.1	-1.1
Assessment Points -8	DAIKIN EDLA08 (	28.74	7	0.5	8000	32.82	-40.17	-2.69	2.96	0	-	-	-	2	-1.1	-6.17
Assessment Points -8	DAIKIN EDLA08 (	32.43	7	0.5	8000	32.91	-41.22	-3.03	2.97	-0.92	-0.92	-	-	2	-1.1	-8.39
Assessment Points -8	DAIKIN EDLA08 (	32.43	7	0.5	8000	32.91	-41.22	-3.04	2.97	-0.94	-0.94	-	-	2	-1.1	-8.41
Assessment Points -8	DAIKIN EDLA08 (	34.4	7	0.5	8000	32.82	-41.73	-3.22	2.97	-2.03	-2.03	-	-	2	-1.1	-10.28
Assessment Points -8	DAIKIN EDLA08 (	34.41	7	0.5	8000	32.82	-41.73	-3.22	2.97	-2.06	-2.06	-	-	2	-1.1	-10.31
Assessment Points -8	DAIKIN EDLA08 (	50.38	7	0.5	8000	32.82	-45.05	-4.72	2.99	0	-	-	-	2	-1.1	-13.05
Assessment Points -11	DAIKIN EDLA08 (	20.13	4.4	0.5	500	59	-37.08	-0.05	2.95	-7.18	-21.61	-7.34	-	2	-3.2	16.45
Assessment Points -11	DAIKIN EDLA08 (	20.13	4.4	0.5	250	60	-37.08	-0.02	2.95	-5.75	-18.23	-6.01	-	2	-8.6	13.5
Assessment Points -11	DAIKIN EDLA08 (	20.13	4.4	0.5	125	65	-37.08	-0.01	2.95	-4.56	-4.56	-	-	2	-16.1	12.21
Assessment Points -11	DAIKIN EDLA08 (	20.13	4.4	0.5	1000	54	-37.08	-0.08	2.95	-9.81	-25	-9.94	-	2	0	11.98
Assessment Points -11	DAIKIN EDLA08 (	20.13	4.4	0.5	2000	48	-37.08	-0.17	2.95	-13	-25	-13.28	-	2	1.2	3.9
Assessment Points -11	DAIKIN EDLA08 (	20.13	4.4	0.5	63	61	-37.08	0	2.95	-4.58	-4.58	-	-	2	-26.2	-1.9
Assessment Points -11	DAIKIN EDLA08 (	20.13	4.4	0.5	4000	42	-37.08	-0.53	2.95	-15.99	-25	-16.46	-	2	1	-5.54
Assessment Points -11	DAIKIN EDLA08 (	36.89	4.4	0.5	4000	41.91	-42.34	-0.97	2.99	-25	-25	-	-	2	1	-20.41
Assessment Points -11	DAIKIN EDLA08 (	20.13	4.4	0.5	8000	33	-37.08	-1.88	2.95	-18.4	-25	-19.47	-	2	-1.1	-20.5
Assessment Points -11	DAIKIN EDLA08 (	36.89	4.4	0.5	8000	32.91	-42.34	-3.45	2.99	-25	-25	-	-	2	-1.1	-33.99
Assessment Points -11	DAIKIN EDLA08 (	20.79	7	0.5	500	59	-37.36	-0.05	2.93	-6.8	-16.49	-7.29	-	2	-3.2	16.53
Assessment Points -11	DAIKIN EDLA08 (	20.79	7	0.5	125	65	-37.36	-0.01	2.93	-0.24	-0.24	-	-	2	-16.1	16.22
Assessment Points -11	DAIKIN EDLA08 (	20.79	7	0.5	250	60	-37.36	-0.02	2.93	-5.3	-13.76	-5.97	-	2	-8.6	13.65
Assessment Points -11	DAIKIN EDLA08 (	20.79	7	0.5	1000	54	-37.36	-0.08	2.93	-9.41	-19.35	-9.88	-	2	0	12.08
Assessment Points -11	DAIKIN EDLA08 (	20.79	7	0.5	2000	48	-37.36	-0.18	2.93	-12.35	-20	-13.17	-	2	1.2	4.24
Assessment Points -11	DAIKIN EDLA08 (	20.79	7	0.5	63	61	-37.36	0	2.93	-3.03	-3.03	-	-	2	-26.2	-0.66
Assessment Points -11	DAIKIN EDLA08 (	20.79	7	0.5	4000	42	-37.36	-0.55	2.93	-14.77	-20	-16.31	-	2	1	

Assessment Points -10	DAIKIN EDLA08	20.48	7	0.5	125	65	-37.22	-0.01	2.93	0	-	-	-	2	-16.1	16.6
Assessment Points -10	DAIKIN EDLA08	20.48	7	0.5	500	59	-37.22	-0.05	2.93	-10.6	-16.62	-11.85	-	2	-3.2	12.85
Assessment Points -10	DAIKIN EDLA08	20.48	7	0.5	250	60	-37.22	-0.02	2.93	-7.8	-13.89	-9.03	-	2	-8.6	11.28
Assessment Points -10	DAIKIN EDLA08	20.48	7	0.5	1000	54	-37.22	-0.08	2.93	-14.26	-19.49	-15.81	-	2	0	7.36
Assessment Points -10	DAIKIN EDLA08	20.48	7	0.5	2000	48	-37.22	-0.18	2.93	-16.89	-20	-19.8	-	2	1.2	-0.16
Assessment Points -10	DAIKIN EDLA08	20.48	7	0.5	63	61	-37.22	0	2.93	-2.9	-2.9	-	-	2	-26.2	-0.4
Assessment Points -10	DAIKIN EDLA08 (	36.95	7	0.5	1000	53.91	-42.35	-0.15	2.98	-18.03	-18.03	-	-	2	0	-1.63
Assessment Points -10	DAIKIN EDLA08	20.48	7	0.5	4000	42	-37.22	-0.54	2.93	-18.31	-20	-23.23	-	2	1	-8.14
Assessment Points -10	DAIKIN EDLA08 (	36.95	7	0.5	2000	47.91	-42.35	-0.32	2.98	-20	-20	-	-	2	1.2	-8.58
Assessment Points -10	DAIKIN EDLA08 (	36.94	7	0.5	4000	41.91	-42.35	-0.97	2.98	-20	-20	-	-	2	1	-15.43
Assessment Points -10	DAIKIN EDLA08 (	36.95	7	0.5	4000	41.91	-42.35	-0.97	2.98	-20	-20	-	-	2	1	-15.43
Assessment Points -10	DAIKIN EDLA08	20.48	7	0.5	8000	33	-37.22	-1.92	2.93	-19.1	-20	-26.35	-	2	-1.1	-21.41
Assessment Points -10	DAIKIN EDLA08 (	36.94	7	0.5	8000	32.91	-42.35	-3.46	2.98	-20	-20	-	-	2	-1.1	-29.02
Assessment Points -10	DAIKIN EDLA08 (	36.95	7	0.5	8000	32.91	-42.35	-3.46	2.98	-20	-20	-	-	2	-1.1	-29.02
Assessment Points -9	DAIKIN EDLA08	17.63	4.4	0.5	500	59	-35.93	-0.04	2.94	-0.08	-0.08	-	-	2	-3.2	24.7
Assessment Points -9	DAIKIN EDLA08	17.63	4.4	0.5	1000	54	-35.93	-0.07	2.94	0	-	-	-	2	0	22.94
Assessment Points -9	DAIKIN EDLA08 (	17.78	4.4	0.5	1000	53.91	-36	-0.07	2.94	0	-	-	-	2	0	22.78
Assessment Points -9	DAIKIN EDLA08 (	28.55	4.4	0.5	1000	53.91	-40.11	-0.11	2.98	0	-	-	-	2	0	18.66
Assessment Points -9	DAIKIN EDLA08	17.63	4.4	0.5	2000	48	-35.93	-0.15	2.94	0	-	-	-	2	1.2	18.06
Assessment Points -9	DAIKIN EDLA08 (	17.78	4.4	0.5	2000	47.91	-36	-0.15	2.94	0	-	-	-	2	1.2	17.9
Assessment Points -9	DAIKIN EDLA08	17.63	4.4	0.5	250	60	-35.93	-0.02	2.94	-2.89	-2.89	-	-	2	-8.6	17.5
Assessment Points -9	DAIKIN EDLA08	17.63	4.4	0.5	125	65	-35.93	-0.01	2.94	-3.93	-3.93	-	-	2	-16.1	13.98
Assessment Points -9	DAIKIN EDLA08 (	28.55	4.4	0.5	2000	47.91	-40.11	-0.25	2.98	0	-	-	-	2	1.2	13.73
Assessment Points -9	DAIKIN EDLA08	17.63	4.4	0.5	4000	42	-35.93	-0.46	2.94	0	-	-	-	2	1	11.55
Assessment Points -9	DAIKIN EDLA08 (	17.78	4.4	0.5	4000	41.91	-36	-0.47	2.94	0	-	-	-	2	1	11.39
Assessment Points -9	DAIKIN EDLA08 (	28.55	4.4	0.5	4000	41.91	-40.11	-0.75	2.98	0	-	-	-	2	1	7.03
Assessment Points -9	DAIKIN EDLA08	17.63	4.4	0.5	63	61	-35.93	0	2.94	-4.33	-4.33	-	-	2	-26.2	-0.52
Assessment Points -9	DAIKIN EDLA08	17.63	4.4	0.5	8000	33	-35.93	-1.65	2.94	0	-	-	-	2	-1.1	-0.74
Assessment Points -9	DAIKIN EDLA08 (	17.78	4.4	0.5	8000	32.91	-36	-1.66	2.94	0	-	-	-	2	-1.1	-0.91
Assessment Points -9	DAIKIN EDLA08 (	28.55	4.4	0.5	8000	32.91	-40.11	-2.67	2.98	0	-	-	-	2	-1.1	-6
Assessment Points -9	DAIKIN EDLA08 (	34.39	4.4	0.5	4000	41.82	-41.73	-0.9	2.98	-13.94	-13.94	-	-	2	1	-8.77
Assessment Points -9	DAIKIN EDLA08 (	34.39	4.4	0.5	8000	32.82	-41.73	-3.22	2.98	-16.69	-16.69	-	-	2	-1.1	-24.92
Assessment Points -9	DAIKIN EDLA08	18.38	7	0.5	500	59	-36.29	-0.04	2.91	0	-	-	-	2	-3.2	24.38
Assessment Points -9	DAIKIN EDLA08	18.38	7	0.5	1000	54	-36.29	-0.07	2.91	0	-	-	-	2	0	22.55
Assessment Points -9	DAIKIN EDLA08 (	18.52	7	0.5	1000	53.91	-36.36	-0.07	2.91	0	-	-	-	2	0	22.4
Assessment Points -9	DAIKIN EDLA08	18.38	7	0.5	250	60	-36.29	-0.02	2.91	0	-	-	-	2	-8.6	20.01
Assessment Points -9	DAIKIN EDLA08	18.38	7	0.5	2000	48	-36.29	-0.16	2.91	0	-	-	-	2	1.2	17.67
Assessment Points -9	DAIKIN EDLA08	18.38	7	0.5	125	65	-36.29	-0.01	2.91	0	-	-	-	2	-16.1	17.52
Assessment Points -9	DAIKIN EDLA08 (	18.52	7	0.5	2000	47.91	-36.36	-0.16	2.91	0	-	-	-	2	1.2	17.51
Assessment Points -9	DAIKIN EDLA08 (	29.02	7	0.5	2000	47.91	-40.25	-0.25	2.96	0	-	-	-	2	1.2	13.57
Assessment Points -9	DAIKIN EDLA08	18.38	7	0.5	4000	42	-36.29	-0.48	2.91	0	-	-	-	2	1	11.14
Assessment Points -9	DAIKIN EDLA08 (	18.52	7	0.5	4000	41.91	-36.36	-0.49	2.91	0	-	-	-	2	1	10.98
Assessment Points -9	DAIKIN EDLA08 (	29.02	7	0.5	4000	41.91	-40.25	-0.76	2.96	0	-	-	-	2	1	6.86
Assessment Points -9	DAIKIN EDLA08	18.38	7	0.5	63	61	-36.29	0	2.91	-1.08	-1.08	-	-	2	-26.2	2.35
Assessment Points -9	DAIKIN EDLA08	18.38	7	0.5	8000	33	-36.29	-1.72	2.91	0	-	-	-	2	-1.1	-1.2
Assessment Points -9	DAIKIN EDLA08 (	18.52	7	0.5	8000	32.91	-36.36	-1.73	2.91	0	-	-	-	2	-1.1	-1.36
Assessment Points -9	DAIKIN EDLA08 (	34.78	7	0.5	4000	41.82	-41.83	-0.91	2.98	-6.85	-6.85	-	-	2	1	-1.79
Assessment Points -9	DAIKIN EDLA08 (	29.02	7	0.5	8000	32.91	-40.25	-2.72	2.96	0	-	-	-	2	-1.1	-6.19
Assessment Points -9	DAIKIN EDLA08 (	34.78	7	0.5	8000	32.82	-41.83	-3.25	2.98	-8.47	-8.47	-	-	2	-1.1	-16.85
Assessment Points -12	DAIKIN EDLA08	14.92	1.2	0.5	500	59	-34.48	-0.03	2.98	-7.69	-7.69	-	-	2	-3.2	18.58
Assessment Points -12	DAIKIN EDLA08 (	15.27	1.2	0.5	500	58.91	-34.68	-0.03	2.98	-7.63	-7.63	-	-	2	-3.2	18.34
Assessment Points -12	DAIKIN EDLA08	14.92	1.2	0.5	250	60	-34.48	-0.02	2.98	-6.47	-6.47	-	-	2	-8.6	15.41
Assessment Points -12	DAIKIN EDLA08 (	15.27	1.2	0.5	250	59.91	-34.68	-0.02	2.98	-6.43	-6.43	-	-	2	-8.6	15.16
Assessment Points -12	DAIKIN EDLA08	14.92	1.2	0.5	1000	54	-34.48	-0.06	2.98	-9.42	-9.42	-	-	2	0	15.02
Assessment Points -12	DAIKIN EDLA08 (	15.27	1.2	0.5	1000	53.91	-34.68	-0.06	2.98	-9.35	-9.35	-	-	2	0	14.81
Assessment Points -12	DAIKIN EDLA08	14.92	1.2	0.5	125	65	-34.48	-0.01	2.98	-5.7	-5.7	-	-	2	-16.1	13.69
Assessment Points -12	DAIKIN EDLA08 (	15.27	1.2	0.5	125	64.91	-34.68	-0.01	2.98	-5.68	-5.68	-	-	2	-16.1	13.43
Assessment Points -12	DAIKIN EDLA08 (	21.21	1.2	0.5	1000	53.82	-37.53	-0.08	2.99	-8.87	-8.87	-	-	2	0	12.33
Assessment Points -12	DAIKIN EDLA08 (	25.69	1.2	0.5	1000	53.91	-39.19	-0.1	2.99	-7.99	-7.99	-	-	2	0	11.61
Assessment Points -12	DAIKIN EDLA08 (	25.9	1.2	0.5	1000	53.82	-39.27	-0.1	2.99	-7.96	-7.96	-	-	2	0	11.48
Assessment Points -12	DAIKIN EDLA08	14.92	1.2	0.5	2000	48	-34.48	-0.13	2.98	-11.62	-11.62	-	-	2	1.2	7.96
Assessment Points -12	DAIKIN EDLA08 (	15.27	1.2	0.5	2000	47.91	-34.68	-0.13	2.98	-11.52	-11.52	-	-	2	1.2	7.76
Assessment Points -12	DAIKIN EDLA08 (	21.21	1.2	0.5	2000	47.82	-37.53	-0.18	2.99	-10.95	-10.95	-	-	2	1.2	5.35
Assessment Points -12	DAIKIN EDLA08	25.69	1.2	0.5	2000	47.91	-39.19	-0.22	2.99	-9.83	-9.83	-	-	2	1.2	4.86
Assessment Points -12	DAIKIN EDLA08 (	25.9	1.2	0.5	2000	47.82	-39.27	-0.22	2.99	-9.79	-9.79	-	-	2	1.2	4.73
Assessment Points -12	DAIKIN EDLA08 (	33.22	1.2	0.5	2000	47.91	-41.43	-0.29	3	-8.34	-8.34	-	-	2	1.2	4.05
Assessment Points -12	DAIKIN EDLA08 (	34.15	1.2	0.5	2000	47.82	-41.67	-0.29	3	-8.22	-8.22	-	-	2	1.2	3.83
Assessment Points -12	DAIKIN EDLA08 (	38.38	1.2	0.5	2000	47.82	-42.68	-0.33	3	-7.9	-7.9	-	-	2	1.2	3.11
Assessment Points -12	DAIKIN EDLA08 (	31.4	1.2	0.5	1000	53.91	-40.94	-0.12	2.99	-14.95	-14.95	-	-	2	0	2.9
Assessment Points -12	DAIKIN EDLA08	14.92	1.2	0.5	63	61	-34.48	0	2.98	-5.27	-5.27	-	-	2	-26.2	0.03
Assessment Points -12	DAIKIN EDLA08	14.92	1.2	0.5	4000	42	-34.48	-0.39	2.98	-14.15	-14.15	-	-	2	1	-1.04
Assessment Points -12	DAIKIN EDLA08 (	15.27	1.2	0.5	4000	41.91	-34.68	-0.4	2.98	-14.05	-14.05	-	-	2	1	-1.24
Assessment Points -12	DAIKIN EDLA08 (	21.21	1.2	0.5	4000	41.82	-37.53	-0.56	2.99	-13.4	-13.4	-	-	2	1	-3.68
Assessment Points -12	DAIKIN EDLA08 (	25.69	1.2	0.5	4000	41.91	-39.19	-0.67	2.99	-12.11	-12.11	-	-	2	1	-4.08
Assessment Points -12	DAIKIN EDLA08 (	49.51	1.2	0.5	2000	47.82	-44.89	-0.43	3	-12.86	-12.86	-	-	2	1.2	-4.16
Assessment Points -12	DAIKIN EDLA08	25.9	1.2	0.5	4000	41.82	-39.27	-0.68	2.99	-12.07	-12.07	-	-	2	1	-4.2
Assessment Points -12	DAIKIN EDLA08 (	33.22	1.2	0.5	4000	41.91	-41.43	-0.87	3	-10.31	-10.31	-	-	2	1	-4.7
Assessment Points -12	DAIKIN EDLA08 (	31.4	1.2	0.5	2000	47.91	-40.94	-0.27	2.99	-17.78	-17.78	-	-	2	1.2	-4.89
Assessment Points -12	DAIKIN EDLA08 (	34.15	1.2	0.5	4000	41.82	-41.67	-0.9	3	-10.16	-10.16	-	-	2	1	-4.91
Assessment Points -12	DAIKIN EDLA08 (	38.38	1.2	0.5	4000	41.82	-42.68	-1.01	3	-9.76	-9.76	-	-	2	1	-5.63
Assessment Points -12	DAIKIN EDLA08 (	43.75	1.2	0.5	4000	41.82	-43.82	-1.15	3	-10.49	-10.49	-	-	2	1	-7.64
Assessment Points -12	DAIKIN EDLA08	56.41	1.2	0.5	2000	47.82	-46.03	-0.49	3.29	-15.77	-15.77	-	-	2	1.2	-7.98
Assessment Points -12	DAIKIN EDLA08 (	49.51	1.2	0.5	4000	41.82	-44.89	-1.3	3	-15.54	-15.54	-	-	2	1	-13.92
Assessment Points -12	DAIKIN EDLA08 (	31.4	1.2	0.5	4000	41.91	-40.94	-0.82</								

Assessment Points -13	DAIKIN EDLA08 (	17.84	1.2	0.5	250	59.91	-36.03	-0.02	2.98	-10.26	-10.26	-	-	2	-8.6	9.99
Assessment Points -13	DAIKIN EDLA08	17.54	1.2	0.5	125	65	-35.88	-0.01	2.98	-8.05	-8.05	-	-	2	-16.1	9.95
Assessment Points -13	DAIKIN EDLA08 (	17.84	1.2	0.5	125	64.91	-36.03	-0.01	2.98	-8.28	-8.28	-	-	2	-16.1	9.48
Assessment Points -13	DAIKIN EDLA08	17.54	1.2	0.5	1000	54	-35.88	-0.07	2.98	-15.24	-15.24	-	-	2	0	7.8
Assessment Points -13	DAIKIN EDLA08 (	17.84	1.2	0.5	1000	53.91	-36.03	-0.07	2.98	-16.36	-16.36	-	-	2	0	6.43
Assessment Points -13	DAIKIN EDLA08 (	28.39	1.2	0.5	2000	47.91	-40.06	-0.25	2.99	-8.91	-8.91	-	-	2	1.2	4.89
Assessment Points -13	DAIKIN EDLA08 (	28.59	1.2	0.5	2000	47.82	-40.12	-0.25	2.99	-8.87	-8.87	-	-	2	1.2	4.77
Assessment Points -13	DAIKIN EDLA08 (	23.93	1.2	0.5	2000	47.82	-38.58	-0.21	2.99	-10.82	-10.82	-	-	2	1.2	4.41
Assessment Points -13	DAIKIN EDLA08 (	35.02	1.2	0.5	2000	47.91	-41.89	-0.3	3	-7.69	-7.69	-	-	2	1.2	4.23
Assessment Points -13	DAIKIN EDLA08 (	35.94	1.2	0.5	2000	47.82	-42.11	-0.31	3	-7.54	-7.54	-	-	2	1.2	4.06
Assessment Points -13	DAIKIN EDLA08 (	36.54	1.2	0.5	2000	47.82	-42.26	-0.32	3	-7.45	-7.45	-	-	2	1.2	4
Assessment Points -13	DAIKIN EDLA08 (	34.12	1.2	0.5	1000	53.91	-41.66	-0.14	3	-14.56	-14.56	-	-	2	0	2.56
Assessment Points -13	DAIKIN EDLA08	17.54	1.2	0.5	2000	48	-35.88	-0.15	2.98	-19.02	-19.02	-	-	2	1.2	-0.87
Assessment Points -13	DAIKIN EDLA08 (	17.84	1.2	0.5	2000	47.91	-36.03	-0.15	2.98	-20.71	-20.71	-	-	2	1.2	-2.79
Assessment Points -13	DAIKIN EDLA08	17.54	1.2	0.5	63	61	-35.88	0	2.98	-6.72	-6.72	-	-	2	-26.2	-2.82
Assessment Points -13	DAIKIN EDLA08 (	52.25	1.2	0.5	2000	47.82	-45.36	-0.45	3.07	-11.21	-11.21	-	-	2	1.2	-2.93
Assessment Points -13	DAIKIN EDLA08 (	28.39	1.2	0.5	4000	41.91	-40.06	-0.75	2.99	-11.01	-11.01	-	-	2	1	-3.91
Assessment Points -13	DAIKIN EDLA08 (	28.59	1.2	0.5	4000	41.82	-40.12	-0.75	2.99	-10.96	-10.96	-	-	2	1	-4.02
Assessment Points -13	DAIKIN EDLA08 (	35.02	1.2	0.5	4000	41.91	-41.89	-0.92	3	-9.49	-9.49	-	-	2	1	-4.39
Assessment Points -13	DAIKIN EDLA08 (	35.94	1.2	0.5	4000	41.82	-42.11	-0.94	3	-9.3	-9.3	-	-	2	1	-4.53
Assessment Points -13	DAIKIN EDLA08 (	36.54	1.2	0.5	4000	41.82	-42.26	-0.96	3	-9.18	-9.18	-	-	2	1	-4.57
Assessment Points -13	DAIKIN EDLA08 (	23.93	1.2	0.5	4000	41.82	-38.58	-0.63	2.99	-13.26	-13.26	-	-	2	1	-4.65
Assessment Points -13	DAIKIN EDLA08 (	34.12	1.2	0.5	2000	47.91	-41.66	-0.29	3	-17.37	-17.37	-	-	2	1.2	-5.22
Assessment Points -13	DAIKIN EDLA08 (	46.48	1.2	0.5	4000	41.82	-44.35	-1.22	3	-8.63	-8.63	-	-	2	1	-6.38
Assessment Points -13	DAIKIN EDLA08 (	59.15	1.2	0.5	2000	47.82	-46.44	-0.51	3.41	-14.89	-14.89	-	-	2	1.2	-7.4
Assessment Points -13	DAIKIN EDLA08	17.54	1.2	0.5	4000	42	-35.88	-0.46	2.98	-23.48	-23.48	-	-	2	1	-11.84
Assessment Points -13	DAIKIN EDLA08 (	52.25	1.2	0.5	4000	41.82	-45.36	-1.37	3.07	-13.74	-13.74	-	-	2	1	-12.58
Assessment Points -13	DAIKIN EDLA08 (	17.84	1.2	0.5	4000	41.91	-36.03	-0.47	2.98	-24.86	-24.86	-	-	2	1	-13.46
Assessment Points -13	DAIKIN EDLA08 (	34.12	1.2	0.5	4000	41.91	-41.66	-0.9	3	-20.27	-20.27	-	-	2	1	-14.92
Assessment Points -13	DAIKIN EDLA08 (	59.15	1.2	0.5	4000	41.82	-46.44	-1.55	3.41	-17.69	-17.69	-	-	2	1	-17.45
Assessment Points -13	DAIKIN EDLA08 (	28.39	1.2	0.5	8000	32.91	-40.06	-2.66	2.99	-13.48	-13.48	-	-	2	-1.1	-19.39
Assessment Points -13	DAIKIN EDLA08 (	28.59	1.2	0.5	8000	32.82	-40.12	-2.68	2.99	-13.43	-13.43	-	-	2	-1.1	-19.51
Assessment Points -13	DAIKIN EDLA08 (	23.93	1.2	0.5	8000	32.82	-38.58	-2.24	2.99	-15.95	-15.95	-	-	2	-1.1	-20.05
Assessment Points -13	DAIKIN EDLA08 (	35.02	1.2	0.5	8000	32.91	-41.89	-3.28	3	-11.75	-11.75	-	-	2	-1.1	-20.1
Assessment Points -13	DAIKIN EDLA08 (	35.94	1.2	0.5	8000	32.82	-42.11	-3.36	3	-11.52	-11.52	-	-	2	-1.1	-20.28
Assessment Points -13	DAIKIN EDLA08 (	36.54	1.2	0.5	8000	32.82	-42.26	-3.42	3	-11.38	-11.38	-	-	2	-1.1	-20.34
Assessment Points -13	DAIKIN EDLA08 (	46.48	1.2	0.5	8000	32.82	-44.35	-4.35	3	-10.74	-10.74	-	-	2	-1.1	-22.71
Assessment Points -13	DAIKIN EDLA08	17.54	1.2	0.5	8000	33	-35.88	-1.64	2.98	-25	-25	-	-	2	-1.1	-25.64
Assessment Points -13	DAIKIN EDLA08 (	17.84	1.2	0.5	8000	32.91	-36.03	-1.67	2.98	-25	-25	-	-	2	-1.1	-25.9
Assessment Points -13	DAIKIN EDLA08 (	52.25	1.2	0.5	8000	32.82	-45.36	-4.89	3.07	-16.5	-16.5	-	-	2	-1.1	-29.95
Assessment Points -13	DAIKIN EDLA08 (	34.12	1.2	0.5	8000	32.91	-41.66	-3.19	3	-23.22	-23.22	-	-	2	-1.1	-31.27
Assessment Points -13	DAIKIN EDLA08 (	59.15	1.2	0.5	8000	32.82	-46.44	-5.54	3.41	-20.59	-20.59	-	-	2	-1.1	-35.43
Assessment Points -14	DAIKIN EDLA08	19.91	1.2	0.5	500	59	-36.98	-0.05	2.99	-13.08	-13.08	-	-	2	-3.2	10.68
Assessment Points -14	DAIKIN EDLA08 (	20.17	1.2	0.5	500	58.91	-37.1	-0.05	2.99	-13.84	-13.84	-	-	2	-3.2	9.72
Assessment Points -14	DAIKIN EDLA08	19.91	1.2	0.5	250	60	-36.98	-0.02	2.99	-10	-10	-	-	2	-8.6	9.39
Assessment Points -14	DAIKIN EDLA08	19.91	1.2	0.5	125	65	-36.98	-0.01	2.99	-7.96	-7.96	-	-	2	-16.1	8.94
Assessment Points -14	DAIKIN EDLA08 (	20.17	1.2	0.5	250	59.91	-37.1	-0.02	2.99	-10.45	-10.45	-	-	2	-8.6	8.74
Assessment Points -14	DAIKIN EDLA08 (	30.82	1.2	0.5	1000	53.91	-40.78	-0.12	2.99	-12.49	-12.49	-	-	2	0	5.52
Assessment Points -14	DAIKIN EDLA08	19.91	1.2	0.5	1000	54	-36.98	-0.08	2.99	-17.18	-17.18	-	-	2	0	4.74
Assessment Points -14	DAIKIN EDLA08 (	36.73	1.2	0.5	2000	47.91	-42.3	-0.32	3	-7.47	-7.47	-	-	2	1.2	4.02
Assessment Points -14	DAIKIN EDLA08 (	37.64	1.2	0.5	2000	47.82	-42.51	-0.32	3	-7.31	-7.31	-	-	2	1.2	3.88
Assessment Points -14	DAIKIN EDLA08 (	31	1.2	0.5	1000	53.82	-40.83	-0.12	2.99	-14.01	-14.01	-	-	2	0	3.86
Assessment Points -14	DAIKIN EDLA08 (	20.17	1.2	0.5	1000	53.91	-37.1	-0.08	2.99	-18.02	-18.02	-	-	2	0	3.7
Assessment Points -14	DAIKIN EDLA08 (	26.37	1.2	0.5	2000	47.82	-39.42	-0.23	2.99	-10.72	-10.72	-	-	2	1.2	3.64
Assessment Points -14	DAIKIN EDLA08 (	36.56	1.2	0.5	1000	53.91	-42.26	-0.15	3	-14.38	-14.38	-	-	2	0	2.12
Assessment Points -14	DAIKIN EDLA08 (	54.7	1.2	0.5	2000	47.82	-45.76	-0.47	3.2	-10.15	-10.15	-	-	2	1.2	-2.16
Assessment Points -14	DAIKIN EDLA08 (	30.82	1.2	0.5	2000	47.91	-40.78	-0.27	2.99	-15.31	-15.31	-	-	2	1.2	-2.24
Assessment Points -14	DAIKIN EDLA08	19.91	1.2	0.5	63	61	-36.98	0	2.99	-6.63	-6.63	-	-	2	-26.2	-3.83
Assessment Points -14	DAIKIN EDLA08	19.91	1.2	0.5	2000	48	-36.98	-0.17	2.99	-21.23	-21.23	-	-	2	1.2	-4.2
Assessment Points -14	DAIKIN EDLA08 (	36.73	1.2	0.5	4000	41.91	-42.3	-0.96	3	-9.21	-9.21	-	-	2	1	-4.57
Assessment Points -14	DAIKIN EDLA08 (	37.64	1.2	0.5	4000	41.82	-42.51	-0.99	3	-9	-9	-	-	2	1	-4.68
Assessment Points -14	DAIKIN EDLA08 (	38.18	1.2	0.5	4000	41.82	-42.64	-1	3	-8.88	-8.88	-	-	2	1	-4.7
Assessment Points -14	DAIKIN EDLA08 (	20.17	1.2	0.5	2000	47.91	-37.1	-0.17	2.99	-21.85	-21.85	-	-	2	1.2	-5.02
Assessment Points -14	DAIKIN EDLA08 (	31	1.2	0.5	2000	47.82	-40.83	-0.27	2.99	-18.2	-18.2	-	-	2	1.2	-5.28
Assessment Points -14	DAIKIN EDLA08 (	26.37	1.2	0.5	4000	41.82	-39.42	-0.69	2.99	-13.15	-13.15	-	-	2	1	-5.45
Assessment Points -14	DAIKIN EDLA08 (	36.56	1.2	0.5	2000	47.91	-42.26	-0.32	3	-17.19	-17.19	-	-	2	1.2	-5.66
Assessment Points -14	DAIKIN EDLA08 (	48.93	1.2	0.5	4000	41.82	-44.79	-1.29	3	-7.45	-7.45	-	-	2	1	-5.7
Assessment Points -14	DAIKIN EDLA08 (	61.61	1.2	0.5	2000	47.82	-46.79	-0.53	3.51	-14.41	-14.41	-	-	2	1.2	-7.19
Assessment Points -14	DAIKIN EDLA08 (	54.7	1.2	0.5	4000	41.82	-45.76	-1.44	3.2	-12.57	-12.57	-	-	2	1	-11.75
Assessment Points -14	DAIKIN EDLA08 (	30.82	1.2	0.5	4000	41.91	-40.78	-0.81	2.99	-18.75	-18.75	-	-	2	1	-12.43
Assessment Points -14	DAIKIN EDLA08	19.91	1.2	0.5	4000	42	-36.98	-0.52	2.99	-24.67	-24.67	-	-	2	1	-14.19
Assessment Points -14	DAIKIN EDLA08 (	20.17	1.2	0.5	4000	41.91	-37.1	-0.53	2.99	-25	-25	-	-	2	1	-14.73
Assessment Points -14	DAIKIN EDLA08 (	36.56	1.2	0.5	4000	41.91	-42.26	-0.96	3	-20.08	-20.08	-	-	2	1	-15.39
Assessment Points -14	DAIKIN EDLA08 (	36.69	1.2	0.5	4000	41.82	-42.29	-0.96	3	-20.03	-20.03	-	-	2	1	-15.46
Assessment Points -14	DAIKIN EDLA08 (	31	1.2	0.5	4000	41.82	-40.83	-0.81	2.99	-22.31	-22.31	-	-	2	1	-16.13
Assessment Points -14	DAIKIN EDLA08 (	61.61	1.2	0.5	4000	41.82	-46.79	-1.62	3.51	-17.18	-17.18	-	-	2	1	-17.26
Assessment Points -14	DAIKIN EDLA08 (	36.73	1.2	0.5	8000	32.91	-42.3	-3.44	3	-11.42	-11.42	-	-	2	-1.1	-20.35
Assessment Points -14	DAIKIN EDLA08 (	37.64	1.2	0.5	8000	32.82	-42.51	-3.52	3	-11.18	-11.18	-	-	2	-1.1	-20.49
Assessment Points -14	DAIKIN EDLA08 (	38.18	1.2	0.5	8000	32.82	-42.64	-3.57	3	-11.03	-11.03	-	-	2	-1.1	-20.52
Assessment Points -14	DAIKIN EDLA08 (	26.37	1.2	0.5	8000	32.82	-39.42	-2.47	2.99	-15.84	-15.84	-	-	2	-1.1	-21.01
Assessment Points -14	DAIKIN EDLA08 (	42.28	1.2	0.5	4000	41.82	-43.52	-1.11	3	-25	-25	-	-	2	1	-21.81
Assessment Points -14	DAIKIN EDLA08 (	48.93	1.2	0.5	8000	32.82	-44.79	-4.58	3	-9.31	-9.31	-				

Assessment Points -10		62.2	49.83	7															
Assessment Points -9		59.66	48.31	7															
Assessment Points -12		56.02	46.56	1.2															
Assessment Points -13		57.05	49.11	1.2															
Assessment Points -14		57.98	51.39	1.2															
Point Sources	x	y	Height	Lw	Hz	Adjust Level													
DAIKIN EDLA08		55.33	31.67	0.5	-	31.5	2												
-	-	-	-		61	63													
-	-	-	-		65	125													
-	-	-	-		60	250													
-	-	-	-		59	500													
-	-	-	-		54	1000													
-	-	-	-		48	2000													
-	-	-	-		42	4000													
-	-	-	-		33	8000													
Barriers	x	y	Height	Reflection Coefficient															
Boundary Fence		65.58	36.91	1.8	0.98	31.5													
-		50.27	44.09	-	0.98	63													
-		41.77	46.16	-	0.98	125													
-		41.02	41.59	-	0.98	250													
-		37.52	33.03	-	0.98	500													
-		53.45	26.41	-	0.98	1000													
-	-	-	-		0.98	2000													
-	-	-	-		0.98	4000													
-	-	-	-		0.98	8000													
-	-	-	-		0.98	16000													
Buildings	x	y	Height	Reflection Coefficient															
51 Ascot Drive		57.38	35.43	7.6	0.98	31.5													
-		54.06	27.27	10	0.98	63													
-		60.38	24.7	-	0.98	125													
-		63.7	32.86	-	0.98	250													
-	-	-	-		0.98	500													
-	-	-	-		0.98	1000													
-	-	-	-		0.98	2000													
-	-	-	-		0.98	4000													
-	-	-	-		0.98	8000													
-	-	-	-		0.98	16000													
53 Ascot Drive		56.66	15.58	7.6	0.98	31.5													
-		59.99	23.69	10	0.98	63													
-		53.59	26.34	-	0.98	125													
-		50.28	18.23	-	0.98	250													
-	-	-	-		0.98	500													
-	-	-	-		0.98	1000													
-	-	-	-		0.98	2000													
-	-	-	-		0.98	4000													
-	-	-	-		0.98	8000													
-	-	-	-		0.98	16000													
53 Ascot Dr (b)		51.66	21.64	7.6	0.98	31.5													
-		52.48	23.66	8.8	0.98	63													
-		51.34	24.16	-	0.98	125													
-		50.46	22.13	-	0.98	250													
-	-	-	-		0.98	500													
-	-	-	-		0.98	1000													
-	-	-	-		0.98	2000													
-	-	-	-		0.98	4000													
-	-	-	-		0.98	8000													
-	-	-	-		0.98	16000													
53 Ascot Dr (c)		52.49	23.67	2.7	0.98	31.5													
-		50.26	18.23	-	0.98	63													
-		46.31	19.86	-	0.98	125													
-		48.54	25.3	-	0.98	250													
-	-	-	-		0.98	500													
-	-	-	-		0.98	1000													
-	-	-	-		0.98	2000													
-	-	-	-		0.98	4000													
-	-	-	-		0.98	8000													
-	-	-	-		0.98	16000													
49 Ascot Drive		69.89	48.86	7.6	0.98	31.5													
-		66.58	40.77	10	0.98	63													
-		60.2	43.36	-	0.98	125													
-		63.43	51.45	-	0.98	250													
-	-	-	-		0.98	500													
-	-	-	-		0.98	1000													
-	-	-	-		0.98	2000													
-	-	-	-		0.98	4000													
-	-	-	-		0.98	8000													
-	-	-	-		0.98	16000													
49 Ascot Drive (b)		62.34	48.7	7.6	0.98	31.5													
-		61.39	46.3	8.8	0.98	63													
-		60.13	46.78	-	0.98	125													
-		61.1	49.23	-	0.98	250													
-	-	-	-		0.98	500													
-	-	-	-		0.98	1000													
-	-	-	-		0.98	2000													
-	-	-	-		0.98	4000													
-	-	-	-		0.98	8000													
-	-	-	-		0.98	16000													
49 Ascot dr (c)		56.42	44.82	2.7	0.98	31.5													
-		60.13	43.33	-	0.98	63													
-		63.38	51.39	-	0.98	125													
-		59.67	52.88	-	0.98	250													
-	-	-	-		0.98	500													
-	-	-	-		0.98	1000													
-	-	-	-		0.98	2000													
-	-	-	-		0.98	4000													
-	-	-	-		0.98	8000													
-	-	-	-		0.98	16000													
--- Configuration ---																			
Calculation Method ISO9613-2:2024 (New)																			


Hard Ground (Ground Factor = 0)																	
15.0°C Temperature																	
70% Humidity																	
Results are A-weighted																	
Second order reflections are included																	
Reflections are only considered at a distance of 1m or greater from a reflector (facade level)																	
ISO9613-2 barrier attenuation limit (20/25dB) is enabled																	
Vertical edges (lateral paths) are included																	
Limited to convex paths																	
Limited in distance (ISO17534-3 recommendation)																	
Ground reflections are not screened (ISO17534-3 recommendation)																	
--- Key ---																	
Lw	Sound Power Level (dB)																
Lp	Sound Pressure Level (dB)																
Ad	Distance attenuation (geometric divergence) ISO9613-2 (dB)																
Ab	Barrier attenuation ISO9613-2 (dB)																
Ag	Ground effect ISO9613-2 (dB)																
Aa	Air absorption ISO9613-1 (dB)																

12 Sound data

12 - 2 Sound Pressure Spectrum - Heating


EBLA04-08EV3
EDLA04-08EV3
EBLA04-08E3V3
EDLA04-08E3V3

Heating

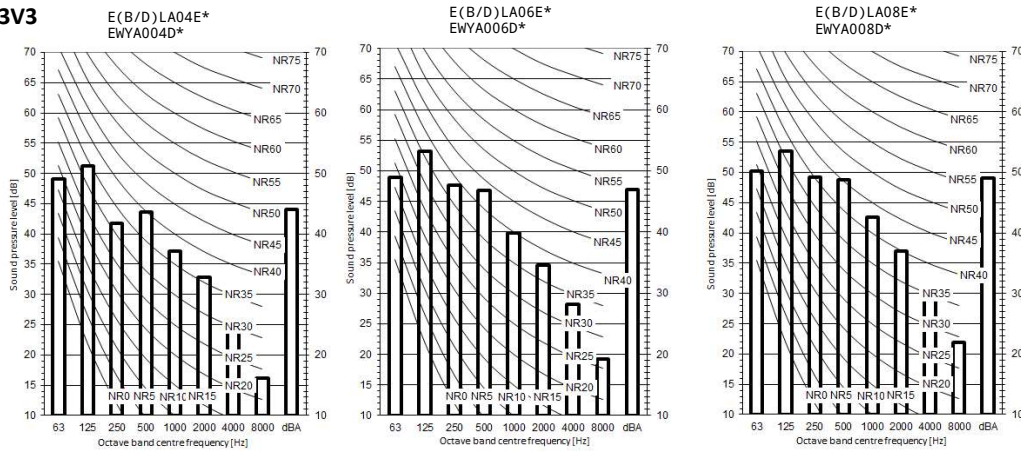

Notes

- 1.Data is valid at free field condition.
Measured in a semi-anechoic chamber
- 2.Data is valid at nominal operation condition.
- 3.dBA = A-weighted sound pressure level (A scale according to IEC).
- 4.Reference acoustic pressure 0 dB = 20 μ Pa
- 5.If the sound is measured under actual installation conditions, the measured value will be higher due to environmental noise and sound reflections.



Measuring location (discharge side)

3D140605